

NFPA No.

10



INSTALLATION OF

PORTABLE FIRE EXTINGUISHERS 1969

MORGAN TECHNICAL LIBRARY
NATIONAL FIRE PROTECTION ASSN.
BATTERYMARCH PARK
QUINCY, MA 02269



One Dollar

Copyright © 1969

NATIONAL FIRE PROTECTION ASSOCIATION
International

60 Battery March Street, Boston, Mass. 02110

12M-6-69-WP-SM

Printed in U.S.A.

Official NFPA Definitions

Adopted Jan. 23, 1964. Where variances to these definitions are found, efforts to eliminate such conflicts are in process.

SHALL is intended to indicate requirements.

SHOULD is intended to indicate recommendations or that which is advised but not required.

APPROVED means acceptable to the authority having jurisdiction. The National Fire Protection Association does not approve, inspect or certify any installations, procedures, equipment or materials nor does it approve or evaluate testing laboratories. In determining the acceptability of installations or procedures, equipment or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure or use. The authority having jurisdiction may also refer to the listings or labeling practices of nationally recognized testing laboratories,* i.e., laboratories qualified and equipped to conduct the necessary tests, in a position to determine compliance with appropriate standards for the current production of listed items, and the satisfactory performance of such equipment or materials in actual usage.

*Among the laboratories nationally recognized by the authorities having jurisdiction in the United States and Canada are the Underwriters' Laboratories, Inc., the Factory Mutual Engineering Division, the American Gas Association Laboratories, the Underwriters' Laboratories of Canada, the Canadian Standards Association Testing Laboratories, and the Canadian Gas Association Approvals Division.

LISTED: Equipment or materials included in a list published by a nationally recognized testing laboratory that maintains periodic inspection of production of listed equipment or materials, and whose listing states either that the equipment or material meets nationally recognized standards or has been tested and found suitable for use in a specified manner.

LABELED: Equipment or materials to which has been attached a label of a nationally recognized testing laboratory that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling is indicated compliance with nationally recognized standards or the conduct of tests to determine suitable usage in a specified manner.

AUTHORITY HAVING JURISDICTION: The organization, office or individual responsible for "approving" equipment, an installation, or a procedure.

Statement on NFPA Procedures

This material has been developed in the interest of safety to life and property under the published procedures of the National Fire Protection Association. These procedures are designed to assure the appointment of technically competent Committees having balanced representation from those vitally interested and active in the areas with which the Committees are concerned. These procedures provide that all Committee recommendations shall be published prior to action on them by the Association itself and that following this publication these recommendations shall be presented for adoption to the Annual Meeting of the Association where anyone in attendance, member or not, may present his views. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accepts any liability resulting from compliance or non-compliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

Copyright and Republishing Rights

This publication is copyrighted © by the National Fire Protection Association. Permission is granted to republish in full the material herein in laws, ordinances, regulations, administrative orders or similar documents issued by public authorities. All others desiring permission to reproduce this material in whole or in part shall consult the National Fire Protection Association.

**Standard for the Installation of
Portable Fire Extinguishers**

NFPA No. 10-1969

1969 Edition of No. 10


This Standard was prepared by the NFPA Committee on Portable Fire Extinguishers and this present edition was adopted at the 1969 Annual Meeting of the Association held in New York, N.Y., May 12-16.

Special attention is called to a companion publication entitled Recommended Good Practice for the Maintenance and Use of Portable Fire Extinguishers (NFPA No. 10A); see 1010 of this Standard for further information. NFPA No. 10L presents a Model Enabling Act for the Sale and Servicing of Portable Fire Extinguishers.

This 1969 edition of NFPA No. 10 is being submitted to the United States of America Standards Institute for approval as a USA Standard. Earlier editions have been so approved, the latest (1968) being designated USAS Z112.1-1968.

Origin and Development of No. 10

In 1918 and 1919 the NFPA Committee on Field Practice (predecessor of the present committee) was active in developing a standard on First Aid Protection. The earliest official NFPA Standard on this subject was adopted in 1921. Revised editions were adopted by the Association in 1926, 1928, 1929, 1930, 1931, 1932, 1936, 1938, 1942, 1945, 1950, 1953, 1955, 1956, 1957, 1958, 1959, 1961, 1962 and 1963. In 1965 the previous editions were divided in two separate texts, one covering "installation" (this publication) and the second covering "maintenance and use" (designated No. 10A). This publication contains the latest recommendations of the Association and replaces all previous issues including the 1965, 1966, 1967 and 1968 editions.

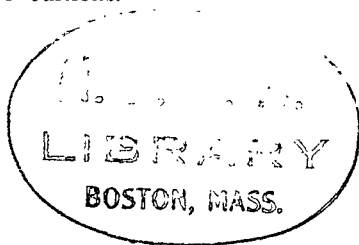

JUL 9 1969

Committee on Portable Fire Extinguishers

Dewey Yates, Chairman

Chief of Fire Prevention, Bureau of Fire Prevention, Miami Fire Department,
P.O. Box 33-708, Miami, Fla.
(rep. Fire Marshals Association of North America)

S. E. Auck, Underwriters' Laboratories, Inc.

R. E. Berry, Edison Electric Institute.

F. L. Brannigan, U.S. Atomic Energy Commission.

Royal A. Brown, National Paint, Varnish and Lacquer Association.

Leo Cook, Commerce & Industry Insurance Co.

Thos. L. Culbertson, American Petroleum Institute.

C. R. Fredriksen, National Assn. of Fire Equipment Distributors, Inc.

S. K. Goodwin, Factory Insurance Assn.

Lester Hebenstreit, Compressed Gas Association.

R. H. Jensen, Illinois Institute of Technology.

Thore Johnson, Illinois Inspection and Rating Bureau.

K. R. Laidley, Fire Extinguisher Manufacturers' Institute of Canada.

C. H. Lindsay, Elmira, N. Y.

George B. Needham, New England Insurance Rating Assn.

Marshall E. Petersen, American Mutual Insurance Alliance.

Arnie Selan, Fire Equipment Mfrs. Assn.

Samuel T. Sides, Fire Marshals Association of North America.

H. F. Smith, Factory Mutual Engineering Corporation.

R. J. Wright, Underwriters' Laboratories of Canada.

Alternates.

Wm. F. Hudson, National Assn. of Fire Equipment Distributors, Inc. (Alternate to C. R. Fredriksen.)

Alfred Krulce, Fire Equipment Mfrs. Assn. (Alternate to Arnie Selan.)

Robert E. Lenhard, Compressed Gas Association. (Alternate to Lester Hebenstreit.)

E. E. Williams, Factory Insurance Assn. (Alternate to S. K. Goodwin.)

SCOPE: Standards for the installation of portable fire extinguishers and equipment and recommended practices for the maintenance and use of these devices. Does not apply to permanently installed fire extinguishing systems even though portions of those systems are portable, such as hose and nozzles which may be attached to a fixed supply of extinguishing agent.

Contents

Chapter 1. General	10-3
Chapter 2. Classification of Fires and Rating of Portable Fire Extinguishers	10-6
Chapter 3. Selection of Extinguishers	10-8
Chapter 4. Distribution of Portable Fire Extinguishers	10-12
Chapter 5. Inspection, Maintenance and Hydrostatic Tests	10-16
Appendix A	10-20
Appendix B — Recommended Markings to Indicate Extinguisher Suitability	10-28
Appendix C — Description of Types of Extinguishers	10-31

Standard for the Installation of Portable Fire Extinguishers

NFPA No. 10-1969

Principles of Fire Extinguishment

Many fires are small at origin and may be extinguished by the use of proper portable fire extinguishers. It is strongly recommended that the fire department be notified as soon as a fire is discovered. This alarm should not be delayed awaiting results of application of portable fire extinguishers.

Fire extinguishers can represent an important segment of any overall fire protection program. However, their successful functioning depends upon the following conditions having been met:

1. The extinguisher is properly located and in working order.
2. The extinguisher is of proper type for a fire which may occur.
3. The fire is discovered while still small enough for the extinguisher to be effective.
4. The fire is discovered by a person ready, willing, and able to use the extinguisher.

CHAPTER 1. GENERAL

1000. General Information.

1010. Purpose. This standard is prepared for the use and guidance of persons charged with selecting, purchasing, installing, approving, listing and designing portable fire extinguishing equipment.

NOTE: Two NFPA publications contain essential information about extinguishers. Each is prepared for a specific group of users as indicated below; some users may require both.

NFPA No. 10 — Standard for the Installation of Portable Fire Extinguishers

For persons charged with—

Designing	}	Fire Extinguishers
Listing		
Selecting		
Purchasing		
Installing		
Approving		

NFPA No. 10A — Maintenance and Use of Portable Fire Extinguishers

For persons charged with—

Inspecting	}	Fire Extinguishers
Recharging		
Maintaining		
Testing		
Operating		

The Association also publishes a Model Enabling Act for the Sale and Servicing of Portable Fire Extinguishers, designated NFPA No. 10L.

1020. Scope. The provisions of this standard apply to the installation of portable extinguishing equipment and devices. They do not apply to permanently installed systems for fire extinguishment, even though portions of such systems may be portable (such as hose and nozzles attached to a fixed supply of extinguishing agent).

NOTE: Such systems are covered by the following NFPA standards: No. 11 — Foam Extinguishing Systems; No. 12 — Carbon Dioxide Extinguishing Systems; No. 13 — Installation of Sprinkler Systems; No. 14 — Installation of Standpipe and Hose Systems; No. 15 — Water Spray (Fixed) Systems for Fire Protection; No. 16 — Foam-Water Sprinkler Systems and Foam-Water Spray Systems; No. 17 — Dry Chemical Extinguishing Systems.

1030. The various types of fire extinguishers are not all equally effective on all kinds of fires. Therefore, consideration shall be given to the class of fire which may occur and the nature of the processes or contents within a building.

1040. The requirements given herein are minimum. Portable fire extinguishers are designed to cope with fire of limited size and are necessary even though the property is equipped with automatic sprinklers, standpipe and hose, or other fixed protection equipment (see Paragraphs 4110 and 4210).

1050. The methods of operation of the various types of portable extinguishers are generally apparent and are indicated prominently on each extinguisher.

1060. The fire protection requirements of this standard are general in nature and are not intended to abrogate the specific requirements of other NFPA standards for specific situations or specific occupancies.

1200. General Requirements.

1210. Portable extinguishers shall be maintained in a fully charged and operable condition, and kept in their designated places at all times when they are not being used.

1220. Extinguishers shall be conspicuously located where they will be readily accessible and immediately available in the event of fire. They shall be located along normal paths of travel. Some extinguishers should be located near exits from an area.

1221. Extinguishers shall not be obstructed or obscured from view. In large rooms, and in certain locations where visual obstruction cannot be completely avoided, means shall be provided to indicate the location and intended use of extinguishers conspicuously.

1222. If extinguishers intended for different classes of fire are grouped, their intended use shall be marked conspicuously to insure choice of the proper extinguisher at the time of a fire.

1223. In situations where extinguishers must be temporarily provided, a good practice is to provide portable stands, consisting of a horizontal bar on uprights with feet, on which the extinguishers may be hung.

1230. Extinguishers shall be installed on the hangers or in the brackets supplied, mounted in cabinets, or set on shelves unless the extinguishers are of the wheeled type.

1231. Extinguishers having a gross weight not exceeding 40 pounds shall be installed so that the top of the extinguisher is not more than 5 feet above the floor. Extinguishers having a gross weight greater than 40 pounds (except wheeled types) shall be so installed that the top of the extinguisher is not more than 3½ feet above the floor. Where they may be used by women, consideration should be given to mounting the extinguishers at a lower height.

1232. Extinguishers mounted in cabinets or wall recesses or set on shelves shall be placed in a manner such that the extinguisher operating instructions face outward. The location of such extinguishers shall be marked conspicuously (see Paragraph 1221).

1233. Extinguishers installed under conditions where they are subject to severe vibration shall be installed in brackets specifically designed to cope with this vibration.

1240. Extinguishers shall be suitable for use within a temperature range of at least plus 40 to plus 120 degrees Fahrenheit.

1241. When extinguishers are installed in locations subjected to temperatures outside this range, they shall be of a type approved or listed for the temperature to which they will be exposed, or placed in an enclosure capable of maintaining the temperature within the plus 40 to plus 120 degrees Fahrenheit (see Section 3200 for other conditions influencing the selection of extinguishers).

CHAPTER 2. CLASSIFICATION OF FIRES AND RATING OF PORTABLE FIRE EXTINGUISHERS

2000. General.

2010. The basic types of fires are Classes A, B, C, and D as defined in the following paragraphs.

2011. CLASS A fires are fires in ordinary combustible materials, such as wood, cloth, paper, rubber, and many plastics.

2012. CLASS B fires are fires in flammable liquids, gases, and greases.

2013. CLASS C fires are fires which involve energized electrical equipment where the electrical nonconductivity of the extinguishing media is of importance. (When electrical equipment is de-energized, extinguishers for Class A or B fires may be used safely.)

2014. CLASS D fires are fires in combustible metals, such as magnesium, titanium, zirconium, sodium, and potassium.

2015. Certain combustible metals and reactive chemicals require special extinguishing agents or techniques. If there is doubt, applicable NFPA standards should be consulted or reference made to NFPA No. 49 — Hazardous Chemicals Data, or NFPA No. 325M — Fire-Hazard Properties of Flammable Liquids, Gases, and Volatile Solids.

2100. Classification and Ratings of Fire Extinguishers.

2110. Portable fire extinguishers are classified for use on certain classes of fires and rated for relative extinguishing effectiveness at a temperature of plus 70 degrees Fahrenheit by nationally recognized testing laboratories. This is based upon the preceding classification of fires and the fire-extinguishment potentials as determined by fire tests.

NOTE: The classification and rating system described in this standard is that used by Underwriters' Laboratories, Inc. and Underwriters' Laboratories of Canada and is based on extinguishing preplanned fires of determined size and description as follows:

CLASS A RATING— Wood and excelsior fires excluding deep-seated conditions.

CLASS B RATING— Two-inch depth gasoline fires in square pans.

CLASS C RATING— No fire test. Agent must be a nonconductor of electricity.

CLASS D RATING— Special tests on specific combustible metal fires.

2120. The classification consists of a **LETTER** which indicates the Class of fire on which an extinguisher has been found to be effective, preceded by a rating **NUMERAL** (Class A and B only) which indicates the relative extinguishing effectiveness.

NOTE: Currently Underwriters' Laboratories Inc. and Underwriters' Laboratories of Canada classify extinguishers for use on Class A fires with the following ratings: 1-A; 2-A; 3-A; 4-A; 6-A; 10-A; 20-A; 30-A; and 40-A. Effective June 1, 1969, these Laboratories will classify extinguishers for use on Class B fires with the following ratings: 1-B; 2-B; 5-B; 10-B; 20-B; 30-B; 40-B; 60-B; 80-B; 120-B; 160-B; 240-B; 320-B; 480-B; and 640-B. Ratings from 1-B to 20-B are based on indoor flammable liquid fire tests; ratings at or above 30-B are based on outdoor flammable liquid fire tests. Ratings of 4B, 6B, 8B, 12B, and 16B, previously used to classify individual extinguishers for use on Class B fires, will not be used for new extinguishers following the June 1, 1969 date. Where this standard calls for minimum extinguisher ratings of 4B, 8B, or 12B, there is no intent to change these requirements where met by existing extinguishers or multiple foam extinguishers as allowed by par. 4211. However, if a single extinguisher must be purchased to fill this requirement, the next higher rating should be used after June 1, 1969. (Example: Table 4210 calls for a basic minimum Class B extinguisher rating of 4B for light hazard situations. This can still be met by an existing 4B rated extinguisher or by two 2B rated foam extinguishers. If a single new extinguisher must be purchased, a 5B rating would be the minimum size to meet this 4B requirement.)

2121. For Class B fires it must be recognized that the amount of fire which can be extinguished by a particular extinguisher is related to the degree of training and experience.

2122. For extinguishers classified for use on Class C fires, no **NUMERAL** is used since Class C fires are essentially either Class A or B fires involving energized electrical wiring and equipment. The size of the different suitable extinguishers installed should be commensurate with the size and extent of the Class A and/or Class B components of the electrical hazard or containing equipment being protected (see Paragraph 4410).

2123. For extinguishers classified for use on Class D fires, no **NUMERAL** is used. The relative effectiveness of these extinguishers for use on specific combustible metal fires is detailed on the extinguisher nameplate.

2124. Extinguishers which are effective on more than one Class of fire have multiple **LETTER** and **NUMERAL-LETTER** classifications and ratings.

2125. The classification and rating is found on the label of Underwriters' Laboratories, Inc. and Underwriters' Laboratories of Canada, which is affixed to the extinguisher.

EXAMPLE: An extinguisher is rated and classified 4-A; 20-B:C. This indicates the following:

1. It should extinguish approximately twice as much Class A fire as a 2-A (2½-gallon water) rated extinguisher.

2. It should extinguish approximately twenty times as much Class B fire as a 1-B rated extinguisher.
3. It is suitable for use on energized electrical equipment.

2200. Extinguishers Listed Prior to 1955.

2210. Extinguishers listed in accordance with rating procedures given in the 1955 and earlier editions of this standard are assigned minimum equivalent ratings, as shown in Appendix A of this standard. (See Sections 4500 and A-2200 and Table A-2200).

CHAPTER 3. SELECTION OF EXTINGUISHERS

3000. General Recommendations.

See Section A-3000 and Table A-3000, Appendix A

3010. The selection of extinguishers for a given situation will depend upon the character of the fires anticipated, the construction and occupancy of the individual property, the vehicle or hazard to be protected, ambient-temperature conditions, and other factors. In making this selection, Chapter 2 is to be used in determining the classification of the fire and the rating or relative fire extinguishing effectiveness of the extinguishers. The number of extinguishers required is determined by using Chapter 4 (see also Table A3000 in the Appendix, and NFPA No. 10A, Maintenance and Use of Portable Extinguishers).

3020. It should be borne in mind that some extinguishers will be suitable for only one class of hazard or condition while others are suitable for more than one.

3100. Selection By Hazard.

3101. Extinguishers shall be selected for the specific class or classes of hazards to be protected in accordance with the following paragraphs.

3110. Extinguishers for protecting Class A hazards shall be selected from among the following: foam, loaded stream, multipurpose dry chemical and water types.

NOTE: Certain smaller extinguishers which are charged with multipurpose dry chemical are rated on Class B and Class C fires, but have insufficient effectiveness to earn the minimum 1-A rating even though they have value in extinguishing smaller Class A fires. They shall not be used to meet the requirements of Paragraph 4110.

3120. Extinguishers for protection of Class B hazards shall be selected from the following: bromotrifluoromethane, carbon dioxide, dry chemical, foam, loaded stream, and multipurpose dry chemical.

NOTE 1: Certain sizes of loaded-stream extinguishers are not classified for use on these types of fires.

NOTE 2: Extinguishers with ratings less than 1-B shall not be considered in determining suitability (see Paragraph 4110).

3130. Extinguishers for protection of Class C hazards shall be selected from the following: bromotrifluoromethane, carbon dioxide, dry chemical, and multipurpose dry chemical.

NOTE: Carbon dioxide extinguishers equipped with metal horns are not considered safe for use on fires in energized electrical equipment and, therefore, are not classified for use on Class C hazards.

3140. Extinguishers and extinguishing agents for the protection of Class D hazards shall be of types approved for use on the specific combustible-metal hazard. (See Paragraph A-3140, Appendix A).

3141. Chemical reaction between burning metals and many extinguishing agents (including water) may range from explosive to inconsequential, depending in part on the type, form, and quantity of metal involved. In general, the hazards from a metal fire are significantly increased when such extinguishing agents are applied.

NOTE: The advantages and limitation of a wide variety of commercially available metal fire extinguishing agents are discussed in Section 15, Chapter VI of the NFPA Fire Protection Handbook (13th Edition).

3142. The agents and extinguishers discussed in this section are of specialized types and their use often involves special techniques peculiar to a particular combustible metal. A given agent will not necessarily control or extinguish all metal fires. Some agents are valuable in working with several metals; others are useful in combating only one type of metal fire. The authorities having jurisdiction should be consulted in each case to determine the desired protection for the particular hazard involved.

3143. Reference should be made to the manufacturer's recommendations for use and special technique for extinguishing fires in various combustible metals. (See NFPA No. 10A — Maintenance and Use of Portable Fire Extinguishers.)

3150. The selection of extinguishers for other types of hazards may require special extinguishers, extinguishing agents, or techniques (see Paragraph 2015).

3200. Other Conditions of Selection.

3210. Temperature — In the selection of an extinguisher, the ambient temperature to which it will be exposed shall be considered (see Paragraphs 1240 and 1241 and C-1222 in Appendix C).

3220. Gross Weight — In the selection of an extinguisher, the physical ability of the user should be contemplated. For instance, when the probable user of the extinguisher is a woman, the lightest weight extinguisher consistent with the needs of the hazard should be selected.

3230. Corrosion — In some extinguisher installations, there exists a possibility of exposing the extinguisher to a corrosive atmosphere. When this is the case, consideration should be given to providing the extinguishers so exposed with proper protection or providing extinguishers which have been found suitable for use in these conditions.

3240. Agent Reaction — The possibility of adverse reactions, contamination, or other effects of an extinguishing agent on manufacturing processes and/or equipment should be considered in the selection of an extinguisher.

3250. Wheeled Units — When wheeled extinguishers are used, consideration should be given to the mobility of the extinguisher within the area in which it will be used. For outdoor locations, the use of proper rubber-tired or wide-rimmed wheel designs should be considered according to the terrain. For indoor locations, the size of doorways and passages should be large enough to permit ready passage of the extinguisher.

3260. Vibration — When extinguishers are located on vehicles or in areas where they are subjected to vibration, consideration should be given to the use of special brackets designed to cope with the effects of vibration.

3270. Wind and Draft — If the hazard is subject to winds or draft, the use of extinguishers and agents having sufficient range to overcome these conditions should be considered.

3280. Miscellaneous — Many other factors should be considered in the selection of an extinguisher, such as inspecting, recharging, maintaining, testing, and operating (see NFPA No. 10A).

3290. Other NFPA standards covering specific situations make special recommendations covering the selection of portable extinguishers (see Paragraph 1060).

3300. Health and Safety Considerations.

3301. In the selection of an extinguisher, consideration shall be given to health and safety hazards involved in its maintenance and use, as described in the following paragraphs.

3302. Prominent caution labels on the extinguisher, warning signs at entry points to confined spaces, provision for remote application, extra-long-range extinguisher nozzles, special ventilation, provision of breathing apparatus and other personal protective equipment, and adequate training of personnel are among measures which should be considered to minimize the effects of these hazards. (See NFPA No. 10A.)

3310. Bromotrifluoromethane extinguishers contain an extinguishing agent (FE1301) which is not toxic in its normal state. However, when applied to a fire, decomposition products may be formed. When using these extinguishers in unventilated places, such as small rooms, closets, motor vehicles, or other confined spaces, operators and others should avoid breathing the gases produced by thermal decomposition of the agent.

3320. Carbon dioxide extinguishers contain an extinguishing agent which will not support life when used in sufficient concentration to extinguish a fire. The use of this type of extinguisher in an unventilated space can dilute the oxygen supply. Prolonged occupancy of such spaces can result in loss of consciousness due to oxygen deficiency.

3330. Water-type, loaded stream, and foam extinguishers, and carbon dioxide extinguishers with metal horns, present a shock hazard if used on fires in energized electrical equipment.

3340. Dry chemical extinguishers, when used in a small unventilated area, can greatly reduce visibility. Dry chemical, discharged in an area, may also clog filters in air-cleaning systems.

3350. Most fires produce toxic decomposition products of combustion and some materials may produce highly toxic gases. Fires may also consume available oxygen or produce dangerously high exposure to convected or radiated heat. All of these may affect the degree to which a fire can be safely approached with extinguishers. (See Underwriters' Laboratories, Inc. Bulletin of Research No. 53 — July, 1963.*)

*Survey of Available Information on the Toxicity of the Combustion and Thermal Decomposition Products of Certain Building Materials under Fire Conditions.

CHAPTER 4. DISTRIBUTION OF PORTABLE FIRE EXTINGUISHERS

4000. General Recommendations.

4010. The number of fire extinguishers needed to protect a property shall be determined as outlined herein, considering the area and arrangement of the building or occupancy, the severity of the hazard, the anticipated classes of fires, and the distances to be traveled to reach extinguishers. In addition, the anticipated rate of fire spread, the intensity and rate of heat development, the smoke contributed by the burning materials, and the accessibility of a fire to close approach with portable extinguishers should be considered. Whenever possible the individual property should be surveyed for actual protection requirements.

NOTE: Most buildings have Class A fire hazards. In any occupancy, there may be a predominant hazard with "special hazard" areas requiring supplemental protection. For example, a hospital will generally have need for Class A extinguishers covering patient's rooms, corridors, offices, etc., but will need Class B extinguishers in laboratories, kitchens, and where flammable anesthetics are stored or handled, and Class C extinguishers in electrical switch gear or generator rooms.

4020. Fire extinguishers shall be provided for the protection of both the building structure, if combustible, and the occupancy hazards contained therein.

4021. Required building protection shall be provided by fire extinguishers suitable for Class A fires.

4022. Occupancy hazard protection shall be provided by fire extinguishers suitable for such Class A, B, C, or D fire potentials as may be present.

4023. Extinguishers provided for building protection may be considered also for the protection of occupancies having a Class A fire potential.

4024. Combustible buildings having an occupancy hazard subject to Class B, and/or Class C fires, shall have a standard complement of Class A fire extinguishers for building protection, plus additional Class B and/or Class C extinguishers. Where fire extinguishers have more than one letter classification (such as 2-A:20-B:C), they may be considered to satisfy the requirements of each letter class.

4030. Rooms or areas shall be graded generally as light hazard, ordinary hazard, or extra hazard. Limited areas of greater or lesser hazard shall be protected as required.

4031. **LIGHT HAZARD** — Where the amount of combustibles or flammable liquids present is such that fires of small size may be expected. These may include offices, schoolrooms, churches, assembly halls, telephone exchanges, etc.

4032. **ORDINARY HAZARDS** — Where the amount of combustibles or flammable liquids present is such that fires of moderate size may be expected. These may include mercantile storage and display, auto showrooms, parking garages, light manufacturing, warehouses not classified as extra hazard, school shop areas, etc.

4033. **EXTRA HAZARD** — Where the amount of combustibles or flammable liquids present is such that fires of severe magnitude may be expected. These may include woodworking, auto repair, aircraft servicing, warehouses with high-piled (14 feet or higher) combustibles, and processes such as flammable liquid handling, painting, dipping, etc.

4100. Fire Extinguisher Size and Placement for Class A Hazards.

4110. Minimal sizes of fire extinguishers for the listed grades of hazard shall be provided on the basis of Table 4110. Extinguishers shall be located so that the maximum travel distances shall not exceed those specified in Table 4110.

Table 4110

Basic Minimum Extinguisher Rating for Area Specified	Maximum Travel Distances to Extinguishers	Areas to be Protected per Extinguisher		
		Light Hazard Occupancy	Ordinary Hazard Occupancy	Extra Hazard Occupancy
1A	75 ft.	3000 sq. ft.	Not Permitted Except as Specified in Par. 4120	Not Permitted Except as Specified in Par. 4120
2A	75 ft.	6000 sq. ft.	3000 sq. ft.	Not Permitted Except as Specified in Par. 4120
3A	75 ft.	9000 sq. ft.	4500 sq. ft.	3000 sq. ft.
4A	75 ft.	11,250 sq. ft.	6000 sq. ft.	4000 sq. ft.
6A	75 ft.	11,250 sq. ft.	9000 sq. ft.	6000 sq. ft.

4120. The protection requirements specified in Table 4110 may be fulfilled by several extinguishers of lower ratings for ordinary or extra-hazard occupancies, subject to approval by the authority having jurisdiction. Consideration should be given to the number

of persons available to operate the extinguishers, the degree of training provided, and the possibility of use by women.

4130. Where the floor area of a building is less than that specified in Table 4110, at least one extinguisher of the minimum size recommended shall be provided.

4140. The protection requirements may be fulfilled with extinguishers of higher rating provided the travel distance to such larger extinguishers shall not exceed 75 feet.

4200. Fire Extinguisher Size and Placement for Class B Fires Other Than for Fires in Flammable Liquids of Appreciable Depth.

4210. Minimal sizes of fire extinguishers for the listed grades of hazard shall be provided on the basis of Table 4210. Extinguishers shall be located so that the maximum travel distances shall not exceed those specified in Table 4210.

Table 4210

Type of Hazard	Basic Minimum Extinguisher Rating	Maximum Travel Distance to Extinguishers
Light	4B	50 ft
Ordinary	8B	50 ft
Extra	12B	50 ft

NOTE: See Note to Paragraph 2120 herein.

4211. Two or more extinguishers of lower rating, except for foam extinguishers, shall not be used to fulfill the protection requirements of Table 4210. Up to three foam extinguishers may be used to fulfill these requirements.

4220. The protection requirements may be fulfilled with extinguishers of higher ratings provided the travel distance to such larger extinguishers shall not exceed 50 feet.

4300. Fire Extinguisher Size and Placement for Class B Fires in Flammable Liquids of Appreciable Depth.

4310. For flammable liquid hazards of appreciable depth, (Class B), such as in dip or quench tanks, Class B fire extinguishers shall be provided on the basis of one numerical unit of Class B extinguishing potential per square foot of flammable liquid surface of the largest tank hazard within the area.

NOTE: Appreciable depth is defined as a depth of a liquid greater than $\frac{1}{4}$ inch.

4311. Two or more extinguishers of lower ratings, except for foam extinguishers, shall not be used in lieu of the extinguisher required for the largest tank. Up to three foam extinguishers may be used to fulfill these requirements.

4312. When protection is sought for flammable liquid in appreciable depth and when the liquid surface area is in excess of 20 square feet, the protection requirements should be based on an evaluation of the extent of the hazard and engineering judgment applied. Consideration should be given to installing fixed protection systems. Portable extinguisher protection for such hazards should be generally restricted to plants having trained fire brigades.

4313. Where approved automatic fire protection devices or systems have been installed for a flammable liquid hazard, additional portable Class B fire extinguishers, as required in Paragraph 4310, may be waived.

4320. Travel distances should be given consideration with reference to special hazards and the availability of the extinguisher for such protection. Scattered or widely separated hazards shall be individually protected if the specified travel distances in Paragraphs 4210 and 4220 are exceeded. Likewise, extinguishers in the proximity of a hazard shall be carefully located so as to be accessible in the presence of a fire without undue danger to the operator.

4400. Fire Extinguisher Size and Placement for Class C Hazards.

4410. Extinguishers with Class C ratings shall be required where energized electrical equipment may be encountered which would require a nonconducting extinguishing media. This will include fire either directly involving or surrounding electrical equipment. Since the fire itself is a Class A or Class B hazard the extinguishers are sized and located on the basis of the anticipated Class A or B hazard.

NOTE: Whenever possible electrical equipment should be de-energized before attacking a Class C fire.

4500. Distribution of Extinguishers Listed Prior to 1955.

4510. To determine the area of coverage applicable to fire extinguishers rated under procedures given in the 1955 and earlier editions of this standard, the approximate present minimum equivalent ratings should be used as given in Table A-2200 of Appendix A.

CHAPTER 5. INSPECTION, MAINTENANCE, AND HYDROSTATIC TESTS

5000. This chapter is concerned with the rules governing inspection, maintenance, and testing of extinguishers; proper maintenance being of prime importance in insuring operation at the time of a fire. The owner or occupant of a property in which extinguishers are located shall be responsible for such inspection, maintenance, and testing.

5001. For details of conducting needed inspections, proper maintenance operations, and required tests, see NFPA No. 10A — Maintenance and Use of Portable Fire Extinguishers.

5100. Inspection.

5110. Extinguishers shall be inspected monthly, or at more frequent intervals when circumstances require, to ensure they are in their designated places, to ensure they have not been actuated or tampered with, and to detect any obvious physical damage, corrosion, or other impairments.

5120. Any extinguishers showing defects shall be given a complete maintenance check.

5200. Maintenance.

5210. At regular intervals, not more than one year apart, or when specifically indicated by an inspection, extinguishers shall be thoroughly examined and/or recharged or repaired to insure operability and safety, or replaced as needed.

5220. On properties where extinguishers are maintained by the occupant, a supply of recharging materials should be kept on hand. These materials shall be those furnished by the manufacturer of the extinguisher which is to be recharged, i.e., recharges of one manufacturer shall not be used in extinguishers manufactured by another company.

NOTE 1: Certain recharging materials deteriorate with age, exposure to excessive temperature, and/or moisture. Thus, the storage of such recharging materials for long periods of time should be avoided.

NOTE 2: It is important that only those recharge materials specified on the extinguisher nameplate be used. The use of other recharging materials may impair the efficiency, cause malfunction, or result in rupture of the extinguisher that could cause injury to the operator.

5221. Extinguishers removed from the premises to be recharged shall be replaced by spare extinguishers during the period they are gone.

5222. Pails or drums of powder-extinguishing agents for scoop or shovel application to metal fires shall be kept full at all times. Particular care should be taken to keep the powder dry.

NOTE: Damp and wet extinguishing powder will not be free flowing and, if it contains sufficient moisture, can result in hazardous reaction if applied to a metal fire.

5230. Each extinguisher shall have a durable tag securely attached to show the maintenance or recharge date and the initials or signature of the person who performs this service.

NOTE: Under special circumstances or where local requirements are in effect, additional information may be desirable or required on record tags.

5300. Hydrostatic Tests.

5310. The methods of conducting hydrostatic tests are described in NFPA No. 10A — Maintenance and Use of Portable Fire Extinguishers.

5311. IF, AT ANY TIME, AN EXTINGUISHER SHOWS EVIDENCE OF CORROSION OR MECHANICAL INJURY, IT SHALL BE SUBJECTED TO A HYDROSTATIC PRESSURE TEST, OR REPLACED.

5312. For evaluating the condition of extinguisher cylinders made to ICC* specifications, see the Standard for Visual Inspection of Compressed Gas Cylinders (CGA C-6), published by the Compressed Gas Association, 500 Fifth Avenue, New York, New York 10036 (Price \$.50 each).

5320. At intervals not exceeding those specified in the following paragraphs, extinguishers shall be hydrostatically tested. The first hydrostatic retest may be conducted between the fifth and sixth years for those with a designated test interval of five years.

*ICC stands for Interstate Commerce Commission. The ICC is now a part of the U. S. Department of Transportation (DOT).

5321. Hydrostatic Test Interval for Extinguishers.

Extinguisher Type	Test Interval. Year
Soda-Acid	5
Cartridge-Operated Water and/or Antifreeze	5
Storage-Pressure Water and/or Antifreeze	5
Wetting Agent	5
Foam	5
Loaded Stream	5
Dry Chemical Extinguishers with Stainless Steel Shells, Aluminum Shells, or Soldered-Brass Shells	5
Carbon Dioxide Extinguishers	5
Dry Chemical Extinguishers with Brazed-Brass Shells, or Mild-Steel Shells	12
Bromotrifluoromethane	12
Dry Powder Extinguishers for Metal Fires	12

NOTE: Cylinders under jurisdiction of the U. S. Department of Transportation (formerly Interstate Commerce Commission) or the Board of Transport Commissioners of Canada may require hydrostatic testing at more frequent periods.

5322. Nitrogen cylinders (or other cylinders used for inert-gas storage), such as found on wheeled extinguishers, shall be tested at a 5-year interval.

5323. On those extinguishers which are equipped with shutoff valves at the outlet end of the hose (except carbon dioxide), a hydrostatic test shall be performed on the hose and couplings (excluding nozzles) at a test pressure of 300 psi and a test interval equivalent to the unit on which the hose is installed.

5324. Hydrostatic tests are not required on fire pails, pump-type water and/or antifreeze extinguishers, and factory-sealed disposable (nonrefillable) containers. If such an extinguisher or water pail shows evidence of corrosion or mechanical injury, it may be unsafe or unsuitable for further use and shall be replaced with a new unit.

5325. The hydrostatic test date shall be recorded on a record tag of metal or equally durable material, or a suitable metallized decal which shall be affixed (by a heatless process) to the shell of an extinguisher which favorably passes the hydrostatic test. The record tag shall contain the following information: Date of test, test pressure, name or initials of person or agency making the test.

NOTE: The hydrostatic test date should not be stamped with a hammer

and metal stamps on the extinguisher shell because the shell may be weakened by such stamping operation. On certain cylinders, it is permissible to stamp the hydrostatic test date as set forth in the U. S. Department of Transportation (formerly Interstate Commerce Commission) or the Board of Transport Commissioners of Canada regulations.

5326. For extinguishers subjected to an original factory test pressure of 350 psi or greater, the test pressure shall be 75 per cent of the factory test pressure (as noted on the extinguisher name plate), but in no case less than 300 psi. For extinguishers subjected to an original factory test pressure of less than 350 psi, the test pressure shall be 75 per cent of the factory test pressure. Pressure shall be applied at a rate of rise to reach the test pressure in approximately 1 minute, and the pressure shall be held for 1 minute, after which it shall be released.

Table 5326

**Hydrostatic Test Pressure Requirements — Non-ICC Shells
Shells Not Specified in U. S. Department of Transportation Regulations
(formerly Interstate Commerce Commission)**

Extinguisher Type	Original Factory Test Pressure	Requires Hydrostatic Test Pressure
All Dry Chemical and Dry Powder	400 psi or greater	75 % of factory test pressure
	350-399 psi	300 psi
	below 350 psi	75 % of factory test pressure
Foam — 500 psi factory test	500	375
Foam — 350 psi factory test	350	300
Soda-Acid — 500 psi factory test	500	375
Soda-Acid — 350 psi factory test	350	300
Stored-Pressure or Cartridge-Operated Water-Type (including Anti-Freeze and Loaded-Stream)	400 psi or greater	75 % of factory test pressure
	350-399 psi	300 psi
	below 350	75 % of factory test pressure

5327. Carbon dioxide extinguishers, nitrogen cylinders, and other cylinders or cartridges used for the storage of inert, compressed gases shall be hydrostatically tested in accordance with the requirements

of the U. S. Department of Transportation (formerly Interstate Commerce Commission) or the Board of Transport Commissioners of Canada.

NOTE: Such apparatus and procedures are set forth in the Code of Federal Regulations, Title 49, Parts 171-190, and are available from the Superintendent of Documents, U. S. Government Printing Office, Washington, D. C. 20402, at a cost of \$6.25.

In Canada the corresponding information is set forth in the "Board of Transport Commissioners of Canada Regulations Governing the Transportation of Dangerous Articles by Rail," available from the Queen's Printer, Ottawa, Ontario, at a cost of \$6.00.

5328. Extinguisher shells, cartridges, or cylinders which show leakage or permanent distortion in excess of specified limits, or which rupture, shall be removed from service.

APPENDIX A

A-2200. The method of classifying extinguishers used in the 1955 and earlier editions of NFPA No. 10 differs from the method presently used. Columns 3 and 4 of Table A-2200 enable approximate evaluation of older extinguishers in terms of the present method of classification.

NOTE: A further revision of the method of classifying extinguishers rated for Class B fires was adopted in 1969. See Note to Paragraph 2120 herein.

(a). Under the present method of classification it is possible for units of the same size to have different classifications. For example, 15-pound carbon dioxide extinguishers may have a classification of from 4-B:C to 12-B:C, according to the fire-extinguishing potential of the individual units as determined by Underwriters'

Laboratories, Inc., and Underwriters' Laboratories of Canada. Therefore, an exact conversion from the old method to the new method of classification is not possible.

(b). Whenever fire extinguishers are found with the present classification on the label, Table A-2200 should not be used. The classification is usable directly in the application of Chapter 4, Distribution of Units, of this standard.

(c). Whenever fire extinguishers are found with the old classification on the label, use this table for approximate conversion and use the resulting classification value in applying Chapter 4 of this standard. For example, a 15-pound carbon dioxide extinguisher has the classification "B-1, C-1" on the label. From this table, it is found that the approximate classification under the present method is "4-B, C" and this is used in applying the requirements of Chapter 4.

Table A-2200
Conversion of Extinguisher Classification

Extinguishing Agent	Extinguisher Type and Size	Pre-1955 UL Classification	Approximate Present Classification
Chemical Solution (Soda-Acid)	1 ¼, 1 ½ gallon	A-2	1-A
	2 ½ gallon	A-1	2-A
	17 gallon	A	10-A
	33 gallon	A	20-A
Water	1 ½, 1 ¾ gallon (pump or pressure)	A-2	1-A
	2 ½ gallon (pump or pressure)	A-1	2-A
	4 gallon (pump or pressure) ..	A-1	3-A
	5 gallon (pump or pressure) ..	A-1	4-A
	17 gallon (pressure)	A	10-A
	33 gallon (pressure)	A	20-A
	5 12-quart or 6 10-quart water-filled pails; 55-gallon water-filled drum with 3 fire pails; 25- to 55-gallon water-filled bucket tank with 5 or 6 fire pails	A-1	2-A
Loaded Stream ...	1 gallon	A-2, B-4	1-A
	1 ¾ and 2 ½ gallon	A-1, B-2	2-A, ½-B†
	33 gallon	A	20-A

†NOTE: Portable fire extinguishers with fractional ratings are not considered as meeting the requirements of this standard.

Table A2200 — Conversion of Extinguisher Classification (Con't)

Extinguishing Agent	Extinguisher Type and Size	Pre-1955 UL Classification	Approximate Present Classification
Foam	1 ¼ and 1 ½ gallon	A-2, B-2	1-A, 2-B
	2 ½ gallon	A-1, B-1	2-A, 4-B
	5 gallon	A-1, B-1	4-A, 6-B
	10 gallon	A, B	6-A, 8-B
	17 gallon	A, B	10-A, 10-B
	33 gallon	A, B	20-A, 20-B
Carbon Dioxide ..	6 or less pounds of carbon dioxide	B-2, C-2	1-B, C
	7 ½ pounds of carbon dioxide	B-2, C-1	2-B, C
	10 to 12 pounds of carbon dioxide	B-2, C-1	4-B, C
	15 to 20 pounds of carbon dioxide	B-1, C-1	4-B, C
	25 and 26 pounds of carbon dioxide	B-1, C-1	6-B, C
	50 pounds of carbon dioxide ..	B-1, C-1	10-B, C
	75 pounds of carbon dioxide ..	B-1, C-1	12-B, C
	100 pounds of carbon dioxide ..	B, C	12-B, C
Dry Chemical	4 to 6 ¼ pounds of dry chemical	B-2, C-2	4-B, C
	7 ½ pounds of dry chemical ..	B-2, C-1	6-B, C
	10 to 15 pounds of dry chemical ..	B-1, C-1	8-B, C
	20 pounds of dry chemical ...	B-1, C-1	16-B, C
	30 pounds of dry chemical ...	B-1, C-1	20-B, C
	75 to 350 pounds of dry chemical	B, C	40-B, C
Wetting Agent ...	10 gallons	A, B	6-A
	20 gallons	A, B	12-A
	50 gallons	A, B	30-A

NOTES: Carbon dioxide extinguishers with metallic horns will not carry any "C" classification.

Vaporizing liquid extinguishers (carbon tetrachloride or chlorobromomethane base) are not recognized in this standard and reference to them has thus been deleted from this Table as compared to earlier editions.

See also the Note to Paragraph 2120 herein. Ratings of 4-B, 6-B, 8-B, 12-B and 16-B were eliminated June 1, 1969.

A-3000. The following appendix material (Table A-3000) summarizes the characteristics of extinguishers and may be used as an aid in selecting extinguishers in accordance with Chapter 3. The ratings given are those which were in effect at the time this standard was prepared. Current listings should be consulted for up-to-date ratings.

Table A-3000 — Characteristics of Extinguishers

Extinguishing Agent	Method of Operation	Capacity	Horizontal Range of Stream	Approximate Time of Discharge	Hydrostatic Test Interval	Protection Required Below 40°F	UL or ULC Classifications*
Water	Cartridge and stored pressure	1 ¼ gal	30-40 ft	30 sec	5 yr	Yes	1-A
	Cartridge and stored pressure	2 ½ gal	30-40 ft	1 min	5 yr	Yes	2-A
Water	Pump	1 ½ gal	30-40 ft	45 sec	—	Yes	1-A
	Pump	2 ½ gal	30-40 ft	1 min	—	Yes	2-A
	Pump	4 gal	30-40 ft	2 min	—	Yes	3-A
	Pump	5 gal	30-40 ft	2-3 min	—	Yes	4-A
Water (Anti-freeze-Calcium Chloride)	Cartridge and stored pressure	1 ¼, 1 ½ gal	30-40 ft	30 sec	5 yr	No	1-A
	Cartridge and stored pressure	2 ½ gal	30-40 ft	1 min	5 yr	No	2-A
	Cartridge and stored pressure	33 gal (wheeled)	50 ft	3 min	5 yr	No	20-A
Water (Soda-Acid)	Chemically generated expellent	1 ¼, 1 ½ gal	30-40 ft	30 sec	5 yr	Yes	1-A
	Chemically generated expellent	2 ½ gal	30-40 ft	1 min	5 yr	Yes	2-A
	Chemically generated expellent	17 gal (wheeled)	50 ft	3 min	5 yr	Yes	10-A
	Chemically generated expellent	33 gal (wheeled)	50 ft	3 min	5 yr	Yes	20-A

Table A-3000 — Characteristics of Extinguishers (Continued)

Extinguishing Agent	Method of Operation	Capacity	Horizontal Range of Stream	Approximate Time of Discharge	Hydrostatic Test Interval	Protection Required Below 40°F	UL or ULC Classifications*
Water (Wetting Agent)	Cartridge and stored pressure	10 gal (wheeled)	35 ft	1 min	5 yr	Yes	6-A
	Cartridge and stored pressure	20 gal (wheeled)	35 ft	1 1/2 min	5 yr	Yes	10-A
	Cartridge and stored pressure	45 gal (wheeled)	35 ft	2 min	5 yr	Yes	25-A
	Cartridge and stored pressure	50 gal (wheeled)	35 ft	3 min	5 yr	Yes	30-A
Loaded Stream	Cartridge and stored pressure	1 gal	30-40 ft	30 sec	5 yr	No	1-A
	Cartridge and stored pressure	1 3/4 gal	30-40 ft	45 sec	5 yr	No	2-A:1/2-B†
	Cartridge and stored pressure	2 1/2 gal	30-40 ft	1 min	5 yr	No	2-A:1-B to 3-A:2-B
	Cartridge and stored pressure	17 gal (wheeled)	50 ft	3 min	5 yr	No	10-A
	Cartridge and stored pressure	33 gal (wheeled)	50 ft	3 min	5 yr	No	20-A
Foam	Chemically generated expellant	1 1/4, 1 1/2 gal	30-40 ft	40 sec	5 yr	Yes	1-A:2-B
	Chemically generated expellant	2 1/2 gal	30-40 ft	1 1/2 min	5 yr	Yes	2-A:4-B to 2-A:6-B
	Chemically generated expellant	5 gal	30-40 ft	2 min	5 yr	Yes	4-A:6-B
	Chemically generated expellant	17 gal (wheeled)	50 ft	3 min	5 yr	Yes	10-A:10-B to 10-A:12-B
	Chemically generated expellant	33 gal (wheeled)	50 ft	3 min	5 yr	Yes	20-A:20-B to 20-A:40-B

Table A-3000 — Characteristics of Extinguishers (Continued)

Extinguishing Agent	Method of Operation	Capacity	Horizontal Range of Stream	Approximate Time of Discharge	Hydrostatic Test Interval	Protection Required Below 40°F	UL or ULC Classifications*
Carbon Dioxide††	Self expellent	2 to 5 lb	3 to 8 ft	8 to 30 sec	5 yr	No	1 to 4-B:C
	Self expellent	10 to 15 lb	3 to 8 ft	8 to 30 sec	5 yr	No	2 to 12-B:C
	Self expellent	20 to 26 lb	3 to 8 ft	10 to 30 sec	5 yr	No	8 to 12-B:C
	Self expellent	50 to 100 lb (wheeled)	3 to 10 ft	10 to 30 sec	5 yr	No	10 to 40-B:C
Dry Chemical (Sodium bicarbonate)	Cartridge and stored pressure	1 lb	5 to 8 ft	8 to 10 sec	5 or 12 yrs	No	1 to 2-B:C
	Cartridge and stored pressure	1 ½ to 2 lb	5 to 8 ft	8 to 12 sec	5 or 12 yrs	No	2 to 4-B:C
	Cartridge and stored pressure	2 ¼ to 6 lb	5 to 20 ft	8 to 20 sec	5 or 12 yrs	No	4 to 12-B:C
	Cartridge and stored pressure	8 to 30 lb	5 to 20 ft	10 to 25 sec	5 or 12 yrs	No	12 to 60-B:C
	Nitrogen cylinder or stored pressure	75 to 350 lb (wheeled)	15 to 45 ft	20 to 105 sec	5 or 12 yrs	No	40 to 80-B:C

Table A-3000 — Characteristics of Extinguishers (Continued)

Extinguishing Agent	Method of Operation	Capacity	Horizontal Range of Stream	Approximate Time of Discharge	Hydrostatic Test Interval	Protection Required Below 40°F	UL or ULC Classifications*
Dry Chemical (Potassium Bicarbonate)	Cartridge and stored pressure	2½ to 5 lb	5 to 8 ft	8 to 10 sec	5 or 12 yrs	No	8 to 16-B:C
	Cartridge and stored pressure	8 to 30 lb	5 to 20 ft	8 to 25 sec	5 or 12 yrs	No	16 to 80-B:C
	Nitrogen cylinder and stored pressure	125 to 300 lb (wheeled)	15 to 45 ft	30 to 60 sec	5 or 12 yrs	No	80 to 320-B:C
Dry Chemical (Multipurpose)	Cartridge and stored pressure	1 to 6½ lb†††	5 to 12 ft	8 to 12 sec	5 or 12 yrs	No	0 to 1-A and 2 to 12-B:C
	Cartridge and stored pressure	7 to 30 lb	5 to 20 ft	10 to 25 sec	5 or 12 yrs	No	1 to 10-A and 16 to 60-B:C
	Nitrogen cylinder and stored pressure	125 to 300 lb (wheeled)	15 to 45 ft	30 to 60 sec	5 or 12 yrs	No	20-A:80-B:C to 40-A:240-B:C
Dry Chemical (Foam Compatible)	Cartridge and stored pressure	2½ to 5 lb	5 to 20 ft	8 to 10 sec	5 or 12 yrs	No	4 to 10-B:C
	Cartridge and stored pressure	9 to 10 lb	5 to 20 ft	10 to 25 sec	5 or 12 yrs	No	12 to 30-B:C
	Cartridge and stored pressure	18 to 30 lb	5 to 20 ft	10 to 25 sec	5 or 12 yrs	No	20 to 60-B:C
	Nitrogen cylinder and stored pressure	150 to 350 lb (wheeled)	15 to 45 ft	20 to 150 sec	5 or 12 yrs	No	80 to 240-B:C

Table A-3000 — Characteristics of Extinguishers (Continued)

Extinguishing Agent	Method of Operation	Capacity	Horizontal Range of Stream	Approximate Time of Discharge	Hydrostatic Test Interval	Protection Required Below 40°F	UL or ULC Classifications*
Bromotrifluoromethane	Self expellent	2 ½ lb	4 to 6 ft	8 to 10 sec	12 yrs	No	4-B:C

† — Extinguishers with fractional ratings do not meet the requirements of this standard.

†† — Carbon-dioxide extinguishers with metallic horns do not carry a "C" classification.

††† — Some small extinguishers containing multipurpose dry chemical do not carry an "A" classification.

* — UL and ULC ratings checked as of April 15, 1968. Readers concerned with subsequent ratings should review the pertinent "Lists" and "Supplements" issued by these Laboratories. (Write: Underwriters' Laboratories, Inc., 207 East Ohio St., Chicago, Ill. 60611, or Underwriters' Laboratories of Canada, 7 Crouse Road, Scarborough, Ont., Canada.)

Vaporizing liquid extinguishers (carbon tetrachloride or chlorobromomethane base) are not recognized in this standard and reference to them has thus been deleted from this Table as compared to earlier editions.

See also the Note to Paragraph 2120 herein. Ratings of 4-B, 6-B, 8-B, 12-B, and 16-B were eliminated June 1, 1969.

A-3140. Fire of high intensity may occur in certain metals. Ignition is generally the result of frictional heating, exposure to moisture, or exposure from a fire in other combustible materials. The greatest hazard exists when these metals are in the molten state or in finely divided forms of dust, turnings, or shavings.

NOTE: The properties of a wide variety of combustible metals and the agents available for extinguishing fires in these metals are discussed in Section 15, Chapter VI of the NFPA Fire Protection Handbook (13th Edition).

APPENDIX B

Recommended Markings to Indicate Extinguisher Suitability

The following recommendations are given as a guide in marking extinguishers, and/or extinguisher locations, to indicate the suitability of the extinguisher for a particular class of fire (see Paragraph 2100).


Markings should be applied by decalcomanias, painting or similar methods having at least equivalent legibility and durability.

Where markings are applied to the extinguisher, they should be located on the front of the shell above or below the extinguisher nameplate. Markings should be of a size and form to give easy legibility at a distance of 3 feet.


Where markings are applied to wall panels, etc., in the vicinity of extinguishers, they should be of a size and form to give easy legibility at a distance of 25 feet.



1. Extinguishers suitable for "Class A" fires should be identified by a triangle containing the letter "A". If colored, the triangle shall be colored green.*



2. Extinguishers suitable for "Class B" fires should be identified by a square containing the letter "B". If colored, the square shall be colored red.*



3. Extinguishers suitable for "Class C" fires should be identified by a circle containing the letter "C". If colored, the circle shall be colored blue.*



4. Extinguishers suitable for fires involving metals should be identified by a five-pointed star containing the letter "D". If colored, the star shall be colored yellow.*

*NOTE: Recommended colors as described in the Federal Color Standard Number 595† are:

Green — No. 14260

Red — No. 11105

Blue — No. 15102

Yellow — No. 13655

Extinguishers suitable for more than one class of fire may be identified by multiple symbols as described previously.

†Available from the Superintendent of Documents, U.S. Government Printing Office, Washington, D.C. 20401. Price: \$2.25 per copy.