

NFPA 11

Standard for Low-Expansion Foam

1994 Edition



NOTICE

All questions or other communications relating to this document should be sent only to NFPA headquarters, addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable federal, state and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action that is not in compliance with applicable laws, and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision—This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference—Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders, or similar instruments. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term “adoption by reference” means the citing of title and publishing information only.

2. Adoption by Transcription—A. Public authorities with lawmaking or rule-making powers only upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders, or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rule-making process. B. Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rule-making powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately, provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rule-making powers may apply for and may receive a special royalty where the public interest will be served thereby.

3. Scope of License Grant—The terms and conditions set forth above do not extend to the index to this document.

(For further explanation, see the Policy Concerning the Adoption, Printing, and Publication of NFPA Documents, which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accept any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document, and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

Errata

NFPA 11

Low-Expansion Foam

1994 Edition

Reference: 3-3.3.2.2, Appendix B, Storage Tank Protection Summary

The Committee on Foam notes the following error in the 1994 edition of NFPA 11, *Standard for Low-Expansion Foam*:

1. In 3-3.3.2.2, change the reference in the first and third sentences from "Figure 3-3.3.2.2" to "Table 3-3.3.1.2". In the second sentence, change the word "figure" to "table". The parenthetical reference remains unchanged. Paragraph 3-3.3.2.2 now reads as follows:

3-3.3.2.2 Below-the Seal or Weather Shield System. The design parameters for the application of fixed foam discharge outlets below the seal (or weather shield) to protect open-top floating roof tanks shall be in accordance with Table 3-3.3.1.2. the requirements given in the table apply to tanks containing hydrocarbons or flammable and combustible materials requiring alcohol-resistant foams. The required minimum application rates given in Table 3-3.3.1.2 apply unless listings for specific products require higher application rates when Type II fixed foam discharge outlets are used. (See Figure 3-3.3.2.2.)

2. An editorial change has been made to *Appendix B, Storage Tank Protection Summary*. A copy of this change is available from the Standards Administration Department, NFPA, One Batterymarch Park, Quincy, MA 02269.

Issue Date: October 2, 1994

Copyright © 1994 All Rights Reserved
NATIONAL FIRE PROTECTION ASSOCIATION

**CHARLES S. MORGAN LIBRARY
NATIONAL FIRE PROTECTION ASSOCIATION
1 BATTERYMARCH PARK
QUINCY, MA 02269-9101**

Appendix B Storage Tank Protection Summary

		Fixed-Roof (Cone) Tanks and Pan-type Floating Roof Tanks	Pontoon or Double-Deck Floating Roof Tanks (Open-Top or Covered) Annular Seal Area
	No. of Foam Outlets Required	Up to 80 ft (24.4 m) dia. 1 Foam Chamber 81 to 120 ft (24.7-36.6 m) dia. 2 Foam Chambers 121 to 140 ft (36.9-42.7 m) dia. 3 Foam Chambers 141 to 160 ft (43-48.8 m) dia. 4 Foam Chambers 161 to 180 ft (49.1-54.9 m) dia. 5 Foam Chambers 181 to 200 ft (55.2-61 m) dia. 6 Foam Chambers Over 201 ft (61.3 m) dia. 1 additional for each (See Table 3-2.3.2.1) 5000 sq ft	1 For each 40 ft (12.2 m) of circumference with a 12-in. (30.5-cm) high foam dam. 1 For each 80 ft (24.4 m) of circumference with a 24-in. (61-cm) high foam dam. (See 3-3.3.1 and Section 3-4.)
	Hydrocarbon Application Rates	0.10 gpm (4.1 L/min) per sq ft (sq m) of liquid surface. (See Table 3-2.3.2.2)	0.30 gpm (12.2 L/min) per sq ft (sq m) of annular ring area between tank wall and foam dam. (See A-3-2.11.1.)
	Polar Solvent Rates	See Manufacturer's Approval Report.	Not covered by NFPA 11.
	Hydrocarbon Discharge Times	Flash Pt. 100°F-140°F (37.8°C-60°C) Type I 20 min Type II 30 min Flash Pt. below 100°F (37.8°C) 30 min 55 min Crude Petroleum 30 min 55 min	20 min (See Section 3-3.)
	Polar Solvents	Type I 30 min Type II 55 min	Not covered by NFPA 11.
	No. Required	Not Applicable.	Mechanical Shoe Seal 1 — For each 130 ft (39.6 m) of tank circumference (no foam dam required) Tube Seal — Over 6 in. (15.2 cm) from top of seal to top of pontoon with foam outlets under metal weather shield or secondary seal. 1 — For each 60 ft (18.3 m) of tank circumference (no foam dam required) Tube seal — Less than 6 in. (15.2 cm) from top of seal to top of pontoon with foam outlets under metal weather shield or secondary seal. 1 — For each 60 ft (18.3 m) of tank circumference [foam dam at least 12 in. (30.5 cm) high required]. (See 3-3.3.3.)
	Hydrocarbon Application Rates	Not Applicable.	0.30 gpm (12.2 L/min) per sq ft (sq m) of annular ring area with foam dam or with foam application under metal weather seal or secondary seal. 0.50 gpm (20.4 L/min) per sq ft (sq m) for all other applications.
	Discharge Times	Not Applicable.	20 min — with foam dam or under metal weather shield or secondary seal.
	Polar Solvents	Not Applicable.	Not covered by NFPA 11.

Storage Tank Protection Summary (con't)

		Fixed-Roof (Cone) Tanks	Pontoon or Double-Deck Floating Roof Tanks
	Size of Tank	Monitors for tanks up to 60 ft (18.3 m) in diameter. Hand hoselines for tanks less than 30 ft (9.2 m) in diameter and less than 20 ft (6.1 m) high. (See 3-2.2.1.)	Monitors not recommended. Handlines are suitable for extinguishment of rim fires in open-top floating roof tanks. (See 3-3.4.)
	Hydrocarbon Application Rates	0.16 gpm/ft ² [(6.5 L/min)/(m ²)] (See 3-2.2.2, 3-2.2.3, 3-2.2.4.)	0.16 gpm/ft ² (6.5 L/min/m ²) For rim fires in open-top floating roof tanks. (See 3-2.2.2, 3-2.2.3, and 3-2.2.4.)
	Discharge Times	Flash point below 100°F (37.8°C) 65 min Flash point 100°F – 140°F (37.8°C – 60°C) 50 min Crude Oil 65 min (See 3-2.2.3.)	Use same times as for open-top floating roof tank rim fires.
	No. Required	Same as table for foam chambers. See above. (See 3-2.4.1, 3-2.4.2, 3-2.4.2.1.)	Not Recommended.
	Hydrocarbon Application Rates	Minimum 0.1 gpm/ft ² [(4.1 L/min)/m ²] of liquid surface Maximum 0.2 gpm/ft ² [(8.2 L/min)/m ²] Foam velocity from outlet shall not exceed 10 ft per sec (3.05 m per sec) for Class 1B liquids or 20 ft per sec (6.1 m per sec) for all other liquids. (See 3-2.4.2, 3-2.4.3.)	Not Recommended.
	Discharge Times	Flash point 100°F (37.8°C) 30 min to 140°F (60°C) Flash point below 100° (37.8°C) 55 min Crude Petroleum 55 min (See 3-2.4.3.)	Not Recommended.
	Polar Solvents	Not Recommended.	Not Recommended.

For SI units: 1 gpm/ft² = 40.746 (L/min)/m²; 1 ft = 0.305 m;
1 ft² = 0.0929 m²; 1 in. = 2.54 cm; °C = °F – 32/1.8; 1 ft per sec = 0.3051 m per sec.

**CHARLES S. MORGAN LIBRARY
NATIONAL FIRE PROTECTION ASSOCIATION
1 BATTERY MARCH PARK
QUINCY, MA 02269-9101**

11-1

Copyright © 1994 NFPA, All Rights Reserved

NFPA 11

Standard for

Low-Expansion Foam

1994 Edition

This edition of NFPA 11, *Standard for Low-Expansion Foam*, was prepared by the Technical Committee on Foam and acted on by the National Fire Protection Association, Inc. at its Fall Meeting held November 15-18, 1993, in Phoenix, AZ. It was issued by the Standards Council on January 14, 1994, with an effective date of February 11, 1994, and supersedes all previous editions.

The 1994 edition of this document has been approved by the American National Standards Institute.

Origin and Development of NFPA 11

NFPA committee activity in this field dates from 1921 when the Committee on Manufacturing Risks and Special Hazards prepared standards on foam as a section of the general *Standard on Protection of Fire Hazards, Incident to the Use of Volatiles in Manufacturing Processes*. Subsequently the standards were successively under the jurisdiction of the Committee on Manufacturing Hazards and the Committee on Special Extinguishing Systems, prior to the present committee organization. The present text supersedes the prior editions adopted in 1922, 1926, 1931, 1936, 1942, 1950, 1954, 1959, 1960, 1963, 1969, 1970, 1972, 1973, 1974, 1975, 1976, and 1978. It also supersedes the 1977 edition of NFPA 11B.

The 1983 edition was completely rewritten to include all the material formerly contained in NFPA 11B, *Standard on Synthetic and Combined Agent Systems*. A new format was used to be consistent with that used in the international foam systems standard. The standard was revised in 1988.

The standard was completely rewritten for the 1994 edition to more clearly state the requirements and to separate the mandatory requirements from the advisory text in an effort to make the document more usable, enforceable, and adoptable.

Technical Committee on Foam

Richard F. Murphy, *Chair*

Exxon Research & Engr. Co., NJ
Rep. American Petroleum Inst.

Laurence D. Watrous, *Secretary*

Professional Loss Control Inc., TX

William M. Carey, Underwriters Laboratories Inc., IL

Salvatore A. Chines, Industrial Risk Insurers, CT

Rep. Industrial Risk Insurers

Frederick L. Deacon, Kemper Nat'l Insurance Cos., IL

Arthur R. Dooley, Dooley Tackaberry, Inc., TX

Rep. Nat'l Assn. of Fire Equipment Distributors (NAFED)

Christopher P. Hanauska, Hughes Assoc. Inc., MN

Alan L. Holder, LA Power & Light Co., LA

Rep. Electric Light Power Group/Edison Electric Inst.

Larry Jesclard, Engineered Fire Systems, Inc., AK

Rep. Fire Suppression Systems Assn.

John A. Krembs, M&M Protection Consultants, IL

John Lake, Fire Protection Industries, Inc., PA

Rep. Nat'l Fire Sprinkler Assn.

Joan M. Leedy, 3M Co., MN

Giorgio Marini, Genova, Italy

D. N. Meldrum, Malvern, PA

Carlos M. Mendes, Levitt-Safety Ltd, Canada

Rep. Fire Equipment Mfrs. Inst. of Canada

Robert C. Merritt, Factory Mutual Research Corp., MA

Keith Olson, Ansul Fire Protection, WI

Rep. Fire Equipment Mfrs. Assn. Inc.

John M. Poulson, Union Carbide Corp., WV

Fay Purvis, Nat'l Foam System, Inc., PA

Niall Ramsden, Resource Protection, England

Alfredo Sainz, Grinnell Corp., RI

Adrian Semmence, Angus Fire Armour, TX

Gary M. Taylor, Taylor/Wagner, Inc., Canada

Christopher L. Vollman, Rolf Jensen & Assoc. Inc., TX

Klaus Wahle, U.S. Coast Guard, DC

B. J. Walker, Walker & Assoc., MO

H. E. Wolff, Valley Forge, PA

Alternates

William M. Cline, Factory Mutual Research Corp., MA

(Alt. to R. C. Merritt)

N. E. Cundasawmy, Angus Fire Armour, Canada

(Alt. to A. Semmence)

Peter E. Getchell, Kemper Nat'l Insurance Cos., PA

(Alt. to F. L. Deacon)

Dennis C. Kennedy, Rolf Jensen & Assoc. Inc., IL

(Alt. to C. L. Vollman)

Kevin P. Kuntz, M&M Protection Consultants, NJ

(Alt. to J. A. Krembs)

Norbert W. Makowka, Nat'l Assn. of Fire Equipment

Distributors (NAFED), IL

(Alt. to A. R. Dooley)

David Malek, Star Sprinkler, Inc., WI

(Alt. to J. Lake)

Francisco N. Nazario, Exxon Research & Engr. Co., NJ

(Alt. to R. F. Murphy)

David K. Riggs, SOTEC, LA

(Alt. to L. Jesclard)

Bruce S. Shipley, Chubb Nat'l Foam, Inc., PA

(Alt. to F. Purvis)

Mark A. Tschiegg, Industrial Risk Insurers, IL

(Alt. to S. A. Chines)

Kenneth W. Zastrow, Underwriters Laboratories Inc., IL

(Alt. to W. M. Carey)

Nonvoting

Donald M. Johnson, San Bruno, CA

Rep. Technical Committee on Flammable & Combustible
Liquids

Richard L. Tuve, Consultant, Fire Technology, MD

Member Emeritus

Mark T. Conroy, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on the installation, maintenance, and use of foam systems for fire protection, including foam hose streams.

Contents

Foreword	11- 4	Chapter 5 Installation Requirements	11-21
Chapter 1 General	11- 4	5-1 Foam Concentrate Pumps	11-21
1-1 Scope	11- 4	5-2 Flushing	11-21
1-2 Purpose	11- 4	5-3 Power Supply	11-21
1-3 Units	11- 4	5-4 Piping	11-21
1-4 Definitions.	11- 4	5-5 Valves in Systems	11-21
Chapter 2 System Components and System Types	11- 7	5-6 Hangers, Support, and Protection for Pipework	11-22
2-1 General	11- 7	5-7 Hose Requirements	11-22
2-2 Water Supplies	11- 7	Chapter 6 Testing and Acceptance	11-22
2-3 Foam Concentrates	11- 7	6-1 Inspection and Visual Examination	11-22
2-4 Concentrate Compatibility	11- 8	6-2 Flushing after Installation	11-22
2-5 Foam Proportioning	11- 8	6-3 Acceptance Tests	11-22
2-6 Foam Concentrate Pumps	11- 8	6-4 System Restoration	11-22
2-7 Piping	11- 9	Chapter 7 Maintenance	11-22
2-8 System Types	11- 9	7-1 Periodic Inspection	11-22
2-9 Operation and Control of Systems	11- 9	7-2 Foam Concentrate Inspection	11-23
Chapter 3 System Design	11-10	7-3 Operating Instructions and Training	11-23
3-1 Types of Hazards	11-10	Chapter 8 Referenced Publications	11-23
3-2 Outdoor Fixed-Roof (Cone) Tanks	11-10	Appendix A Explanatory Material	11-23
3-3 Outdoor Open-Top Floating Roof Tanks	11-13	Appendix B Storage Tank Protection Summary	11-40
3-4 Outdoor Covered (Internal) Floating Roof Tanks	11-15	Appendix C Tests for the Physical Properties of Foam	11-42
3-5 Indoor Hazards	11-18	Appendix D Foam Fire Fighting Data Sheet	11-47
3-6 Loading Racks	11-18	Appendix E Referenced Publications	11-48
3-7 Diked Areas — Outdoor	11-18	Index	11-48
3-8 Non-Diked Spill Areas	11-19		
3-9 Supplementary Protection	11-19		
Chapter 4 Specifications and Plans	11-20		
4-1 Preliminary Approval	11-20		
4-2 Approval of Plans	11-20		
4-3 Specifications	11-20		
4-4 Plans	11-20		

NFPA 11

Standard for Low-Expansion Foam

1994 Edition

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates explanatory material on that paragraph in Appendix A.

Information on referenced publications can be found in Chapter 8 and Appendix E.

Foreword

Fire-fighting foam is an aggregate of air-filled bubbles formed from aqueous solutions and is lower in density than flammable liquids. It is used principally to form a cohesive floating blanket on flammable and combustible liquids and prevents or extinguishes fire by excluding air and cooling the fuel. It also prevents reignition by suppressing formation of flammable vapors. It has the property of adhering to surfaces, which provides a degree of exposure protection from adjacent fires.

Foam may be used as a fire prevention, control, or extinguishing agent for flammable liquid hazards. Foam for these hazards may be supplied by fixed piped systems or portable foam-generating systems. Foam may be applied through foam discharge outlets, which allow it to fall gently on the surface of the burning fuel. Foam may also be applied by portable hose streams using foam nozzles or large-capacity monitor nozzles or subsurface injection systems.

Foam may be supplied by overhead piped systems for protection of hazardous occupancies associated with potential flammable liquid spills in the proximity of high-value equipment or for protection of large areas. The foam used for flammable liquid spills is in the form of a spray or dense "snowstorm." The foam particles coalesce on the surface of the burning fuel after falling from the overhead foam outlets, which are spaced to cover the entire area at a uniform density. For systems required to meet both foam and water spray design criteria, see NFPA 16, *Standard on the Installation of Deluge Foam-Water Sprinkler and Foam-Water Spray Systems*.

Large-spill flammable liquid fires can be fought with mobile equipment, such as an airport crash truck or industrial foam truck equipped with agent and equipment capable of generating large volumes of foam at high rates. Foam for this type of hazard may be delivered as a solid stream or in a dispersed pattern. Standards for industrial foam trucks include NFPA 11C, *Standard for Mobile Foam Apparatus*, and standards for aircraft crash trucks include NFPA 414, *Standard for Aircraft Rescue and Fire Fighting Vehicles*.

Foam does not break down readily and, when applied at an adequate rate, has the ability to extinguish fire progressively. As application continues, foam flows easily across the burning surface in the form of a tight blanket, preventing reignition on the surfaces already extinguished.

Foam is not suitable for three-dimensional flowing liquid fuel fires or for gas fires.

Chapter 1 General

1-1 Scope. This standard covers the characteristics of foam-producing materials used for fire protection and the requirements for the design, installation, operation, testing, and maintenance of equipment and systems, for flammable and combustible liquid hazards and local areas within buildings, and storage tanks and indoor and outdoor processing areas.

It is not the intent of this standard to specify where foam protection is required. To determine where foam protection is required, see applicable standards such as NFPA 30, *Flammable and Combustible Liquids Code*.

Foam can be applied to protect the surface of a flammable liquid that is not burning. The foam concentrate manufacturer shall be consulted to determine the optimum method of application, rate of discharge, application density, and frequency of reapplication required to establish and maintain the integrity of the foam blanket.

This standard is not applicable to the following types of systems:

- Chemical foams and systems (considered obsolete),
- Foam-water deluge sprinkler or spray systems,
- Foam-water closed-head sprinkler systems,
- Combined agent systems,
- Mobile foam apparatus,
- Medium- and high-expansion foam systems.

1-2 Purpose. This standard is intended for the use and guidance of those responsible for designing, installing, testing, inspecting, approving, listing, operating, or maintaining fixed, semifixed, or portable foam fire extinguishing systems for interior or exterior hazards. Nothing in this standard is intended to restrict new technologies or alternative arrangements, provided the level of safety prescribed by the standard is not lowered.

1-3 Units. Metric units of measurement in this standard are in accordance with the modernized metric system known as the International System of Units (SI). The liter unit, which is not part of but is recognized by SI, is commonly used in international fire protection. Conversion factors for this unit are found in Table 1-3.

Table 1-3

Name of Unit	Unit Symbol	Conversion Factor
liter	L	1 gal = 3.785 L
liter per minute	(L/min)/m ²	1 gpm/ft ² = 40.746 (L/min)/m ²
per square meter		
cubic decimeter	dm ³	1 gal = 3.785 dm ³
pascal	Pa	1 psi = 6894.757 Pa
bar	bar	1 psi = 0.0689 bar
bar	bar	1 bar = 10 ⁵ Pa
kilopascal	kPa	1 psi = 6.895 kPa

For additional conversions and information, see ASTM E380, *Standard for Metric Practice*.

1-4 Definitions.

Air-Aspirating Discharge Devices. These devices are specially designed to aspirate and mix air into the foam solution to generate foam. The foam then is discharged in a specific design pattern.

Approved. Acceptable to the authority having jurisdiction.

NOTE: The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization concerned with product evaluations that is in a position to determine compliance with appropriate standards for the current production of listed items.

Authority Having Jurisdiction. The organization, office, or individual responsible for approving equipment, an installation, or a procedure.

NOTE: The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

Concentration. The percent of foam concentrate contained in a foam solution. The type of foam concentrate used determines the percentage of concentration required. A 3 percent foam concentrate is mixed in the ratio of 97 parts water to 3 parts foam concentrate to make foam solution. A 6 percent concentrate is mixed with 94 parts water to 6 parts foam concentrate.

Discharge Device. A fixed, semifixed, or portable device that directs the flow of foam to the fire or flammable liquid surface.

Eductor (Inductor).* A device that uses the Venturi principle to introduce a proportionate quantity of foam concentrate into a water stream. The pressure at the throat is below atmospheric pressure and will draw in liquid from atmospheric storage.

Expansion. The ratio of final foam volume to original foam solution volume.

Fixed Foam Discharge Outlet. A device permanently attached to a tank, dike, or other containment structure, designed to introduce foam.

Fixed Monitor (Cannon). A device that delivers a large foam stream and is mounted on a stationary support that either is elevated or is at grade. The monitor can be fed solution by permanent piping or hose.

Flammable and Combustible Liquids. Flammable liquids shall be or shall include any liquids having a flash point below 100°F (37.8°C) and having a vapor pressure

not exceeding 40 psi (276 kPa) (absolute) at 100°F (37.8°C). Flammable liquids shall be subdivided as follows:

(a) Class I liquids shall include those having flash points below 100°F (37.8°C) and shall be subdivided as follows:

1. Class IA liquids shall include those having flash points below 73°F (22.8°C) and having a boiling point below 100°F (37.8°C).

2. Class IB liquids shall include those having flash points below 73°F (22.8°C) and having a boiling point above 100°F (37.8°C).

3. Class IC liquids shall include those having flash points at or above 73°F (22.8°C) and below 100°F (37.8°C).

Combustible liquids shall be or shall include any liquids having a flash point at or above 100°F (37.8°C). They shall be subdivided as follows:

(a) Class II liquids shall include those having flash points at or above 100°F (37.8°C) and below 140°F (60°C).

(b) Class IIIA liquids shall include those having flash points at or above 140°F (60°C) and below 200°F (93.3°C).

(c) Class IIIB liquids shall include those having flash points at or above 200°F (93.3°C).

Foam. Fire-fighting foam, within the scope of this standard, is a stable aggregation of small bubbles of lower density than oil or water that exhibits a tenacity for covering horizontal surfaces. Air foam is made by mixing air into a water solution containing a foam concentrate by means of suitably designed equipment. It flows freely over a burning liquid surface and forms a tough, air-excluding, continuous blanket that seals volatile combustible vapors from access to air. It resists disruption from wind and draft or heat and flame attack and is capable of resealing in case of mechanical rupture. Fire-fighting foams retain these properties for relatively long periods of time. Foams also are defined by expansion and are arbitrarily subdivided into three ranges of expansion. These ranges correspond broadly to certain types of usage described below. The three ranges are:

(a) Low-expansion foam — expansion up to 20,

(b) Medium-expansion foam — expansion 20-200, and

(c) High-expansion foam — expansion 200-1000.

Foam Chamber. See Fixed Foam Discharge Outlet.

Foam Concentrate. Foam concentrate is a concentrated liquid foaming agent as received from the manufacturer. For the purpose of this document, "foam concentrate" and "concentrate" are used interchangeably.

(a) *Protein-Foam Concentrates.* Protein-foam concentrates consist primarily of products from a protein hydrolysate, plus stabilizing additives and inhibitors to protect against freezing, to prevent corrosion of equipment and containers, to resist bacterial decomposition, to control viscosity, and to otherwise ensure readiness for use under emergency conditions. They are diluted with water to form 3 percent to 6 percent solutions depending on the type. These concentrates are compatible with certain dry chemicals.

(b) *Fluoroprotein-Foam Concentrates.* Fluoroprotein-foam concentrates are very similar to protein-foam concentrates as described above, but with a synthetic fluorinated surfactant additive. In addition to an air-excluding foam blanket,

they also can deposit a vaporization-preventing film on the surface of a liquid fuel. They are diluted with water to form 3 percent to 6 percent solutions depending on the type. These concentrates are compatible with certain dry chemicals.

(c) *Synthetic-Foam Concentrates.* Synthetic-foam concentrates are based on foaming agents other than hydrolyzed proteins and include:

1. *Aqueous Film-Forming Foam (AFFF) Concentrates.* These concentrates are based on fluorinated surfactants plus foam stabilizers and usually diluted with water to a 3 percent or 6 percent solution. The foam formed acts as a barrier both to exclude air or oxygen and to develop an aqueous film on the fuel surface capable of suppressing the evolution of fuel vapors. The foam produced with AFFF concentrate is dry chemical compatible and thus is suitable for combined use with dry chemicals.

2. *Medium- and High-Expansion Foam Concentrates* (usually derived from hydrocarbon surfactants). These concentrates are used in specially designed equipment to produce foams having foam-to-solution volume ratios of 20:1 to approximately 1000:1. This equipment can be air-aspirating or blower-fan type. Guidance for the use of these materials is provided in NFPA 11A, *Standard for Medium- and High-Expansion Foam Systems*.

3. *Other Synthetic Foam Concentrates.* Other synthetic foam concentrates also are based on hydrocarbon surface active agents and are listed as wetting agents, foaming agents, or both. In general, their use is limited to portable nozzle foam application for spill fires within the scope of their listings. The appropriate listings shall be consulted to determine proper application rates and methods. (See NFPA 18, *Standard on Wetting Agents*.)

(d) *Film-Forming Fluoroprotein (FFFP) Foam Concentrates.* These concentrates use fluorinated surfactants to produce a fluid aqueous film for suppressing hydrocarbon fuel vapors. This type of foam utilizes a protein base plus stabilizing additives and inhibitors to protect against freezing, corrosion, and bacterial decomposition, and it also resists fuel pickup. The foam is usually diluted with water to a 3 or 6 percent solution and is dry chemical compatible.

(e) *Alcohol-Resistant Foam Concentrates.* These concentrates are used for fighting fires on water-soluble materials and other fuels destructive to regular, AFFF, or FFFP foams, as well as for fires involving hydrocarbons. There are three general types. One is based on water-soluble natural polymers, such as protein or fluoroprotein concentrates, and also contains alcohol-insoluble materials that precipitate as an insoluble barrier in the bubble structure.

The second type is based on synthetic concentrates and contains a gelling agent that surrounds the foam bubbles and forms a protective raft on the surface of water-soluble fuels; these foams can also have film-forming characteristics on hydrocarbon fuels. The third type is based on both water-soluble natural polymers, such as fluoroprotein, and contains a gelling agent that protects the foam from water-soluble fuels. This foam can also have film-forming and fluoroprotein characteristics on hydrocarbon fuels. Alcohol-resistant foam concentrates are generally used in concentrations of 3 to 10 percent solutions, depending on the nature of the hazard to be protected and the type of concentrate.

Foam-Generating Methods.* The methods of generation of air foam recognized in this standard include:

(a) *Foam Hose Stream.* A foam stream from a handline.

(b) *Foam Nozzles or Fixed Foam Makers.* A specially designed hose line nozzle or fixed foam maker designed to aspirate air that is connected to a supply of foam solution. They are constructed so that one or several streams of foam solution issue into a space with free access to air. Part of the energy of the liquid is used to aspirate air into the stream, and turbulence downstream of this point creates a stable foam capable of being directed to the hazard being protected. Various types of devices can be installed at the end of the nozzle to cause the foam to issue in a wide pattern or a compacted stream.

(c) *Pressure Foam Maker (High Back-Pressure or Forcing Type).* A foam maker utilizing the Venturi principle for aspirating air into a stream of foam solution forms foam under pressure. Sufficient velocity energy is conserved in this device so that the resulting foam can be conducted through piping or hoses to the hazard being protected.

(d) *Foam Monitor Stream.* A large-capacity foam stream from a nozzle that is supported in position and can be directed by one person.

Foam Solution. A homogeneous mixture of water and foam concentrate in the proper proportions. For the purpose of this document, "foam solution" and "solution" are used interchangeably.

Handline. A hose and nozzle that can be held and directed by hand. The nozzle reaction usually limits the solution flow to about 300 gpm (1135 L/min).

Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation that maintains periodic inspection of production of labeled equipment or materials and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

Listed. Equipment or materials included in a list published by an organization acceptable to the authority having jurisdiction and concerned with product evaluation that maintains periodic inspection of production of listed equipment or materials and whose listing states either that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.

NOTE: The means for identifying listed equipment may vary for each organization concerned with product evaluation, some of which do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

Non-Air-Aspirating Discharge Devices. These devices are designed to provide a specific water discharge pattern. When discharging AFFF or FFFP solution, they generate an effective AFFF or FFFP with a discharge pattern similar to the water discharge pattern.

Portable Monitor (Cannon). A device that delivers a foam monitor stream and is mounted on a movable support or wheels so it can be transported to the fire scene.

Premixed Foam Solution. Premixed solution is produced by introducing a measured amount of foam concentrate into a given amount of water in a storage tank.

Proportioning. Proportioning is the continuous introduction of foam concentrate at the recommended ratio into the water stream to form foam solution.

Proportioning Methods for Air Foam Systems.* The methods of proportioning used to create the proper solution of water and foam liquid concentrate recognized by this standard include the following:

(a) *Coupled Water-Motor Pump.* A suitably designed positive displacement pump in the water supply line is coupled to a second, smaller, positive displacement foam concentrate pump to provide proportioning.

(b) *Foam Nozzle Eductor.* A suitably designed Venturi with "pickup tube" is included in the foam nozzle construction so that foam liquid concentrate is drawn up through a short length of pipe or flexible tubing connecting the foam nozzle with the container of foam concentrate. The concentrate is thus automatically mixed with the water in recommended proportions.

(c) *In-line Eductor.** A Venturi eductor is located in the water supply line to the foam maker. The eductor is connected by single or multiple lines to the source of foam concentrate. It is precalibrated, and it may be adjustable.

(d) *Metered Proportioning.** A separate foam concentrate pump is used to inject foam concentrate into the water stream. Orifices or Venturis, or both, control or measure the proportion of water to foam concentrate. Either manual or automatic adjustment of foam concentrate injection by pressure or flow control can be utilized. Another type of proportioning uses a pump or diaphragm tank to balance the pressure of the water and the concentrate. Variable orifices proportion automatically through a wide range of solution requirements.

(e) *Pressure Proportioning Tank.** A suitable method is provided for displacing foam concentrate from a closed tank by water (with or without a diaphragm separator), using water flow through a Venturi orifice.

(f) *Pump Proportioner (Around-the-Pump Proportioner).** The pressure drop between the discharge and suction side of the water pump of the system is used to induct foam concentrate into water by suitable variable or fixed orifices connected to a Venturi inductor in a bypass between the pump suction and the pump discharge.

Semisubsurface Foam Injection. Discharge of foam at the liquid surface within a storage tank from a floating hose that rises from a piped container near the tank bottom.

Subsurface Foam Injection. Discharge of foam into a storage tank from an outlet near the tank bottom.

Type I Discharge Outlet.* An approved discharge outlet that conducts and delivers foam gently onto the liquid surface without submergence of the foam or agitation of the surface.

Type II Discharge Outlet. An approved discharge outlet that does not deliver foam gently onto the liquid surface but is designed to lessen submergence of the foam and agitation of the surface.

Chapter 2 System Components and System Types

2-1 General.

2-1.1 A foam system consists of a water supply, a foam concentrate supply, proportioning equipment, a piping system, foam makers, and discharge devices designed to distribute foam effectively over the hazard. Some systems include detection devices. This chapter provides requirements for the correct use of these foam system components.

2-1.2 All components shall be listed for their intended use.

Exception: Where listings for components do not exist, components shall be approved.

2-2 Water Supplies.

2-2.1 Water Supplies, Including Premix Solution.

2-2.1.1 Quality. The water supply to foam systems can be hard or soft, fresh or salt, but shall be of suitable quality so that adverse effects on foam formation or foam stability do not occur. No corrosion inhibitors, emulsion breaking chemicals, or any other additives shall be present without prior consultation with the foam concentrate supplier.

2-2.1.2* Quantity. The water supply shall be adequate in quantity to supply all the devices that might be used simultaneously for the specified time. This includes not only the volume required for the foam apparatus but also water that might be used in other fire-fighting operations, in addition to the normal plant requirements. Premixed solution-type systems need not be provided with a continuous water supply.

2-2.1.3 Pressure. The pressure available at the inlet to the foam system (foam generator, air foam maker, etc.) under required flow conditions shall be at least the minimum pressure for which the system has been designed.

2-2.1.4 Temperature. Optimum foam production is obtained using water at temperatures between 40°F (4°C) and 100°F (37.8°C). Higher or lower water temperatures can reduce foam efficiency.

2-2.1.5 Design. The water system shall be designed and installed in accordance with NFPA 24, *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*. Where solids of sufficient size to obstruct openings or damage the foam equipment might be present, strainers shall be provided. Hydrants furnishing the water supply for foam equipment shall be provided in sufficient number and shall be located as required by the authority having jurisdiction.

2-2.1.6 Storage. Water supply or premixed solution shall be protected against freezing in climates where freezing temperatures can be expected.

2-2.2 Water Pumps. When water pumps are required for foam system operation, they shall be designed and installed in accordance with NFPA 20, *Standard for the Installation of Centrifugal Fire Pumps*.

2-3 Foam Concentrates.

2-3.1 Types of Foam Concentrate. Foam concentrate shall be listed. The concentrate used in a foam system shall be acceptable for use on the specific flammable or combustible liquid to be protected. Some concentrates are suitable

for use both on hydrocarbon fuels and on water-miscible or polar fuels and solvents. The limitations of the listing and the manufacturer's specifications shall be followed.

2-3.1.1 Foam concentrates for protection of hydrocarbon fuels shall be one of the following types:

- (a) Protein,
- (b) Fluoroprotein,
- (c) Aqueous film-forming foam (AFFF),
- (d) Film-forming fluoroprotein (FFFP),
- (e) Alcohol-resistant, or
- (f) Others listed for this purpose.

2-3.1.2 Water-miscible and polar flammable or combustible liquids shall be protected by alcohol-resistant concentrates listed for this purpose.

2-3.2 Concentrate Storage.

2-3.2.1 Storage Facilities. Foam concentrates and equipment shall be stored in an accessible location not exposed to the hazard they protect. If housed, they shall be in a noncombustible structure. For outdoor nonautomatic systems, the authority having jurisdiction may permit the storage of foam concentrate in a location off premises where these supplies are available at all times. Adequate loading and transportation facilities shall be ensured. Off-premises supplies shall be of the proper type for use in the systems of the given installation. At the time of a fire, these off-premises supplies shall be accumulated in sufficient quantities, before placing the equipment in operation, to ensure uninterrupted foam production at the design rate for the required period of time.

2-3.2.2* Quantity. The amount of concentrate shall be at least sufficient for the largest single hazard protected or group of hazards that are to be protected simultaneously.

2-3.2.3 Foam Concentrate Storage Tanks. Bulk liquid storage tanks shall be fabricated from or be lined with materials compatible with the concentrate.

2-3.2.4 Storage Conditions. In order to ensure the correct operation of any foam-producing system, the chemical and physical characteristics of the materials comprising the system shall be taken into consideration in design. Since such systems might or might not be operated for long periods after installation, the choice of proper storage conditions and maintenance methods largely determines the reliability and the degree of excellence of system operation when they are put into service.

2-3.2.4.1* Foam concentrates are subject to freezing and to deterioration from prolonged storage at high temperatures and shall be stored within the listed temperature limitations. They might be stored in the containers in which they are transported or might be transferred into large bulk storage tanks, depending on the requirements of the system. The location of stored containers requires special consideration to protect against exterior deterioration due to rusting or other causes. Bulk storage containers also require special design consideration to minimize the liquid surface in contact with air. Clear markings shall be provided on storage vessels to identify the type of concentrate and its intended concentration in solution.

2-3.2.5 Foam Concentrate Supply.

2-3.2.5.1 Foam Concentrate Consumption Rates. The consumption rates shall be based on the percentage concentrate used in the system design (e.g., 3 percent or 6 percent or other, if so listed or approved by the authority having jurisdiction).

2-3.2.5.2 Reserve Supply of Foam Concentrate. There shall be a readily available reserve supply of foam concentrate sufficient to meet design requirements in order to put the system back into service after operation. This supply can be in separate tanks or compartments, in drums or cans on the premises, or available from an approved outside source within 24 hours.

2-3.2.6 Auxiliary Supplies. Other equipment that might be necessary to recommission the system, such as bottles of nitrogen or carbon dioxide for premix systems, also shall be readily available.

2-4 Concentrate Compatibility.

2-4.1 Compatibility of Foam Concentrates. Different types and brands of concentrates and solutions might be incompatible and shall not be mixed in storage. Foams generated separately from protein, fluoroprotein, FFFP, and AFFF concentrates can be applied to a fire in sequence or simultaneously.

2-4.2 Foam Compatibility with Dry Chemical Agents. Some expanded foam might not be compatible with all dry chemical agents. The manufacturers of the dry chemical and foam concentrate to be used in the system shall confirm that their products are mutually compatible. Where used, limitations imposed on either of the agents alone shall be applied.

2-5 Foam Proportioning. The method of foam proportioning shall conform to one of the following:

- (a) Foam nozzle eductor,
- (b) In-line eductor,
- (c) Pressure proportioners,
- (d) Around-the-pump proportioners,
- (e) Direct pumping proportioners,
- (f) Metered proportioning, or
- (g) Balanced pressure proportioners.

2-6* Foam Concentrate Pumps.

2-6.1 The design and materials of construction for foam concentrate pumps shall be suitable for use with the type of foam concentrate used in the system. Special attention shall be paid to the type of seal or packing used.

2-6.1.1 Where pumps utilizing cast or ductile iron components are used, the pumps shall be left flooded with concentrate to minimize corrosion, foaming, or sticking.

2-6.2 Foam concentrate pumps shall have adequate capacities to meet the maximum system demand. To ensure positive injection of concentrates, the discharge pressure ratings of pumps at the design discharge capacity shall be in excess of the maximum water pressure available under any condition at the point of concentration injection.

2-7 Piping.

2-7.1 Pipe Materials. Pipe within the hazard area shall be of steel or other alloy suitable for the pressure and temperature involved. Steel pipe shall not be less than standard weight (Schedule 40 through nominal 12 in. diameter). Steel pipe shall conform to ASTM A135, A53, or A795. Pipe outside the hazard area shall conform to the materials allowed by NFPA 24, *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*. Where exposed to corrosive influences, the piping shall be corrosion resistant or protected against corrosion.

Exception: Lightweight pipe [Schedule 10 in nominal sizes through 5 in.; 0.134 in. (3.40 mm) wall thickness for 6 in.; and 0.188 in. (4.78 mm) wall thickness for 8 in. and 10 in.] shall be permitted to be used in areas where fire exposure is improbable. Selection of pipe wall thickness shall anticipate internal pressure, internal and external pipe wall corrosion, and mechanical bending requirements.

2-7.1.1 Foam System Piping. Galvanized pipe shall be used for normally noncorrosive atmospheres. Corrosive atmospheres might require other coatings. Pipe carrying foam concentrate shall not be galvanized. Piping in constant contact with foam concentrates shall be constructed of material compatible with and not affected by the concentrate. Piping in constant contact with foam concentrate shall not have a detrimental effect on the foam concentrate.

2-7.1.1.1 For the purpose of computing friction loss in foam solution piping, the following C factors shall be used for the Hazen and Williams formula:

Black steel or unlined cast iron pipe	100
Galvanized steel pipe	120
Asbestos-cement or cement-lined cast iron pipe	140

2-7.2 All pipe fittings shall be in accordance with ANSI B16.1, *Cast Iron Pipe Flanges and Flanged Fittings*; B16.3, *Malleable Iron Threaded Fittings*; B16.4, *Gray Iron Threaded Fittings*; B16.5, *Pipe Flanges and Flanged Fittings*; B16.9, *Factory-Made Wrought Steel Buttwelding Fittings*; B16.11, *Forged Fittings, Socket-Welding and Threaded*; B16.25, *Buttwelding Ends*; or ASTM A234, *Standard Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and Elevated Temperatures*. Fittings shall not be less than standard weight. Cast iron fittings shall not be used where dry sections of piping are exposed to possible fire or where fittings are subject to stress in self-supporting systems.

2-7.2.1 Rubber or elastomeric-gasketed fittings shall not be used in fire-exposed areas unless the foam system is automatically actuated.

2-7.2.2 Galvanized fittings shall be used for normally noncorrosive atmospheres. Corrosive atmospheres might require other coatings. Fittings carrying foam concentrate shall not be galvanized.

2-7.3 Joining of Pipes and Fittings. Pipe threading shall be in conformance with ANSI B1.20.1, *Pipe Threads*. Dimensions of cut- and roll-grooves and outside diameters of piping materials shall conform to the manufacturers' recommendations and the approval laboratories' certifications.

2-7.3.1* Welding practices shall conform to the requirements of AWS D10.9, *Standard for the Qualification of Welding Procedures and Welders for Piping and Tubing*. Special

care shall be taken to ensure that the openings are fully cut out and that no obstructions remain in the waterway.

2-7.3.2 Care shall be taken to ensure that no galvanic corrosion can occur between piping and fittings.

2-7.4 Strainers. Where solids of sufficient size might be present to obstruct openings in foam equipment, approved strainers shall be used. The ratio of the strainer's open basket area to its inlet pipe area shall be at least 10 to 1.

2-7.5* Valves. All valves for water and foam solution lines shall be of the indicator type, such as OS & Y or post indicator. Valve specifications normal for water use shall be permitted outside the hazard or diked area. Inside the hazard or diked area, automatic control valves and shutoff valves shall be of steel or other alloy capable of withstanding exposure to expected fire temperatures.

2-7.5.1 All valves required for automatic foam systems shall be supervised in their normal operating position by one of the following methods:

- (a) Electrical, in accordance with NFPA 72, *National Fire Alarm Code*,
- (b) Locked,
- (c) Sealed.

2-8 System Types. There are four basic types of systems:

- (a) Fixed,
- (b) Semifixed,
- (c) Mobile,
- (d) Portable.

2-8.1 Fixed Systems. These systems are complete installations in which foam is piped from a central foam station, discharging through fixed delivery outlets to the hazard to be protected. Any required pumps are permanently installed.

2-8.2 Semifixed Systems. These systems are the type in which the hazard is equipped with fixed discharge outlets connected to piping that terminates at a safe distance. The fixed piping installation might or might not include a foam maker. Necessary foam-producing materials are transported to the scene after the fire starts and are connected to the piping.

2-8.3 Mobile Systems. These systems include any foam-producing unit that is mounted on wheels and that is self-propelled or towed by a vehicle. These units can be connected to a suitable water supply or can utilize a premixed foam solution. For mobile systems, see NFPA 11C, *Standard for Mobile Foam Apparatus*.

2-8.4 Portable Systems. These systems are the type in which the foam-producing equipment and materials, hose, etc., are transported by hand.

2-9 Operation and Control of Systems.

2-9.1 Methods of Actuation. Systems can be actuated automatically or manually. All systems shall have provisions for manual actuation.

2-9.2 Automatically Actuated Systems.

2-9.2.1 An automatic system is one that is activated by automatic detection equipment.

2-9.2.2 Operation shall be controlled by listed or approved mechanical, electrical, hydraulic, or pneumatic means. Where operation is automatic, an adequate and reliable source of energy shall be used. The need for an alternate power supply shall be determined by the authority having jurisdiction.

2-9.2.3 Automatic detection equipment, whether pneumatic, hydraulic, or electric, shall be provided with supervision arranged so that failure of equipment or loss of supervising air pressure or loss of electric energy results in positive notification of the abnormal condition. See applicable sections of NFPA 72, *National Fire Alarm Code*.

Exception: Small systems for localized hazards shall be permitted to be unsupervised, subject to approval of the authority having jurisdiction.

2-9.2.4 Electric automatic detection equipment and any auxiliary electric equipment, if in hazardous areas, shall be designed expressly for use in such areas. See NFPA 70, *National Electrical Code*®, Article 500 and other articles in Chapter 5.

2-9.2.5 In some cases, it shall be permitted to arrange the system to shut off automatically after a predetermined operating time. This feature shall be subject to the approval of the authority having jurisdiction. Where automatic shutdown is required, an alarm condition shall remain until manually reset.

2-9.2.6 The detection system shall activate a local alarm as well as an alarm at a constantly attended location. These alarms also shall be actuated when the system is operated manually.

2-9.3 Manually Actuated Systems. Controls for manually actuated systems shall be located in an accessible place sufficiently removed from the hazard zone to permit them to be operated safely in an emergency, yet close enough to ensure operator knowledge of fire conditions. The location and purposes of the controls shall be indicated plainly and shall be related to the operating instructions.

2-9.4 Equipment. All operating devices shall be suitable for the service conditions they encounter. They shall not be readily rendered inoperative, or be susceptible to inadvertent operation, by environmental factors such as high or low temperature, atmospheric humidity or pollution, or marine conditions. Such systems shall have means for manual actuation.

Chapter 3 System Design

3-1* Types of Hazards. This chapter covers design information for the use of foam to protect outdoor storage tanks, interior flammable liquid hazards, loading racks, diked areas, and non-diked spill areas.

3-2* Outdoor Fixed-Roof (Cone) Tanks. Within the scope of this standard, fixed-roof (cone) tanks are defined as vertical cylindrical tanks with a fixed roof designed as a conical section and that comply with the requirements set forth in NFPA 30, *Flammable and Combustible Liquids Code* (paragraph 2-2.3.1). Typically, these tanks have a weak seam at the junction of the vertical side and roof. In the event of an internal explosion, the seam usually parts; the roof blows off, leaving the shell intact to retain the tank

contents. The resulting fire involves the entire exposed surface of the product.

3-2.1 Methods of Protection. The following methods for protecting exterior fixed-roof tanks are included within this section:

- (a) Foam monitors and handlines,
- (b) Surface application with fixed foam discharge outlets,
- (c) Subsurface application,
- (d) Semisubsurface injection methods.

This list of methods shall not be considered to be in any order of preference.

3-2.1.1 Supplementary Protection. In addition to the primary means of protection, there shall be provisions for supplementary protection in accordance with the requirements found in Section 3-9.

3-2.1.2 Basis of Design. System design shall be based on protecting the tank requiring the largest foam solution flow, including supplementary hose streams.

3-2.1.3* Limitations. The requirements provided in this section are based on extrapolations of test experience and appropriate listings and reflect the limitations known to date.

Foam can fail to seal against the tank shell as a result of prolonged free burning prior to agent discharge. If adequate water supplies are available, cooling of the tank shell is recommended.

Fixed outlets shall not be used to protect horizontal or pressure tanks.

3-2.2 Design Criteria for Foam Monitors and Handlines.

3-2.2.1 Limitations. Monitor nozzles shall not be considered as the primary means of protection for fixed-roof tanks over 60 ft (18 m) in diameter. Foam handlines shall not be considered as the primary means of protection for fixed-roof tanks over 30 ft (9 m) in diameter or those over 20 ft (6 m) in height.

3-2.2.2 Foam Application Rates. The specified minimum delivery rate for primary protection is based on the assumption that all the foam reaches the area being protected. In determining actual solution flow requirements, consideration shall be given to potential foam losses from wind and other factors.

3-2.2.3* The design parameters for the use of monitors and handline nozzles to protect tanks containing hydrocarbons shall be in accordance with Table 3-2.2.3.

3-2.2.4* Tanks Containing Flammable and Combustible Liquids Requiring Alcohol-Resistant Foams. Water-soluble and certain flammable and combustible liquids and polar solvents that are destructive to regular (nonalcohol-resistant) foams require the use of alcohol-resistant foams. In general, alcohol-resistant foams can be effectively applied through foam monitor or foam hose streams to spill fires of these liquids when the liquid depth does not exceed 1 in. (25 mm). For liquids of greater depth, monitor and foam hose streams shall be limited for use with special alcohol-resistant foams listed and/or approved for the purpose. If application results in foam submergence, the performance of alcohol-resistant foams usually deteriorates significantly, particularly where there is a substantial depth of fuel. The degree of performance deterioration

Table 3-2.2.3 Foam Handline and Monitor Protection for Fixed-Roof Storage Tanks Containing Hydrocarbons

Hydrocarbons Type	Minimum Application Rate		Minimum Discharge Time (min)
	gpm/ft ²	(L/min)/m ²	
Flash point between 100°F and 140°F (37.8°C and 93.3°C)	0.16	6.5	50
Flash point below 100°F (37.8°C) or liquids heated above their flash points	0.16	6.5	65
Crude petroleum	0.16	6.5	65

NOTE 1: Included in this table are gasohols and unleaded gasolines containing no more than 10 percent oxygenated additives by volume. Where oxygenated additives content exceeds 10 percent by volume, protection is normally in accordance with 3-2.2.4. Certain nonalcohol-resistant foams might be suitable for use with fuels containing oxygenated additives of more than 10 percent by volume. The manufacturer should be consulted for specific listings or approvals.

NOTE 2: Flammable liquids having a boiling point of less than 100°F (37.8°C) might require higher rates of application. Suitable rates of application should be determined by test. Flammable liquids with a wide range of boiling points might develop a heat layer after prolonged burning and then can require application rates of 0.2 gpm/ft² [(8.1 L/min)/m²] or more.

NOTE 3: Care should be taken in applying portable foam streams to high-viscosity materials heated above 200°F (93.3°C). Good judgment should be used in applying foam to tanks containing hot oils, burning asphalts, or burning liquids that have a boiling point above the boiling point of water. Although the comparatively low water content of foams can beneficially cool such fuels at a slow rate, it can also cause violent frothing and "slop over" of the tank's contents.

depends on the degree of water solubility of the fuel, i.e., the more soluble, the greater the deterioration.

In all cases, the manufacturer of the foam concentrate and the foam-making equipment shall be consulted as to limitations and for recommendations based on listings or specific fire tests.

3-2.2.5 Design Parameters. Where monitors and handline nozzles are used to protect tanks containing flammable and combustible liquids requiring alcohol-resistant foams, the operation time shall be 65 minutes at listed application rates, unless the foam manufacturer has established, by fire test, that a shorter time can be permitted.

3-2.3 Design Criteria Surface Application with Fixed Foam Discharge Outlets.

3-2.3.1 Fixed Foam Discharge Outlets. For this application, discharge outlets are commonly called foam chambers. Most foam chambers are of a Type II discharge outlet design, since they are normally suitable for use with modern foams. For the protection of a flammable liquid contained in a vertical fixed-roof (cone) atmospheric storage tank, discharge outlets shall be attached to the tank. Where two or more discharge outlets are required, the outlets shall be spaced equally around the tank periphery, and each outlet shall be sized to deliver foam at approximately the same rate. Fixed foam discharge outlets shall be attached securely at the top of the shell and shall be located or connected to preclude the possibility of the tank contents overflowing into the foam lines. They shall be attached securely so that displacement of the roof is not likely to subject them to serious damage. Fixed foam discharge outlets shall be provided with an effective and dura-

ble seal, frangible under low pressure, to prevent entrance of vapors into foam outlets and pipelines. Fixed foam discharge outlets shall be provided with suitable inspection means to permit proper maintenance and for inspection and replacement of vapor seals.

3-2.3.2 Design Criteria for Tanks Containing Hydrocarbons.

3-2.3.2.1* Fixed-roof (cone) tanks shall be provided with approved fixed foam discharge outlets as indicated in Table 3-2.3.2.1 below.

Table 3-2.3.2.1 Number of Fixed Foam Discharge Outlets for Fixed-Roof Tanks Containing Hydrocarbons or Flammable and Combustible Liquids Requiring Alcohol-Resistant Foams

Tank Diameter (or equivalent area)	Minimum Number of Discharge Outlets
Feet	Meters
Up to 80	Up to 24
Over 80 to 120	Over 24 to 36
Over 120 to 140	Over 36 to 42
Over 140 to 160	Over 42 to 48
Over 160 to 180	Over 48 to 54
Over 180 to 200	Over 54 to 60

3-2.3.2.2* Minimum Discharge Times and Application Rates. When fixed foam discharge outlets are used for fixed-roof (cone) tanks containing hydrocarbons, the minimum discharge times and application rates shall be in accordance with Table 3-2.3.2.2.

Table 3-2.3.2.2 Minimum Discharge Times and Application Rate for Type I and Type II Fixed Foam Discharge Outlets on Fixed-Roof (Cone) Storage Tanks Containing Hydrocarbons

Hydrocarbon Type	Minimum Application Rate gpm/ft ² [(L/min)/m ²]	Minimum Discharge Time (min)	
		Type I Foam Discharge Outlet I	Type II Foam Discharge Outlet
Flash point between 100°F and 140°F (37.8°C and 93.3°C)	0.10 (4.1)	20	30
Flash point below 100°F (37.8°C) or liquids heated above their flash points	0.10 (4.1)	30	55
Crude petroleum	0.10 (4.1)	30	55

NOTE 1: Included in this table are gasohols and unleaded gasolines containing no more than 10 percent oxygenated additives by volume. Where oxygenated additives content exceeds 10 percent by volume, protection is normally in accordance with 3-2.3.3. Certain nonalcohol-resistant foams might be suitable for use with fuels containing oxygenated additives of more than 10 percent by volume. The manufacturer shall be consulted for specific listings or approvals.

NOTE 2: Flammable liquids having a boiling point of less than 100°F (37.8°C) might require higher rates of application. Suitable rates of application should be determined by test.

NOTE 3: For high-viscosity liquids heated above 200°F (93.3°C), lower initial rates of application might be desirable to minimize frothing and expulsion of the stored liquid. Good judgment should be used in applying foams to tanks containing hot oils, burning asphalts, or burning liquids that have boiling points above the boiling point of water. Although the comparatively low water content of foams can beneficially cool such liquids at a slow rate, it can also cause violent frothing and "slop over" of the tank's contents.

3-2.3.2.2.1 If the apparatus available has a delivery rate higher than 0.1 gpm/ft² [4.1(L/min)/m²], a proportionate reduction in the time figure can be made, except that the time shall not be less than 70 percent of the minimum discharge times shown.

3-2.3.3* Design Criteria for Tanks Containing Flammable and Combustible Liquids Requiring Alcohol-Resistant Foams. Water-soluble and certain flammable and combustible liquids and polar solvents that are destructive to nonalcohol-resistant foams require the use of alcohol-resistant foams. Systems using these foams require special engineering consideration. In all cases, the manufacturers of the foam concentrate and the foam-making equipment shall be consulted as to limitations and for recommendations based on listings or specific fire tests.

3-2.3.3.1 Fixed-roof (cone) tanks shall be provided with approved fixed foam discharge outlets as indicated in Table 3-2.3.2.1.

3-2.3.3.2 Minimum Discharge Times and Application Rates. Minimum discharge times and application rates for fixed-roof (cone) tanks containing flammable and combustible liquids requiring alcohol-resistant foams shall be in accordance with Table 3-2.3.3.2.

Table 3-2.3.3.2 Minimum Application Rate and Discharge Times for Fixed-Roof (Cone) Tanks Containing Flammable and Combustible Liquids Requiring Alcohol-Resistant Foams

Application Rate for Specific Product Stored	Minimum Discharge Time (min)	
	Type I Foam Discharge Outlet	Type II Foam Discharge Outlet
Consult manufacturer for listings on specific products	30	55

NOTE: Most currently manufactured alcohol-resistant foams are suitable for use with Type II fixed foam discharge outlets. However, some older alcohol-resistant foams require gentle surface application by Type I fixed foam discharge outlets. Consult manufacturers for listings on specific products.

3-2.4 Subsurface Application Design Criteria.

3-2.4.1* Subsurface foam injection systems are suitable for protection of liquid hydrocarbons in vertical fixed-roof atmospheric storage tanks. Subsurface injection systems shall not be used for protection of Class IA hydrocarbon liquids or for the protection of alcohols, esters, ketones, aldehydes, anhydrides, or other products requiring the use of alcohol-resistant foams. Foam concentrates and equipment for subsurface injection shall be listed for this purpose. Fluoroprotein foam, AFFF, and FFFP for subsurface injection shall have expansion ratios between 2 and 4.

3-2.4.2* Foam Discharge Outlets. The discharge outlet into the tank can be the open end of a foam delivery line or product line. Outlets shall be sized so that foam generator discharge pressure and foam velocity limitations are not exceeded. The foam velocity at the point of discharge into the tank contents shall not exceed 10 ft/s (3 m/s) for Class IB liquids or 20 ft/s (6 m/s) for other classes of liquids unless actual tests prove higher velocities are satisfactory. Where two or more outlets are required, they shall be located so that the foam travel on the surface can not exceed 100 ft (30 m). Each outlet shall be sized to deliver foam at approximately the same rate. For even foam distri-

bution, outlets can be shell connections or can be fed through a pipe manifold within the tank from a single shell connection. Rather than installing additional tank nozzles, shell connections can be made in manway covers. Tanks shall be provided with subsurface foam discharge outlets as shown in Table 3-2.4.2.

Table 3-2.4.2 Minimum Number of Subsurface Foam Discharge Outlets for Fixed-Roof Tanks Containing Hydrocarbons

Tank Diameter		Minimum Number of Discharge Outlets	
		Flash Point Below 100°F (37.8°C)	Flash Point 100°F (37.8°C) or Higher
Feet	Meters		
Up to 80	Up to 24	1	1
Over 80 to 120	Over 24 to 36	2	1
Over 120 to 140	Over 36 to 42	3	2
Over 140 to 160	Over 42 to 48	4	2
Over 160 to 180	Over 48 to 54	5	2
Over 180 to 200	Over 54 to 60	6	3
Over 200	Over 60	6	3
		plus 1 outlet for each additional 5000 ft ² (465 m ²)	plus 1 outlet for each additional 7500 ft ² (697 m ²)

NOTE 1: Liquids with flash points below 73°F (22.8°C), combined with boiling points below 100°F (37.8°C), require special consideration.

NOTE 2: Table 3-2.4.2 is based on extrapolation of fire test data on 25-ft (7.5-m), 93-ft (27.9-m), and 115-ft (34.5-m) diameter tanks containing gasoline, crude oil, and hexane, respectively.

NOTE 3: The most viscous fuel that has been extinguished by subsurface injection where stored at ambient conditions [60°F (15.6°C)] had a viscosity of 2000 ssu (440 centistokes) and a pour point of 15°F (-9.4°C). Subsurface injection of foam generally is not recommended for fuels that have a viscosity greater than 2000 ssu (440 centistokes) at their minimum anticipated storage temperature.

NOTE 4: In addition to the control provided by the smothering effect of the foam and the cooling effect of the water in the foam that reaches the surface, fire control and extinguishment can be enhanced further by the rolling of cool product to the surface.

3-2.4.2.1* Foam Discharge Outlet Elevation. Foam discharge outlets shall be located so as not to discharge into a water bottom. This shall be accomplished by having the outlets located at least 1 ft (0.3 m) above the highest water level to prevent destruction of the foam.

3-2.4.2.2* Subsurface Injection Back-Pressure Limitations. The sizes and lengths of discharge pipe or lines used beyond the foam maker and the anticipated maximum depth of the fuel to be protected shall be such that the back pressure is within the range of pressures under which the device has been tested and listed by testing laboratories.

3-2.4.3 Minimum Discharge Times and Application Rates. The minimum discharge times and application rates for subsurface application on fixed roof storage tanks shall be in accordance with Table 3-2.4.3.

3-2.4.3.1* Liquid hydrocarbons that contain foam-destructive products might require higher application rates. Some foams might fail to extinguish fires in gasolines containing oxygenates where using subsurface discharge at the usually required rate. In such cases, the manufacturer of the foam concentrate shall be consulted for recommendations based on listings and/or approvals.

Table 3-2.4.3 Minimum Discharge Times and Application Rates for Subsurface Application on Fixed-Roof Storage Tanks

Hydrocarbon Type	Minimum Discharge Time (min)	Minimum Application Rate gpm/ft ²	Minimum Application Rate (L/min)/m ²
Flash point between 100°F and 140°F (37.8°C and 93.3°C)	30	0.1	4.1
Flash point below 100°F (37.8°C) or liquids heated above their flash points	55	0.1	4.1
Crude petroleum	55	0.1	4.1

NOTE 1: The maximum application rate shall be 0.20 gpm/ft² [(8.1 L/min)/m²].

NOTE 2: For high-viscosity liquids heated above 200°F (93.3°C), lower initial rates of application might be desirable to minimize frothing and expulsion of the stored liquid. Good judgment should be used in applying foams to tanks containing hot oils, burning asphalts, or burning liquids that are heated above the boiling point of water. Although the comparatively low water content of foams can beneficially cool such liquids at a slow rate, it can also cause violent frothing and "slop over" of the tank's contents.

3-2.5* Semisubsurface Systems. All equipment used in such systems shall be listed or approved for this purpose.

3-3 Outdoor Open-Top Floating Roof Tanks. Within the scope of this standard, open-top floating roof tanks are defined as vertical cylindrical tanks without fixed roofs that have double-deck or pontoon-type floating roofs and are constructed in accordance with the requirements of NFPA 30, *Flammable and Combustible Liquids Code*. The seal can be a mechanical shoe seal or tube seal. The tube seal can be equipped with a metal weather shield. Secondary seals of combustible or noncombustible materials can also be installed. [See Figures 3-3(a) through (d).]

Tanks equipped with the following floating roof types are not covered in Section 3-3:

- (a) Roofs made from floating diaphragms;
- (b) Roofs made from plastic blankets;
- (c) Roofs made from plastic or other flotation material, even if encapsulated in metal or fiberglass;
- (d) Roofs that rely on flotation device closures that can be easily submerged if damaged;
- (e) Pan roofs.

Systems for tanks so equipped shall be designed in accordance with 3-4.1.1.

3-3.1* Types of Fires Anticipated. Open-top floating roof tanks can experience two distinct types of fires: a seal fire or a full surface area fire (as a result of the floating roof sinking). Experience indicates that the most frequent type of fire involves only the seal of the floating roof tank. Prior to selecting the method of protection, the type of fire that will serve as the basis for design shall be defined. (See NFPA 30, *Flammable and Combustible Liquids Code*, for fire protection requirements.)

3-3.1.1 Subsurface and semisubsurface injection shall not be used for protection of open-top or covered floating roof tanks because of the possibility of improper distribution of foam at the fuel surface.

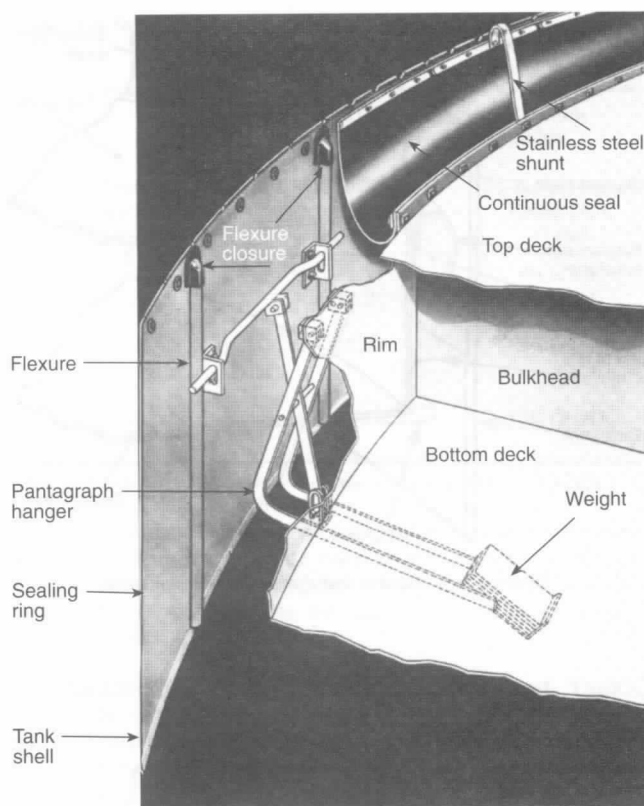


Figure 3-3(a) Pantograph-type seal open-top floating roof tank.

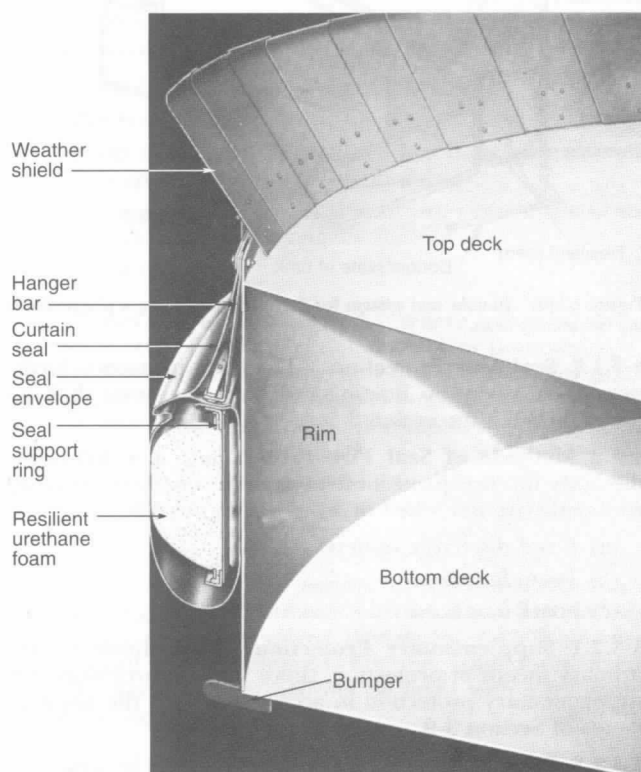


Figure 3-3(b) Tube seal open-top floating roof tank.

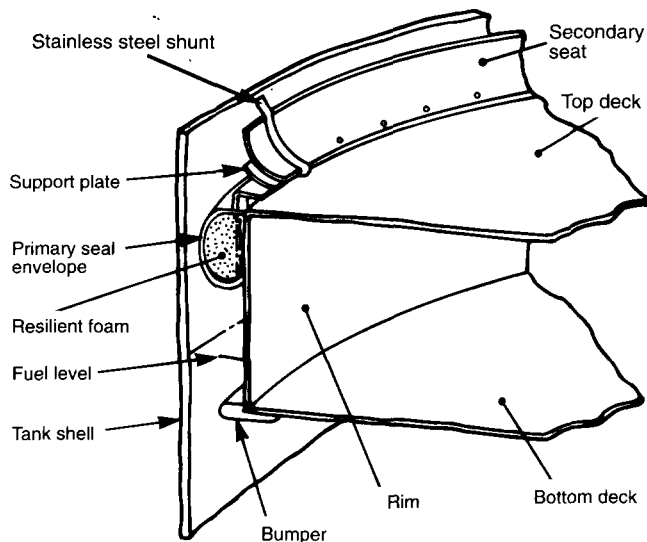


Figure 3-3(c) Double seal system for floating roofs.

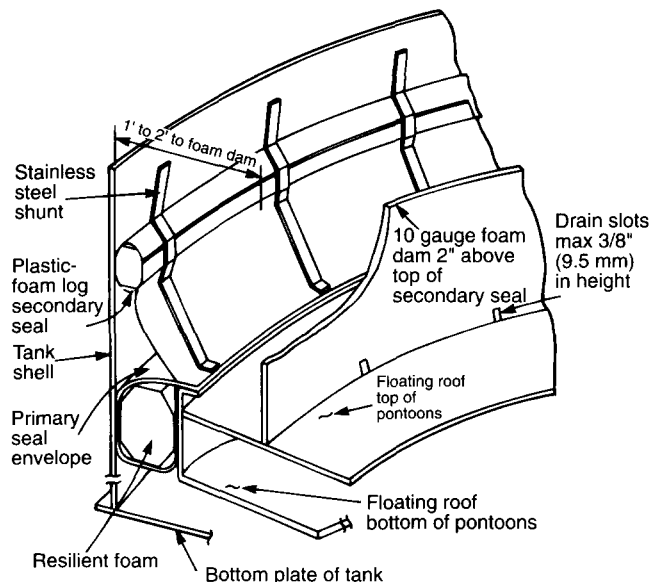


Figure 3-3(d) Double seal system for floating roofs using a plastic-foam log (secondary seal).

3-3.1.2 Seal Area Protection. The foam protection facilities for an open-top floating roof tank seal area shall be based on 3-3.2 through 3-3.5.

3-3.2 Methods of Seal Fire Protection. The following methods for fire protection of seals in open-top floating roof tanks are described in 3-3.3 through 3-3.5:

- (a) Fixed discharge outlets,
- (b) Foam handlines,
- (c) Foam monitors.

3-3.2.1 Supplementary Protection. In addition to the primary means of protection, there shall be provisions for supplementary protection in accordance with the requirements of Section 3-9.

3-3.2.2 Basis of Design. System design shall be based on protecting the tank requiring the largest foam solution flow, including supplementary hose streams.

3-3.2.3 Limitations. The requirements given in this section are based on extrapolations of test experience and appropriate listings, and reflect the limitations known to date.

Foam can fail to seal against the tank shell as a result of prolonged free burning prior to agent discharge. If adequate water supplies are available, cooling of the tank shell is recommended.

3-3.3 Fixed Discharge Outlets Design Criteria for Seal Area Protection. Application of foam from fixed discharge outlets can be achieved by either of the following two methods:

- (a) The first method discharges foam above the mechanical shoe seal, a metal weather shield, or a secondary seal.
- (b) The second method discharges foam below a mechanical shoe seal directly onto the flammable liquid, behind a metal weather shield directly onto the tube seal envelope, or beneath a secondary seal onto the primary seal.

3-3.3.1 Top-of-Seal Method with Foam Dam. Fixed foam discharge outlets located above a mechanical shoe seal, above a tube seal weather shield, or above a secondary seal shall be used in conjunction with a foam dam. See 3-3.3.3 for foam dam design criteria. There are two acceptable arrangements when utilizing fixed foam discharge outlets.

- (a) Fixed foam discharge outlets (normally Type II) mounted above the top of the tank shell.
- (b) Fixed foam discharge outlets mounted on the periphery of the floating roof.

[See Appendix Figures A-3-3.3.1.1(a) and (b).]

3-3.3.1.1* For this application, the fixed foam discharge outlets shall not be fitted with a frangible vapor seal device.

3-3.3.1.2 Top of Seal System Design. The design parameters for the application of fixed foam discharge outlets on top of the seal to protect open-top floating roof tanks shall be in accordance with Table 3-3.3.1.2. The requirements specified in the table apply to tanks containing hydrocarbons or flammable and combustible materials requiring alcohol-resistant foams. The required minimum application rates specified in Table 3-3.3.1.2 apply, unless listings for specific products require higher application rates where Type II fixed foam discharge outlets are used. (See Figure 3-3.3.1.2.)

NOTE: Both fixed foam (wall mounted) and roof mounted discharge outlets are shown for illustrative purposes. Although both methods are shown, only one is needed.

3-3.3.1.3 If the application rate is higher than the minimum rate specified in Table 3-3.3.1.2, the discharge time can be reduced proportionately, but not less than 70 percent of the minimum discharge times specified.

3-3.3.2 Below Primary Seal or Weather Shield Method. Fixed foam discharge outlets located below either a mechanical shoe seal, a metal weather shield, or a metal secondary seal shall use the designs illustrated in Figure 3-3.3.2.2.

3-3.3.2.1 A foam dam shall be installed if a tube seal is used and the top of the tube seal is less than 6 in. (152 mm) below the top of the pontoon. See 3-3.3.3 for foam dam design criteria.

Table 3-3.3.1.2 Top-of-Seal Fixed Foam Discharge Protection for Open-Top Floating Roof Tanks
(See Figure 3-3.3.1.2)

Seal Type	Applicable Illustration Detail	Minimum Application Rate gpm/ft ² [(L/min)/m ²]	Minimum Discharge Time (min)	Maximum Spacing Between Discharge Outlets with	
				12-in. (305-mm) Foam Dam ft (m)	24-in. (610-mm) Foam Dam ft (m)
Mechanical shoe seal	A	0.3 (12.2)	20	40 (12.2)	80 (24.4)
Tube seal with metal weather shield	B	0.3 (12.2)	20	40 (12.2)	80 (24.4)
Fully or partly combustible secondary seal	C	0.3 (12.2)	20	40 (12.2)	80 (24.4)
All metal secondary seal	D	0.3 (12.2)	20	40 (12.2)	80 (24.4)

NOTE: Where the fixed foam discharge outlets are mounted above the top of the tank shell, a foam splashboard is necessary due to the effect of winds.

3-3.3.2.2 Below-the-Seal or Weather Shield System. The design parameters for the application of fixed foam discharge outlets below the seal (or weather shield) to protect open-top floating roof tanks shall be in accordance with Figure 3-3.3.2.2. The requirements given in the figure apply to tanks containing hydrocarbons or flammable and combustible materials requiring alcohol-resistant foams. The required minimum application rates given in Figure 3-3.3.2.2 apply unless listings for specific products require higher application rates when Type II fixed foam discharge outlets are used. (See Figure 3-3.3.2.2.)

3-3.3.2.3 Below-the-seal (or shield) application shall not be used with combustible secondary seals.

3-3.3.3 Foam Dam Design Criteria.

3-3.3.3.1 The foam dam shall be circular and constructed of at least No. 10 U.S. Standard Gauge Thickness [0.134 in. (3.4 mm)] steel plate.

3-3.3.3.2 The foam dam shall be welded or otherwise securely fastened to the floating roof.

3-3.3.3.3 The foam dam shall be designed to retain foam at the seal area, at a sufficient depth to cover the seal area while causing the foam to flow laterally to the point of seal rupture. Dam height shall be at least 12 in. (305 mm). The dam shall extend at least 2 in. (51 mm) above a metal secondary seal or a combustible secondary seal using a plastic-foam log. Dam height shall be at least 2 in. (51 mm) higher than any burnout panels in metal secondary seals.

3-3.3.3.4 The foam dam shall be at least 1 ft (0.3 m), but no more than 2 ft (0.6 m), from the edge of the roof.

3-3.3.3.5 To allow drainage of rain water, the foam dam bottom shall be slotted on the basis of 0.04 in.² of slot area per ft² of dammed area (278 mm² of slot area per m² of dammed area) restricting drain slots to a maximum 3/8 in. (9.5 mm) in height. Excessive dam openings for drainage shall be avoided to prevent loss of foam through the drainage slots. (See Figure 3-3.3.3.5.)

3-3.4* Foam Handline Design Criteria for Seal Area Protection. Foam handlines can be used from the wind girder for extinguishment of seal fires in open-top floating roof tanks. Listed or approved equipment shall be used. (See A-3-3.4 and Figure A-3-3.4 for a suggested system design.)

3-3.5 Foam Monitor Design Criteria for Seal Area Protection. Monitors shall not be used as the primary means of floating roof seal fire extinguishment because of the difficulty of directing foam into the annular space and the possibility of sinking the roof.

3-4 Outdoor Covered (Internal) Floating Roof Tanks.

Within the scope of this standard, covered (internal) floating roof tanks are defined as vertical cylindrical tanks with a fixed metal roof (cone or geodesic dome) equipped with ventilation at the top and containing a metal double-deck or pontoon-type floating roof or a metal floating cover supported by liquidtight metal flotation devices and are constructed in accordance with the requirements of NFPA 30, *Flammable and Combustible Liquids Code*. (See Figure 3-4.)









Tanks equipped with the following floating roof types are not covered in Section 3-4:

- (a) Roofs made from floating diaphragms;
- (b) Roofs made from plastic blankets;
- (c) Roofs made with plastic or other flotation material, even if encapsulated in metal or fiberglass;
- (d) Roofs that rely on flotation device closures that can be easily submerged if damaged;
- (e) Pan roofs.

3-4.1 Types of Fires Anticipated. Where a covered floating roof is other than a steel double deck or pontoon type, a design for full surface protection shall be used. For double deck or pontoon roofs of steel construction, a design for seal area protection shall be permitted.

3-4.1.1 Design for Full Surface Fire. Where the basis for design is a full surface fire, the covered (internal) floating roof tank shall be considered as equivalent to a fixed-roof (cone) tank of the same diameter for the purpose of foam system design. For a full surface fire, the foam facilities shall be designed in accordance with 3-2.3 and Section 3-9, except that separately valved laterals for each foam discharge shall not be required. For this application, fixed foam discharge outlets shall not be fitted with a frangible vapor seal device.

3-4.1.1.1 Subsurface and semisubsurface injection shall not be used because of the possibility of improper distribution of foam.

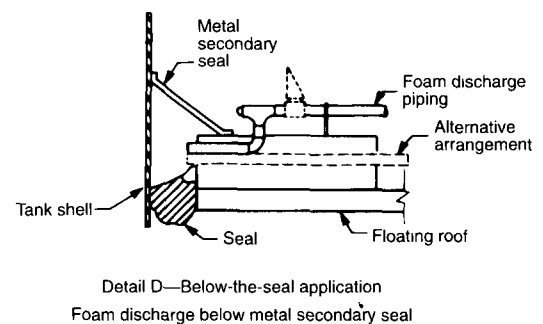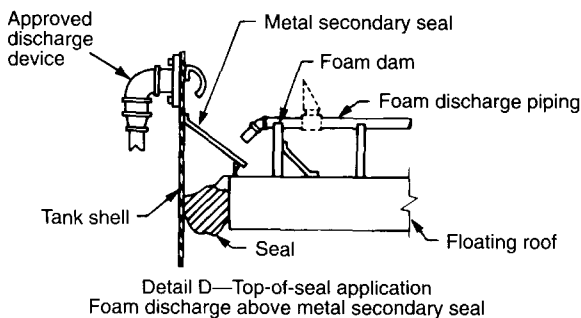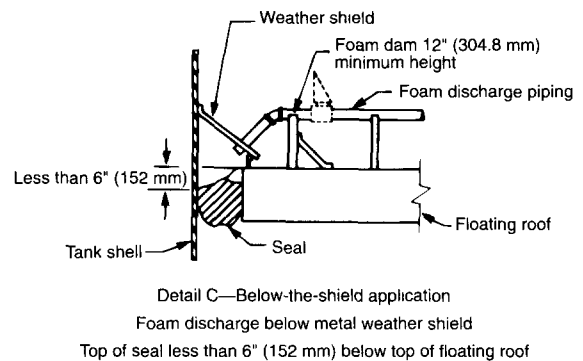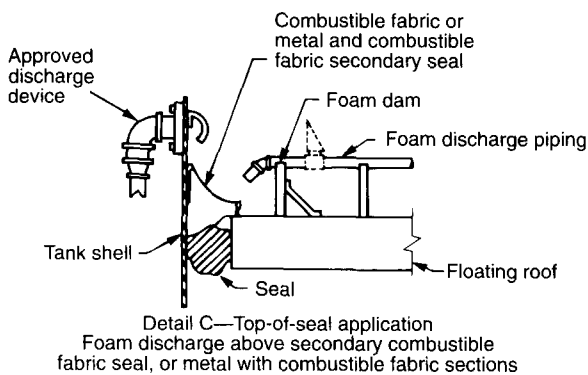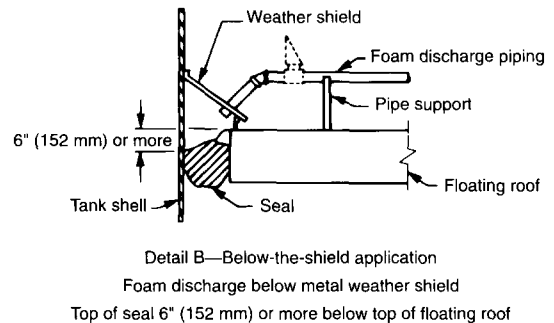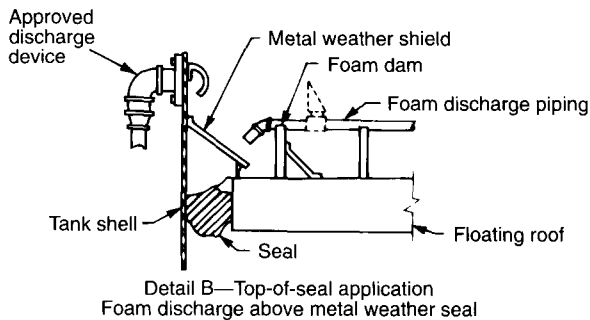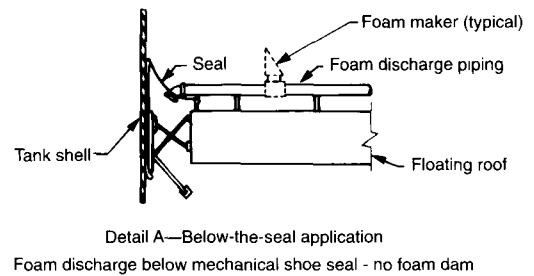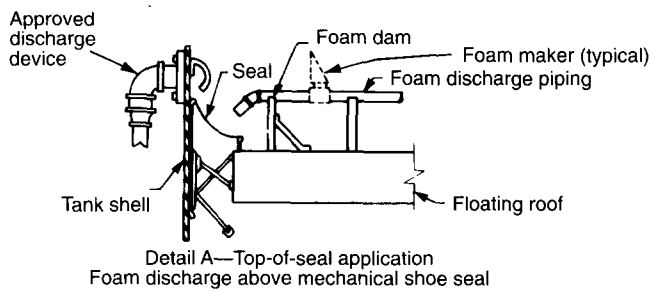

This foam application method is not suitable if secondary seal is constructed of any combustible fabric sections.
(Refer to application above seal.)

Figure 3-3.3.1.2 Typical foam system illustrations for top-of-seal fire protection.

Figure 3-3.3.2.2 Typical foam system arrangement illustrations for below-the-seal (or shield) application.

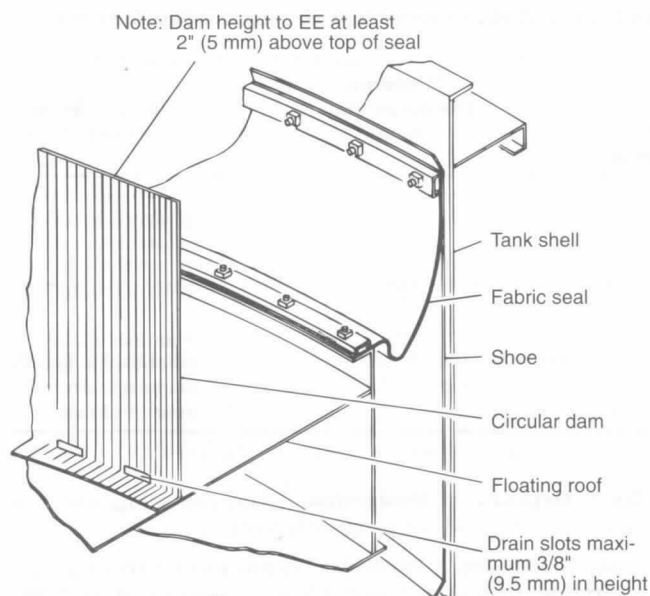


Figure 3-3.3.3.5 Typical foam dam for floating roof tank protection.

3-4.1.2 Design for Seal Area Fire. Where the basis for design is a seal fire, the covered (internal) floating roof tank shall be considered as equivalent to an open-top floating roof tank of the same diameter for the purpose of foam system design. For a seal fire, the foam discharge system shall be designed in accordance with the requirements specified in Table 3-3.3.1.2 utilizing fixed foam discharge outlets.

3-4.1.2.1 Supplementary Protection. In addition to the primary means of protection, there shall be provisions for supplementary protection in accordance with the requirements of Section 3-9.

3-4.1.2.2* Basis of Design. System design shall be based on protecting the tank requiring the largest solution flow, including supplementary hose streams.

If the application rate is higher than the minimum rate specified in Table 3-2.3.2.2, the discharge time shall be permitted to be reduced proportionately, but shall not be less than 70 percent of the minimum discharge times specified.

3-4.1.2.3 Limitations. The requirements given in this section are based on extrapolations of test experience and appropriate listings and reflect the limitations known to date.

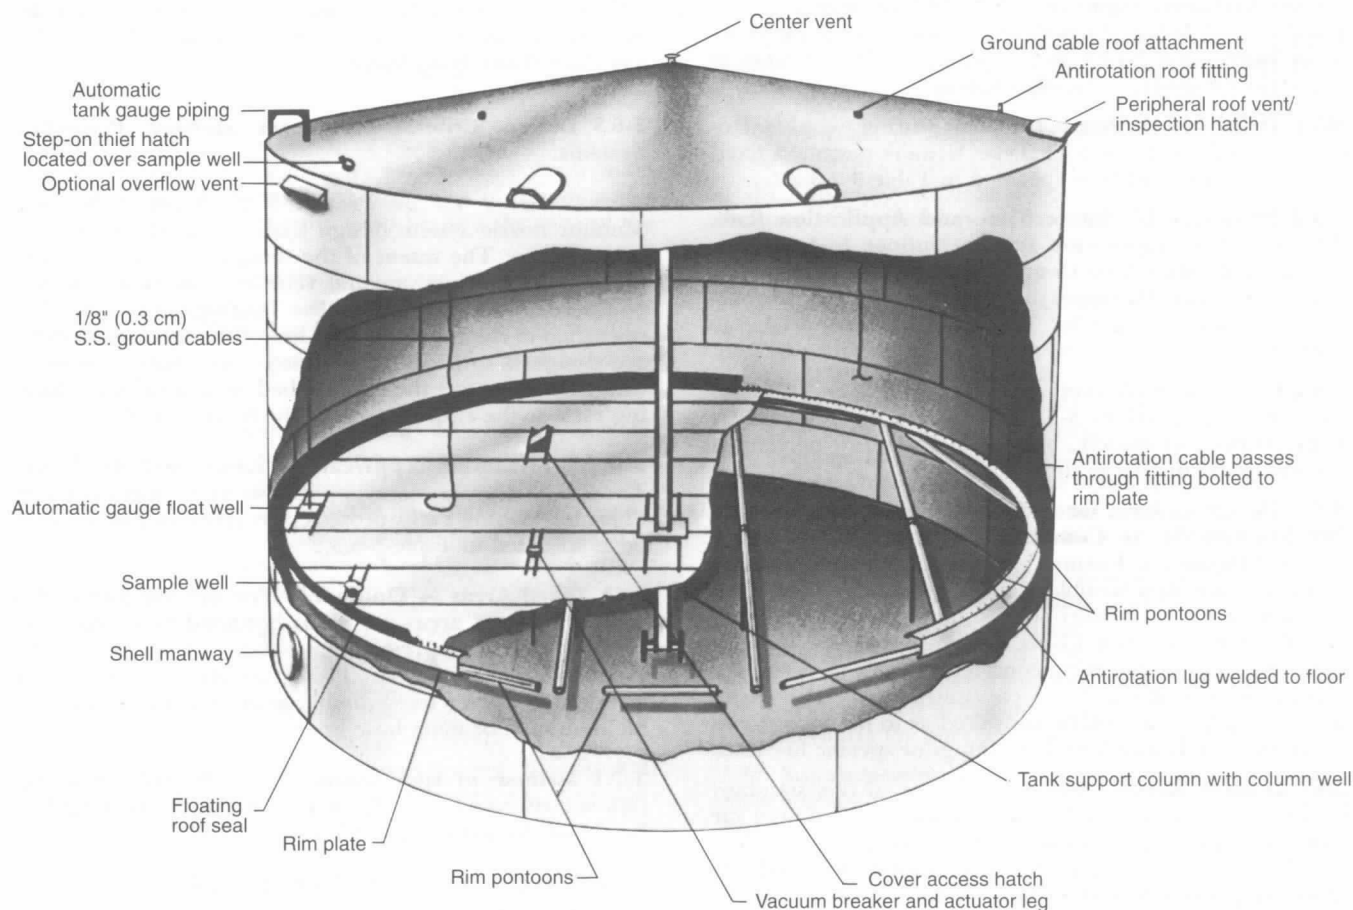


Figure 3-4 Typical covered floating roof tank.

Table 3-6.3.2 Minimum Application Rates and Discharge Times for Loading Racks Protected by Foam Monitor Nozzle Systems

Foam Type	Minimum Application Rate		Minimum Discharge Time (min)	Product Being Loaded
	gpm/ft ²	[(L/min)/m ²]		
Protein, fluoroprotein	0.16	(6.5)	15	Hydrocarbons
AFFF, FFFP, & alcohol-resistant AFFF or FFFP	0.10*	(4.1)	15	Hydrocarbons
Alcohol-resistant foams	Consult manufacturer for listings on specific products		15	Flammable and combustible liquids requiring alcohol-resistant foam

* If a fuel depth of more than 1 in. (2.5 cm) can accumulate within the protected area, the application rate shall be increased to 0.16 gpm/ft² [(6.5 L/min)/m²].

Foam can fail to seal against the tank shell as a result of prolonged free burning prior to agent discharge. If adequate water supplies are available, cooling of the tank shell is recommended.

3-5 Indoor Hazards. This section addresses foam fire extinguishing systems, which are intended to protect indoor storage tanks that have liquid surface areas of 400 ft² (37.2 m²) or greater. For other types of indoor hazards, see the design criteria requirements of NFPA 16, *Standard on the Installation of Deluge Foam-Water Sprinkler and Foam-Water Spray Systems*, and NFPA 16A, *Standard for the Installation of Closed-Head Foam-Water Sprinkler Systems*.

3-5.1 Discharge Outlets. Tanks for storing liquid hydrocarbons shall be fitted with Type II, tank-mounted fixed foam discharge outlets as specified in Table 3-2.3.2.1.

3-5.2 Minimum Discharge Time and Application Rate. The minimum application rate for indoor hydrocarbon storage tanks shall be 0.16 gpm/ft² [(6.5 L/min)/m²] of liquid surface area. Minimum discharge time shall be as specified in Table 3-2.3.2.2 for Type II fixed foam discharge outlets.

3-5.2.1 If the application rate is higher than the minimum rate specified in 3-5.2, the discharge time can be reduced proportionately, but not less than 70 percent of the minimum discharge times indicated.

3-5.3 Design Criteria for Indoor Storage Tanks Containing Flammable or Combustible Liquids Requiring Alcohol-Resistant Foams. Water-soluble and certain flammable and combustible liquids and polar solvents that are destructive to nonalcohol-resistant foams require the use of alcohol-resistant foams. Systems using these foams require special engineering consideration. In all cases, the manufacturers of the foam concentrate and the foam-making equipment shall be consulted as to limitations and for recommendations based on listings or specific fire tests.

3-6* Loading Racks. Within the scope of this standard loading racks are defined as being either truck or rail car types for the purpose of loading or unloading product. Total rack size, flammable or combustible products involved, proximity of other hazards and exposures, drainage facilities, wind conditions, ambient temperatures, and available staff all shall be considered when designing a loading rack foam system. The speed of system operation is always critical in minimizing life and property loss.

3-6.1 Methods of Protection. The following are two acceptable methods of protecting loading racks:

(a) Foam-water sprinkler application utilizing air-aspirating foam-water sprinklers or nozzles or non-air-aspirating standard sprinklers,

(b) Foam monitors.

3-6.2 Design Criteria for Foam-Water Sprinkler Systems. For design criteria for sprinkler systems see NFPA 16, *Standard on the Installation of Deluge Foam-Water Sprinkler and Foam-Water Spray Systems*.

3-6.3 Design Criteria for Foam Monitor Protection Systems.

3-6.3.1* Areas To Be Protected by Monitor Nozzles. Monitor nozzle system design shall be based on the total ground area. The intent of the design shall be to protect the canopy, pumps, meters, vehicles, and miscellaneous equipment associated with the loading and unloading operation in the event of a spill fire. Although most systems are designed to protect the canopy area only, it is often desirable to protect the total curbed area around the loading rack or the entire length of the truck or rail car.

3-6.3.2 Minimum Application Rates and Discharge Times. Minimum foam application rates and discharge times for loading racks protected by monitor nozzles shall be as specified in Table 3-6.3.2.

3-7* Diked Areas — Outdoor. For the purpose of this standard, diked areas are areas bounded by contours of land or physical barriers that retain a fuel to a depth greater than 1 in. (2.5 cm). Protection of these areas can be achieved by either fixed discharge outlets, fixed or portable monitors, or foam hose lines.

3-7.1 Methods of Application. Where fixed foam protection is considered for a diked area, it can be accomplished by any of the following methods:

- (a) Fixed low-level foam discharge outlets,
- (b) Foam monitors,
- (c) Foam-water sprinklers or nozzles.

This list of methods shall not be considered as being in the order of preference.

Table 3-7.1.1 Minimum Application Rates and Discharge Times for Fixed Foam Application on Diked Areas Involving Hydrocarbon Liquids

Type of Foam Discharge Outlets	Minimum Application Rate		Minimum Discharge Time (min)	
	gpm/ft ²	[(L/min)/m ²]	Class I Hydrocarbon	Class II Hydrocarbon
Fixed low-level foam discharge outlets	0.10	(4.1)	30	20
Foam monitors	0.16	(6.5)	30	20

3-7.1.1 Minimum Application Rates and Discharge Times for Fixed Discharge Outlets on Diked Areas Involving Liquid Hydrocarbons. The minimum application rates and discharge times for fixed foam application on diked areas shall be as specified in Table 3-7.1.1.

3-7.1.2 Fixed Foam Discharge Outlets. Fixed foam discharge outlets vary considerably in capacity and range area of coverage. Fixed foam discharge outlets shall be sized and located to apply foam uniformly over the dike area at the application rate specified in Table 3-7.1.1. Large dike areas shall be permitted to be subdivided to keep the total design solution within practical limits.

3-7.1.2.1 Fixed Foam-Water Sprinklers or Nozzles. Where fixed foam-water sprinklers or nozzles are used, the system design shall be in accordance with NFPA 16, *Standard on the Installation of Foam-Water Sprinkler and Foam-Water Spray Systems*.

3-7.1.2.1.1 Limitations. Where foam-water sprinklers or nozzles are used as the primary protection, consideration shall be given to the possibility that some of the foam discharge can be carried by the wind beyond the area of the fuel spill.

Overhead application by foam-water sprinklers or nozzles might need supplementary low-level foam application to provide coverage below large obstructions.

Overhead pipework can be susceptible to damage by explosion.

3-7.1.2.2 Fixed Low-Level Foam Discharge Outlets. These outlets shall be permitted to be open pipe fittings or directional flow nozzles designed to discharge a compact, low-velocity foam stream onto the inner wall of the dike or, where necessary, directly onto the dike floor. They shall be located around the dike wall, and, where necessary, inside the dike area, to apply foam uniformly over the dike area.

3-7.1.2.2.1 Limitations. Where fixed discharge outlets installed at a low level are used as the primary protection, they shall be located so that no point in the dike area is more than 30 ft (9 m) from a discharge outlet where the discharge per outlet is 60 gpm (225 L/min) or less.

For outlets having discharge rates higher than 60 gpm (225 L/min) the maximum distance between discharge outlets shall be 60 ft (18 m).

Low-level foam discharge outlets might need supplementary overhead foam spray application to provide coverage or cooling for overhead structures or for tank surfaces.

3-7.1.2.3 Foam Monitors. Where monitors are used to discharge foam onto the dike area, they shall be located outside the dike area.

3-7.1.2.3.1 Limitations. Where foam monitors are used as the primary protection, consideration shall be given to the possibility that some of the foam discharge can be carried by the wind beyond the area of the fuel spill.

Where the monitor discharge is in the form of a compact, high-velocity foam stream, it shall be directed against the dike walls, tank surfaces, or other structures to prevent its plunging directly into the burning liquid surface.

3-7.2 Diked Areas Involving Flammable or Combustible Liquids Requiring Alcohol-Resistant Foams. Water-soluble and certain flammable and combustible liquids and polar solvents that are destructive to nonalcohol-resistant foams require the use of alcohol-resistant foams. Systems using these foams require special engineering consideration.

3-7.2.1 Design Criteria for Diked Areas Involving Flammable or Combustible Liquids Requiring Alcohol-Resistant Foams. The design criteria shall be as follows:

(a) Methods of fixed protection shall be the same as those described in 3-7.1.2 for hydrocarbon hazards.

(b) Application rates shall be in accordance with manufacturer recommendations based on listings or approvals for specific products and corresponding foam-making devices.

(c) The minimum discharge time shall be 30 minutes.

3-8 Non-Diked Spill Areas. For the purpose of this standard, non-diked spill areas are areas where a flammable or combustible liquid spill might occur, uncontained by curbing, dike walls, or walls of a room or building. In such cases it is assumed that any fire would be classified as a spill fire, i.e., one in which the flammable liquid spill has an average depth not exceeding 1 in. (25 mm) and is bounded only by the contour of the surface on which it is lying.

3-8.1 Design Criteria for Protection of Spill Fires Involving Hydrocarbons or Flammable and Combustible Liquids Requiring Alcohol-Resistant Foams. To determine protection for spill fires, it is necessary to estimate the potential spill area. Once this has been determined, Table 3-8.1 shall be used to calculate requirements to be used as design criteria for portable nozzles or monitors.

3-9* Supplementary Protection. In addition to the primary means of protection, some types of hazards require provisions for supplemental means of protection. The supplemental protection requirements are described in this section.

3-9.1 Supplemental Foam Hose Stream Requirements. Approved foam hose stream equipment shall be provided in addition to tank foam installations as supplementary protection for small spill fires. The minimum number of

Table 3-8.1 Minimum Application Rate and Discharge Times for Non-Diked Spill Fire Protection Using Portable Foam Nozzles or Monitors

Foam Type	Minimum Application Rate gpm/ft ²	Minimum Application Rate (L/min)/m ²	Minimum Discharge Time (min)	Anticipated Product Spill
Protein fluoroprotein	0.16	6.5	15	Hydrocarbon
AFFF, FFFP, & alcohol -resistant AFFF or FFFP	0.10	4.1	15	Hydrocarbon
Alcohol-resistant foams	Consult manufacturer for listings on specific products		15	Flammable and combustible liquids requiring alcohol- resistant foam

fixed or portable hose streams required shall be as specified in Table 3-9.1 and shall be available to provide protection of the area. The equipment for producing each foam stream shall have a solution application rate of at least 50 gpm (189 L/min), with the minimum number of hose streams shown as follows:

Table 3-9.1 Supplemental Foam Hose Stream Requirements

Diameter of Largest Tank	Minimum Number of Hose Streams Required
Up to 65 ft (19.5 m)	1
65 to 120 ft (19.5 to 36 m)	2
Over 120 ft (36 m)	3

3-9.1.1 Additional foam-producing materials shall be provided to permit operation of the hose stream equipment simultaneously with tank foam installations as specified in Table 3-9.1.1.

Table 3-9.1.1 Hose Stream Operating Times, Supplementing Tank Foam Installations

Diameter of Largest Tank	Minimum Operating Time*
Up to 35 ft (10.5 m)	10 min
35 to 95 ft (10.5 to 28.5 m)	20 min
Over 95 ft (28.5 m)	30 min

* Based on simultaneous operation of the required minimum number of hose streams discharging at a rate of 50 gpm (189 L/min).

Chapter 4 Specifications and Plans

4-1* Preliminary Approval. It is good practice for the owner or his or her designated representative (architect, contractor, or other authorized person) to review the basic hazard with the authority having jurisdiction to obtain guidance and preliminary approval of the proposed protection concept.

4-2 Approval of Plans. Plans shall be submitted to the authority having jurisdiction for approval before installation.

4-3 Specifications. Specifications for foam systems shall be developed with care and shall include the following:

(a) The specifications shall designate the authority having jurisdiction and shall indicate whether submission of plans is required.

(b) The specifications shall state that the installation shall conform to this standard and shall meet the approval of the authority having jurisdiction.

(c) The specifications shall include the specific tests that might be required to meet the approval of the authority having jurisdiction and shall indicate how testing costs are to be met.

4-4 Plans. Preparation of plans shall be entrusted only to fully experienced and responsible persons. They shall be submitted for approval to the authority having jurisdiction before foam systems are installed or existing systems are modified. These plans shall be drawn to an indicated scale or be suitably dimensioned.

4-4.1 The plans shall include or be accompanied by the following information, where applicable:

- Physical details of the hazard, including the location, arrangement, and hazardous materials involved;
- Type and percentage of foam concentrate;
- Required solution application rate;
- Water requirements;
- Calculations specifying required amount of concentrate;
- Hydraulic calculations (*See Chapter 6 of NFPA 13, Standard for the Installation of Sprinkler Systems*, for hydraulic calculation procedures);
- Identification and capacity of all equipment and devices;
- Location of piping, detection devices, operating devices, generators, discharge outlets, and auxiliary equipment;
- Schematic wiring diagram;
- Explanation of any special features.

4-4.2 Complete plans and detailed data describing pumps, drivers, controllers, power supply, fittings, suction and discharge connections, and suction conditions shall be submitted by the engineer or contractor to the authority having jurisdiction for approval before installation.

4-4.2.1 Where field conditions necessitate any significant change from the approved plan, revised "as installed" plans shall be supplied for approval to the authority having jurisdiction.

4-4.3 Charts specifying head, delivery, efficiency, and brake horsepower curves of pumps shall be furnished by the contractor.

Chapter 5 Installation Requirements

5-1* Foam Concentrate Pumps. Pressure shall not exceed the working pressure of the concentrate piping system. Positive displacement pumps and centrifugal pumps capable of overpressuring the system shall be provided with adequate means of pressure relief from the discharge to the supply side of the circuit to prevent excessive pressure and temperature.

5-2 Flushing. Pumps shall have adequate means for flushing with water. They shall be provided with a drain cock or valve.

5-3 Power Supply.

5-3.1 Power supply for the drivers of foam concentrate pumps shall be installed in accordance with NFPA 20, *Standard for the Installation of Centrifugal Fire Pumps*, and NFPA 70, *National Electrical Code*.

5-3.2 Power supplies shall be arranged such that disconnecting power from the protected facility during a fire shall not disconnect the power supply to the foam concentrate pump feeder circuit.

5-3.3 Controllers governing the start-up of concentrate pumps with electric drivers of 30 horsepower or less shall be listed as limited service controller. Controllers governing the start-up of foam concentrate pumps with electric drivers of greater than 30 horsepower shall be listed as fire pump controller. Controllers governing the start-up of foam concentrate pumps with diesel engine drivers shall be listed as diesel engine fire pump controller.

5-3.4* A service disconnecting means in the feeder circuits to limited service controllers shall be permitted, where allowed by the authority having jurisdiction, provided the disconnecting means is supervised for the proper position. Supervision for proper position shall be performed by:

- (a) Central station, proprietary, or remote station signaling electrical supervision service;
- (b) Local electrical supervision through use of a signaling service that will cause the sounding of an audible signal at a constantly attended point; or
- (c) Locking the disconnect in the correct position with monthly recorded inspections.

5-4 Piping.

5-4.1 General Requirements.

5-4.1.1 All piping inside of dikes or within 50 ft (15 m) of tanks not diked shall be buried under at least 1 ft (0.3 m) of earth or, if aboveground, shall be properly supported and protected against mechanical injury.

5-4.1.2 Piping that is subject to freezing shall be installed for proper drainage with a pitch of $\frac{1}{2}$ in. for every 10 ft (4 mm per m) or shall be protected from freezing temperatures.

5-4.1.3 For systems that apply foam to a tank's liquid surface from the top side, all piping within the dike or within 50 ft (15 m) of tanks not diked shall be designed to absorb the upward force and shock caused by a tank roof rupture. One of the following designs shall be used:

- (a) Piping less than 4 in. (100 mm) in diameter:

1. Where piping is buried, a swing joint or other suitable means shall be provided at each tank riser to absorb the upward force. The swing joint may consist of approved standard weight steel, ductile, or malleable iron fittings.

2. Where piping is supported aboveground, it shall not be secured for a distance of 50 ft (15 m) from the tank shell to provide flexibility in an upward direction so that a swing joint is not needed. If there are threaded connections within this distance, they shall be back welded for strength.

(b)* The vertical piping of 4 in. (101 mm) in diameter and greater on the protected tank shall be provided with one brace at each shell course. This design can be used in lieu of swing joints or other approved aboveground flexibility, as specified in 5-4.1.3(a)1 and 5-4.1.3(a)2.

5-4.1.4 One flange or union joint shall be provided in each riser at a convenient location, preferably directly below the foam maker, to permit hydrostatic testing of the piping system up to this joint. With all welded construction, this might be the only joint that can be opened.

5-4.1.5 In systems with semifixed equipment on fixed-roof tanks, the foam or solution laterals to each foam maker shall terminate in connections that are located at a safe distance from the tanks. These connections shall not be located within the dike. Connections shall be located at a distance of at least one tank diameter from the tank but in no case less than 50 ft (15 m). The inlets to the piping shall be fitted with corrosion-resistant metal connections, compatible with the equipment supplying foam solution to the system, and provided with plugs or caps.

5-5 Valves in Systems.

5-5.1 The laterals to each foam discharge outlet on fixed roof tanks shall be separately valved outside the dike in fixed installations. Shutoff valves to divert the foam or solutions to the proper tank shall be located either in the central foam station or at points where laterals to the protected tanks branch from the main feed line. These valves shall not be located within the dike. Valves shall be located at a distance of at least one tank diameter from the tank but in no case less than 50 ft (15 m).

Exception: Shutoff valves can be permitted to be located at shorter distances where remotely operated, subject to the approval of the authority having jurisdiction.

5-5.2 Where two or more foam proportioners are installed in parallel and discharge into the same outlet header, valves shall be provided between the outlet of each device and the header. The water line to each proportioner inlet shall be separately valved.

5-5.3 For subsurface applications, each foam delivery line shall be provided with a valve and a check valve unless the latter is an integral part of the high back-pressure foam maker or pressure generator to be connected at the time of use. Where product lines are used for foam, product valving shall be arranged to ensure foam enters only the tank to be protected.

5-5.4 Drain valves that are readily accessible shall be provided for low points in underground and aboveground piping.

5-6 Hangers, Support, and Protection for Pipework.

5-6.1 Where protecting hazards where there is a possibility of explosion, pipework shall be routed to afford the best protection against damage. The supply piping to foam outlets that protect a given hazard in a fire area shall not pass over another hazard in the same fire area.

5-6.2 All hangers shall be of approved types. Tapping or drilling of load-bearing structural members shall not be permitted where unacceptable weakening of the structure would occur. Attachments can be made to existing steel or concrete structures and equipment supports. Where systems are of such a design that the standard method of supporting pipe for protection purposes cannot be used, the piping shall be supported in such a manner as to produce the strength equivalent to that afforded by the standard means of support.

5-7 Hose Requirements. Unlined fabric hose shall not be used with foam equipment.

Chapter 6 Testing and Acceptance

6-1 Inspection and Visual Examination. Foam systems shall be examined visually to determine that they have been properly installed. They shall be inspected for such items as conformity with installation plans; continuity of piping; removal of temporary blinds; accessibility of valves, controls, and gauges; and proper installation of vapor seals, where applicable. Devices shall be checked for proper identification and operating instructions.

6-2 Flushing after Installation. In order to remove foreign materials that might have entered both underground and aboveground water supply mains during installation, they shall be flushed thoroughly at the maximum practicable rate of flow before connection is made to system piping. The minimum rate of flow for flushing shall not be less than the water demand rate of the system, as determined by the system design. The flow shall be continued for a sufficient time to ensure thorough cleaning. Disposal of flushing water must be suitably arranged. All foam system piping shall be flushed after installation, using the system's normal water supply with foam-forming materials shut off, unless the hazard cannot be subjected to water flow. Where flushing cannot be accomplished, pipe interiors shall be carefully visually examined for cleanliness during installation.

6-3* Acceptance Tests. The completed system shall be tested by qualified personnel to meet the approval of the authority having jurisdiction. These tests shall be adequate to determine that the system has been properly installed, and that it functions as intended.

6-3.1 Pressure Tests. All piping, except piping handling expanded foam for other than subsurface application, shall be subjected to a two-hour hydrostatic pressure test at 200 psig (1379 kPa gauge) or 50 psi (345 kPa) in excess of the maximum pressure anticipated, whichever is greater, in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*. All normally dry horizontal piping shall be inspected for drainage pitch.

6-3.2 Operating Tests. Before approval, all operating devices and equipment shall be tested for proper function.

6-3.3* Discharge Tests. Where conditions permit, flow tests shall be conducted to ensure that the hazard is fully protected in conformance with the design specification. The following data shall be required:

- (a) Static water pressure,
- (b) Residual water pressure at the control valve and at a remote reference point in the system,
- (c) Actual discharge rate,
- (d) Consumption rate of foam-producing material,
- (e) Concentration of the foam solution, and
- (f) Foam quality (expansion and $\frac{1}{4}$ drain time).

Foam concentration proportioning shall be:

- (a) Not less than the rated concentration, or
- (b) No more than 30 percent above the rated concentration, or 1 percentage point above the rated concentration, whichever is less. For information on tests for physical properties of foam, see Appendix C.

The foam discharged shall be visually inspected to ensure that it is satisfactory for the purpose intended.

NOTE: The rate of concentrate flow can be measured by timing a given displacement from the storage tank. Solution concentration can be measured by either refractometric or conductivity means (*see C-2*), or it may be calculated from solution and concentrate flow rates. Solution flow rates can be calculated by utilizing recorded inlet or end-of-system operating pressures or both.

6-4 System Restoration. After completion of acceptance tests, the system shall be flushed and restored to operational condition.

Chapter 7 Maintenance

7-1 Periodic Inspection. At least annually, all foam systems shall be thoroughly inspected and checked for proper operation. The inspection shall include performance evaluation of the foam concentrate or premix solution quality or both. Test results that deviate more than 10 percent from those recorded in acceptance testing shall be discussed immediately with the manufacturer. Regular service contracts are recommended. The goal of this inspection and testing shall be to ensure that the system is in full operating condition and that it remains in that condition until the next inspection. The inspection report, with recommendations, shall be filed with the owner. Between the regular service contract inspections or tests, the system shall be inspected by competent personnel following an approved schedule.

7-1.1* Foam-Producing Equipment. Proportioning devices, their accessory equipment, and foam makers shall be inspected.

7-1.1.1 Fixed discharge outlets equipped with frangible seals shall be provided with suitable inspection means to permit proper maintenance and for inspection and replacement of vapor seals.

7-1.2 Piping. Aboveground piping shall be examined to determine its condition and to verify that proper drainage pitch is maintained. Pressure tests of normally dry piping

shall be made when visual inspection indicates questionable strength due to corrosion or mechanical damage. Underground piping shall be spot-checked for deterioration at least every 5 years.

7-1.3 Strainers. Strainers shall be inspected periodically and shall be cleaned after each use and flow test.

7-1.4 Detection and Actuation Equipment. Control valves, including all automatic and manual-actuating devices, shall be tested at regular intervals.

7-2 Foam Concentrate Inspection. At least annually, an inspection shall be made of foam concentrates and their tanks or storage containers for evidence of excessive sludging or deterioration. Samples of concentrates shall be sent to the manufacturer or qualified laboratory for quality condition testing. Quantity of concentrate in storage shall meet design requirements, and tanks or containers shall normally be kept full, with adequate space allowed for expansion.

7-3 Operating Instructions and Training. Operating and maintenance instructions and layouts shall be posted at control equipment with a second copy on file. All persons who are expected to inspect, test, maintain, or operate foam-generating apparatus shall be thoroughly trained and training shall be kept current over time.

Chapter 8 Referenced Publications

8-1 The following documents or portions thereof are referenced within this standard and shall be considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

8-1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 1993 edition.

NFPA 16, *Standard for the Installation of Deluge Foam-Water Sprinkler and Foam-Water Spray Systems*, 1991 edition.

NFPA 20, *Standard for the Installation of Centrifugal Fire Pumps*, 1993 edition.

NFPA 24, *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*, 1992 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 1993 edition.

NFPA 70, *National Electrical Code*, 1993 edition.

NFPA 72, *National Fire Alarm Code*, 1993 edition.

8-1.2 Other Publications.

8-1.2.1 ANSI Publications. American National Standards Institute, Inc., 1430 Broadway, New York, NY 10018.

ANSI B1.20.1, *Pipe Threads*, 1992.

ANSI B16.1, *Cast Iron Pipe Flanges and Flanged Fittings*, 1989.

ANSI B16.3, *Malleable Iron Threaded Fittings*, 1992.

ANSI B16.4, *Gray Iron Threaded Fittings*, 1992.

ANSI B16.5, *Pipe Flanges and Flanged Fittings*, Errata - Oct. 1988, Addenda B16.5A, 1992.

ANSI B16.9, *Factory-Made Wrought Steel Buttwelding Fittings*, 1993.

ANSI B16.11, *Forged Fittings, Socket-Welding and Threaded*, 1991.

ANSI B16.25, *Buttwelding Ends*, 1992.

8-1.2.2 ASTM Publications. American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103.

ASTM A53, Rev B-90, *Standard Specification for Pipe Steel, Black and Hot-Dipped, Zinc-Coated Welded and Seamless* (Replaces ASTM A120-19 pp. Locator Code G-65-45).

ASTM A135, Rev A-89, *Standard Specification for Electric Resistance-Welded Pipe* - 7 pp. DOD Adopted Locator Code G-65-45.

ASTM A234, Rev A-90, *Standard Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and Elevated Temperatures* - 7 pp. Locator Codes E-15-13, E-15-17, E-15-01.

ASTM A795, *Standard Specification for Black and Hot Dipped Zinc Coated (Galvanized) Welded and Seamless Steel Pipe for Fire Protection Use* - 6 pp. Code G-65-45.

8-1.2.3 AWS Publication. American Welding Society, 2501 N.W. 7th Street, Miami, FL 33125.

AWS D10.9-1980, *Standard for the Qualification of Welding Procedures and Welders for Piping and Tubing*.

Appendix A Explanatory Material

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

A-1-4 Eductor (Inductor).

Air Foam Hose Nozzle with Built-in Eductor. Figure A-1-4(a) shows the type of proportioner in which the jet in the foam maker is utilized to draft the concentrate.

Limitations. The bottom of the concentrate container should not be more than 6 ft (1.8 m) below the level of the foam maker.

The length and size of hose or pipe between the concentrate container and the foam maker should conform to the recommendations of the manufacturer.

Hydrocarbon Surfactant-type Foam Concentrates. These are synthetic foaming agents generally based on a hydrocarbon surface active agent. They produce foams of widely different character (expansion and drainage times), depending on the type of foam-producing devices employed. In general, such foams do not provide the stability and burn-back resistance of protein-type foams or the rapid control and extinguishment of AFFF, but they can be useful for petroleum-product spill fire fighting in accordance with their listings and approvals.

There are hydrocarbon-base foaming agents that have been listed as foaming agents, wetting agents, or combination foaming/wetting agents. The appropriate listings should be consulted to determine proper application rates and methods.



Figure A-1-4(a) Air foam hose nozzle with built-in eductor.

A-1-4 Foam Generating Methods. Foam nozzle and monitor streams may also be employed for the primary protection of process units and buildings, subject to the approval of the authority having jurisdiction. The discharge characteristics of the equipment selected to produce foam nozzle and monitor streams for outdoor storage tank protection should be verified by actual tests to make certain that the streams will be effective on the hazards involved.



Figure A-1-4(b) Handline foam nozzle.

A-1-4 Proportioning Methods for Air Foam Systems.

In-Line Eductor. This eductor is for installation in a hose line, usually at some distance from the foam maker or playpipe, as a means of drafting air foam concentrate from a container. [See Figures A-1-4(g) and (h).]

Limitations.

1. The in-line eductor must be designed for the flow rate of the particular foam maker or playpipe with which it is to be used. The device is very sensitive to downstream pressures and is accordingly designed for use with specified lengths of hose or pipe located between it and the foam maker.



Figure A-1-4(c) Adjustable straight stream-to-fan pattern foam-water monitor.

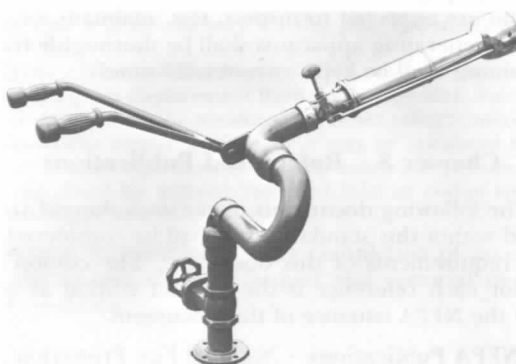


Figure A-1-4(d) Adjustable straight stream-to-spray foam-water monitor.



Figure A-1-4(e) Wheeled portable foam-water monitor.

2. The pressure drop across the eductor is approximately one third of the inlet pressure.
3. The elevation of the bottom of the concentrate container should not be more than 6 ft (1.8 m) below the eductor.



Figure A-1-4(f) Portable foam-water monitor.

Metered Proportioning. By means of an auxiliary pump, foam compound is injected into the water stream passing through an inductor. The resulting foam solution is then delivered to a foam maker or playpipe. The proportioner can be inserted into the line at any point between the water source and foam maker or playpipe. [See Figures A-1-4(i) and (j).]



Figure A-1-4(g) In-line eductor.

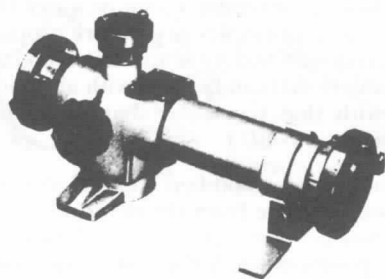


Figure A-1-4(h) In-line eductor.

To operate, the main water valve is opened and a reading of the pressure indicated on the duplex gauge is taken. When both gauge hands are set at the same point, the proper amount of foam concentrate is being injected into the water stream. This is done automatically by the use of a differential pressure diaphragm valve.

Limitations.


1. The capacity of the proportioner can be varied from approximately 50 percent to 200 percent of its rated capacity.
2. The pressure drop across the proportioner ranges from 5 psi to 30 psi (34 kPa to 207 kPa), depending on the volume of water flowing through the proportioner within the capacity limits of item No. 1 above.
3. A separate pump is needed to deliver concentrate to the proportioner.

Pressure Proportioning Tank. This method employs water pressure as the source of power. With this device, the water supply pressurizes the foam concentrate storage tank. At the same time, water flowing through an adjacent Venturi or orifice creates a pressure differential. The low-pressure area of the Venturi is connected to the foam concentrate tank, so that the difference between the water supply pressure and this low-pressure area forces the foam concentrate through a metering orifice and into the Venturi. Also, the differential across the Venturi varies in proportion to the flow, so one Venturi will proportion properly over a wide flow range. The pressure drop through this unit is relatively low. [See Figure A-1-4(k).]

A special test procedure is available to permit the use of a minimum amount of concentrate when testing the pressure proportioner system.

Limitations.

1. Foam concentrates with specific gravities similar to water can create a problem when mixed.
2. The capacity of these proportioners can be varied from approximately 50 percent to 200 percent of their rated capacity.
3. The pressure drop across the proportioner ranges from 5 psi to 30 psi (34 kPa to 207 kPa), depending on the volume of water flowing within the capacity limits of item No. 2 above.

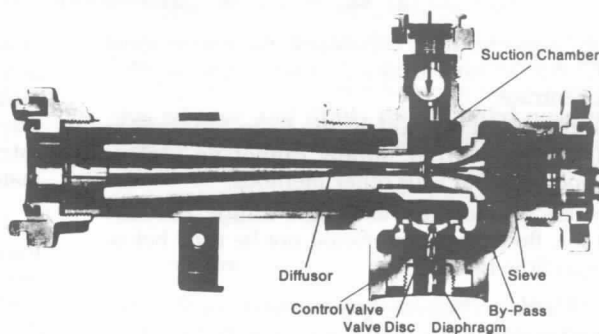

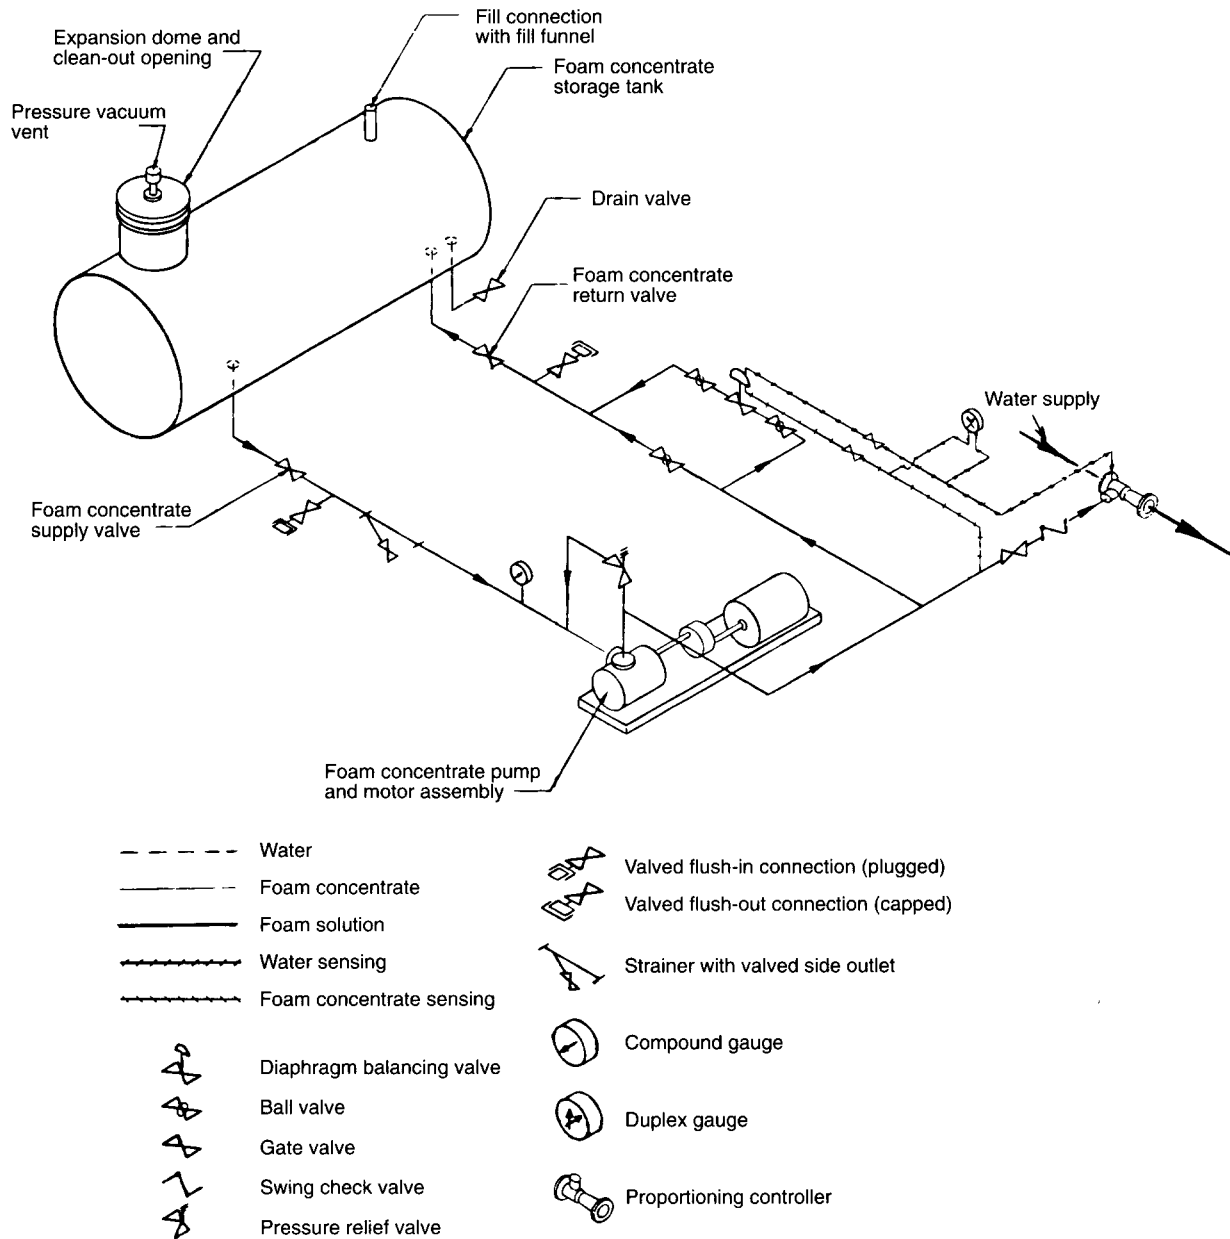


Figure A-1-4(i) Balanced pressure proportioning with single injection point (metered proportioning).

4. When the concentrate is exhausted, the system must be turned off, and the tank drained of water and refilled with foam concentrate.

5. Since water enters the tank as the foam concentrate is discharged, the concentrate supply cannot be replenished during operation, as with other methods.

6. This system proportions at a significantly reduced percentage at low flow rates and should not be used below minimum design flow rate.

Diaphragm (Bladder) Pressure Proportioning Tank. This method also uses water pressure as a source of power. This device incorporates all the advantages of the pressure proportioning tank with the added advantage of a collapsible diaphragm that physically separates the foam concentrate from the water supply. Diaphragm pressure proportioning

tanks operate through a similar range of water flows and according to the same principles as pressure proportioning tanks. The added design feature is a reinforced elastomeric diaphragm (bladder) that can be used with all concentrates listed for use with that particular diaphragm (bladder) material. [See Figure A-1-4(l).]

The proportioner is a modified Venturi device with a foam concentrate feed line from the diaphragm tank connected to the low-pressure area of the Venturi. Water under pressure passes through the controller, and part of this flow is diverted into the water feed line to the diaphragm tank. This water pressurizes the tank, forcing the diaphragm filled with foam concentrate to slowly collapse. This forces the foam concentrate out through the foam concentrate feed line and into the low-pressure area of the

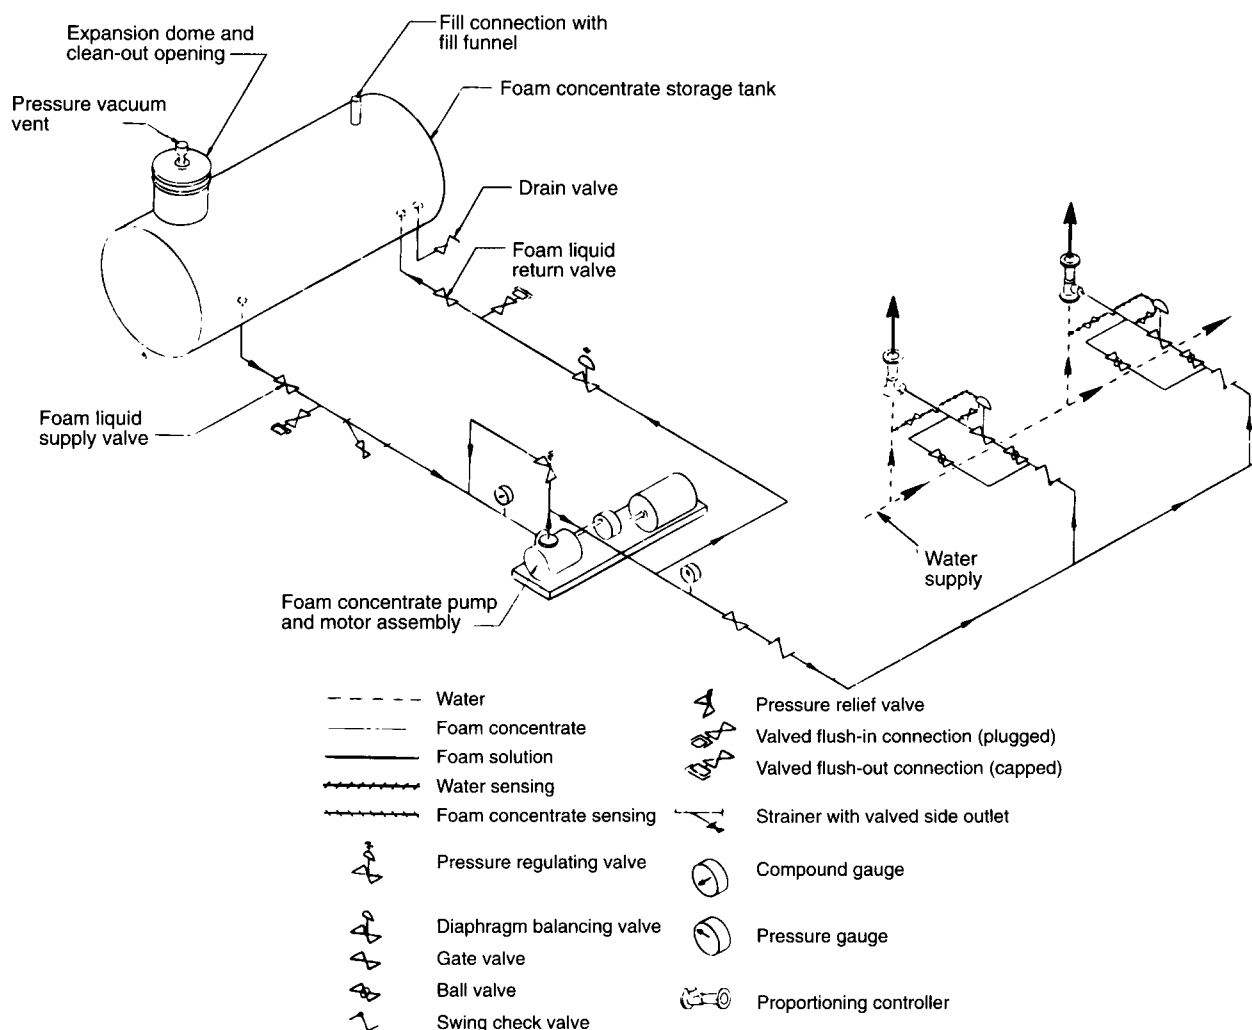


Figure A-1-4(j) Balanced pressure proportioning with multiple injection points (metered proportioning).

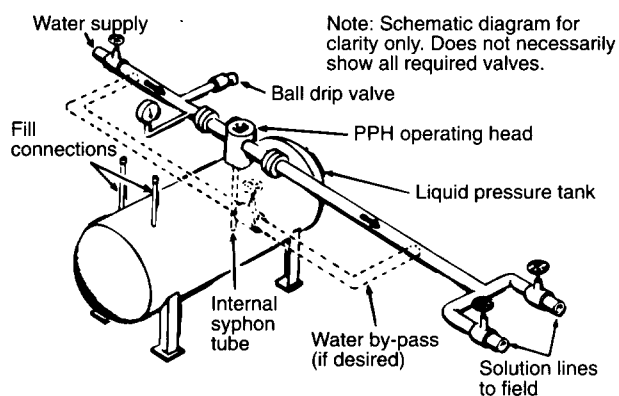


Figure A-1-4(k) Typical arrangement of pressure proportioning tank.


proportioner controller. The concentrate is metered by use of an orifice or metering valve and mixes in the proper proportion with the main water supply, sending the correct foam solution downstream to the foam makers.

Limitations. Limitations are the same as those listed above for pressure proportioning tank, under Figure A-1-4(k), except the system can be used for all types of concentrates.

Pump Proportioner (Around-the-Pump Proportioner). This device consists of an eductor installed in a bypass line between the discharge and suction of a water pump. A small portion of the discharge of the pump flows through this eductor and draws the required quantity of air foam concentrate from a container, delivering the mixture to the pump suction. Variable capacity can be secured by the use of a manually controlled multiported metering valve. [See Figure A-1-4(m).]


Limitations.

1. The pressure on the water suction line at the pump must be essentially zero gauge pressure or on the vacuum side. A small positive pressure at the pump suction can cause a reduction in the quantity of concentrate educted or cause the flow of water back through the eductor into the concentrate container.

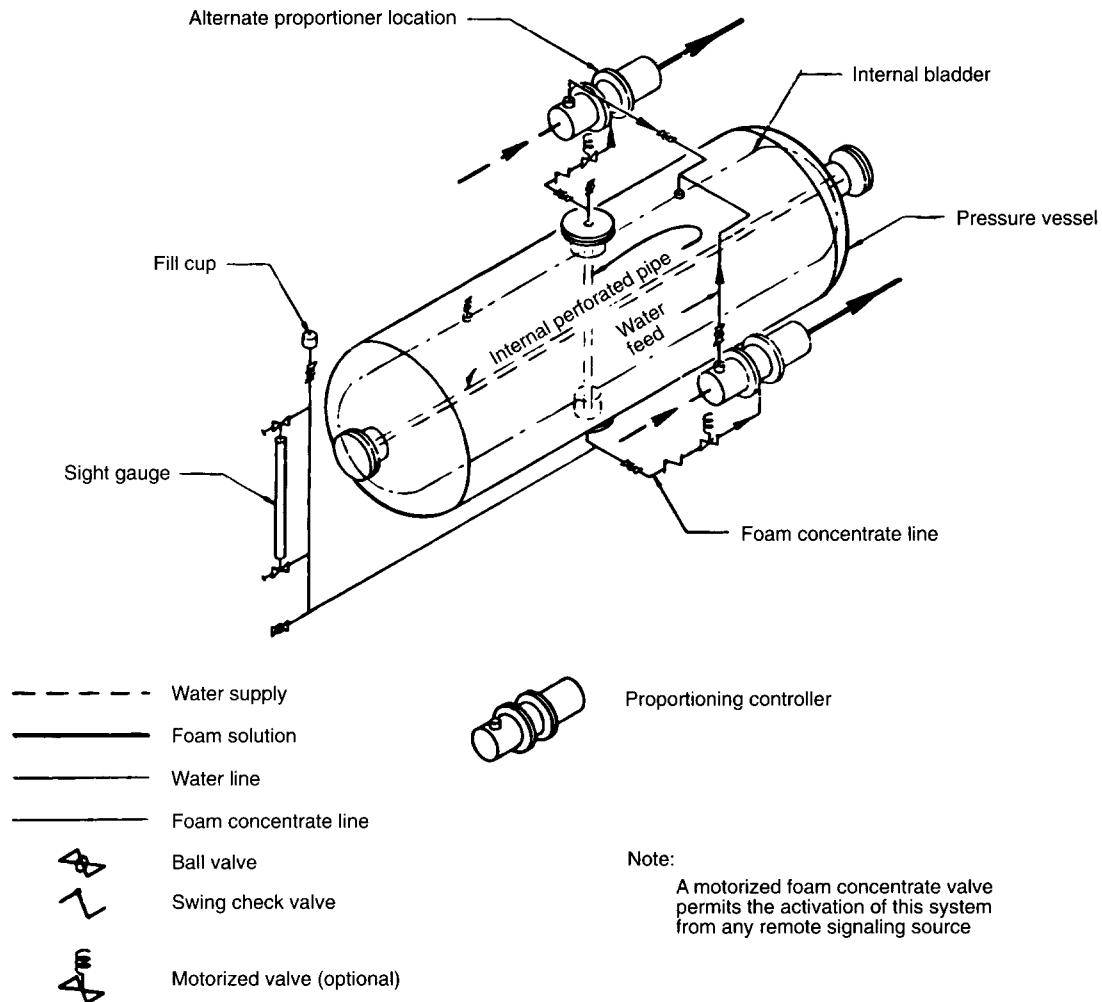


2. The elevation of the bottom of the concentrate container should not be more than 6 ft (1.8 m) below the proportioner.

3. The bypass stream to the proportioner uses from 10 gpm to 40 gpm (38 L/min to 151 L/min) of water depending on the size of the device and the pump discharge pressure. This factor must be recognized in determining the net delivery of the water pump.

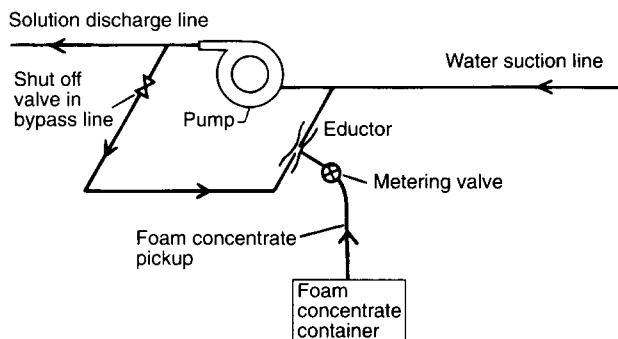

A-1-4 Type I Discharge Outlet. Approved Type I discharge outlets include:

- Porous tubes [see Figure A-1-4(n)].
- Foam troughs along the inside of tank wall [see Figure A-1-4(o)].

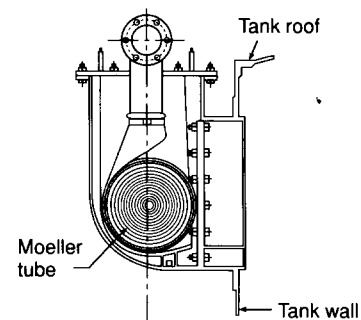

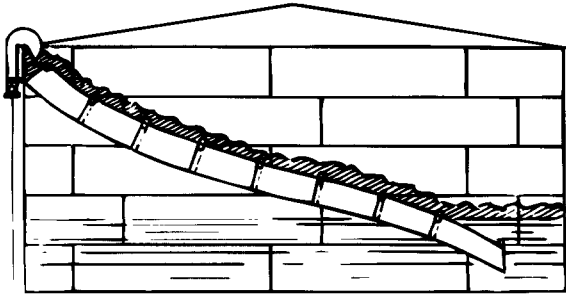


Figure A-1-4(o) Foam trough.

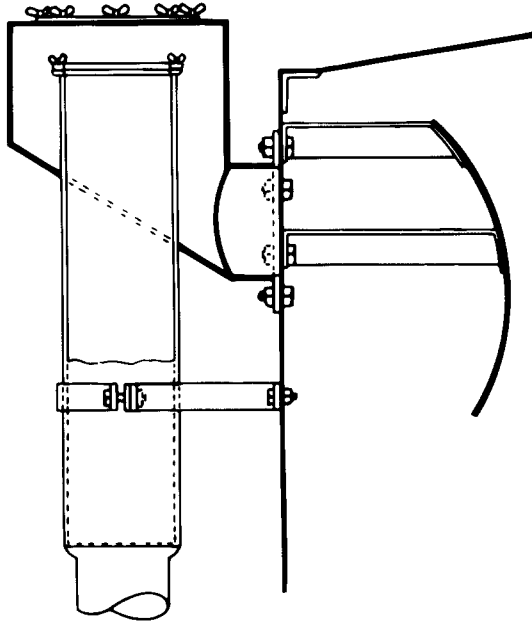


Figure A-1-4(p) Air foam chamber with Type II outlet.

These outlets are designed to extinguish fire with a minimum of foam-producing materials. It should be noted, however, that Type I devices become Type II devices if they suffer mechanical damage.

Type I discharge outlets are generally considered obsolete because nearly all currently manufactured foams are suitable for use with Type II discharge outlets.

Porous Tube. The coarsely woven tube is rolled up in the foam chamber, one end being securely fastened to the foam supply line and the free end being stitched to close the opening at this point. When foam is admitted to the tube, the diaphragm closing the mouth of the chamber is broken out by the pressure of the tube against it. The tube then unrolls, dropping into the tank. The buoyancy of the foam causes the tube to rise to the surface and foam to flow through the interstices of the fabric directly onto the liquid surface.

Foam Trough. The trough shown schematically in Figure A-1-4(o) consists of sections of steel sheet formed into a chute securely attached to the inside of the tank wall so that it forms a descending spiral from the top of the tank to within 4 ft (1.2 m) of the bottom.

A-2-2.1.2 Additional water supplies are recommended for cooling the hot tank shell to assist the foam in sealing


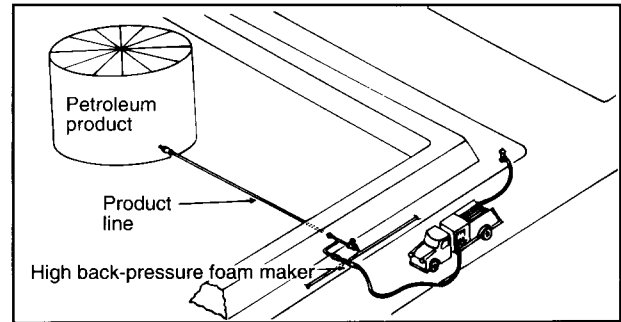


Figure A-1-4(q) Semifixed subsurface foam installation.

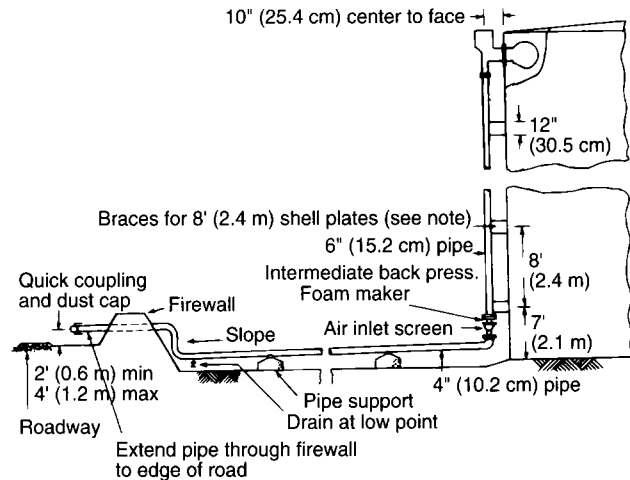

NOTE: One brace [$\frac{1}{2}$ in. (1.3 cm) plate, 12 in. (30.5 cm) long] should be provided at each shell course. This helps maintain the shell in place during the early stages of the fire and prevents buckling before cooling water is applied.

Figure A-1-4(r) Typical air foam piping for intermediate back-pressure foam system.

against the shell. Some foams are susceptible to breakdown and failure to seal as a result of heating the tank shell due to prolonged burning prior to agent discharge.

A-2-3.2.2 The level of concentrate in the storage tank should be monitored to ensure an adequate supply is available at all times.

The hazard requiring the largest foam solution flow rate does not necessarily dictate the total amount of foam concentrate required.

Example: A Class II product tank requiring a flow of 300 gpm (1136 L/min) foam solution for 30 minutes would require 270 gal (1022 L/min) of 3 percent concentrate. A Class I product tank requiring a flow of 250 gpm (946 L/min) foam solution for 55 minutes would require 412 gal (1560 L/min) of 3 percent concentration.

A-2-3.2.4.1 The storage temperature should be monitored to ensure that listed temperature limitations are not exceeded.

A-2-6 Foam concentrate pumps are generally of the positive displacement variety. Centrifugal pumps might not be suitable for use with foam concentrates exhibiting high-viscosity characteristics. The foam equipment manufacturer should be consulted for guidance. Provisions should

be made for automatic shutoff of the foam concentrate pump after the concentrate supply is exhausted.

A-2-7.3.1 Welding is preferable where it can be done without introducing fire hazards.

A-2-7.5 A hazard area generally includes all areas within dikes and within 50 ft (15 m) of tanks without dikes. Other areas that should be considered hazard areas include:

(a) Locations more than 50 ft (15 m) from tanks without dikes, if the ground slope allows exposure from accidentally released flammable and combustible liquids.

(b) Extensive manifold areas where flammable and combustible liquids might be released accidentally.

(c) Other similar areas.

The presence of flammable and combustible liquids within pipelines that do not possess the potential to release flammable and combustible liquids should not be considered as creating a hazard area.

Ball valves may be used for foam concentrate proportioning systems.

A-3-1 There have been cases reported where the application of foam through solid streams that were plunged into the flammable liquid have been believed to be the source of ignition of the ensuing fire. The ignitions have been attributed to static discharges resulting from splashing and turbulence. Therefore, any application of foam to an unignited flammable liquid should be as gentle as possible. Proper application methods with portable equipment may include a spray pattern or banking the foam stream off a backboard so that the foam flows gently onto the liquid surface. Also, properly designed fixed foam chambers on tanks could be expected to deliver the foam fairly gently and not cause a problem.

Covered (internal) floating roof tanks can experience two distinct types of fires: a full surface area fire (as a result of the floating roof sinking) or a seal fire. There have been few fires in double-deck or pontoon-type floating roof tanks where fixed roofs and venting are designed in accordance with NFPA 30, *Flammable and Combustible Liquids Code*. Prior to selecting the method of protection, the type of fire that will serve as the basis for design should be defined.

A-3-2 These systems are used for the protection of outdoor process and storage tanks. They include the protection of such hazards in manufacturing plants as well as in large tank farms, oil refineries, and chemical plants. These systems usually are designed for manual operation but, in whole or in part, may be automatic in operation. Foam systems are the preferred protection for large outdoor tanks of flammable liquids.

A-3-2.1.3 Where the entire liquid surface has been involved, fires in tanks up to 150 ft (39 m) in diameter have been extinguished with large-capacity foam monitors. Depending on the fixed-roof tank outage and fire intensity, the updraft due to chimney effect may prevent sufficient foam from reaching the burning liquid surface to form a blanket. Foam should be applied continuously and evenly. Preferably, it should be directed against the inner tank shell so that it flows gently onto the burning liquid surface without undue submergence. This can be difficult to accomplish, as adverse winds, depending on velocity and direction, reduce the effectiveness of the foam stream.

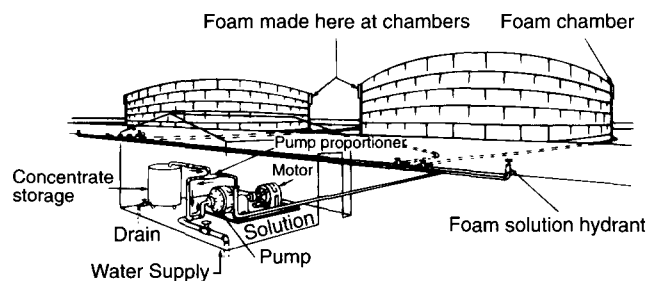


Figure A-3-2 Schematic arrangement of air foam protection for storage tanks.

Fires in fixed-roof tanks with ruptured roofs that have only limited access for foam application are not easily extinguished by monitor application from ground level. Fixed foam monitors may be installed for protection of drum storage areas or diked areas.

A-3-2.2.3 Where protection is desired for hydrocarbons having a flash point above 200°F (93.3°C), a minimum discharge time of 35 minutes should be used.

A-3-2.2.4 When using some older types of alcohol-resistant foam concentrate, consideration should be given to solution transit time. Solution transit time (the elapsed time between injection of the foam concentrate into the water and the induction of air) may be limited, depending on the characteristics of the foam concentrate, the water temperature, and the nature of the hazard protected. The maximum solution transit time of each specific installation should be within the limits established by the manufacturer.

A-3-2.3.2.1 It is recommended that, for tanks greater than 200 ft (60 m) in diameter, at least one additional discharge outlet should be added for each additional 5000 ft² (465 m²) of liquid surface or fractional part thereof. Since there has been limited experience with foam application to fires in fixed-roof tanks greater than 140 ft (42 m) in diameter, requirements for foam protection on such tanks are based on the extrapolation of data from successful extinguishments in smaller tanks. Tests have shown that foam may travel effectively across at least 100 ft (30 m) of burning liquid surface. On fixed-roof tanks of over 200 ft (60 m) diameter, subsurface injection may be used to reduce foam travel distances for tanks containing hydrocarbons only.

Unless subsurface foam injection is utilized, a properly sized flanged connection should be installed on all atmospheric pressure storage tanks, regardless of present intended service, to facilitate the future installation of an approved discharge outlet if a change in service should require such installation. Figures A-3-2.3.2.1(a) and (b) are typical fixed foam discharge outlets or foam chambers.

A-3-2.3.2.2 Where protection is desired for hydrocarbons having a flash point above 200°F (93.3°C), a minimum time of 15 minutes for Type I outlets and 25 minutes for Type II outlets should be used.

A-3-2.3.3 The system should be designed based on fighting a fire in one tank at a time. The rate of application for which the system is designed should be the rate computed for the protected tank considering both the liquid surface area and the type of flammable liquid stored.

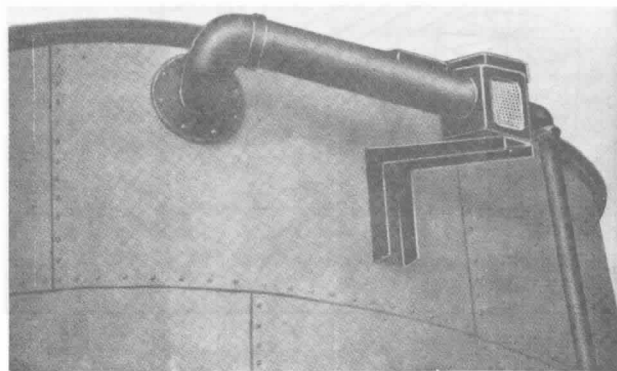


Figure A-3-2.3.2.1(a) Air foam maker in horizontal position at top of storage tank.



Figure A-3-2.3.2.1(b) Foam chamber and foam maker.

Example: The property contains a 40-ft (12.2-m) diameter tank storing ethyl alcohol and 35-ft (10.7-m) diameter tanks storing isopropyl ether.

Liquid surface area:

40-ft (12.2-m) diameter tank = 1257 ft² (116.8 m²)

Assuming the solution rate for ethyl alcohol:

0.1 gpm/ft² [(4.1 L/min)/m²]

or 1257 × 0.1 = 126 gpm (477 L/min)

Liquid surface area:

35-ft (10.7-m) diameter tank = 962 ft² (89.4 m²)

Assuming the solution rate for isopropyl ether:

0.15 gpm/ft² [(6.1 L/min)/m²]

or 962 × 0.15 = 144 gpm

For SI units: Solution Rate = (89.4) (6.1) = 545 L/min

In this example, the smaller tanks storing the more volatile product require the higher foam-generating capacity. In applying this requirement, due consideration should be given to the future possibility of change to a more hazardous service requiring greater rates of application.

Unfinished solvents or those of technical grade may contain quantities of impurities or diluents. The proper rate of application for these, as well as for mixed solvents, should be selected with due regard to the foam-breaking properties of the mixture.

A-3-2.4.1 Experience with fuel storage tank fire fighting has shown that the main problems are operational, i.e., difficulty in delivering the foam relatively gently to the fuel surface at an application rate sufficient to effect extinguishment. A properly engineered and installed subsurface foam system offers the potential advantages of less chance for foam-generation equipment disruption as a result of an initial tank explosion or the presence of fire surrounding the tank, and the ability to conduct operations a safe distance from the tank. Thus, the opportunity for establishing and maintaining an adequate foam application rate is enhanced. The following guidelines regarding fire attack are recommended.

After necessary suction connections are made to the water supply and foam-maker connections are made to foam lines, foam pumping operations should be initiated simultaneously with opening of block valves permitting the start of foam flow to the tank. Solution pressure should be brought up to and maintained at design pressure.

When foam first reaches the burning liquid surface, there may be a momentary increase in intensity caused by the mechanical action of steam formation when the first foam contacts the heat of the fire.

Initial flame reduction and reduction of heat is then usually quite rapid, and gradual reduction in flame height and intensity will occur as the foam closes in against the tank shell and over the turbulent areas over foam injection points. If sufficient water supplies are available, cooling of the tank shell at and above the liquid level will enhance extinguishment and should be used. Care should be taken that water streams are not directed into the tank where they could disrupt the established foam blanket.

After the fire has been substantially extinguished by the foam, some fire may remain over the point of injection. With flash points below 100°F (37.8°C) (Class IB and Class IC liquids), the fire over the turbulent area will continue until it is adequately covered by foam. With gasoline or equivalent liquids, when fire remains only over the area of injection, intermittent injection should be used so that foam will retrogress over the area during the time foam injection is stopped. Depending on local circumstances, it may be possible to extinguish any residual flickers over the turbulent area with portable equipment rather than continue the relatively high rate of application to the whole tank.

If the tank contains a burning liquid capable of forming a heat wave, a slop-over may occur from either topside or subsurface injection of foam, especially if the tank has been burning for 10 minutes or longer. Slop-over can be con-

trolled by intermittent foam injection or reduction in foam-maker inlet pressure until slop-over ceases. Once slop-over has subsided, and in the case of liquids that do not form a heat wave, the pump rate should be continuous.

Figures A-3-2.4.1(a) and (b) illustrate typical arrangements of semifixed subsurface systems.

A-3-2.4.2 Figures A-3-2.4.2(a) through (d) should be used to determine foam velocity.

Figure A-3-2.4.2(e) illustrates optional arrangements for multiple subsurface discharge outlets.

A-3-2.4.2.1 Figure A-3-2.4.2.1 illustrates a typical foam inlet tank connection.

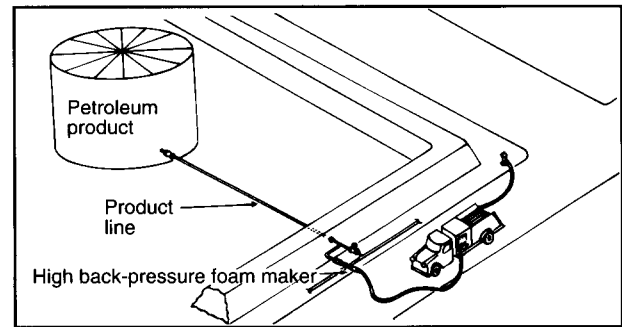


Figure A-3-2.4.1(a) Semifixed subsurface foam installation.

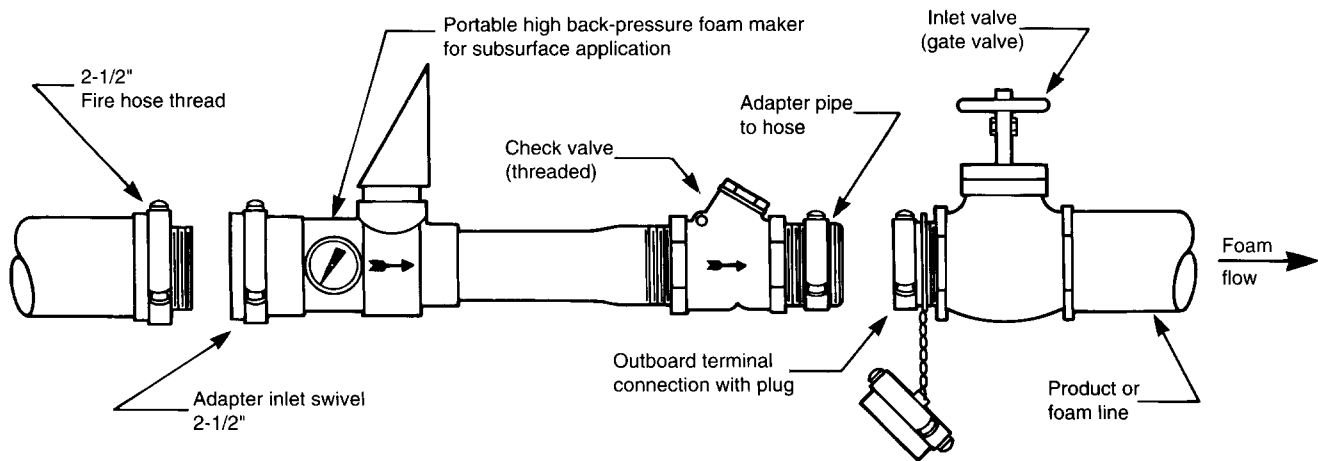


Figure A-3-2.4.1(b) Typical connection for portable high back-pressure foam maker for subsurface application in semifixed system.

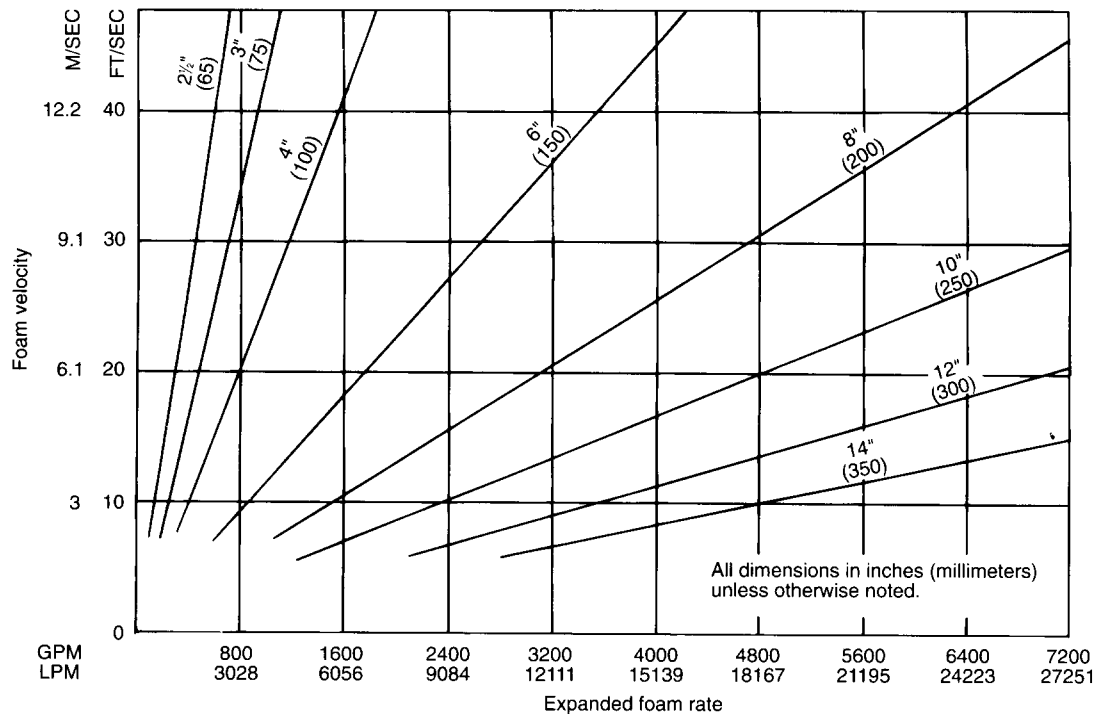


Figure A-3-2.4.2(a) Foam velocity vs. pipe size (2 1/2, 3, 4, 6, 8, 10, 12, and 14) — standard schedule 40 pipe.

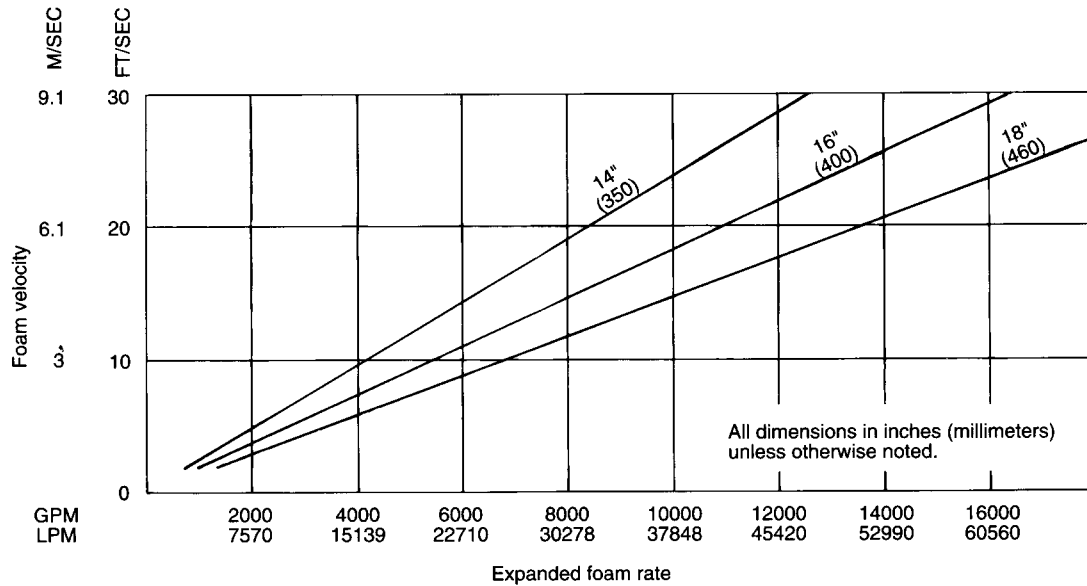


Figure A-3-2.4.2(b) Foam velocity vs. pipe size (14", 16", and 18") — standard schedule 40 pipe.

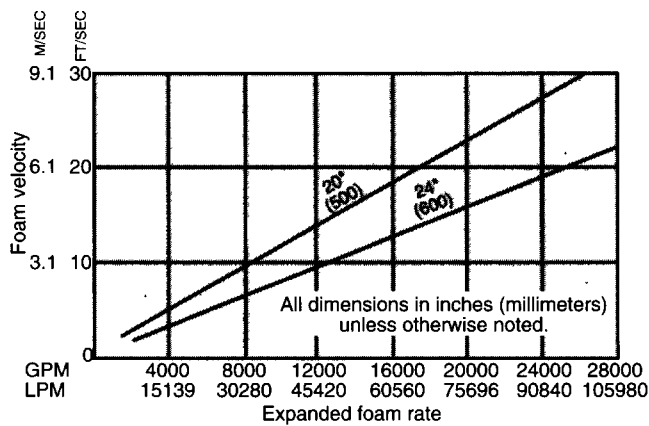


Figure A-3-2.4.2(c) Foam velocity vs. pipe size (20" and 24") — standard schedule 40 pipe.

NOTE: Expanded foam velocity also may be calculated by using the following formulae.

English Velocity (ft/sec) = $\frac{\text{Expanded foam (GPM)}}{KA}$	Metric Velocity (m/sec) = $\frac{\text{LPM foam} \times 21.22}{d^2}$
A = Area of ID of the injection pipe in sq. ft.	Where d = Pipe ID in mm
K = Constant 449	
GPM = Gallons per minute	
OR	
$V = \frac{\text{GPM foam} \times 0.4085}{d^2}$	
Where d = Pipe ID in inches	

Figure A-3-2.4.2(d) Expanded foam velocity calculation.

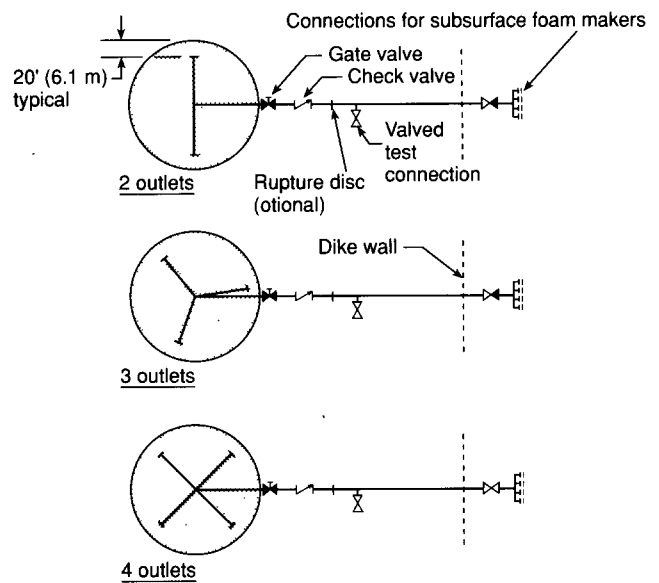


Figure A-3-2.4.2(e) Typical arrangement of semifixed subsurface system.

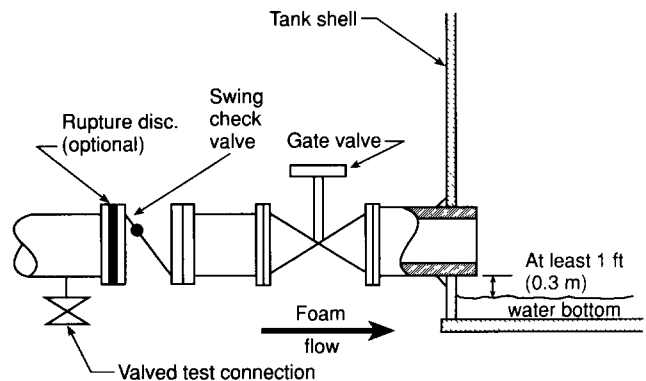


Figure A-3-2.4.2.1 Typical tank foam-maker discharge connection for subsurface injection.

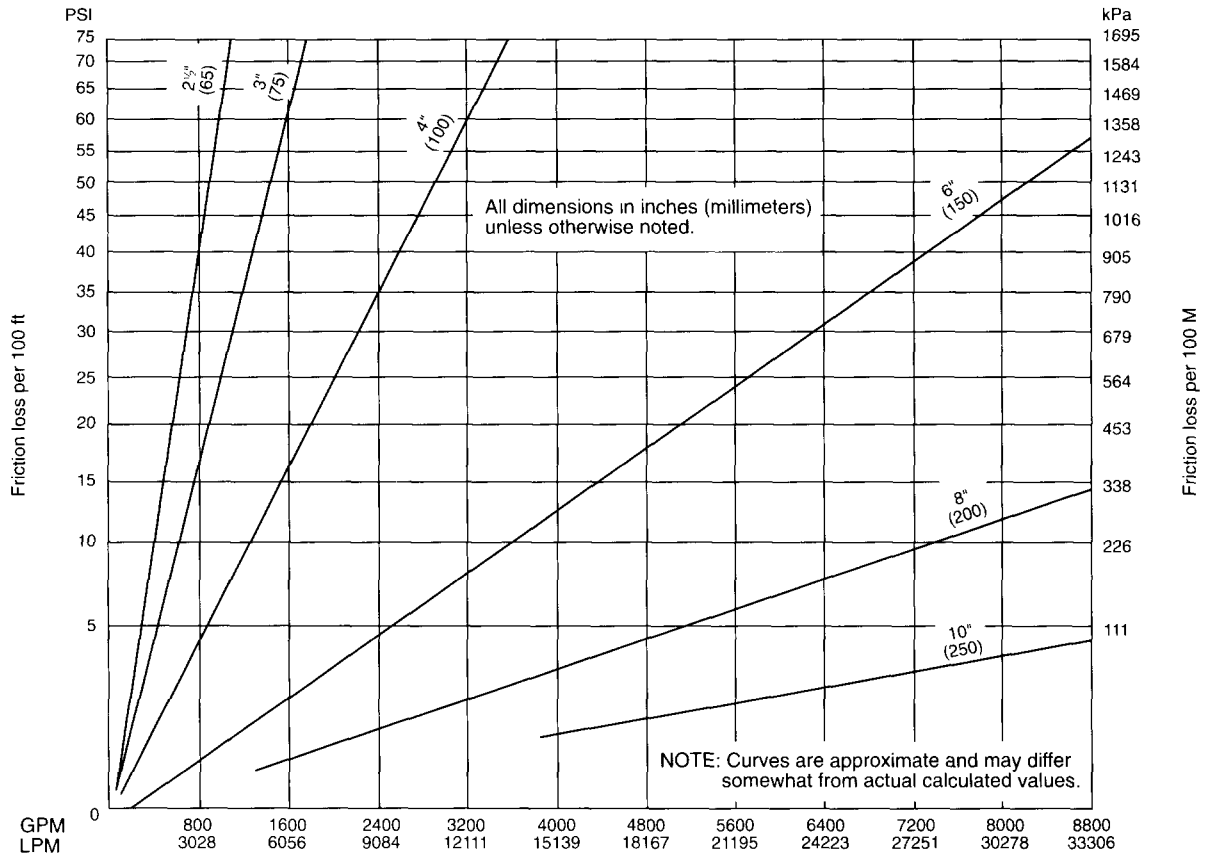


Figure A-3-2.4.2.2(a) Foam friction losses — 4 expansion (2½", 3", 4", 6", 8", and 10") — standard schedule 40 pipe.

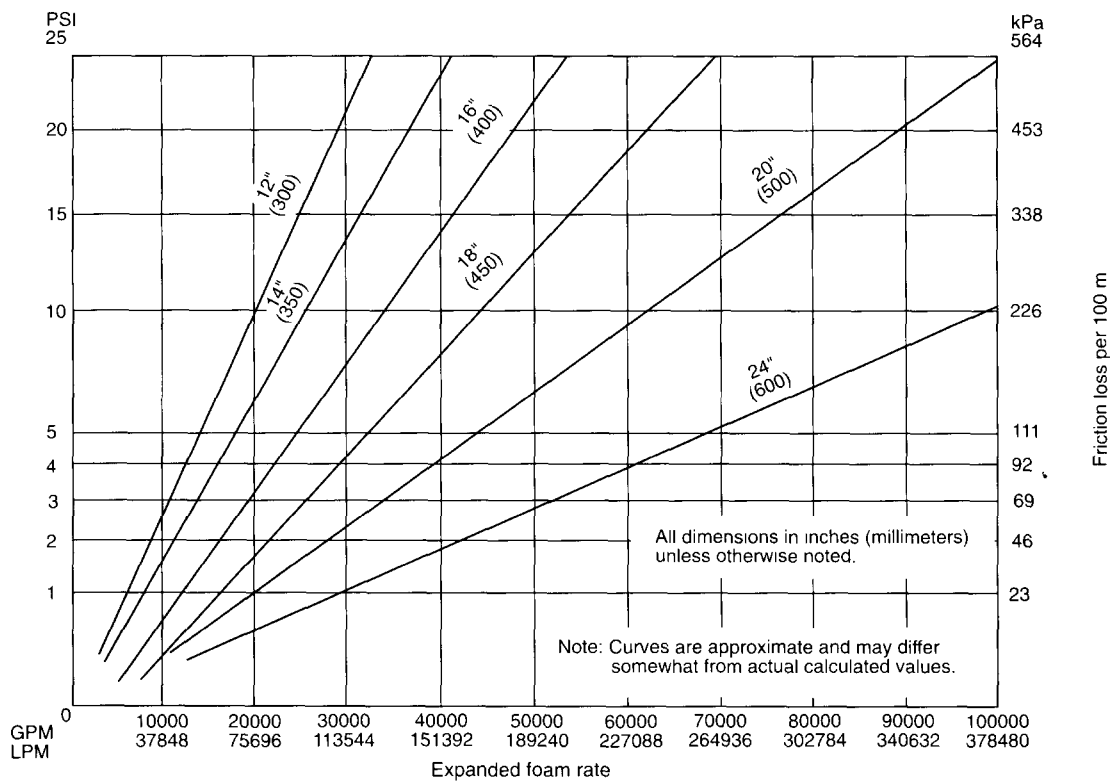


Figure A-3-2.4.2.2(b) Foam friction losses — 4 expansion (12", 14", 16", 18", 20", and 24") — standard schedule 40 pipe.

A-3-2.4.2.2 The back-pressure consists of the static head plus pipe friction losses between the foam maker and the foam inlet to the tank. The friction loss curves [see Figures A-3-2.4.2.2(a) and (b)] are based on a maximum foam expansion of 4, which is the value to be used for friction loss and inlet velocity calculations.

A-3-2.4.3.1 Optimum fluoroprotein foam, AFFF, and FFFP characteristics for subsurface injection purposes should have expansion ratios between 2 and 4. [See Figures A-3-2.4.3.1(a) and (b).]

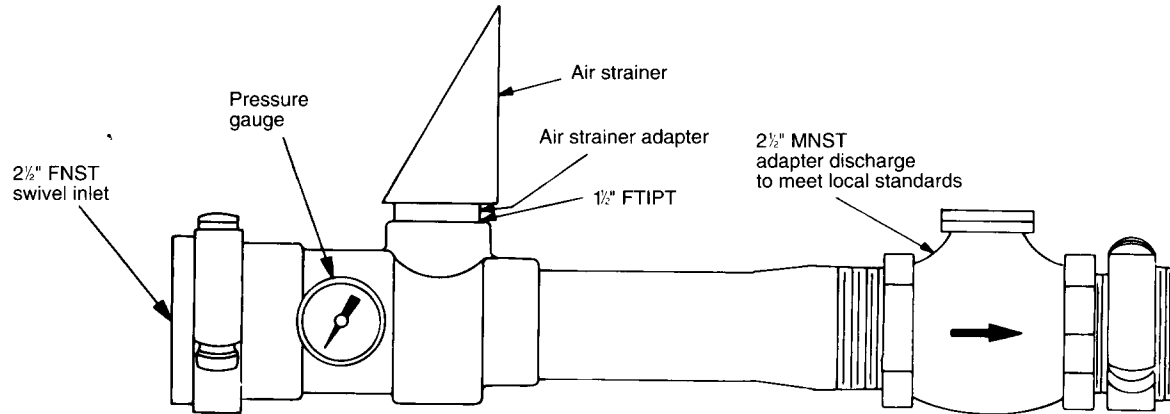


Figure A-3-2.4.3.1(a) Portable high back-pressure foam maker for semifixed systems.

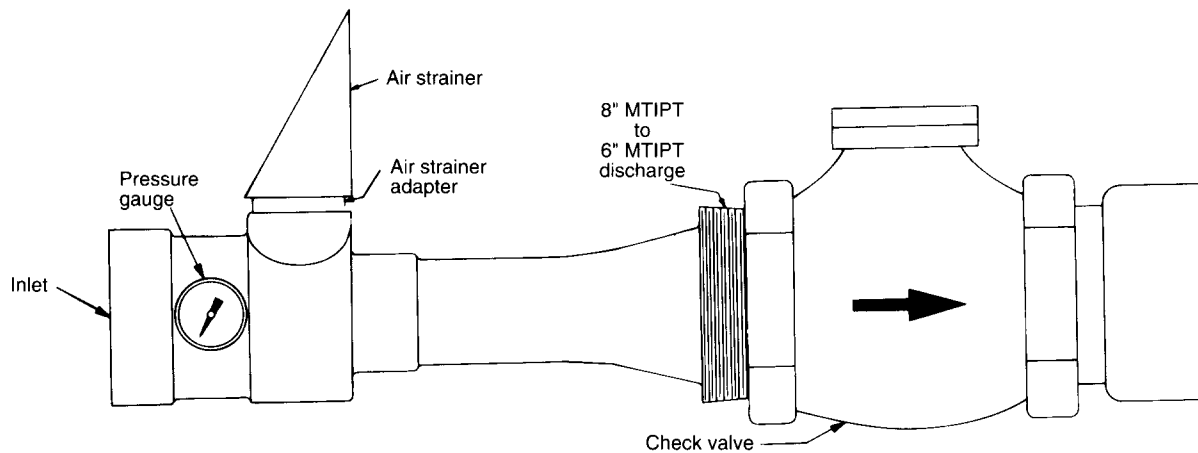


Figure A-3-2.4.3.1(b) Fixed high back-pressure foam maker for fixed systems.

A-3-2.5 Semisubsurface Systems. This section describes the design criteria that are applicable to systems used to apply foam to the surface of fixed-roof (cone) storage tanks via a flexible hose rising from the base of the tank. Manufacturer recommendations should be followed for the design and installation of such systems.

These systems are not considered appropriate for floating roof tanks with or without a fixed roof because the floating roof prevents foam distribution. The flexible foam delivery hose is contained initially in a sealed housing and is connected to an external foam generator capable of working against the maximum product head. When operated, the hose is released from its housing, and the hose floats to the surface as a result of the buoyancy of the foam. Foam then discharges through the open end of the hose directly onto the liquid surface.

Consideration should be given to the following factors when selecting this type of system.

(a) The total foam output should reach the surface of the burning liquid.

(b) With large tanks, the semisubsurface units can be arranged to produce an even distribution over the fuel surface.

(c) Any type of concentrate suitable for gentle surface application to the particular fuel may be used.

(d) Foam-generating equipment and operating personnel may be located at a distance from the fire.

(e) The system may be used for the protection of foam destructive liquids, provided the flexible hose is not affected by them.

(f) Certain high-viscosity fuels may not be suitable for protection by this type of system.

(g) There is no circulation of the cold fuel and, therefore, no assistance in extinguishment.

(h) The system may be difficult to check, test, and maintain.

(i) The high back-pressure foam generator has to produce foam at a pressure sufficient to overcome the head pressure of fuel as well as all friction losses in the foam pipework. Friction losses with foam differ from those with foam solution.

Design application rates and discharge times for hydrocarbons are typically the same as for Type II topside application systems, i.e., 0.1 gpm/ft² (4.1 Lpm/m²). Manufacturers should be consulted for appropriate application rates and design recommendations to be followed for protection of products requiring the use of alcohol-resistant foams.

Duration of discharge should be in accordance with Table A-3-2.5(a).

Semisubsurface foam units should be spaced equally, and the number of units should be in accordance with Table A-3-2.5(b).

Each semisubsurface unit should be secured by pipe supports suitable for the intended application and for mounting through the tank wall. To prevent leakage of the product, it is recommended that a check valve be fitted at the foam entry point adjacent to the tank wall for each unit.

A-3-3.1 Most fires in open-top floating roof tanks occur in the seal areas, and these fires can be extinguished with the foam systems described in Chapter 3. However, some fires involve the full surface area when the roof sinks. These

Table A-3-2.5(a) Duration of Discharge for Semisubsurface Systems

Product Stored Foam	Type Minimum	Discharge Time (min)
Hydrocarbons with flash point below 100°F (37.8°C)	Protein, AFFF, fluoroprotein, FFFP, and alcohol-resistant AFFF or FFFP	55
Flash point at or above 100°F (37.8°C)	All foams	30
Liquids requiring alcohol-resistant foams	Alcohol-resistant foams	55

Table A-3-2.5(b) Minimum Number of Subsurface Units

Tank Diameter Feet	Tank Diameter Meters	Minimum Number of Semisubsurface Units
Up to 80	Up to 24	1
Over 80 to 120	Over 24 to 36	2
Over 120 to 140	Over 36 to 42	3
Over 140 to 160	Over 42 to 48	4
Over 160 to 180	Over 48 to 54	5
Over 180 to 200	Over 54 to 60	6
Over 200	Over 60	6
		plus 1 outlet for each additional 5000 ft ² (465 m ²)

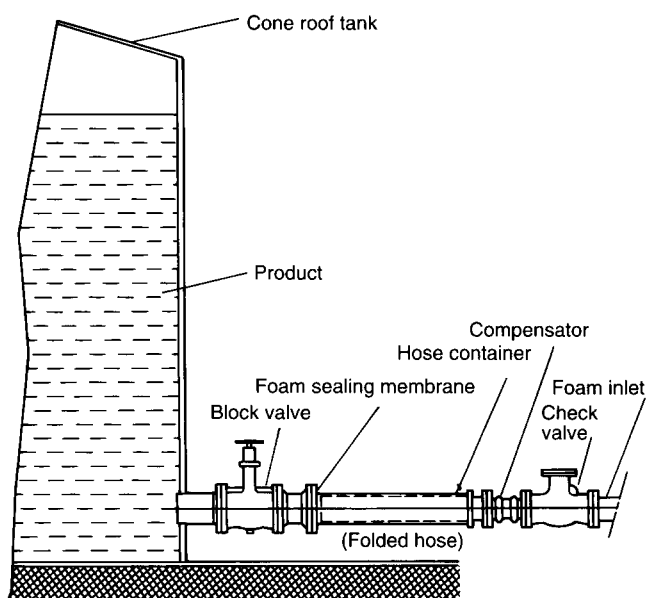


Figure A-3-2.5 Semisubsurface system arrangement.

fires are very infrequent and normally do not justify a fixed system to protect for this risk. Plans should be made to fight a full surface fire in a floating roof tank with portable or mobile equipment. Large capacity foam monitor nozzles

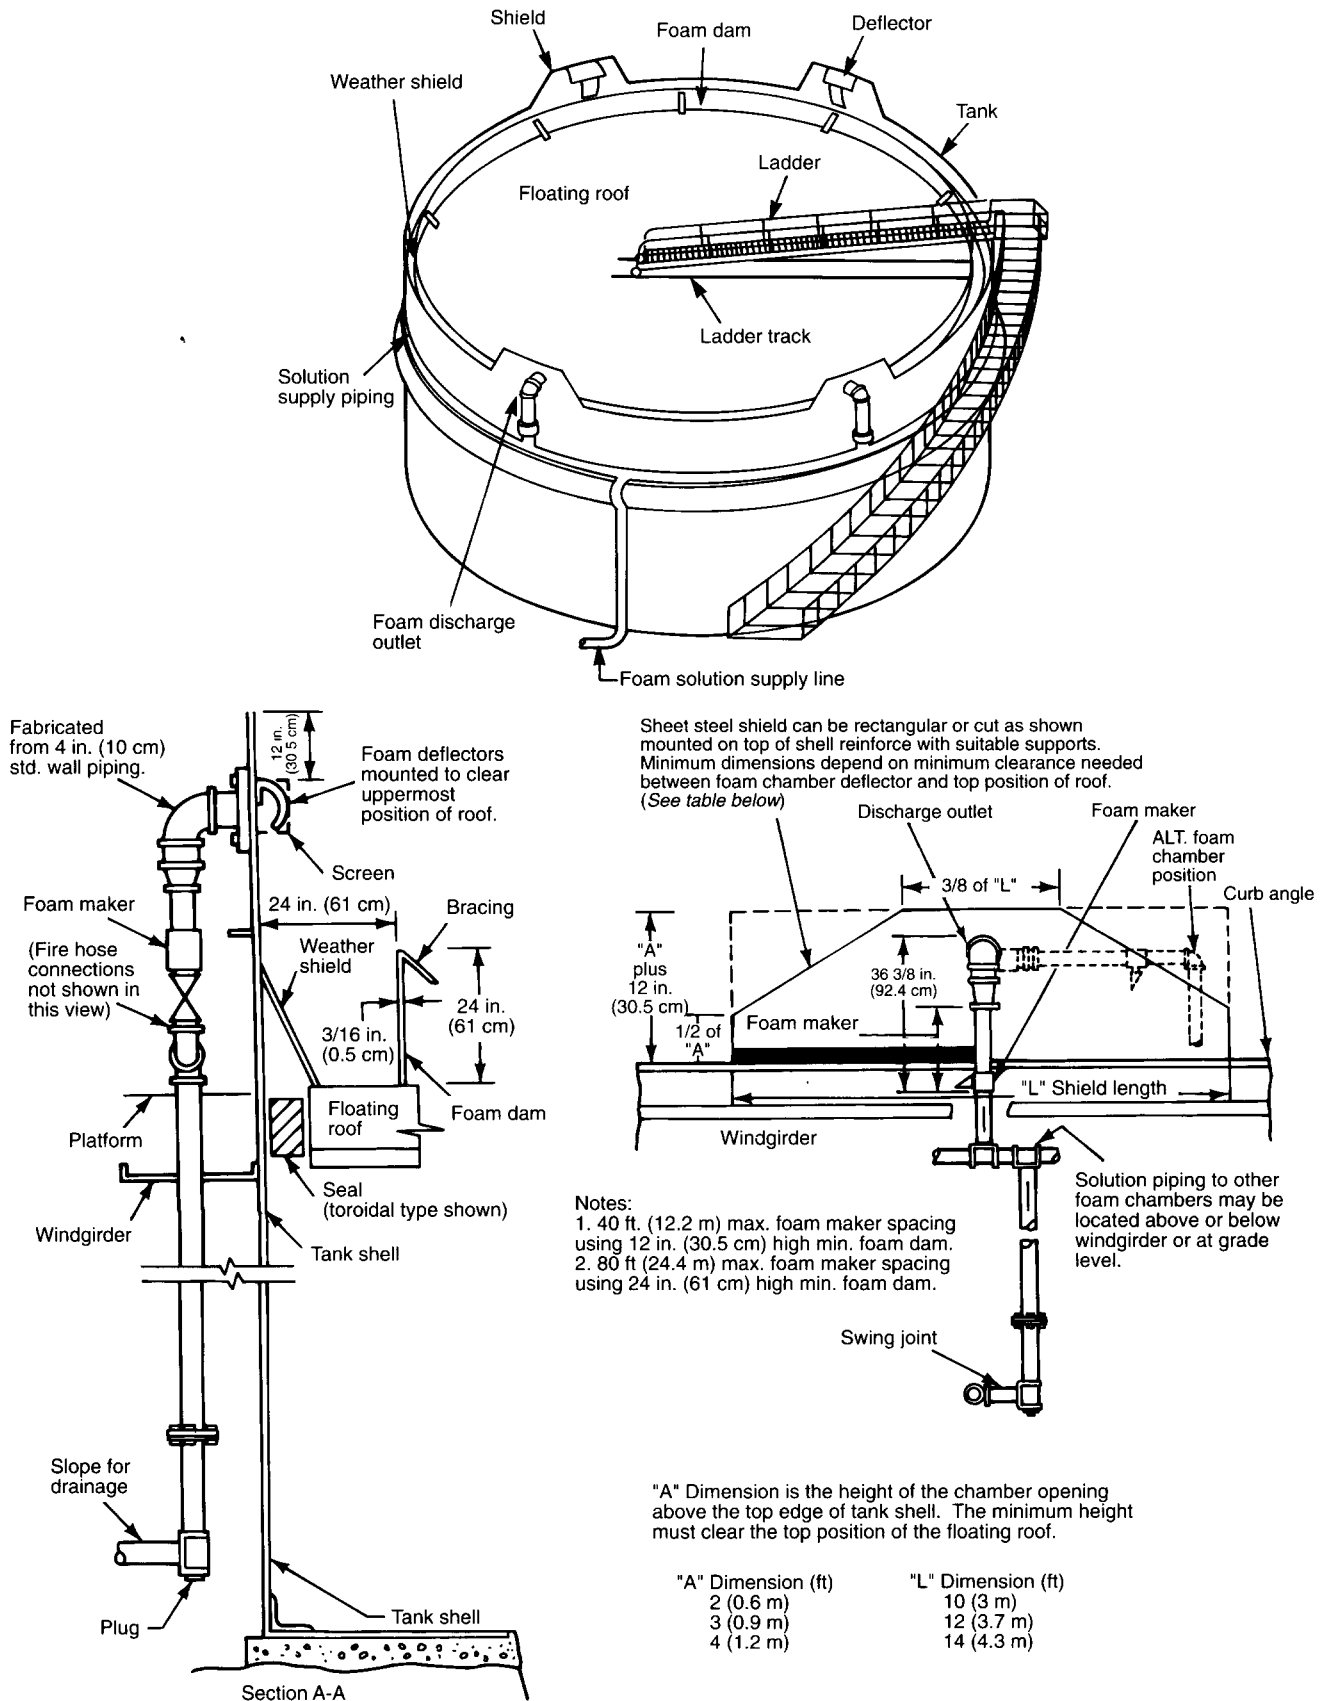


Figure A-3-3.3.1.1(a) Typical foam splash board for discharge devices mounted above the top of the shell.

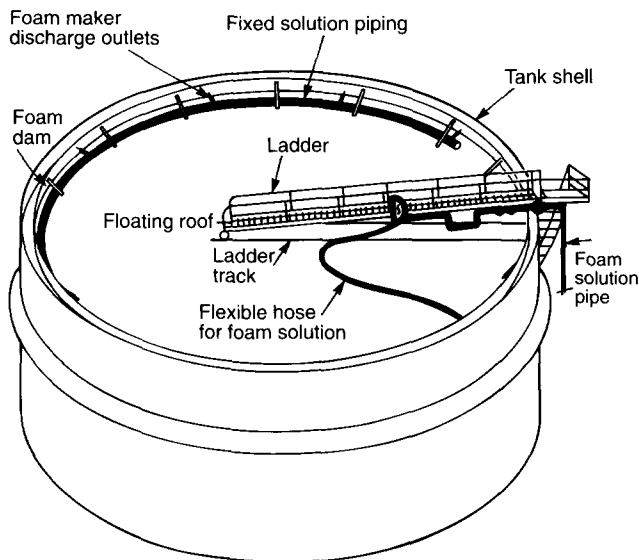


Figure A-3.3.3.1.1(b) Fixed foam discharge outlets mounted on the periphery of the floating roof.

with capacities up to 6000 gpm (22 712 L/min) are currently available. If foam proportioning devices are not provided with the foam monitors, additional foam proportioning trucks may be required through mutual aid. Generally, the number of foam proportioning trucks available at any location is not sufficient to fight a sunken floating roof fire, and outside assistance is required.

Generally, the fire water systems available in floating roof tank areas are not designed to fight a full surface fire, so additional water is required. Therefore, relay pumping with municipal or mutual aid water pumpers may be required to obtain enough water for foam generation.

Another aspect to consider is the amount of foam concentrate available. The foam application rate of 0.16 gpm/ft² [(6.5 L/min)/m²] of surface area listed in Chapter 3 may have to be increased for very large tanks. Therefore, the amount of foam concentrate available through mutual aid should be established prior to the fire. In some cases, it may be necessary to increase the on-site foam storage if mutual aid supplies are limited.

If it is decided to fight a fire in a tank with a sunken roof instead of protecting the adjacent facilities and allowing a controlled burnout, the most important aspect is to plan ahead and hold simulated drills. Coordinating the efforts of many different organizations and various pumping operations required for fighting potentially catastrophic fires requires well-developed plans and plenty of practice.

A-3-3.3.1.1 Since all the discharge outlets are supplied from a common (ring) foam solution main, some vapor seal devices may not rupture due to pressure variations encountered as the system is activated. [See Figures A-3-3.3.1.1(a) and (b).]

A-3-3.4 Use of foam handlines for the extinguishment of seal fires should be limited to open-top floating roof tanks of less than 250 ft (76.2 m) in diameter. The following design information applies to foam handline protection methods.

(a) A foam dam should be installed in accordance with 3-3.3.3.

(b) To establish a safe base for operation at the top of the tank, a single fixed foam discharge outlet should be installed at the top of the stairs. This fixed foam discharge outlet is meant to provide coverage of the seal area for approximately 40 ft (12.2 m) on both sides of the top of the stairs.

(c) The fixed foam discharge outlet should be designed to discharge at least 50 gpm (379 L/min).

(d) To permit use of foam handlines from the windgirder, two 1.5-in. (40-mm) diameter valved hose connections should be provided at the top of the stairs in accordance with Figure A-3-3.4.

The windgirder should be provided with a railing for the safety of the fire fighters. (See Figure A-3-3.4.)

A-3-4.1.2.2 The hazard requiring the highest foam solution flow rate does not necessarily dictate the total amount of foam concentrate required.

A-3-6 To minimize life and property loss, automation of foam systems protecting a truck loading rack should be taken into account. NFPA 16, *Standard on the Installation of Deluge Foam-Water Sprinkler and Foam-Water Spray Systems*, states that, "Automatic operation shall be provided and supplemented by auxiliary manual tripping means.

Exception: Manual operation only may be provided when acceptable to the authority having jurisdiction."

There are two methods of automating foam monitor systems for this application, as follows:

(a) Completely automatic detection and actuation (see applicable sections of NFPA 72, *National Fire Alarm Code*, for design criteria).

(b) Actuation by push-button stations or other means of manual release.

A-3-6.3.1 The proper choice of each monitor location is a very important factor in designing a foam monitor system. Traffic patterns, possible obstructions, wind conditions, and effective foam nozzle range affect the design. The appropriate monitors and nozzles should be located so that foam is applied to the entire protected area at the required application rate.

Consult the manufacturer of the monitor nozzle for specific performance criteria related to stream range and foam pattern, discharge capacity, and pressure requirements. Manufacturers also should be consulted to confirm applicable listings and/or approvals.

A-3-7 Generally, portable monitors, or foam hose streams, or both, have been adequate in fighting spill fires in diked areas. In order to obtain maximum flexibility due to the uncertainty of location and the extent of a possible spill in process areas and tank farms, portable or trailer-mounted monitors are more practical than fixed foam systems in covering the area involved. The procedure for fighting diked area spill fires is to extinguish and secure one area and then move on to extinguish the next section within the dike. This technique must be continued until the complete dike area has been extinguished.

A-3-9 Auxiliary foam hose streams may be supplied directly from the main system protecting the tanks (e.g., centralized fixed pipe system) or may be provided by additional equipment. The supplementary hose stream requirements provided herein are not intended to protect



Permanently installed foam hydrants, where used, should be located in the vicinity of the hazard protected and in safe and accessible locations. The location should be such that excessive lengths of hose are not required. Limitations on the length of hose that may be used depend on the pressure requirements of the foam nozzle.

A-5-1 Provisions should be made for automatic shutoff of the foam concentrate pump after the concentrate supply is exhausted.

A-5-3.4 Limited services controllers generally do not have a service disconnect means. In order to perform routine inspection and maintenance safely, it may be desirable to provide an external service disconnect. Special care must be taken to ensure the disconnect is not left in a position rendering the foam concentrate pump inoperable.

A-5-4.1.3(b) This riser can be welded to the tank by means of steel brace plates positioned perpendicular to the tank and centered on the riser pipe. [See Figure A-1-4(p).]

A-6-3 Acceptance Tests.

(a) A foam system will extinguish a flammable liquid fire if operated within the proper ranges of solution pressure and concentration and at sufficient discharge density per sq ft (sq m) of protected surface. The acceptance test of a foam system should ascertain:

1. All foam-producing devices are operating at system design pressure and at system design foam solution concentration.
2. Laboratory-type tests have been conducted, where necessary, to determine that water quality and foam liquid are compatible.

(b) The following data are considered essential to the evaluation of foam system performance:

1. Static water pressure.
2. Stabilized flowing water pressure at both the control valve and a remote reference point in the system.
3. Rate of consumption of foam concentrate.

The concentration of foam solution should be determined. The rate of solution discharge may be computed from hydraulic calculations utilizing recorded inlet or end-of-system operating pressure or both. The foam liquid concentrate consumption rate may be calculated by timing a given displacement from the storage tank or by refractometric or conductivity means. The calculated concentration and the foam solution pressure should be within the operating limit recommended by the manufacturer.

A-6-3.3 The rate of concentrate consumption may be measured by timing a given displacement from the foam concentrate storage tank but only in systems where the storage tank is small enough and the test run time is long enough so that this can be accomplished with reasonable accuracy.

A-7-1.1 Flushing of the concentrate pump may be necessary at periodic intervals or following complete discharge of concentrate.

Appendix B Storage Tank Protection Summary

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

Appendix B Storage Tank Protection Summary

Top Side Foam Application		Fixed-Roof (Cone) Tanks and Pan-Type Floating Roof Tanks		Pontoon or Double-Deck Floating Roof Tanks (Open-Top or Covered) Annular Seal Area
	No. of Foam Outlets Required	Up to 80 ft (2.44 m) dia. 81 to 120 ft (24.7–36.6 m) dia. 121 to 140 ft (36.9–42.7 m) dia. 141 to 160 ft (43–48.8 m) dia. 161 to 180 ft (49–54.9 m) dia. 181 to 200 ft (55.2–61 m) dia. Over 210 ft (61.2 m) dia. (See Table 3-2.3.2.1)	1 Foam Chamber 2 Foam Chambers 3 Foam Chambers 4 Foam Chambers 5 Foam Chambers 6 Foam Chambers 1 additional for each 5000 sq ft	1 For each 40 ft (12.2 m) of circumference with a 12-in. (30.5-cm) high foam dam. 1 For each 80 ft (24.4 m) of circumference with a 24-in. (61-cm) high foam dam. (See 3-3.3.1 and Section 3-4.)
	Hydrocarbon Application Rates	0.10 gpm (0.38 L/min) per sq ft (sq m) of liquid surface. (See Table 3-2.3.2.2)		0.30 gpm (1.14 L/min) per sq ft (sq m) of annular ring area between tank wall and foam dam. (See A-3-2.11.1.)
	Polar Solvent Rates	See Manufacturer's Approval Report.		Not covered by NFPA 11.
	Hydrocarbon Discharge Times	Flash Pt. 100°F–140°F (37.8°C–194.4°C) Flash Pt. below 100°F (37.8°C) Crude Petroleum	Type I 20 min 30 min 30 min Type II 30 min 55 min 55 min	20 min (See Section 3.3.)
	Polar Solvents	Type I Type II	30 min 55 min	Not covered by NFPA 11.

Storage Tank Protection Summary (cont.)

		Fixed-Roof (Cone) Tanks	Pontoon or Double-Deck Floating Roof Tanks
Foam Outlets Under Floating Roof Tank Seals or Metal Secondary Seal	No. Required	Not Applicable.	Mechanical Shoe Seal. 1—For each 130 ft (39.6 m) of tank circumference (no foam dam required) Tube Seal—Over 6 in. (15.2 cm) from top of seal to top of pontoon with foam outlets under metal weather shield or secondary seal. 1—For each 60 ft (18.3 m) of tank circumference (no foam dam required) Tube Seal—Less than 6 in. (15.2 cm) from top of seal to top of pontoon with foam outlets under metal weather shield or secondary seal. 1—For each 60 ft (18.3 m) of tank circumference [foam dam at least 12 in. (30.5 cm) high required]. (See 3-3.3.3)
	Hydrocarbon Application Rates	Not Applicable.	0.30 gpm (114 L/min) per sq ft (sq m) of annular ring area with foam dam or with foam application under metal weather seal or secondary seal. 0.50 gpm (1.9 L/min) per sq ft (sq m) for all other applications.
	Discharge Times	Not Applicable.	20 min—with foam dam or under metal weather shield or secondary seal.
	Polar Solvents	Not Applicable.	Not covered by NFPA 11.
Foam Handlines and Monitors for Tank Protection	Size of Tank	Monitors for tanks up to 60 ft (18.3 m) in diameter. Hand hoselines for tanks less than 30 ft (9.2 m) in diameter and less than 20 ft (6.1 m) high. (See 3-2.2.1.)	Monitors not recommended. Handlines are suitable for extinguishment of rim fires in open-top floating roof tanks. (See 3-3.4)
	Hydrocarbon Application Rates	0.16 gpm/ft ² [(6.5 L/min)/(m ²)] (See 3-2.2.2, 3-2.2.3, 3-2.2.4.)	0.16 gpm/ft ² (6.5 L/min/m ²) For rim fires in open-top floating roof tanks. (See 3-2.2.2, 3-2.2.3, and 3-2.2.4)
	Discharge Times	Flash point below 100°F (37.8°C) 65 min Flash point 100°F–140°F 50 min Crude Oil 65 min (See 3-2.2.3)	Use same times as for open-top floating roof tank rim fires.
Subsurface Application Outlets	No. Required	Same as table for foam chambers. See above. (See 3-2.4.1, 3-2.4.2, 3-2.4.2.1.)	Not Recommended.
	Hydrocarbon Application Rates	Minimum 0.1 gpm/ft ² [(4.1 L/min)/m ²] of liquid surface Maximum 0.2 gpm/ft ² [(8.2 L/min)/m ²] Foam velocity from outlet shall not exceed 10 ft per sec (3.05 m per sec) for Class 1B liquids or 20 ft per sec (6.1 m per sec) for all other liquids. (See 3-2.4.2, 3-2.4.3.)	Not Recommended.
	Discharge Times	Flash point 100°F (37.8°C) to 140°F (194.4°C) 30 min Flash point below 100°F (37.8°C) 55 min Crude Petroleum 55 min (See 3-2.4.3.)	Not Recommended.
	Polar Solvents	Not Recommended.	Not Recommended.

For SI units: 1 gpm/ft² = 40.746 (L/min)/m²; 1 ft = 0.305 m;
1 ft² = 0.0929 m²; 1 in. = 0.0254 m; °C = °F – 32/1.8.

Appendix C Tests for the Physical Properties of Foam

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

C-1 Procedures for Measuring Expansion and Drainage Rates of Foams.

Foam Sampling. The object of foam sampling is to obtain a sample of foam typical of that to be applied to burning surfaces under anticipated fire conditions. Inasmuch as foam properties are readily susceptible to modification through the use of improper techniques, it is extremely important that the prescribed procedures be followed.

A collector is designed chiefly to facilitate the rapid collection of foam from low-density patterns; in the interest of standardization, it is used also for all sampling, except where pressure-produced foam samples are being drawn from a line tap. A backboard is inclined at a 45 degree angle suitable for use with vertical streams falling from overhead applicators as well as horizontally directed streams. [See Figures C-1(a) and (b).]

The standard container is 7.9 in. (20 cm) deep and 3.9 in. (10 cm) inside diameter (1600 ml) and preferably made of $\frac{1}{16}$ -in. (1.6-mm) thick aluminum or brass. The bottom is sloped to the center where a $\frac{1}{4}$ -in. (6.4-mm) drain fitted with a $\frac{1}{4}$ -in. (6.4-mm) valve is provided to draw off the foam solution. [See Figure C-1(b).]

Turrets or Handline Nozzles. (It is presumed that the turret or nozzle is capable of movement during operation to facilitate collection of the sample.) It is important that the foam samples taken for analysis represent as nearly as possible the foam reaching the burning surface in a normal fire-fighting procedure. With adjustable stream devices, samples should be taken from both the straight stream position, and the fully dispersed position, and possibly from other intermediate positions.

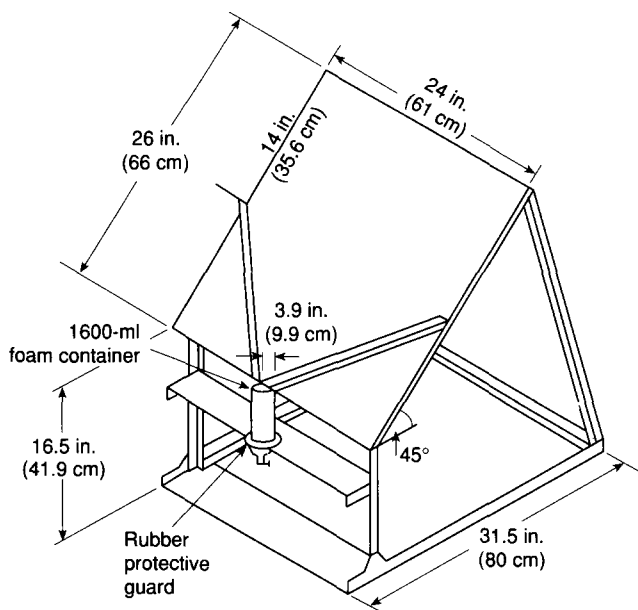


Figure C-1(a) Foam sample collector.

Initially, the collector should be placed at the proper distance from the nozzle to serve as the center of the ground pattern. The nozzle or turret should be placed in operation while it is directed off to one side of the collector. After the pressure and operation have become stabilized, the stream is swung over to center on the collector. When a sufficient foam volume has accumulated to fill the sample containers, usually within only a few seconds, a stopwatch is started for each of the two samples in order to provide the "zero" time for the drainage test described later. Immediately, the nozzle is turned away from the collector, the sample containers removed, and the top struck off with a straight edge. After all foam has been wiped off from the outside of the container, the sample is ready for analysis.

Overhead Devices. (It is presumed that the devices are fixed and not capable of movement.) Prior to starting up the stream, the collector is situated within the discharge area where it is anticipated a representative foam pattern will occur. The two sample containers are removed prior to positioning the collector. The foam system is activated and permitted to achieve equilibrium, after which time the

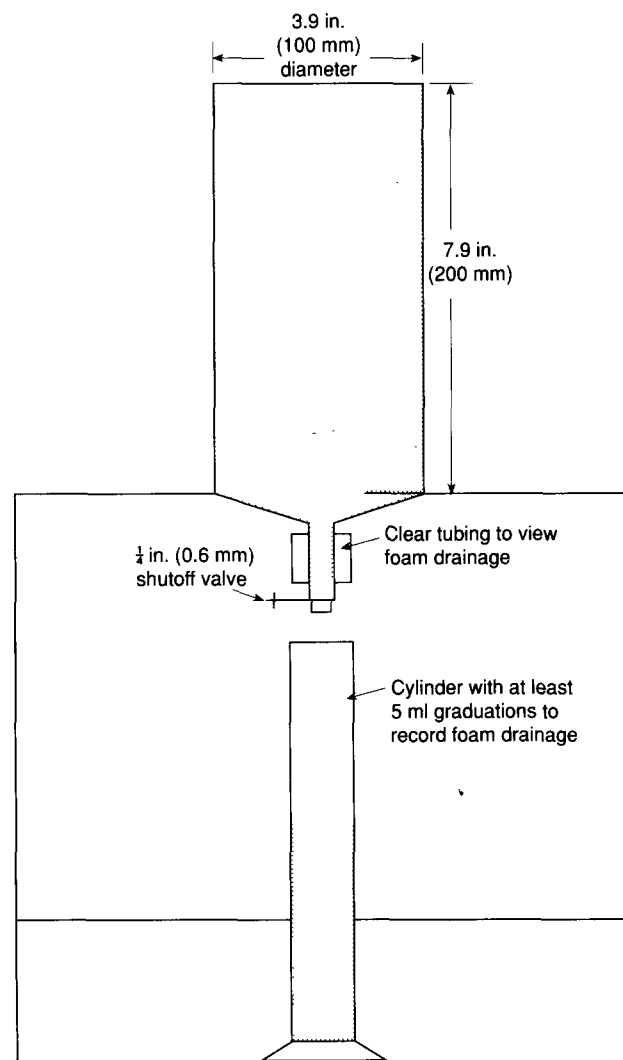


Figure C-1(b) 1600 ml-foam container.

technician, wearing appropriate clothing, enters the area without delay. The sample containers are placed and left on the collector board until adequately filled. Stopwatches are started for each of the samples to provide the "zero" time for the drainage rate test described later. During the entry and retreat of the operator through the falling foam area, the containers must be suitably shielded from extraneous foam. Immediately after removing the samples from under the falling foam, the top should be struck off with a straight edge and all foam wiped off from the outside of the container. The sample is then ready for analysis.

Pressure Foam. (It is presumed that foam is flowing under pressure from a foam pump or high-pressure aspirator toward an inaccessible tank outlet.) A 1-in. pipe tap fitted with a globe valve should be located as close to the point of foam application as practicable. The connection should terminate in an approximate 18-in. (457-mm) section of flexible rubber tubing to facilitate filling the sample container. When drawing the sample, the valve should be opened as wide as possible without causing excessive splashing and air entrainment in the container. Care must be exercised to eliminate air pockets in the sample. As each container is filled, a stopwatch is started to provide the "zero" time for the drainage test described later. Any excess foam is struck off the top with a straight edge and all foam clinging to the outside of the container is wiped off. The sample is then ready for analysis.

Foam Chambers. In some instances where the foam makers are integral with the foam chambers on the top ring of a tank, none of the above methods of sampling may be workable. In this case it will be necessary to improvise as well as possible, making sure any unusual procedures or conditions are pointed out in reporting the results. Where access can be gained to a flowing foam stream, the container can be inserted into the edge of the stream to split off a portion for the sample. The other alternative is to scoop foam from a layer or blanket already on the surface. Here an attempt must be made to obtain a full cross section of foam from the entire depth but without getting any fuel below the foam layer. The greatest difficulty inherent in sampling from a foam blanket is the undesirable lag-in-time factor involved in building up a layer deep enough to scoop a sample. At normal rates of application, it may take a few minutes to build up the several inches in depth required and this time may definitely affect the test results. The degree of error thus incurred will in turn depend on the type of foam involved, but it can vary from zero percent to several hundred percent.

In a Moeller tube installation, it is advisable to sample right alongside the tube as foam oozes out in good volume.

Immediately after filling the container, a stopwatch is started to provide the "zero" time for the drainage test described later. Any excess foam is struck off the top with a straight edge and all foam wiped off from the outside of the container. The sample is then ready for analysis.

Foam Testing. The foam samples, as obtained in the above described procedures, are analyzed for expansion, 25 percent drainage time, and foam solution concentration. It is recommended that duplicate samples be obtained whenever possible and the results averaged for the final value. However, when a shortage of personnel or equipment or both creates a hardship, the taking of one sample should be considered acceptable.

Apparatus required:

- 2 — 1600 ml sample containers
- 1 — Foam collector board
- 1 — Balance (triple beam balance, 2610 g capacity)

Procedure. Prior to the testing, the empty containers fitted with a drain hose and clamp should be weighed to obtain the tare weight. (All containers should be adjusted to the same tare weight to eliminate confusion in handling.) Each foam sample is weighed to the nearest gram and the expansion calculated from the following equation:

$$\frac{1600}{(\text{full weight minus empty weight})} = \text{expansion}$$

(All weights to be expressed in grams)

Foam 25 Percent Drainage Time Determination. The rate at which the foam solution drops out from the foam mass is called the drainage rate and is a specific indication of degree of water retention ability and the fluidity of the foam. A single value is used to express the relative drainage rates of different foams in the "25 percent drainage time," which is the time in minutes that it takes for 25 percent of the total solution contained in the foam in the sample containers to drain.

Apparatus required:

- 2 — Stopwatches
- 1 — Sample stand
- 4 — 100-ml capacity plastic graduates

Procedure. This test is performed on the same sample as used in the expansion determination. Dividing the net weight of the foam sample by 4 will give the 25 percent volume, in ml, of solution contained in the foam. To determine the time required for this volume to drain out, the sample container should be placed on a stand, as indicated, and, the accumulated solution in the bottom of the container should be drawn off into a graduate at regular, suitable intervals. The time intervals at which the accumulated solution is drawn off are dependent on the foam expansion. For foams of expansion 4 to 10, 30-second intervals should be used, and for foams of expansion 10 and higher, 4-minute intervals should be used because of the slower drainage rate of these foams. In this way, a time-drainage volume relationship is obtained and after the 25 percent volume has been exceeded, the 25 percent drainage time is interpolated from the data. The following example shows how this is done. The net weight of the foam sample is 180 grams. Since 1 gram of foam solution occupies a volume of essentially 1 ml, the total volume of foam solution contained in the given sample is 180 ml.

$$\text{Expansion} = \frac{1600}{180} = 8.9$$

$$25\% \text{ volume} = \frac{180}{4} = 45 \text{ ml}$$

The time-solution volume data is recorded as follows:

Time — min	Drained Solution Volume — ml
0	0
0.5	10
1.0	20
1.5	30
2.0	40
2.5	50
3.0	60

The 25 percent volume of 45 ml falls between the 2.0- and 2.5-minute period. The proper increment to add to the lower value of 2.0 minutes is determined by interpolation of the data:

$$\frac{45 \text{ ml (25\% vol.)} - 40 \text{ ml (2.0 min vol.)}}{50 \text{ ml (2.5 min vol.)} - 40 \text{ ml (2.0 min vol.)}} = \frac{5}{10} = \frac{1}{2}$$

The 25 percent drainage time is halfway between 2.0 and 2.5 minutes, or 2.25 minutes, which is rounded off to 2.3 minutes.

An effort should be made to conduct foam tests with water temperatures between 60°F and 80°F (15.6°C to 26.7°C). The water, air, and foam temperatures should be noted in the results. Lower water temperature tends to depress the expansion values and increase the drainage time values.

NOTE: When handling fast-draining foams, remember that they lose their solution rapidly, and the expansion determination should be carried out with speed in order not to miss the 25 percent drainage volume. The stopwatch is started at the time the foam container is filled and continues to run during the time the sample is being weighed. It is recommended that expansion weighing be deferred until after the drainage curve data has been received.

C-2 Foam Solution Concentration Determination.

General. This test is used to determine the percent concentration of a foam concentrate in the water being used to generate foam. It typically is used as a means of determining the accuracy of a system's proportioning equipment. If the level of foam concentrate injection varies widely from that of the design, it may abnormally influence the expansion and drainage foam quality values, which may influence the foam's fire performance.

There are two acceptable methods for measuring foam concentrate percentage in water. Both methods are based on comparing foam solution test samples to premeasured solutions that are plotted on a baseline graph of percent concentration versus instrument reading.

Refractive Index Method. A hand-held refractometer is used to measure the refractive index of the foam solution samples. This method is not particularly accurate for AFFF or alcohol-resistant AFFFs since they typically exhibit very low refractive index readings. For this reason, the conductivity method may be preferred where these products are used.

Equipment. A base (calibration) curve is prepared using the following apparatus:

- (a) Four 100-ml or larger plastic bottles with caps
- (b) One measuring pipette (10 ml) or syringe (10 cc)
- (c) One 100-ml or larger graduated cylinder
- (d) Three plastic-coated magnetic stirring bars
- (e) One hand-held refractometer—American Optical Model 10400 or 10441, Atago NI, or equivalent
- (f) Standard graph paper
- (g) Ruler or other straight edge.

Procedure. Using water and foam concentrate from the system to be tested, make up three standard solutions using the 100-ml (or larger) graduate. These samples should include the nominal intended percentage of injection, the nominal percentage plus 1 percent, and the nominal

percentage minus 1 percent. Place the water in the 100-ml (or larger) graduate (leaving adequate space for the foam concentrate) and then carefully measure the foam concentrate samples into the water using the syringe. Use care not to pick up air in the foam concentrate samples. Pour each measured foam solution from the 100-ml (or larger) graduate into a 100-ml plastic bottle. Each bottle should be marked with the percent solution it contains. Add a plastic stirring bar to the bottle, cap it, and shake it thoroughly to mix the foam solution.

After thoroughly mixing the foam solution samples, a refractive index reading is taken of each percentage foam solution sample. This is done by placing a few drops of the solution on the refractometer prism, closing the cover plate, and observing the scale reading at the dark field intersection. Since the refractometer is temperature compensated, it may take 10 to 20 seconds for the sample to be read properly. It is important to take all refractometer readings at ambient temperatures of 50°F (10°C) or above.

Using standard graph paper, plot the refractive index readings on one axis and the percent concentration readings on the other. This plotted curve will serve as the known baseline for the test series. Set the solution samples aside in the event the measurements need to be checked.

Sampling and Analysis. Collect foam solution samples from the proportioning system, using care to be sure the sample is taken at an adequate distance downstream from the proportioner being tested. Take refractive index readings of the sample and compare them to the plotted curve to determine the percentage of the samples.

Conductivity Method. This method is based on changes in electrical conductivity as foam concentrate is added to water. A hand-held conductivity meter is used to measure the conductivity of foam solutions in microsiemen units. Conductivity is a very accurate method, provided there are substantial changes in conductivity, as foam concentrate is added to the water in relatively low percentages. Since salt or brackish water is very conductive, this method may not be suitable due to small conductivity changes as foam concentrate is added. It will be necessary to make foam and water solutions in advance to determine if adequate changes in conductivity can be detected if the water source is salty or brackish.

Equipment. Prepare a base (calibration) curve using the following apparatus:

- (a) Four 100-ml (or larger) plastic bottles with caps
- (b) One measuring pipette (10 ml) or syringe (10 cc)
- (c) One 100-ml (or larger) graduated cylinder
- (d) Three plastic-coated magnetic stirring bars
- (e) A portable temperature compensated conductivity meter—Omega Model CDH-70, VWR Scientific Model 23198-014, or equivalent
- (f) Standard graph paper
- (g) Ruler or other straight edge.

Procedure. Using the water and foam concentrate from the system to be tested, make up three standard solutions using the 100-ml (or larger) graduate. These samples should include the nominal intended percentage of injection, the nominal percentage plus 1 percent, and the nominal percentage minus 1 percent. Place the water in the 100-ml (or larger) graduate (leaving adequate space for the