

Residential Occupancies
Up to and Including
Four Stories in Height

Sprinkler Systems

NFPA

13R

1996 Edition



**National Fire Protection
Association**

An International Codes and Standards Organization

NOTICE

All questions or other communications relating to this document should be sent only to NFPA headquarters, addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

A statement, written or oral, that is not processed in accordance with Section 5 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable federal, state and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action that is not in compliance with applicable laws, and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision—This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference—Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders, or similar instruments. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription—A. Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders, or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rule-making process. B. Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rule-making powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately, provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rule-making powers may apply for and may receive a special royalty where the public interest will be served thereby.

3. Scope of License Grant—The terms and conditions set forth above do not extend to the index to this document.

(For further explanation, see the Policy Concerning the Adoption, Printing, and Publication of NFPA Documents, which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accept any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document, and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

Copyright © 1996 NFPA, All Rights Reserved

NFPA 13R
Standard for the Installation of
Sprinkler Systems in
Residential Occupancies up to and
Including Four Stories in Height
1996 Edition

This edition of NFPA 13R, *Standard for the Installation of Sprinkler Systems in Residential Occupancies up to and Including Four Stories in Height*, was prepared by the Technical Committee on Automatic Sprinklers and acted on by the National Fire Protection Association, Inc., at its Annual Meeting held May 20–23, 1996, in Boston, MA. It was issued by the Standards Council on July 18, 1996, with an effective date of August 9, 1996, and supersedes all previous editions.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

This edition of NFPA 13R was approved as an American National Standard on July 26, 1996.

Origin and Development of NFPA 13R

The first edition of NFPA 13R represented a milestone in the development of sprinkler installation design standards. The first edition resulted in a standard for the protection of low-rise, residential facilities.

This standard is intended to provide a higher degree of life safety and property protection to the inhabitants of low-rise, multifamily dwellings. Promulgated as a document that provides for increased levels of protection to building occupants, the document also considers the economic aspects of a sprinklered facility as compared to an unsprinklered facility.

As the number of states and cities that implement sprinkler ordinances continues to grow, and as the threshold levels for sprinkler requirements in residential occupancies in the building codes extend to certain low-rise structures, it is believed that systems for certain residential occupancies can be efficiently and effectively installed in accordance with this standard.

The 1994 edition contained expanded information on nonmetallic pipe materials, minor changes to clarify the established design criteria, and a new recommendation on underground pipe materials.

This edition includes several changes that parallel amendments in NFPA 13. Additionally, other changes include a number of clarifications concerning the selection of sprinklers as well as the proper use of sprinklers.

Technical Committee on Automatic Sprinklers

Chester W. Schirmer, Chair
Schirmer Engr Corp., NC

Stephen R. Hoover, Secretary
Kemper Nat'l Insurance Cos., IL
(Nonvoting)

Charles B. Barnett, Badger Fire Protection Inc., OH
Rep. Nat'l Fire Sprinkler Assn.
Kerry M. Bell, Underwriters Laboratories Inc., IL
Edward K. Budnick, Hughes Assoc., Inc., MD
Albert M. Comly, Jr., Vitetta Group, PA
Rep. American Inst. of Architects
Thomas G. Daly, Hilton Hotels Corp., CA
Rep. American Hotel & Motel Assn.
Robert E. Duke, Fire Control Inc., IL
Russell P. Fleming, Nat'l Fire Sprinkler Assn., NY
Rep. Nat'l Fire Sprinkler Assn.
Christopher M. Goddard, Zeneca Inc., DE
Rep. NFPA Industrial Fire Protection Section
Richard E. Hughey, ISO Commercial Risk Services, Inc., NJ
Rolf H. Jensen, Rolf Jensen & Assoc., Inc., IL
Andrew Kim, Nat'l Research Council of Canada, ON, Canada
Kenneth W. Linder, Industrial Risk Insurers, CT
Rep. Industrial Risk Insurers
B. J. Lukes, Grinnell Fire Protection System Co. Ltd, Canada
Rep. Canadian Automatic Sprinkler Assn.
Daniel Madrzykowski, U.S. Nat'l Inst. of Standards & Technology, MD
Wayne M. Martin, Los Angeles City Fire Dept., CA

M. L. "Larry" Maruskin, U.S. Fire Administration, MD
(Vote limited to NFPA 13D, NFPA 13R)
Francis J. Miklouchich, Eastman Kodak Co., NY
Gerald R. Myers, Liberty Mutual Insurance Co., PA
Rep. The Alliance of American Insurers
Joseph G. Novak, South Pasadena Fire Dept., FL
Rep. Fire Marshals Assn. of North America
John G. O'Neill, Gage-Babcock & Assoc., Inc., VA
Thomas L. Siegfried, Altamonte Springs Fire Dept., FL
Rep. Int'l Assn. of Fire Chiefs
Neil P. Stong, Joseph Stong Inc., PA
Rep. American Fire Sprinkler Assn., Inc
Willie R. Templin, American Automatic Sprinkler, Inc., TX
Rep. American Fire Sprinkler Assn., Inc
William L. Testa, Grinnell Fire Protection Systems Co.
Inc., RI
Rep. Nat'l Fire Sprinkler Assn.
John J. Walsh, United Assn. of Journeymen & Apprentices
of the Plumbing & Pipe Fitting Industry of the U.S.
& Canada, MD
William E. Wilcox, Factory Mutual Research Corp., MA
Reginald John Wright, Underwriters Laboratories of Canada,
ON, Canada

Alternates

James R. Bell, Marriott Corp., DC
(Alt. to T. G. Daly)
Antonio C. M. Braga, Factory Mutual Research Corp., MA
(Alt. to W. E. Wilcox)
James A. Bychowski, Schirmer Engr Corp., IL
(Alt. to C. W. Schirmer)
Don R. Dean, Dow Chemical Co., TX
(Alt. to C. M. Goddard)
David D. Evans, Center for Fire Research, MD
(Alt. to D. Madrzykowski)
John Galt, Canadian Automatic Sprinkler Assn., ON, Canada
(Alt. to B. J. Lukes)
Ralph Gerdes, Ralph Gerdes Consultants, IN
(Alt. to A. M. Comly, Jr.)
James Golinveaux, Central Sprinkler Corp., PA
(Alt. to C. B. Barnett)
Kenneth E. Isman, Nat'l Fire Sprinkler Assn., NY
(Alt. to R. P. Fleming)
George E. Laverick, Underwriters Laboratories Inc., IL
(Alt. to K. M. Bell)
Edward R. Lising, Underwriters Laboratories of Canada,
ON, Canada
(Alt. to R. J. Wright)

Maurice Marvi, ISO Commercial Risk Services, Inc., NJ
(Alt. to R. E. Hughey)
Peter J. McWilliams, Eastman Kodak Co., NY
(Alt. to F. J. Miklouchich)
Robert J. Pearce, Jr., Industrial Risk Insurers, CA
(Alt. to K. W. Linder)
J. Kenneth Richardson, Nat'l Research Council of Canada,
ON, Canada
(Alt. to A. Kim)
Paul E. Rousseau, HFP Sprinkler Inc., MA
(Alt. to W. R. Templin)
Gerald R. Schultz, Gage-Babcock & Assoc., Inc., IL
(Alt. to J. G. O'Neill)
Harry Shaw, Harry Shaw & Assoc., Inc., MD
(Alt. to T. L. Siegfried)
Jack Thacker, Allan Automatic Sprinkler Corp. of Southern
California, CA
(Alt. to W. L. Testa)
Lynn K. Underwood, Wausau HPR Engr, WI
(Alt. to G. R. Myers)
James B. Visger, Road Sprinkler Fitters Union, MD
(Alt. to J. J. Walsh)
William A. Webb, Rolf Jensen & Assoc., Inc., IL
(Alt. to R. H. Jensen)

Nonvoting

William E. Koffel, Jr., Koffel Assoc., Inc., MD
Rep. Safety to Life Committee

Barry M. Lee, Wormald Australia Party Ltd
John Nigel Stephens, Loss Prevention Council, England

Robert E. Solomon/Milosh T. Puchovsky, NFPA Staff Liaisons

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on the design and installation of automatic and of open sprinkler systems, including the character and adequacy of water supplies, and the selection of sprinklers, piping, valves, and all materials and accessories; this committee does not cover the installation of fire pumps, nor the construction and installation of gravity and pressure tanks and towers, nor the installation, maintenance, and use of central station, proprietary, auxiliary, and local signaling systems for watchmen, fire alarm, and supervisory service, nor the care of valves controlling water supplies, nor the design of fire department hose connections, nor the installation of private fire service mains and their appurtenances.

Contents

Chapter 1 General Information	13R- 5	2-3 Water Supply	13R- 8
1-1 Scope	13R- 5	2-4 System Components	13R- 8
1-2 Purpose	13R- 5	2-5 System Design	13R-12
1-3 Definitions	13R- 5	2-6 Location of Sprinklers	13R-13
1-4 Units	13R- 6	2-7 Maintenance	13R-13
1-5 Piping	13R- 6	Chapter 3 Referenced Publications	13R-13
1-6 System Types	13R- 7	Appendix A Explanatory Material	13R-14
Chapter 2 Working Plans, Design, Installation, Acceptance Tests, and Maintenance	13R- 7	Appendix B Referenced Publications	13R-19
2-1 Working Plans and Acceptance Tests . . .	13R- 7	Index	13R-19
2-2 Design and Installation	13R- 8		

NFPA 13R
Standard for the Installation of
Sprinkler Systems in Residential
Occupancies up to and Including
Four Stories in Height

1996 Edition

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates explanatory material on that paragraph in Appendix A.

Information on referenced publications can be found in Chapter 3 and Appendix B.

Preface

It is intended that this standard provide a method for those individuals wishing to install a sprinkler system for life safety and property protection. It is not the purpose of this standard to require the installation of an automatic sprinkler system. This standard assumes that one or more smoke detectors will be installed in accordance with NFPA 72, *National Fire Alarm Code*.

Chapter 1 General Information

1-1* Scope. This standard covers the design and installation of automatic sprinkler systems for protection against fire hazards in residential occupancies up to and including four stories in height.

1-2* Purpose. The purpose of this standard is to provide design and installation requirements for a sprinkler system to aid in the detection and control of fires in residential occupancies and thus provide improved protection against injury, life loss, and property damage. A sprinkler system designed and installed in accordance with this standard is expected to prevent flashover (total involvement) in the room of fire origin, where sprinklered, and to improve the chance for occupants to escape or be evacuated.

Nothing in this standard is intended to restrict new technologies or alternative arrangements, provided that the level of safety prescribed by the standard is not reduced.

1-3 Definitions.

Approved.* Acceptable to the authority having jurisdiction.

Authority Having Jurisdiction.* The organization, office, or individual responsible for approving equipment, an installation, or a procedure.

Check Valve. A valve that allows flow in one direction only.

Control Valve. An indicating valve employed to control (shut) a supply of water to a sprinkler system.

Design Discharge. The rate of water discharged by an automatic sprinkler, expressed in gpm (L/min).

Dry System. A system employing automatic sprinklers attached to a piping system containing air under atmospheric or higher pressures. Loss of pressure from the opening of a sprinkler or detection of a fire condition causes the release of water into the piping system and out the opened sprinkler.

Dwelling Unit. One or more rooms, arranged for the use of one or more individuals living together, as in a single housekeeping unit, that normally have cooking, living, sanitary, and sleeping facilities.

Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation that maintains periodic inspection of production of labeled equipment or materials and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

Listed.* Equipment, materials, or services included in a list published by an organization acceptable to the authority having jurisdiction and concerned with evaluation of products or services that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services and whose listing states either that the equipment, material, or service meets identified standards or has been tested and found suitable for a specified purpose.

Multipurpose Piping System. A piping system within a residential occupancy intended to serve both domestic and fire protection needs.

Preaction System. A sprinkler system employing automatic sprinklers attached to a piping system containing air that might or might not be under pressure, with a supplemental detection system installed in the same areas as the sprinklers. Actuation of the detection system opens a valve that allows water to flow into the sprinkler piping system and to be discharged from any sprinklers that are open.

Residential Occupancies. Occupancies, as specified in the scope of this standard, that include the following, as defined in NFPA 101®, *Life Safety Code*®:

- (a) Apartment buildings;
- (b) Lodging and rooming houses;
- (c) Board and care facilities (slow evacuation type with 16 or fewer occupants and prompt evacuation type);
- (d) Hotels, motels, and dormitories.

Residential Sprinkler. A type of sprinkler that meets the definition of fast-response as defined by NFPA 13, *Standard for the Installation of Sprinkler Systems*, and that has been specifically investigated for its ability to enhance survivability in the room of fire origin and that is listed for use in the protection of dwelling units.

Shall. Indicates a mandatory requirement.

Should. Indicates a recommendation or that which is advised but not required.

Sprinkler, Automatic. A fire suppression or control device that operates automatically when its heat-actuated element is heated to its thermal rating or above, allowing water to discharge over a specific area.

Sprinkler System. An integrated system of piping, connected to a water supply, with listed sprinklers that automatically initiate water discharge over a fire area. Where required, the sprinkler system also includes a control valve and a device for actuating an alarm when the system operates.

Standard. A document, the main text of which contains only mandatory provisions using the word “shall” to indicate requirements, which is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions shall be located in an Appendix, footnote, or fine-print note and are not to be considered a part of the requirements of a standard.

Thermal Barrier. A material that limits the average temperature rise of the unexposed surface to not more than 250°F (121°C) after 15 minutes of fire exposure and that complies with the standard time-temperature curve of NFPA 251, *Standard Methods of Tests of Fire Endurance of Building Construction and Materials*.

Waterflow Alarm. A sounding device activated by a waterflow detector or alarm check valve.

Waterflow Detector. An electric signaling indicator or alarm check valve actuated by waterflow in one direction only.

Wet System. A system employing automatic sprinklers attached to a piping system containing water and connected to a water supply so that water discharges immediately from sprinklers opened by a fire.

1-4 Units.* Metric units of measurement in this standard are in accordance with the modernized metric system known as the International System of Units (SI). The liter and bar units are outside of, but recognized by, SI and are commonly used in international fire protection. These units are provided in Table 1-4 with their conversion factors.

Table 1-4 Metric Conversions

Name of Unit	Unit Symbol	Conversion Factor
liter	L	1 gal = 3.785 L
pascal	Pa	1 psi = 6894.757 Pa
bar	bar	1 psi = 0.0689 bar
bar	bar	1 bar = 105 Pa

1-4.1 Where a value for measurement as specified in this standard is followed by an equivalent value in other units, the first stated value shall be regarded as the requirement. A given equivalent value is considered to be approximate.

1-4.2 SI units have been converted by multiplying the quantity by the conversion factor and then rounding the result to the appropriate number of significant digits.

1-5 Piping.

1-5.1* Pipe or tube used in sprinkler systems shall be of the materials specified in Table 1-5.1 or in accordance with 1-5.2 through 1-5.5. The chemical properties, physical properties, and dimensions of the materials in Table 1-5.1 shall be at least equivalent to the standards cited in the table and designed to withstand a working pressure of not less than 175 psi (12.1 bars).

1-5.2* Other types of pipe or tube shall be permitted to be used where listed for sprinkler systems. Listed piping materials including, but not limited to, chlorinated polyvinyl chloride (CPVC), polybutylene, and steel differing from those provided in Table 1-5.1 shall be installed in accordance with their listings and the manufacturers' installation instructions. Nonmetallic pipe and tube shall comply with

Table 1-5.1 Pipe or Tube Materials and Dimensions

Materials and Dimensions	Standard
Specification for Black and Hot-Dipped Zinc-Coated (Galvanized) Welded and Seamless Steel Pipe for Fire Protection Use	ASTM A 795
Specification for Welded and Seamless Pipe Wrought-Steel Pipe	ASTM A 53 ANSI B36.10M
Specification for Electric-Resistance Welded-Steel Pipe	ASTM A 135
Specification for Seamless Copper Water Tube [Copper Tube (Drawn, Seamless)]	ASTM B 88
Specification for General Requirements for Wrought Seamless Copper and Copper-Alloy Tube	ASTM B 251
Fluxes for Soldering Applications of Copper and Copper-Alloy Tube	ASTM B 813
Specification for Filler Metals for Brazing and Braze Welding (Classification BCuP-3 or BCuP-4)	AWS A5.8
Specification for Solder Metal [95-5 (Tin-Antimony-Grade 95TA)]	ASTM B 32

the portions of the ASTM standards specified in Table 1-5.2 that apply to fire protection service in addition to the provisions of this paragraph.

Table 1-5.2 Specially Listed Pipe or Tube Materials and Dimensions

Materials and Dimensions	Standard
Nonmetallic Piping	
Specification for Chlorinated Polyvinyl Chloride (CPVC) Pipe	ASTM F 442
Specification for Polybutylene (PB) Pipe	ASTM D 3309

NOTE: In addition to satisfying these minimum standards, specially listed pipe is required to comply with the provisions of 1-5.2.

1-5.3 Wherever the word “pipe” is used in this standard, it shall be understood also to mean “tube.”

1-5.4 Pipe joined with mechanical grooved fittings shall be joined by a listed combination of fittings, gaskets, and grooves. Where grooves are cut or rolled on the pipe, they shall be dimensionally compatible with the fittings.

Exception: Steel pipe with wall thicknesses less than those of Schedule 30 [sizes 8 in. (203 mm) and larger] or Schedule 40 [sizes less than 8 in. (203 mm)] shall not be joined by fittings used with pipe having cut grooves.

1-5.5 Fittings used in sprinkler systems shall be of the materials listed in Table 1-5.5 or in accordance with 1-5.7. The chemical properties, physical properties, and dimensions of the materials specified in Table 1-5.5 shall be at least equivalent to the standards cited in the table. Fittings used in sprinkler systems shall be designed to withstand a working pressure of not less than 175 psi (12.1 bars) cold water pressure.

1-5.6 Joints for the connection of copper shall be brazed.

Exception: Soldered joints (95-5 solder metal) shall be permitted for wet pipe copper tube systems.

1-5.7* Other types of fittings shall be permitted to be used, but only where listed for sprinkler systems. Listed fittings including, but not limited to, chlorinated polyvinyl chloride

Table 1-5.5 Fitting Materials and Dimensions

Materials and Dimensions	Standard
Cast Iron	
Gray Iron and Threaded Fittings (Class 125 and 250)	ANSI B16.4
Cast Iron Pipe Flanges and Flanged Fittings	ANSI B16.1
Malleable Iron	
Malleable Iron Threaded Fittings (Class 150 and 300)	ANSI B16.3
Steel	
Factory-Made Wrought Steel Buttwelding Fittings (Class 150 and 300)	ANSI B16.9
Buttwelding Ends	ANSI B16.25
Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and Elevated Temperatures	ASTM A 234
Pipe Flanges and Flanged Fittings (Nickel Alloy and Other Special Alloys)	ANSI B16.5
Forged Fittings, Socket-Welding and Threaded	ANSI B16.11
Copper	
Wrought Copper and Copper Alloy Solder Joint Pressure Fittings	ANSI B16.22
Cast Copper Alloy Solder Joint Pressure Fittings	ANSI B16.18

Table 1-5.7 Specially Listed Fittings and Dimensions

Materials and Dimensions	Standard
Specification for Schedule 80 CPVC Threaded Fittings	ASTM F 437
Specification for Schedule 40 CPVC Socket-Type Fittings	ASTM F 438
Specification for Schedule 80 CPVC Socket-Type Fittings	ASTM F 439

NOTE: In addition to satisfying these minimum standards, specially listed pipe fittings are required to comply with the provisions of 1-5.7.

(CPVC), polybutylene, and steel differing from those provided in Table 1-5.5 shall be installed in accordance with their listings and the manufacturer's installation instructions. Nonmetallic pipe and tube fittings shall comply with the portions of the ASTM standards specified in Table 1-5.7 that apply to fire protection service in addition to the provisions of this paragraph.

1-6 System Types.

1-6.1 Wet Pipe Systems. A wet pipe system shall be used where all piping is installed in areas not subject to freezing.

1-6.2* Protection of Piping.

1-6.2.1 Provision shall be made to protect piping from freezing in unheated areas by use of one of the following methods:

1. Antifreeze system;
2. Dry pipe system;
3. Preaction system;
4. Listed standard dry pendent, dry upright, or dry sidewall sprinklers extended from heated areas.

1-6.2.2 Antifreeze systems, dry pipe systems, and preaction systems shall be installed in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*.

Chapter 2 Working Plans, Design, Installation, Acceptance Tests, and Maintenance

2-1 Working Plans and Acceptance Tests.

2-1.1 Working Plans.

2-1.1.1 Working plans shall be submitted for approval to the authority having jurisdiction before any equipment is installed or remodeled. Deviations from approved plans shall require permission of the authority having jurisdiction.

2-1.1.2 Working plans shall be drawn to a specified scale on sheets of uniform size, shall provide a plan of each floor, shall be capable of being easily duplicated, and shall indicate:

- (a) The name of owner and occupant.
- (b) The location, including street address.
- (c) The point of compass.
- (d) The ceiling construction.
- (e) The full height cross section.
- (f) The location of fire walls.
- (g) The location of partitions.
- (h) The occupancy of each area or room.
- (i) The location and size of concealed spaces, attics, closets, and bathrooms.
- (j) Any small enclosures in which no sprinklers are to be installed.
- (k) The size of the city main in the street, pressure, and whether dead-end or circulating and, if dead-end, the direction and distance to the nearest circulating main, and the city main test results including elevation of the test hydrant.
- (l) The make, manufacturer, type, heat-response element, temperature rating, and nominal orifice size of the sprinkler.
- (m) The temperature rating and location of high-temperature sprinklers.
- (n) The number of sprinklers on each riser, per floor.
- (o) The kind and location of alarm bells.
- (p) The type of pipe and fittings.
- (q) The type of protection for nonmetallic pipe.
- (r) The nominal pipe size with lengths shown to scale.

NOTE: Where typical branch lines prevail, it will be necessary to size only one line.

- (s) The location and size of riser nipples.
- (t) The types of fittings and joints and the locations of all welds and bends.
- (u) The types and locations of hangers, sleeves, and braces, and methods of securing sprinklers, where applicable.
- (v) All control valves, check valves, drain pipes, and test connections.
- (w) The underground pipe size, length, location, weight, material, and point of connection to the city main; type of valves, meters, and valve pits; and depth at which the top of the pipe is laid below grade.
- (x) In the case of hydraulically designed systems, the material to be included on the hydraulic data nameplate.
- (y) The name and address of the contractor.

2-1.2 Approval of Sprinkler Systems.

2-1.2.1 The installer shall perform all required acceptance tests (see 2-1.3), complete the Contractor's Material and Test Certificate(s) (see Figure 2-1.2.1), and forward the certificate(s) to the authority having jurisdiction prior to asking for approval of the installation.

2-1.2.2 Where the authority having jurisdiction desires to be present during the conducting of acceptance tests, the installer shall provide advance notification of the time and date the testing will be performed.

2-1.3 Acceptance Tests.

2-1.3.1 Flushing of Underground Connections.

2-1.3.1.1 Underground mains and lead-in connections to system risers shall be flushed before a connection is made to sprinkler piping in order to remove any foreign materials that have entered the underground piping during the course of the installation. For all systems, the flushing operation shall be continued until the water is clear.

2-1.3.1.2 Underground mains and lead-in connections shall be flushed at the hydraulically calculated water demand rate of the system.

2-1.3.1.3 To avoid property damage, provision shall be made for the disposal of water issuing from test outlets.

2-1.3.2* Hydrostatic pressure tests shall be provided in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*.

Exception: Testing for leakage at a water pressure of 50 psi (3.4 bars) above the maximum system pressure shall be permitted for systems having fewer than 20 sprinklers and no fire department connection.

2-2 Design and Installation.

2-2.1 Devices and Materials.

2-2.1.1 Only new sprinklers shall be employed in the installation of sprinkler systems. At least three spare sprinklers of each type, temperature rating, and orifice size used in the system shall be kept on the premises. Replacement sprinklers shall have the same operating characteristics as the sprinklers being replaced.

2-2.1.2 Only listed or approved devices and materials as specified in this standard shall be used in sprinkler systems.

2-2.1.3 Sprinkler systems shall be designed for a maximum working pressure of 175 psi (12.1 bars).

Exception: Higher design pressures shall be permitted to be used where all system components are rated for pressures higher than 175 psi (12.1 bars).

2-2.1.4* Waterflow test connections shall be provided at locations that allow flow testing of water supplies, connections, and alarm mechanisms.

2-3 Water Supply.

2-3.1 General Provisions. Every automatic sprinkler system shall have at least one automatic water supply. Where stored water is used as the sole source of supply, the minimum quantity shall equal the water demand rate times 30 minutes. (See 2-5.1.3.)

2-3.2* Water Supply Sources. The following water supply sources are acceptable:

(a) A connection to a reliable waterworks system with or without a pump, as required. Fire pumps shall be installed in accordance with NFPA 20, *Standard for the Installation of Centrifugal Fire Pumps*.

(b) An elevated tank.

(c) A pressure tank installed in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*, and NFPA 22, *Standard for Water Tanks for Private Fire Protection*.

(d) A stored water source with an automatically operated pump, installed in accordance with NFPA 20, *Standard for the Installation of Centrifugal Fire Pumps*.

2-3.3 Multipurpose Piping System.

2-3.3.1* A common supply main to the building, serving both the sprinklers and domestic use, shall be permitted where the domestic design demand is added to the sprinkler system demand and the total demand flow does not exceed the maximum allowable flow of the piping system components.

Exception: Domestic design demand shall not be required to be added where provision is made to prevent flow on the domestic water system upon operation of sprinklers.

2-3.3.2 Sprinkler systems with nonfire protection connections shall comply with Section 3-6 of NFPA 13, *Standard for the Installation of Sprinkler Systems*.

2-4 System Components.

2-4.1 Valve and Drains.

2-4.1.1 Where a common supply main is used to supply both domestic and sprinkler systems, a single, listed control valve shall be provided to shut off both the domestic and sprinkler systems, and a separate shutoff valve shall be provided for the domestic system only. [See Figure A-2-3.2(a).]

Exception: The sprinkler system piping shall be permitted to have a separate control valve where supervised by one of the following methods:

(a) Central station, proprietary, or remote station alarm service;

(b) Local alarm service that causes the sounding of an audible signal at a constantly attended point; or

(c) Valves that are locked open.

2-4.1.2 Each sprinkler system shall have a 1-in. (25.4-mm) or larger drain and test connection with a valve on the system side of the control valve.

2-4.1.3 Additional 1/2-in. (13-mm) drains shall be installed for each trapped portion of a dry system that is subject to freezing temperatures.

2-4.2 At least one 1 1/2-in. (38-mm) or 2 1/2-in. (64-mm) fire department connection shall be provided.

Exception No. 1: Buildings located in remote areas that are inaccessible for fire department support.

Exception No. 2: Single-story buildings not exceeding 2000 ft² (186 m²) in area.

PROCEDURE

A certificate shall be filled out and signed by both representatives. Copies shall be prepared for approving authorities, owners, and contractor. It is understood the owner's representative's signature in no way prejudices any claim against contractor for faulty material, poor workmanship, or failure to comply with approving authority's requirements or local ordinances.

PROPERTY NAME							DATE			
PROPERTY ADDRESS										
PLANS	ACCEPTED BY APPROVING AUTHORITIES (NAMES)									
	ADDRESS									
	INSTALLATION CONFORMS TO ACCEPTED PLANS						<input type="checkbox"/> YES	<input type="checkbox"/> NO		
	EQUIPMENT USED IS APPROVED IF NO, EXPLAIN DEVIATIONS						<input type="checkbox"/> YES	<input type="checkbox"/> NO		
INSTRUCTIONS	HAS PERSON IN CHARGE OF FIRE EQUIPMENT BEEN INSTRUCTED AS TO LOCATION OF CONTROL VALVES AND CARE AND MAINTENANCE OF THIS NEW EQUIPMENT? IF NO, EXPLAIN						<input type="checkbox"/> YES	<input type="checkbox"/> NO		
	HAVE COPIES OF THE FOLLOWING BEEN LEFT ON THE PREMISES?						<input type="checkbox"/> YES	<input type="checkbox"/> NO		
	1. SYSTEM COMPONENTS INSTRUCTIONS						<input type="checkbox"/> YES	<input type="checkbox"/> NO		
	2. CARE AND MAINTENANCE INSTRUCTIONS						<input type="checkbox"/> YES	<input type="checkbox"/> NO		
	3. NFPA 25						<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO		
LOCATION OF SYSTEM	SUPPLIES BUILDINGS									
SPRINKLERS	MAKE		MODEL	YEAR OF MANUFACTURE	ORIFICE SIZE	QUANTITY	TEMPERATURE RATING			
PIPE AND FITTINGS	Type of Pipe _____ Type of Fittings _____									
ALARM VALVE OR FLOW INDICATOR	ALARM DEVICE				MAXIMUM TIME TO OPERATE THROUGH TEST CONNECTION					
	TYPE		MAKE	MODEL	MIN			SEC		
DRY PIPE OPERATING TEST	DRY VALVE				Q. O. D.					
	MAKE		MODEL	SERIAL NO.	MAKE		MODEL	SERIAL NO.		
		TIME TO TRIP THROUGH TEST CONNECTION ¹		WATER PRESSURE	AIR PRESSURE	TRIP POINT AIR PRESSURE	TIME WATER REACHED TEST OUTLET ¹		ALARM OPERATED PROPERLY	
		MIN	SEC	PSI	PSI	PSI	MIN	SEC	YES	NO
	Without Q.O.D.									
	With Q.O.D.									
	IF NO, EXPLAIN									

¹MEASURED FROM TIME INSPECTOR'S TEST CONNECTION IS OPENED.

Figure 2-1.2.1 Contractor's material and test certificate for aboveground piping.

DELUGE AND PREACTION VALVES	OPERATION <input type="checkbox"/> PNEUMATIC <input type="checkbox"/> ELECTRIC <input type="checkbox"/> HYDRAULIC							
	PIPING SUPERVISED <input type="checkbox"/> YES <input type="checkbox"/> NO				DETECTING MEDIA SUPERVISED <input type="checkbox"/> YES <input type="checkbox"/> NO			
	DOES VALVE OPERATE FROM THE MANUAL TRIP, REMOTE, OR BOTH CONTROL STATIONS <input type="checkbox"/> YES <input type="checkbox"/> NO							
	IS THERE AN ACCESSIBLE FACILITY IN EACH CIRCUIT FOR TESTING <input type="checkbox"/> YES <input type="checkbox"/> NO					IF NO, EXPLAIN		
	MAKE	MODEL	DOES EACH CIRCUIT OPERATE SUPERVISION LOSS ALARM?		DOES EACH CIRCUIT OPERATE VALVE RELEASE?		MAXIMUM TIME TO OPERATE VALVE RELEASE	
		YES NO		YES NO		MIN SEC		
PRESSURE REDUCING VALVE TEST	LOCATION & FLOOR	MAKE & MODEL	SETTING	STATIC PRESSURE		RESIDUAL PRESSURE (FLOWING)		FLOW RATE
				INLET (PSI)	OUTLET (PSI)	INLET (PSI)	OUTLET (PSI)	FLOW (GPM)
TEST DESCRIPTION	<p>HYDROSTATIC: Hydrostatic tests shall be made at not less than 200 psi (13.6 bars) for 2 hours or 50 psi (3.4 bars) above static pressure in excess of 150 psi (10.2 bars) for 2 hours. Differential dry-pipe valve clappers shall be left open during the test to prevent damage. All aboveground piping leakage shall be stopped.</p> <p>PNEUMATIC: Establish 40 psi (2.7 bars) air pressure and measure drop, which shall not exceed 1½ psi (0.1 bars) in 24 hours. Test pressure tanks at normal water level and air pressure and measure air pressure drop, which shall not exceed 1½ psi (0.1 bars) in 24 hours.</p>							
TESTS	ALL PIPING HYDROSTATICALLY TESTED AT ____ PSI (____ BARS) FOR ____ HRS						IF NO, STATE REASON	
	DRY PIPING PNEUMATICALLY TESTED <input type="checkbox"/> YES <input type="checkbox"/> NO EQUIPMENT OPERATES PROPERLY <input type="checkbox"/> YES <input type="checkbox"/> NO							
	DO YOU CERTIFY AS THE SPRINKLER CONTRACTOR THAT ADDITIVES AND CORROSIVE CHEMICALS, SODIUM SILICATE OR DERIVATIVES OF SODIUM SILICATE, BRINE, OR OTHER CORROSIVE CHEMICALS WERE NOT USED FOR TESTING SYSTEMS OR STOPPING LEAKS? <input type="checkbox"/> YES <input type="checkbox"/> NO							
	DRAIN TEST	READING OF GAUGE LOCATED NEAR WATER SUPPLY TEST CONNECTION: ____ PSI (____ BARS)				RESIDUAL PRESSURE WITH VALVE IN TEST CONNECTION OPEN WIDE: ____ PSI (____ BARS)		
	UNDERGROUND MAINS AND LEAD IN CONNECTIONS TO SYSTEM RISERS FLUSHED BEFORE CONNECTION MADE TO SPRINKLER PIPING VERIFIED BY COPY OF THE U FORM NO. 85B <input type="checkbox"/> YES <input type="checkbox"/> NO FLUSHED BY INSTALLER OF UNDER- GROUND SPRINKLER PIPING <input type="checkbox"/> YES <input type="checkbox"/> NO						OTHER EXPLAIN	
	IF POWDER-DRIVEN FASTENERS ARE USED IN CONCRETE, HAS REPRESENTATIVE SAMPLE TESTING BEEN SATISFACTORILY COMPLETED? <input type="checkbox"/> YES <input type="checkbox"/> NO						IF NO, EXPLAIN	
BLANK TESTING GASKETS	NUMBER USED		LOCATIONS				NUMBER REMOVED	
WELDING	WELDED PIPING <input type="checkbox"/> YES <input type="checkbox"/> NO							
	IF YES...							
	DO YOU CERTIFY AS THE SPRINKLER CONTRACTOR THAT WELDING PROCEDURES COMPLY WITH THE REQUIREMENTS OF AT LEAST AWS D10.9, LEVEL AR-3?						<input type="checkbox"/> YES <input type="checkbox"/> NO	
	DO YOU CERTIFY THAT THE WELDING WAS PERFORMED BY WELDERS QUALIFIED IN COMPLIANCE WITH THE REQUIREMENTS OF AT LEAST AWS D10.9, LEVEL AR-3?						<input type="checkbox"/> YES <input type="checkbox"/> NO	
	DO YOU CERTIFY THAT WELDING WAS CARRIED OUT IN COMPLIANCE WITH A DOCUMENTED QUALITY CONTROL PROCEDURE TO ENSURE THAT ALL DISCS ARE RETRIEVED, THAT OPENINGS IN PIPING ARE SMOOTH, THAT SLAG AND OTHER WELDING RESIDUE ARE REMOVED, AND THAT THE INTERNAL DIAMETERS OF PIPING ARE NOT PENETRATED?						<input type="checkbox"/> YES <input type="checkbox"/> NO	
CUTOUTS (DISCS)	DO YOU CERTIFY THAT YOU HAVE A CONTROL FEATURE TO ENSURE THAT ALL CUTOUTS (DISCS) ARE RETRIEVED?						<input type="checkbox"/> YES <input type="checkbox"/> NO	

Figure 2-1.2.1 Contractor's material and test certificate for aboveground piping.

HYDRAULIC DATA NAMEPLATE	NAMEPLATE PROVIDED <input type="checkbox"/> YES <input type="checkbox"/> NO		IF NO, EXPLAIN
REMARKS	DATE LEFT IN SERVICE WITH ALL CONTROL VALVES OPEN		
SIGNATURES	NAME OF SPRINKLER CONTRACTOR		
	TESTS WITNESSED BY		
	FOR PROPERTY OWNER (SIGNED)	TITLE	DATE
	FOR SPRINKLER CONTRACTOR (SIGNED)	TITLE	DATE
ADDITIONAL EXPLANATION AND NOTES			

Figure 2-1.2.1 Contractor's material and test certificate for aboveground piping.

2-4.3 Pressure Gauges. Pressure gauges shall be provided to indicate pressures on the supply and system sides of main check valves and dry pipe valves and to indicate pressure on water supply pressure tanks.

2-4.4* Piping Support. Piping hanging and bracing methods shall comply with NFPA 13, *Standard for the Installation of Sprinkler Systems*.

2-4.5 Sprinklers.

2-4.5.1 Listed residential sprinklers shall be used. Listing shall be based on tests to establish the ability of the sprinklers to control residential fires under standardized fire test conditions. The standardized room fires shall be based on a residential array of furnishings and finishes.

Exception No. 1: Residential sprinklers shall not be used in dry pipe systems unless specifically listed for that purpose.

Exception No. 2: Listed quick-response sprinklers shall be permitted to be installed in dwelling units meeting the definition of a compartment as defined in 2-5.1.2.2, provided no more than four sprinklers are located in the dwelling unit.

2-4.5.2 Temperature Ratings. The requirements of 2-4.5.2.1 through 2-4.5.2.3 shall be used for the selection of sprinkler temperature ratings.

2-4.5.2.1 Ordinary-temperature-rated residential sprinklers [135°F to 170°F (57°C to 77°C)] shall be installed where maximum ambient ceiling temperatures do not exceed 100°F (38°C).

2-4.5.2.2 Intermediate-temperature-rated residential sprinklers [175°F to 225°F (79°C to 107°C)] shall be installed where maximum ambient ceiling temperatures are between 101°F and 150°F (39°C and 66°C).

2-4.5.2.3 The following practices shall be observed when installing residential sprinklers:

Exception: Where higher expected ambient temperatures are otherwise determined.

(a) Sprinklers under glass or plastic skylights exposed to direct rays of the sun shall be of intermediate temperature classification.

(b) Sprinklers in an unventilated concealed space under uninsulated roof, or in an unventilated attic, shall be of intermediate temperature classification.

(c) Sprinklers installed near specific heat sources that are identified in Table 2-4.5.2.3 shall be of ordinary or intermediate temperature rating, as indicated.

Exception to (c): Where sprinklers are listed for positioning closer to a heat source than the minimum distance shown in Table 2-4.5.2.3, such closer minimum distances shall be permitted to be used.

2-4.5.3 Operated or damaged sprinklers shall be replaced with sprinklers having the same performance characteristics as the original equipment.

2-4.5.4 Where residential sprinklers are installed within a compartment, as defined in 2-5.1.2.2, all sprinklers shall have the same temperature classification.

Exception: Different temperature classifications shall be permitted where required by 2-4.5.2.3.

2-4.5.5 Standard or quick-response spray sprinklers shall be used in areas outside the dwelling unit.

Exception: Residential sprinklers shall be permitted to be used in adjoining corridors or lobbies with flat, smooth ceilings and a height not exceeding 10 ft (3.0 m).

2-4.5.6 Operated or damaged sprinklers shall be replaced with sprinklers having the same performance characteristics as the original equipment.

2-4.5.7 Where nonmetallic ceiling plates (escutcheons) are used, they shall be listed. Escutcheon plates used to create a recessed or flush-type sprinkler shall be part of a listed sprinkler assembly.

Table 2-4.5.2.3 Minimum Distances for Ordinary and Intermediate Temperature Residential Sprinklers

Heat Source	Minimum Distance from Edge of Source to Ordinary Temper- ature Sprinkler		Minimum Distance from Edge of Source to Intermediate Tem- perature Sprinkler	
	(in.)	(mm)	(in.)	(mm)
Side of open or recessed fire-place	36	914	12	305
Front of recessed fireplace	84	2134	36	914
Coal- or wood-burning stove	42	1067	12	305
Kitchen range	18	457	9	229
Wall oven	18	457	9	229
Hot air flues	18	457	9	229
Uninsulated heat ducts	18	457	9	229
Uninsulated hot water pipes	12	305	6	152
Side of ceiling- or wall-mounted hot air diffusers	24	607	12	305
Front of wall-mounted hot air diffusers	36	914	18	457
Hot water heater or furnace	6	152	3	76
Light fixture				
0W – 250W	6	152	3	76
250W – 499W	12	305	6	152

2-4.5.8 Painting and Ornamental Finishes.

2-4.5.8.1 Sprinkler frames shall be permitted to be factory painted or enameled as ornamental finish in accordance with 2-4.5.8.2; otherwise, sprinklers shall not be painted, and any sprinklers that have been painted shall be replaced with new, listed sprinklers.

Exception: Sprinklers painted with factory applied coatings shall not be required to be replaced.

2-4.5.8.2* Ornamental finishes shall not be applied to sprinklers by an individual other than the sprinkler manufacturer, and only sprinklers listed with such finishes shall be used.

2-4.6 Alarms. Local waterflow alarms shall be provided on all sprinkler systems and shall be connected to the building fire alarm system, where provided.

2-5 System Design.**2-5.1 Design Criteria — Inside Dwelling Unit.**

2-5.1.1 Design Discharge. The system shall provide a discharge of not less than 18 gpm (68 L/min) to any single operating sprinkler and not less than 13 gpm (49 L/min) per sprinkler to the number of design sprinklers, but the discharge shall not be less than the listing of the sprinkler.

Exception: Design discharge for sprinklers installed in accordance with Exception No. 2 to 2-4.5.1 shall be in accordance with sprinkler listing criteria.

2-5.1.2* Number of Design Sprinklers.

2-5.1.2.1* The number of design sprinklers shall include all sprinklers within a compartment up to a maximum of four sprinklers under a flat, smooth, horizontal ceiling. For compartments containing two or more sprinklers, calculations shall be provided to verify the single operating sprinkler criteria and the multiple (two, three, or four) operating sprinkler criteria.

2-5.1.2.2 The definition of “compartment” as used in 2-5.1.2.1 for determining the number of design sprinklers is a space that is completely enclosed by walls and a ceiling. The compartment enclosure shall be permitted to have openings to an adjoining space, provided the openings have a minimum lintel depth of 8 in. (203 mm) from the ceiling.

2-5.1.3 Water Demand. The water demand for the system shall be determined by multiplying the design discharge specified in 2-5.1.1 by the number of design sprinklers specified in 2-5.1.2.

2-5.1.4 Sprinkler Coverage.

2-5.1.4.1 Residential sprinklers shall be spaced so that the maximum area protected by a single sprinkler does not exceed 144 ft² (13.4 m²).

2-5.1.4.2 The maximum distance between sprinklers shall not exceed 12 ft (3.7 m), and the maximum distance to a wall or partition shall not exceed 6 ft (1.8 m).

2-5.1.4.3 The minimum distance between sprinklers within a compartment shall be 8 ft (2.4 m).

2-5.1.5 The minimum operating pressure of any sprinkler shall be in accordance with the listing information of the sprinkler and shall provide the minimum flow rates specified in 2-5.1.1.

2-5.1.6 Application rates, design areas, areas of coverage, and minimum design pressures other than those specified in 2-5.1.1, 2-5.1.2, 2-5.1.4, and 2-5.1.5 shall be permitted to be used with special sprinklers that have been listed for such specific residential installation conditions.

2-5.1.7 Position of Residential Sprinklers.

2-5.1.7.1 Pendent and upright sprinklers shall be positioned so that the deflectors are within 1 in. to 4 in. (25.4 mm to 102 mm) from the ceiling.

Exception: Special residential sprinklers shall be installed in accordance with the listing limitations.

2-5.1.7.2 Sidewall sprinklers shall be positioned so that the deflectors are within 4 in. to 6 in. (102 mm to 152 mm) from the ceiling.

Exception: Special residential sprinklers shall be installed in accordance with the listing limitations.

2-5.1.7.3* Sprinklers shall be positioned so that the response time and discharge are not unduly affected by obstructions such as ceiling slope, beams, or light fixtures.

2-5.1.8 In closets and storage areas that are required to be protected in accordance with Section 2-6 and are less than 5 ft (1.5 m) in height at the lowest ceiling, a single sprinkler located at the highest ceiling shall be permitted to protect a volume not larger than 300 ft³ (8.93 m³).

2-5.2 Design Criteria — Outside Dwelling Unit. The design discharge, number of design sprinklers, water demand of the system, sprinkler coverage, and position of sprinklers for areas to be sprinklered outside the dwelling unit shall comply with specifications in NFPA 13, *Standard for the Installation of Sprinkler Systems*.

Exception No. 1: Where compartmented into areas of 500 ft² (46 m²) or less by 30-minute fire-rated construction and the area is protected by standard or quick-response sprinklers not exceeding 130 ft² (12 m²) per sprinkler, the system demand shall be permitted to be limited to the number of sprinklers in the compartment area but shall not be less than the demand for a total of four sprinklers. Openings from the compartments shall not be required to be protected, provided such openings have a lintel at least 8 in. (203 mm) in depth and the total area of such openings does not exceed 50 ft² (4.6 m²) for each compartment. Discharge density shall be appropriate for the hazard classification as determined by NFPA 13.

Exception No. 2: Lobbies, other than in hotels and motels, foyers, corridors, and halls outside the dwelling unit, with flat, smooth ceilings not exceeding 10 ft (3.0 m) in height, shall be permitted to be protected with residential sprinklers, with a maximum system demand of four sprinklers.

2-5.3 Pipe Sizing. Piping shall be sized using hydraulic calculation procedures in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*.

2-6 Location of Sprinklers. Sprinklers shall be installed in all areas.

Exception No. 1: Sprinklers shall not be required in bathrooms where the area does not exceed 55 ft² (5.1 m²) and the walls and ceilings, including walls and ceilings behind fixtures, are of non-combustible or limited-combustible materials providing a 15-minute thermal barrier. The area occupied by a noncombustible, full height, shower/bathtub enclosure shall not be required to be added to the floor area when determining the area of the bathroom.

Exception No. 2: Sprinklers shall not be required in clothes closets, linen closets, and pantries within the dwelling units where the area of the space does not exceed 24 ft² (2.2 m²), the least dimension does not exceed 3 ft (0.91 m), and the walls and ceilings are surfaced with noncombustible or limited-combustible materials as defined by NFPA 220, *Standard on Types of Building Construction*.

Exception No. 3: Sprinklers shall not be required in any porches, balconies, corridors, and stairs that are open and attached.

Exception No. 4: Sprinklers shall not be required in attics, pent-house equipment rooms, crawl spaces, floor/ceiling spaces, elevator shafts, and other concealed spaces that are not used or intended for living purposes or storage.

2-7* Maintenance. The owner shall be responsible for the condition of a sprinkler system and shall keep the system in normal operating condition. Sprinkler systems shall be inspected, tested, and maintained in accordance with NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*.

Chapter 3 Referenced Publications

3-1 The following documents or portions thereof are referenced within this standard and shall be considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

3-1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 1996 edition.

NFPA 20, *Standard for the Installation of Centrifugal Fire Pumps*, 1996 edition.

NFPA 22, *Standard for Water Tanks for Private Fire Protection*, 1993 edition.

NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*, 1995 edition.

NFPA 72, *National Fire Alarm Code*, 1996 edition.

NFPA 101, *Life Safety Code*, 1994 edition.

NFPA 220, *Standard on Types of Building Construction*, 1995 edition.

NFPA 251, *Standard Methods of Tests of Fire Endurance of Building Construction and Materials*, 1995 edition.

3-1.2 Other Publications.

3-1.2.1 ANSI Publications. American National Standards Institute, Inc., 1450 Broadway, New York, NY 10018.

ANSI B16.1, *Cast Iron Pipe Flanges and Flanged Fittings*, 1989.

ANSI B16.3, *Malleable Iron Threaded Fittings*, 1992.

ANSI B16.4, *Gray Iron Threaded Fittings*, 1992.

ANSI B16.5, *Pipe Flanges and Flanged Fittings*, 1988.

ANSI B16.9, *Factory-Made Wrought Steel Butt Welding Fittings*, 1993.

ANSI B16.11, *Forged Fittings, Socket-Welding and Threaded*, 1991.

ANSI B16.18, *Cast Copper Alloy Solder Joint Pressure Fittings*, 1984.

ANSI B16.22, *Wrought Copper and Copper Alloy Solder Joint Pressure Fittings*, 1989.

ANSI B16.25, *Butt Welding Ends*, 1992.

ANSI B36.10M, *Welded and Seamless Wrought Steel Pipe*, 1985.

3-1.2.2 ASTM Publications. American Society for Testing and Materials, 100 Bar Harbor Drive, West Conshohocken, PA 19428-2959.

ASTM A 53, *Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless*, 1995.

ASTM A 135, *Standard Specification for Electric-Resistance-Welded Steel Pipe*, 1993.

ASTM A 234, *Standard Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and Elevated Temperatures*, 1995.

ASTM A 795, *Standard Specification for Black and Hot-Dipped Zinc-Coated (Galvanized) Welded and Seamless Steel Pipe for Fire Protection Use*, 1995.

ASTM B 32, *Standard Specification for Solder Metal*, 1995.

ASTM B 88, *Standard Specification for Seamless Copper Water Tube*, 1995.

ASTM B 251, *Standard Specification for General Requirements for Wrought Seamless Copper and Copper-Alloy Tube*, 1993.

AWS D10.9, *Specification for Qualification of Welding Procedures and Welders for Piping and Tubing*, 1988.

To be effective, sprinkler systems installed in accordance with this standard need to open the sprinklers closest to the fire before the fire exceeds the ability of the sprinkler discharge to extinguish or control the fire. Conditions that allow the fire to grow beyond that point before sprinkler activation or that interfere with the quality of water distribution can produce conditions beyond the capabilities of the sprinkler system described in this standard. Unusually high ceilings or ceiling configurations that tend to divert the rising hot gases from sprinkler locations or change the sprinkler discharge pattern

Figure A-1-1(a) Bedroom.



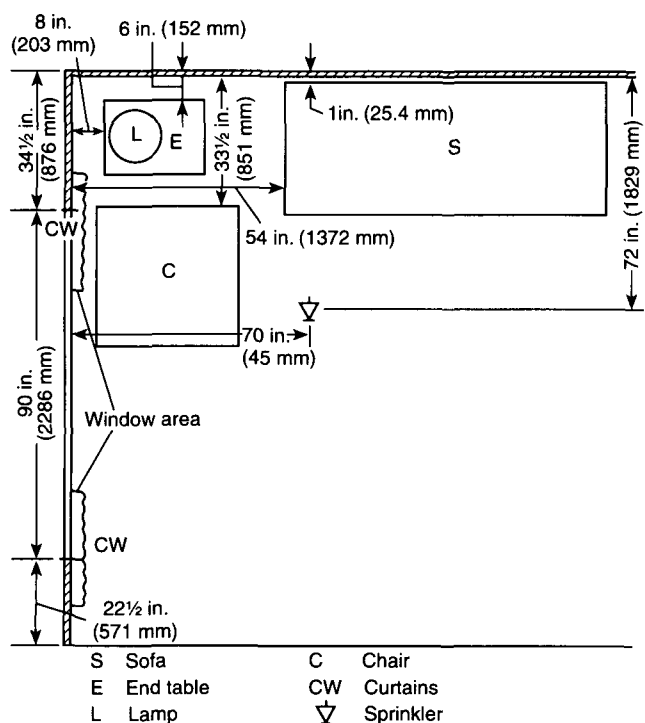


Figure A-1-1(c) Living room.

A-1-2 Levels of Protection. Various levels of sprinkler protection are available to provide life safety and property protection. This standard is designed to provide a high, but not absolute, level of life safety and a lesser level of property protection. Greater protection to both life and property could be achieved by sprinklering all areas in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*, which permits the use of residential sprinklers in residential areas.

This standard recommends, but does not require, sprinklering of all areas in the building; it permits sprinklers to be omitted in certain areas. These areas have been proved by NFPA statistics to be those where the incidence of life loss from fires in residential occupancies is low. Such an approach provides a reasonable degree of fire safety. (See Table A-1-2 for deaths and injuries in multifamily residential buildings.)

It should be recognized that the omission of sprinklers from certain areas could result in the development of untenable conditions in adjacent spaces. Where evacuation times could be delayed, additional sprinkler protection and other fire protection features, such as detection and compartmentation, might be necessary.

A-1-3 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization concerned with product evaluations that is in a position to determine compliance with appropriate standards for the current production of listed items.

A-1-3 Authority Having Jurisdiction. The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

A-1-3 Listed. The means for identifying listed equipment may vary for each organization concerned with product evaluation, some of which do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

A-1-4 For additional conversions and information, see ASTM E 380, *Standard Practice for Use of the International System of Units (SI) (the Modernized Metric System)*.

A-1-5.1 This standard anticipates that the water supply for the system is in compliance with the governing plumbing code for the jurisdiction. It is intended that any pipe material or diameter permitted for multiple family dwellings in the plumbing code and satisfying the hydraulic criteria of NFPA 13R is considered to be in compliance.

A-1-5.2 Not all pipe or tube made to ASTM D 3309, *Standard Specification for Polybutylene (PB) Plastic Hot- and Cold-Water Distribution Systems*, and ASTM F 442, *Standard Specification for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe (SDR-PR)*, as described in 1-5.1 and 1-5.2 is listed for fire sprinkler service. Listed pipe is identified by the logo of the listing agency.

A-1-5.7 Not all fittings made to ASTM F 437, *Standard Specification for Threaded Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80*; ASTM F 438, *Standard Specification for Socket-Type Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 40*; and ASTM F 439 *Standard Specification for Socket-Type Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80*, as described in 1-5.5 and 1-5.7 are listed for fire sprinkler service. Listed fittings are identified by the logo of the listing agency.

A-1-6.2 Listed CPVC sprinkler pipe and fittings should be protected from freezing only with glycerine. The use of diethylene, ethylene, or propylene glycols is specifically prohibited. Laboratory testing shows that glycol-based anti-freeze solutions present a chemical environment detrimental to CPVC. Listed polybutylene sprinkler pipe and fittings can be protected with glycerine, diethylene glycol, ethylene glycol, or propylene glycol.

A-2-1.3.2 Testing of a system can be accomplished by pressurizing the system with water and checking visually for leakage at each joint or coupling.

Where pressure testing systems have rigid thermoplastic piping, such as listed CPVC, or flexible piping, such as listed polybutylene, the sprinkler system should be filled with

Table A-1-2 Fires and Associated Deaths and Injuries in Apartments by Area of Origin; Annual Average of 1986 – 1990 Structure Fires Reported to U.S. Fire Departments

Area of Origin	Civilian Deaths	Civilian (%)	Fires	(%)	Injuries	(%)
Bedroom	309	33.9	17,960	15.8	1714	27.2
Living room, family room, or den	308	33.8	10,500	9.3	1272	20.2
Kitchen	114	12.5	46,900	41.4	1973	31.2
Interior stairway	29	3.2	1040	0.9	91	1.4
Hallway or corridor	23	2.6	3130	2.8	165	2.6
Exterior balcony or open porch	17	1.8	1880	1.7	69	1.1
Dining room	10	1.1	800	0.7	69	1.1
Closet	9	1.0	2120	1.9	116	1.8
Multiple areas	9	1.0	780	0.7	38	0.6
Tool room or other supply storage room or area	8	0.9	1250	1.1	53	0.8
Unclassified area	8	0.9	480	0.4	29	0.5
Exterior stairway	8	0.8	870	0.8	22	0.4
Bathroom	7	0.7	2510	2.2	101	1.6
Heating equipment room or area	6	0.6	2510	2.2	75	1.2
Exterior wall surface	5	0.5	2150	1.9	26	0.4
Laundry room or area	4	0.4	3380	3.0	89	1.4
Crawl space or substructure space	4	0.4	1490	1.3	62	1.0
Wall assembly or concealed space	3	0.4	1020	0.9	21	0.3
Attic or ceiling/roof assembly or concealed space	3	0.3	1100	1.0	18	0.3
Ceiling/floor assembly or concealed space	3	0.3	560	0.5	18	0.3
Garage or carport ¹	3	0.3	1290	1.1	36	0.6
Lobby or entrance way	3	0.3	670	0.6	31	0.5
Unclassified structural area	3	0.3	520	0.5	32	0.5
Unclassified storage area	3	0.3	430	0.4	22	0.3
Unclassified function area	3	0.3	250	0.2	13	0.2
Laboratory	2	0.3	80	0.1	3	0.0
Elevator or dumbwaiter	1	0.2	220	0.2	4	0.1
Sales or showroom area	1	0.2	110	0.1	3	0.1
Exterior roof surface	1	0.1	1040	0.9	15	0.2
Unclassified means of egress	1	0.1	180	0.2	6	0.1
Office	1	0.1	120	0.1	4	0.1
Chimney	1	0.1	980	0.9	2	0.0
Personal service area	1	0.1	40	0.0	4	0.1
Library	1	0.1	10	0.0	0	0.0
Other known area	2	0.2	5000	4.4	115	1.8
Total	912	100.0	113,390	100.0	6313	100.0

¹Does not include dwelling garages coded as a separate property.

NOTE: Fires are estimated to the nearest 10; civilian deaths and injuries are estimated to the nearest 1.

Source: 1986–1990 NFIRS and NFPA Survey.


water. The air should be bled from the highest and farthest sprinklers before the test pressure is applied. Compressed air or compressed gas never should be used for pressure testing CPVC piping. Testing with air pressure may be permitted for polybutylene piping where conducted in accordance with the testing procedures of 8-2.3 of NFPA 13, *Standard for the Installation of Sprinkler Systems*.

Fire department connections are not required for all systems covered by this standard but can be installed at the discretion of the owner. In these cases, hydrostatic tests in accordance with NFPA 13 are required.

Dry systems also should be tested by placing the system under air pressure. Any leak that results in a drop in system pressure greater than 2 psi (0.14 bar) in 24 hours should be corrected. Leaks should be identified using soapy water brushed on each joint or coupling. The presence of bubbles indicates a leak. This test should be made prior to concealing the piping.


A-2-2.1.4 These connections should be installed so that the valve can be opened fully and for a sufficient time period to ensure a proper test without causing water damage. The test connection should be designed and sized to verify the sufficiency of the water supply and alarm mechanisms.

A-2-3.2 The connection to city mains for fire protection is often subject to local regulation of metering and backflow prevention requirements. Preferred and acceptable water supply arrangements are shown in Figures A-2-3.2(a), (b), and (c). Where it is necessary to use a meter between the city water main and the sprinkler system supply, an acceptable arrangement as shown in Figure A-2-3.2(c) can be used. Under these circumstances, the flow characteristics of the meter are to be included in the hydraulic calculation of the system. Where a tank is used for both domestic and fire protection purposes, a low water alarm that actuates when the water level falls below 110 percent of the minimum quantity specified in 2-3.1 should be provided.

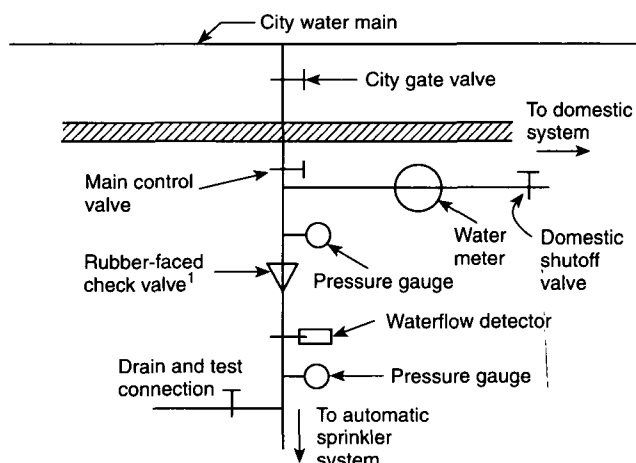

¹Rubber-faced check valves are optional.

Figure A-2-3.2(a) Preferable arrangement.

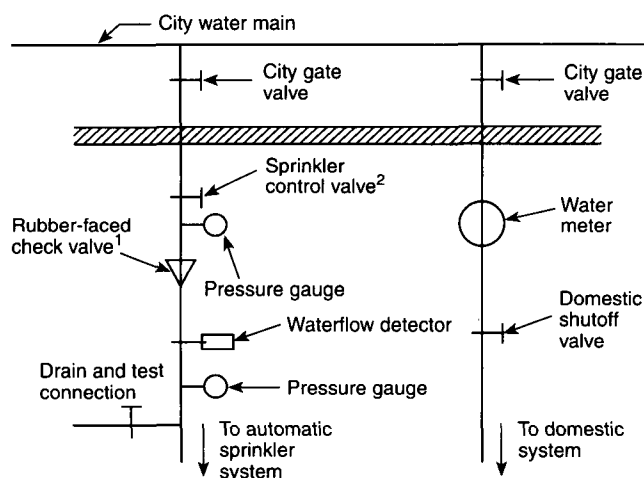


¹Rubber-faced check valves are optional.

²Option: See 2-4.1.1, Exception.

Figure A-2-3.2(b) Acceptable arrangement with valve supervision (see 2-4.1.1, Exception).

A-2-3.3.1 Tables A-2-3.3.1(a) and (b) can be used to determine a domestic design demand. Using Table A-2-3.3.1(a), the total number of water supply fixture units downstream of any point in the piping serving both sprinkler and domestic needs is determined. Using Table A-2-3.3.1(b), the appropriate total flow allowance is determined and added to the sprinkler demand at the total pressure required for the sprinkler system at that point.

A-2-4.4 Sprinkler piping should be adequately secured to restrict the movement of piping upon sprinkler operation. The reaction forces caused by the flow of water through the sprinkler could result in displacement of the sprinkler, thereby adversely affecting sprinkler discharge. Listed CPVC pipe and listed polybutylene pipe have specific requirements for piping support to include additional pipe bracing at sprinklers.

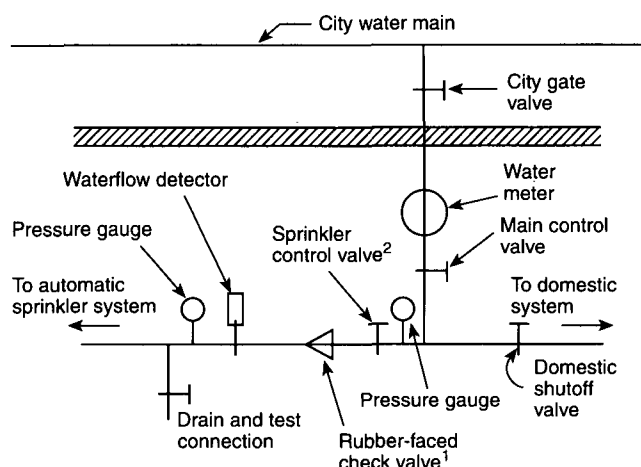

¹Rubber-faced check valves are optional.

²Option: See 2-4.1.1, Exception.

Figure A-2-3.2(c) Acceptable arrangement with valve supervision (see 2-4.1.1, Exception).

Table A-2-3.3.1(a) Fixture Load Values

Private Facilities (within individual dwelling units)	Unit
Bathroom group with flush tank (including lavatory, water closet, and bathtub with shower)	6
Bathroom group with flush valve	8
Bathtub	2
Dishwasher	1
Kitchen sink	2
Laundry trays	3
Lavatory	1
Shower stall	2
Washing machine	2
Water closet with flush valve	6
Water closet with flush tank	3
Public Facilities	
Bathtub	4
Drinking fountain	0
Kitchen sink	4
Lavatory	2
Service sink	3
Shower head	4
Urinal with 1-in. (25.4-mm) flush valve	10
Urinal with 3/4-in. (19-mm) flush valve	5
Urinal with flush tank	3
Washing machine [8 lb (17.6 kg)]	3
Washing machine [16 lb (35.2 kg)]	4
Water closet with flush valve	10
Water closet with flush tank	5

A-2-4.5.8.2 Decorative painting of a residential sprinkler is not to be confused with the temperature identification colors as referenced in 2-2.3 of NFPA 13, *Standard for the Installation of Sprinkler Systems*.

A-2-5.1.2 It is intended that the design area is to include up to four adjacent sprinklers that produce the greatest water demand within the compartment. [See Figures A-2-5.1.2(a) and (b).]

Table A-2-3.3.1(b) Total Estimated Domestic Demand

Total Fixture Load Units [from Table A-2-3.3.1(a)]	Total Demand			
	For Systems with Predominately Flush Tanks		For Systems with Predominately Flush Valves	
	(gpm)	(L/min)	(gpm)	(L/min)
1	3	11.25	—	—
2	5	18.75	—	—
5	10	37.5	15	56
10	15	56	25	94
20	20	75	35	131
35	25	94	45	169
50	30	113	50	187
70	35	131	60	225
100	45	169	70	262
150	55	200	80	300
200	65	244	90	337
250	75	261	100	375
350	100	375	125	469
500	125	469	150	562
750	175	656	175	656
1000	200	750	200	750
1500	275	1031	275	1031
2000	325	1219	325	1219
3500	500	1875	500	1875

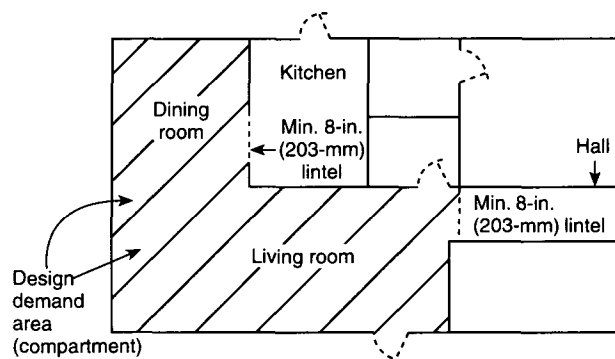


Figure A-2-5.1.2(a) Sprinkler design areas for typical residential occupancy.

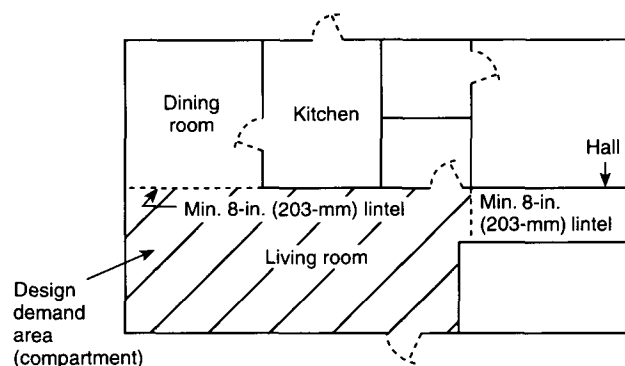


Figure A-2-5.1.2(b) Sprinkler design areas for typical residential occupancy.

A-2-5.1.2.1 Residential sprinklers are currently listed for use under flat, smooth, horizontal ceilings only. Sloped, beamed, and pitched ceilings could require special design features such as larger flows or a design for five or more sprinklers to operate in the compartment.

A-2-5.1.7.3 Fire testing has indicated the need to wet walls in the area protected by residential sprinklers at a level closer to the ceiling than that accomplished by standard sprinkler distribution. Where beams, light fixtures, sloped ceilings, and other obstructions occur, additional residential sprinklers might be necessary to achieve proper response and distribution, and a greater water supply might be necessary. Table A-2-5.1.7.3 and Figure A-2-5.1.7.3 provide guidance for the location of sprinklers near ceiling obstructions.


Small areas created by architectural features such as planter box windows, bay windows, and similar features can be evaluated as follows:

(a) Where no additional floor area is created by the architectural feature, no additional sprinkler protection is required; or

(b) Where additional floor area is created by an architectural feature, no additional sprinkler protection is required, provided all of the following conditions are met:

1. The floor area does not exceed 18 ft² (1.7 m²);
2. The floor area is not greater than 2 ft (0.65 m) in depth at the deepest point of the architectural feature to the plane of the primary wall where measured along the finished floor; and
3. The floor is not greater than 9 ft (2.9 m) in length where measured along the plane of the primary wall.

Measurement from the deepest point of the architectural feature to the sprinkler should not exceed the maximum listed spacing of the sprinkler. The hydraulic design is not required to consider the area created by the architectural feature.

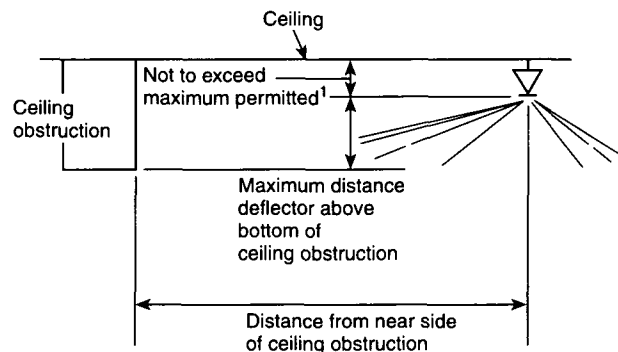

¹See 2-5.1.7.1 and 2-5.1.2.

Figure A-2-5.1.7.3 Position of deflector, upright or pendent, where located above bottom of ceiling obstruction.

A-2-7 The responsibility for properly maintaining a sprinkler system is that of the owner or manager, who should understand the sprinkler system operation. A minimum monthly maintenance program should include:

- (a) Visual inspection of all sprinklers to ensure against obstruction of spray.
- (b) Inspection of all valves to ensure that they are open.
- (c) Testing of all waterflow devices.
- (d) Testing of the alarm system, where installed.

NOTE: Where it is likely that the test will result in a fire department response, notification to the fire department should be made prior to the test.

Table A-2-5.1.7.3 Maximum Distance from Sprinkler Deflector to Bottom of Ceiling Obstruction

Distance from Sprinkler to Side of Ceiling Obstruction		Maximum Distance from Sprinkler Deflector to Bottom of Ceiling Obstruction	
		(in.)	(mm)
< 6 in.	< 152 mm	Not permitted	
6 in. to < 1 ft	152 mm to < 305 mm	0	0
1 ft to < 2 ft	0.32 m to < 0.64 m	1	25.4
2 ft to < 2 ft 6 in.	0.64 m to < 0.80 m	2	51
2 ft 6 in. to < 3 ft	0.80 m to < 0.97 m	3	76
3 ft to < 3 ft 6 in.	0.97 m to < 1.13 m	4	102
3 ft 6 in. to < 4 ft	1.13 m to < 1.29 m	6	152
4 ft to < 4 ft 6 in.	1.29 m to < 1.45 m	7	178
4 ft 6 in. to < 5 ft	1.45 m to < 1.61 m	9	229
5 ft to < 5 ft 6 in.	1.61 m to < 1.77 m	11	279
5 ft 6 in. to < 6 ft	1.77 m to < 1.93 m	14	356

(e) Operation of pumps, where employed. (See NFPA 20, *Standard for the Installation of Centrifugal Fire Pumps*.)

(f) Checking of the pressure of air used with dry systems.

(g) Checking of the water level in tanks.

(h) Special attention to ensure that sprinklers are not painted either at the time of installation or during subsequent redecoration. When sprinkler piping or areas next to sprinklers are being painted, the sprinklers should be protected by covering them with a bag, which should be removed immediately after painting is finished.

(For further information, see NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*.)

Appendix B Referenced Publications

B-1 The following documents or portions thereof are referenced within this standard for informational purposes

only and thus are not considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

B-1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 1996 edition.

NFPA 20, *Standard for the Installation of Centrifugal Fire Pumps*, 1996 edition.

NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*, 1995 edition.

B-1.2 Other Publications.

B-1.2.1 ASTM Publications. American Society for Testing and Materials, 100 Bar Harbor Drive, West Conshohocken, PA 19428-2959.

ASTM D 3309, *Standard Specification for Polybutylene (PB) Plastic Hot- and Cold-Water Distribution Systems*, 1995.

ASTM E 380, *Standard Practice for Use of the International System of Units (SI) (the Modernized Metric System)*, 1993.

ASTM F 437, *Standard Specification for Threaded Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80*, 1993.

ASTM F 438, *Standard Specification for Socket-Type Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 40*, 1993.

ASTM F 439, *Standard Specification for Socket-Type Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80*, 1993.

ASTM F 442, *Standard Specification for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe (SDR-PR)*, 1994.

Index

© 1996 National Fire Protection Association, All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document which it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of the National Fire Protection Association, Inc.

-A-	-B-
Acceptance tests	Barriers, thermal (definition) 1-3
Contractor's Material and Test Certificates 2-1.2.1	Bedrooms Figs. A-1-1(a) to (b)
Hydrostatic pressure tests 2-1.3.2, A-2-1.3.2	Brazed joints 1-5.6
Underground mains and connections, flushing 2-1.3.1 to 2-1.3.1.3	
Alarms	-C-
System supervision by 2-4.1.1	Ceiling plates, nonmetallic 2-4.5.7
Waterflow 2-4.6	Ceilings, sprinkler obstructions and 2-5.1.7.3, A-2-5.1.2.1, A-2-5.1.7.3
Definition 1-3	Check valves (definition) 1-3
Antifreeze systems 1-6.2	Chlorinated polyvinyl chloride (CPVC) piping
Apartments, fire-associated deaths/injuries, statistics	Antifreeze solutions A-1-6.2
by area of origin, 1986-90 Table A-1-2	Materials/dimensions 1-5.2
Approved/approvals 2-1.2	Support A-2-4.4
Definition 1-3, A-1-3	Testing A-2-1.3.2
Authority having jurisdiction (definition) 1-3, A-1-3	Compartment 2-5.1.2.1, A-2-5.1.2.1
	Outside dwelling units 2-5.2
	Residential sprinklers 2-4.5.4

Connections		
Fire department	2-4.2, A-2-1.3.2	
Nonfire protection	2-3.3.2	
Underground, flushing	2-1.3.1	
Waterflow test	2-2.1.4, A-2-2.1.4	
Contractor's Material and Test Certificates	2-1.2.1	
Control valves		
Common supply main	2-4.1.1	
Definition	1-3	
Copper piping	1-5.2, 1-5.5 to 1-5.6	
Coverage, sprinkler	2-5.1.4	
	-D-	
Definitions	1-3, A-1-3	
Deflectors, positioning	2-5.1.7.1, 2-5.1.7.2, Fig. A-2-5.1.7.3	
Design, sprinkler system	2-5	
Design discharge	1-3, 2-5.1.1	
Devices and materials	2-2.1	
Domestic design demand	2-3.3.1, A-2-3.3.1	
Inside dwelling units	2-5.1, A-2-5.1	
Location of sprinklers	2-6	
Outside dwelling units	2-5.2	
Pipe sizing	2-5.3	
Diethylene	A-1-6.2	
Domestic design demand	2-3.3.1, A-2-3.3.1	
Drains	2-4.1	
Dry pipe sprinkler systems	2-4.5.1	
Definition	1-3	
Installation	1-6.2	
Testing	A-2-1.3.2	
Dwelling units		
Definition	1-3	
Inside, sprinkler system design	2-5.1, A-2-5.1.2, A-2-5.1.2.1, A-2-5.1.7.3	
Outside, sprinkler system design	2-5.2	
Sprinklers	2-4.5.1	
	-E-	
Elevated tanks	2-3.2(b)	
Escutcheons	2-4.5.7	
Ethylene	A-1-6.2	
	-F-	
Fire department connections	2-4.2, A-2-1.3.2	
Fires, associated deaths/injuries in apartments, statistics by area of origin, 1986-90	Table A-1-2	
Fittings	1-5.4 to 1-5.7, Table 1-5.7, A-1-5.7	
Flushing of underground mains and connections	2-1.3.1	
Freezing, protection from		
Piping	1-6.2, A-1-6.2	
Valves and drains	2-4.1.3	
	-G-	
Gauges, pressure	2-4.3	
Glycerine	A-1-6.2	
	-H-	
Hydrostatic pressure tests	2-1.3.2, A-2-1.3.2	
	-I-	
Installation, sprinkler system		
Devices and materials	2-2.1	
Residential sprinklers	2-4.5.2.3, 2-4.5.4	
Waterflow test connections	A-2-2.1.4	
	-J-	
Joints	1-5.4 to 1-5.7	
	-L-	
Labeled (definition)	1-3	
Levels of protection	A-1-2	
Listed (definition)	1-3, A-1-3	
Living room	Fig. A-1-1(c)	
	-M-	
Mains		
Control valves	2-4.1.1	
Underground, flushing	2-1.3.1	
Maintenance, system	2-7, A-2-7	
Measurement, units of	1-4	
Mobile home bedroom	Fig. A-1-1(b)	
Multipurpose piping systems		
Definition	1-3	
Water supply	2-3.3 to 2-3.3.2, A-2-3.3.1	
	-N-	
Nonfire protection connections	2-3.3.2	
Number of design sprinklers	2-5.1.2, A-2-5.1.2	
	-O-	
Obstructions to sprinklers	2-5.1.7.3, A-2-5.1.2.1, A-2-5.1.7.3	
Ornamental finishes	see Painting/ornamental finishes	
	-P-	
Painting/ornamental finishes	2-4.5.8, A-2-4.5.8.2	
Pendent sprinklers	1-6.2.1, 2-5.1.7.1, Fig. A-2-5.1.7.3	
Piping	1-5, A-1-5; see also Chlorinated polyvinyl chloride (CPVC) piping; Multipurpose piping systems; Polybutylene piping; Steel piping	
Freezing, protection from	1-6.2, A-1-6.2	
Materials/dimensions	1-5.1 to 1-5.2, Tables 1-5.1 and 1-5.2, A-1-5.1	
Sizing	2-5.3	
Support	2-4.4, A-2-4.4	
Polybutylene piping		
Antifreeze solutions	A-1-6.2	
Materials/dimensions	1-5.2	
Support	A-2-4.4	
Testing	A-2-1.3.2	
Precision sprinkler systems		
Definition	1-3	
Installation	1-6.2	
Pressure gauges	2-4.3	
Pressure tanks	2-3.2(c)	
Propylene glycol	A-1-6.2	
Protection, levels of	A-1-2	
Pumps, water	2-3.2(a), 2-3.2(d)	
Purpose of the standard	1-2, A-1-2	
	-Q-	
Quick-response sprinklers	2-4.5.1, 2-4.5.5	
	-R-	
Referenced publications	Chap. 3, B-1	
Replacement of sprinklers/parts	2-2.1.1, 2-4.5.3, 2-4.5.6	
Residential occupancies		
Definition	1-3	
Sprinkler design areas	Figs. A-2-5.1.2(a) and (b)	