

NFPA 251
Standard Methods
of Tests of
Fire Endurance of
Building Construction
and Materials
1995 Edition



NOTICE

All questions or other communications relating to this document should be sent only to NFPA headquarters, addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable federal, state and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action that is not in compliance with applicable laws, and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision—This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference—Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders, or similar instruments. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term “adoption by reference” means the citing of title and publishing information only.

2. Adoption by Transcription—A. Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders, or similar instruments having the force of law, provided that: (1) due notice of NFPA’s copyright is contained in each law and in each copy thereof; and (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction’s lawmaking or rule-making process. B. Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rule-making powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately, provided that due notice of NFPA’s copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rule-making powers may apply for and may receive a special royalty where the public interest will be served thereby.

3. Scope of License Grant—The terms and conditions set forth above do not extend to the index to this document.

(For further explanation, see the Policy Concerning the Adoption, Printing, and Publication of NFPA Documents, which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accept any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document, and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

Copyright © 1995 NFPA, All Rights Reserved

NFPA 251

Standard Methods of Tests of Fire Endurance of Building Construction and Materials

1995 Edition

This edition of NFPA 251, *Standard Methods of Tests of Fire Endurance of Building Construction and Materials*, was prepared by the Technical Committee on Fire Tests and acted on by the National Fire Protection Association, Inc., at its Annual Meeting held May 22-25, 1995, in Denver, CO. It was issued by the Standards Council on July 21, 1995, with an effective date of August 11, 1995, and supersedes all previous editions.

This edition of NFPA 251 was approved as an American National Standard on August 11, 1995.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

Origin and Development of NFPA 251

NFPA 251 originated in the recommendations of the International Fire Prevention Congress in London in 1903. It was presented to the NFPA by the Committee on Fire-Resistive Construction in 1914. It was adopted officially in a revised form in 1918. Successive editions were published in 1918, 1926, 1934, 1941, 1955, 1958, 1959, 1960, 1961, 1963, 1969, 1979, 1985, and 1990. It was overseen, in succession, by the Technical Committee on Fire-Resistive Construction, the Technical Committee on Building Construction, and, for the last three editions, by the Technical Committee on Fire Tests.

The 1995 edition of this document is a reconfirmation of the earlier edition with only a few items being addressed. Substantial investigation and record research was done on the topic of the hose stream application on test specimens. The findings of the committee could not support modification of the provision that permits a test assembly to be tested one-half the time required for an hourly rating and then to be tested by a hose stream.

The committee also chose to modify the title of this document in response to the research done to convey a truer sense of the standard's proper application.

Technical Committee on Fire Tests

Jesse J. Beitel, *Chair*
Hughes Assoc. Inc., MD

Peter J. Barbadoro, Westinghouse Savannah River Co., SC
April L. Berkol, ITT Sheraton Corp., MA
 Rep. American Hotel & Motel Assn.
John A. Blair, The DuPont Co., DE
 Rep. Society of the Plastics Industry
William P. Chien, State of NY Dept. of Fire Prevention & Control, NY
William E. Fitch, Omega Point Laboratories Inc., TX
Thomas W. Fritz, Armstrong World Industries Inc., PA
Jeffrey E. Gould, Factory Mutual Research Corp., MA
Alfred J. Hogan, Reedy Creek Improvement District, FL
 Rep. Fire Marshals Assn. of North America
Wayne D. Holmes, HSB Professional Loss Control Inc., PA
Karl D. Houser, Gypsum Assn., DC
Marc L. Janssens, American Forest & Paper Assn., DC
James R. Lawson, U.S. Nat'l Inst. of Standards and Technology, MD

Gerald E. Lingenfelter, American Insurance Services Group Inc., NY
George E. Meyer, Warnock Hersey Int'l Inc., CA
John W. Michener, Milliken Research Corp., SC
 Rep. American Textile Mfrs. Inst. Inc.
James A. Milke, University of Maryland, MD
James C. Norris, Union Carbide, PA
Leon Przybyla, Underwriters Laboratories Inc., IL
Sivon C. Reznikoff, Arizona State University, AZ
John Roberts, Underwriters Laboratories of Canada, ON
Howard Stacy, Southwest Research Inst., TX
Herman Stone, General Foam, PA
T. Hugh Talley, Hugh Talley Co., TN
 Rep. Upholstered Furniture Action Council
Richard P. Thornberry, The Code Consortium, Inc., CA
Robert J. Wills, American Iron & Steel Inst., AL
Peter J. Gore Willse, Industrial Risk Insurers, CT

Alternates

Peter H. Billing, American Forest & Paper Assn., FL
 (Alt. to M. L. Janssens)
Delbert F. Boring, Jr., American Iron & Steel Inst., OH
 (Alt. to R. J. Wills)
Tony Crimi, Underwriters Laboratories of Canada, ON
 (Alt. to J. Roberts)
Philip J. DiNenno, Hughes Assoc. Inc., MD
 (Alt. to J. J. Beitel)
Richard D. Gottwald, Society of the Plastics Industry, DC
 (Alt. to J. A. Blair)
Arthur J. Parker, Southwest Research Inst., TX
 (Alt. to H. Stacy)

R. Joseph Pearson, Inchcape Testing Services, Warnock Hersey Int'l, NY
 (Alt. to G. E. Meyer)
William A. Thornberg, Industrial Risk Insurers, CT
 (Alt. to P. J. G. Willse)
James J. Urban, Underwriters Laboratories Inc., IL
 (Alt. to L. Przybyla)
Kay M. Villa, American Textile Mfrs. Inst., DC
 (Alt. to J. W. Michener)
Joe Ziolkowski, American Furniture Mfrs. Assoc., NC
 (Alt. to T. H. Talley)

Nonvoting

A. J. Bartosic, Rohm & Haas Co., PA

Herman H. Spaeth, CA
 (Member Emeritus)

Walter P. Sterling, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on fire testing procedures when such standards are not available; for reviewing existing fire test standards and recommending appropriate action to NFPA; for recommending the application of and advising on the interpretation of acceptable test standards for fire problems of concern to NFPA technical committees and members; and for acting in a liaison capacity between NFPA and the committees of other organizations writing fire test standards. This committee does not cover fire tests that are used to evaluate extinguishing agents, devices, or systems.

Contents

Chapter 1 General	251- 4	Chapter 10 Tests of Loaded Restrained Beams	251-10
1-1 Scope	251- 4	10-1 Application	251-10
1-2 Purpose	251- 4	10-2 Size and Characteristics of Specimen . .	251-10
1-3 Significance	251- 4	10-3 Loading	251-11
1-4 Definitions	251- 4	10-4 Conditions of Acceptance	251-11
Chapter 2 Control of Fire Tests	251- 4	Chapter 11 Alternative Classification Procedure for Loaded Beams	251-11
2-1 Temperature—Time Curve	251- 4	11-1 Application	251-11
2-2 Furnace Temperatures	251- 4	11-2 Temperature Measurement	251-11
2-3 Temperatures of Unexposed Surfaces of Floors, Roofs, Walls, and Partitions . . .	251- 5	11-3 Conditions of Acceptance	251-11
2-4 Furnace Pressure	251- 5	Chapter 12 Alternative Test of Protection for Solid Structural Steel Beams and Girders	251-11
Chapter 3 Test Specimen	251- 6	12-1 Application	251-11
3-1 Specimen	251- 6	12-2 Size and Character of Specimen	251-11
3-2 Protection and Conditioning of Test Specimen	251- 6	12-3 Temperature Measurement	251-11
Chapter 4 Conduct of Fire Tests	251- 7	12-4 Conditions of Acceptance	251-11
4-1 Fire Endurance Test	251- 7	Chapter 13 Performance of Protective Membranes in Wall, Partition, Floor, or Roof Assemblies	251-12
4-2 Hose Stream Test	251- 7	13-1 Application	251-12
Chapter 5 Tests of Bearing Walls and Partitions	251- 7	13-2 Characteristics and Size of Sample . . .	251-12
5-1 Size of Specimen	251- 7	13-3 Temperature Performance of Protective Membranes	251-12
5-2 Loading	251- 7	13-4 Conditions of Performance	251-12
5-3 Conditions of Acceptance	251- 7	Chapter 14 Report of Results	251-12
Chapter 6 Tests of Nonbearing Walls and Partitions	251- 8	14-1 Classification as Determined by Test . .	251-12
6-1 Size of Specimen	251- 8	14-2 Test of Floor and Roof Assemblies . . .	251-12
6-2 Conditions of Acceptance	251- 8	14-3 Performance of Protective Membranes . .	251-13
Chapter 7 Tests of Columns	251- 8	14-4 Tests of Load-Bearing Assemblies . . .	251-13
7-1 Size of Specimen	251- 8	Chapter 15 Referenced Publications	251-13
7-2 Loading	251- 8	Appendix A Explanatory Material	251-13
7-3 Conditions of Acceptance	251- 8	Appendix B Standard Temperature-Time Curve for Control of Fire Tests	251-15
Chapter 8 Alternative Test of Protection for Structural Steel Columns	251- 8	Appendix C Recommendations for Thermocouple Pads	251-16
8-1 Application	251- 8	Appendix D Sample Report Form	251-16
8-2 Size and Character of Specimen	251- 8	Appendix E Guide for Determining Conditions of Restraint for Floor and Roof Assemblies and for Individual Beams	251-17
8-3 Temperature Measurement	251- 8	Appendix F Method of Correcting Fire Endurance for Concrete Slabs Determined by Unexposed Surface Temperature Rise for Nonstandard Moisture Content	251-18
8-4 Exposure to Fire	251- 8	Appendix G Commentary	251-20
8-5 Conditions of Acceptance	251- 8	Appendix H Referenced Publications	251-24
Chapter 9 Tests of Floor and Roof Assemblies	251- 9	Index	251-24
9-1 Application	251- 9		
9-2 Size and Characteristics of Specimen . . .	251- 9		
9-3 Loading	251- 9		
9-4 Temperature Measurement	251- 9		
9-5 Conditions of Acceptance — Restrained Assembly	251-10		
9-6 Conditions of Acceptance — Unrestrained Assembly	251-10		

NFPA 251**Standard Methods of Tests of Fire Endurance of
Building Construction and Materials****1995 Edition**

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates explanatory material on that paragraph in Appendix A.

Information on referenced publications can be found in Chapter 15 and Appendix H.

Chapter 1 General**1-1* Scope.**

1-1.1 These methods of fire tests shall apply to assemblies of masonry units and to composite assemblies of structural materials for buildings, including bearing and other walls and partitions, columns, girders, beams, slabs, and composite slab and beam assemblies for floors and roofs. They also shall apply to other assemblies and structural units that constitute permanent integral parts of a finished building.

1-1.2* It is intended that classifications shall be based on performance during the period of exposure and shall not be used to determine suitability for use after fire exposure.

1-1.3 The results of these tests are one factor in assessing fire performance of building construction and assemblies. These methods prescribe a standard fire exposure for comparing the performance of building construction assemblies. Application of these test results to predict the performance of actual building construction requires careful evaluation of test conditions.

1-2 Purpose. This standard outlines methods of fire test for the fire-resistive properties of building members and assemblies.

1-3 Significance.

1-3.1 This standard is intended to evaluate the duration for which the types of assemblies noted in Section 1-1 contain a fire, retain their structural integrity, or exhibit both properties, depending on the type of assembly involved during a predetermined test exposure.

1-3.2 The test exposes a specimen to a standard fire exposure controlled to achieve specified temperatures throughout a specific time period. In some instances, the fire exposure is followed by the application of a specified standard fire hose stream. The exposure, however, shall not be considered representative of all fire conditions, which vary with changes in the amount, nature, and distribution of fire loading, ventilation, compartment size and configuration, and heat sink characteristics of the compartment. The test does, however, provide a relative measure of fire performance of comparable assemblies under these specified fire exposure conditions. Any variation from the construction or conditions (i.e., size, method of assembly, and materials) that are tested substantially varies the performance characteristics of the assembly.

1-3.3 The test standard provides the following:

- (a) In walls, partitions, and floor or roof assemblies:
 1. Measurement of the transmission of heat;
 2. Measurement of the transmission of hot gases through the assembly sufficient to ignite cotton waste;
 3. Measurement of the load-carrying ability of the test specimen during the test exposure where load-bearing elements are included.
- (b) For individual load-bearing assemblies such as beams and columns, measurement of the load-carrying ability under the test exposure with some consideration for the end support conditions (i.e., restrained or unrestrained) is provided.

1-3.4 The test standard does not provide the following:

- (a) Full information on the performance of assemblies constructed with components or lengths other than those tested;
- (b) Evaluation of the degree to which the assembly contributes to the fire hazard by generation of smoke, toxic gases, or other products of combustion;
- (c) Measurement of the degree of control or limitation of the passage of smoke or products of combustion through the assembly;
- (d) Simulation of the fire behavior of joints between building elements, such as floor-to-wall or wall-to-wall, connections;
- (e) Measurement of flame spread over the surface of the tested element;
- (f) The effect on fire endurance of conventional openings in the assembly (i.e., electrical receptacle outlets, plumbing pipe) unless specifically provided for in the construction tested.

1-4 Definitions.

Shall. Indicates a mandatory requirement.

Should. Indicates a recommendation or that which is advised but not required.

Chapter 2 Control of Fire Tests**2-1 Temperature—Time Curve.**


2-1.1 The conduct of fire tests of materials and construction shall be controlled by the standard temperature—time curve shown in Figure 2-1.1. The points on the curve that determine its character are provided.

2-1.2 For a more precise definition of the temperature—time curve, see Appendix B.

2-1.3 The temperature inside the furnace shall be ambient when the test begins.

2-2* Furnace Temperatures.

2-2.1* The temperature fixed by the curve shall be deemed to be the average temperature obtained from the readings of not less than nine thermocouples for a floor, roof, wall, or partition and not less than eight thermocouples for a structural column, symmetrically disposed and

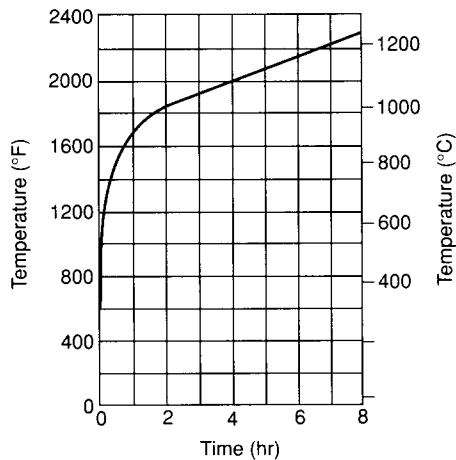

1000°F (538°C).....	at 5 minutes
1300°F (704°C).....	at 10 minutes
1550°F (843°C).....	at 30 minutes
1700°F (927°C).....	at 1 hour
1850°F (1010°C).....	at 2 hours
2000°F (1093°C).....	at 4 hours
2300°F (1260°C).....	at 8 hours
	or over

Figure 2-1.1 Temperature—time curve.

distributed to show the temperature near all parts of the sample, the thermocouples being enclosed in protection tubes of such materials and dimensions that the time constant of the protected thermocouple assembly lies within the range of 5.0 minutes to 7.2 minutes. The exposed length of the pyrometer tube and thermocouple in the furnace chamber shall be not less than 12 in. (305 mm). Other types of protecting tubes or pyrometers shall be permitted to be used that, under test conditions, provide the same time range specified above within the accuracy requirement that applies for the measurement of furnace temperature. For floors and columns, the junction of the thermocouples shall be placed 12 in. (305 mm) away from the exposed face of the specimen at the beginning of the test and, during the test, shall not touch the sample as a result of its deflection. In the case of walls and partitions, the thermocouples shall be placed 6 in. (152 mm) away from the exposed face of the specimen at the beginning of the test and shall not touch the specimen during the test in the event of deflection.

2-2.2 The temperatures shall be measured at intervals not exceeding 1 minute during the test period.

2-2.3 The accuracy of the furnace control shall be such that the area under the temperature—time curve, obtained by averaging the results from the pyrometer readings, is within 10 percent of the corresponding area under the standard temperature—time curve shown in Figure 2-1.1 for fire tests of 1 hour or less, within 7.5 percent for those over 1 hour and not more than 2 hours, and within 5 percent for tests exceeding 2 hours.

2-3 Temperatures of Unexposed Surfaces of Floors, Roofs, Walls, and Partitions.

2-3.1* Temperatures of unexposed surfaces shall be measured with thermocouples placed under dry, felted pads. The properties of these pads shall meet the requirements

of Appendix C. The wire leads of the thermocouple shall have an immersion under the pad and shall be in contact with the unexposed surface for not less than $3\frac{1}{2}$ in. (90 mm). The hot junction of the thermocouple shall be placed approximately under the center of the pad. The outside diameter of protecting or insulating tubes shall be not more than $\frac{5}{16}$ in. (8 mm). The pad shall be held firmly against the surface and shall fit closely about the thermocouples. The wires for the thermocouple in the length covered by the pad shall be not heavier than No. 18 AWG [0.04 in. (1.02 mm)] and shall be electrically insulated with heat-resistant and moisture-resistant coatings.

2-3.2 Temperature measurements shall be obtained from at least nine points on the surface, as follows:

(a) Five thermocouples shall be symmetrically disposed; one shall be located approximately at the center of the specimen and four shall be located approximately at the center of each quadrant. The other four thermocouples shall be located at the discretion of the testing authority to obtain representative information on the performance of the construction under test.

(b) All of the thermocouples shall be located at a distance of at least $1\frac{1}{2}$ times the thickness of the construction or 12 in. (305 mm) from the edges of the test specimen.

Exception: Where an element of the assembly is located near the edge only.

(c) None of the thermocouples shall be located opposite or on top of beams, girders, pilasters, or other structural members if temperatures at such points are obviously lower than at more representative locations.

(d) None of the thermocouples shall be located opposite or on top of fasteners such as screws, nails, or staples that are obviously higher or lower in temperature than at more representative locations if the aggregate area of any part of such fasteners projected to the unexposed surface is less than 1 percent of the area within any 6-in. (152-mm) diameter circle. Such fasteners shall not be required to extend through the assembly.

2-3.3 Temperature readings shall be measured at intervals not exceeding 1 minute.

2-3.4 Where the conditions of acceptance place a limitation on the rise of the temperature of the unexposed surface, the temperature end point of the fire endurance period shall be determined by the average of the measurements taken at individual points.

Exception: Where a temperature rise of 30 percent in excess of the specified limit occurs at any one of these points, all other points shall be ignored and the fire endurance period shall be judged as ended.

2-4 Furnace Pressure.

2-4.1 The pressure-sensing probes shall be as shown in Figure 2-4.1(a) or (b).

2-4.2 The pressure shall be measured using a differential pressure instrument capable of reading in increments no coarser than 0.01 in. wg (2.5 Pa) with a precision of not less than ± 0.005 in. wg (± 1.25 Pa). The differential pressure measurement instrument(s) shall be located to minimize "stack" effects caused by vertical runs of pressure tubing between the furnace probe(s) and instrument locations.

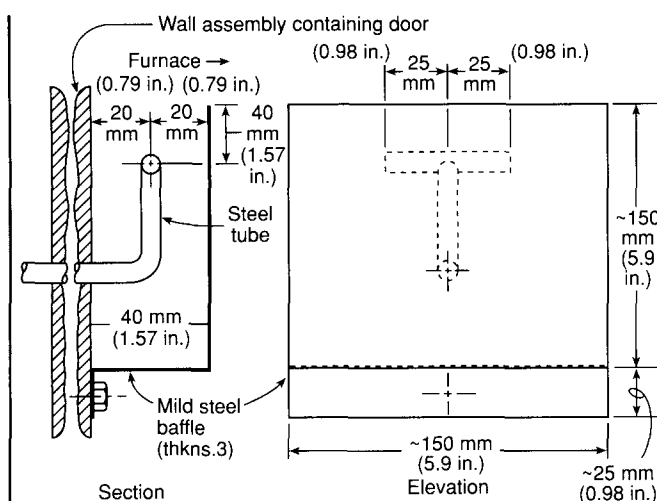


Figure 2-4.1(a) Static pressure-measuring device dimensions.

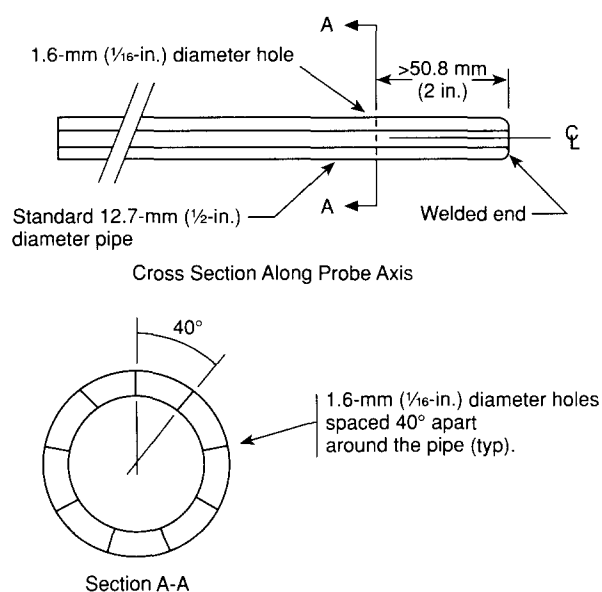


Figure 2-4.1(b) Pressure-sensing probe.

2-4.3 The furnace pressure(s) shall be measured and recorded at intervals not exceeding 1 minute throughout the test.

2-4.4 Control of the furnace pressure shall be established no later than 10 minutes after the start of the test and shall be maintained throughout the remainder of the test.

For vertical specimens, the vertical pressure distribution within the furnace shall be measured by at least two probes separated by a vertical distance [minimum of 6 ft (1.8 m)] within the furnace. Based on their vertical separation and their pressure differences, a calculation of the neutral plane's (zero differential pressure) location shall be made. The pressure measurements made inside the furnace along with the calculation showing the position of the neutral plane with respect to the top of the vertical assembly during the test shall be reported.

For horizontal specimens, the pressure shall be measured at two locations along the centerline of the specimen and 12 in. (300 mm) below the specimen. The pressure (the average of the two readings) during the test shall be reported.

Chapter 3 Test Specimen

3-1 Specimen.

3-1.1 The test specimen shall be a true representation of the construction for which classification is to be determined with respect to materials, workmanship, and details such as dimension of parts. The specimen shall be built under conditions representative of those properties that are practically applied in building construction and operation. The physical properties of the materials and ingredients used in the test specimen shall be determined and recorded.

3-1.2 The size and dimensions of the test specimen described in the standard are intended to apply in rating constructions of dimensions within the usual general range used in buildings. If the conditions of use limit the construction to smaller dimensions, a proportionate reduction shall be permitted to be made in the dimensions of the specimens for a test used to qualify them for such restricted use.

3-1.3 Where it is desired to include a built-up roof covering, the test specimen shall have a roof covering of 3-ply, 15-lb (6.8-kg)-type felt not in excess of 120 lb (54.4 kg) per 100 ft² (9.3 m²) of hot mopping asphalt without gravel surfacing. Tests of assemblies with this covering shall not preclude the field use of other built-up roof coverings.

3-2 Protection and Conditioning of Test Specimen.

3-2.1 The test specimen shall be protected during and after fabrication to ensure its quality and condition when tested. It shall not be tested until close to its full strength, and, if it contains moisture, until the excess moisture has been removed to achieve an air-dry condition in accordance with the requirements of 3-2.1.1 through 3-2.1.3. The testing equipment and sample undergoing the fire test shall be protected from any condition of wind or weather that might lead to abnormal results. The ambient air temperature at the beginning of the test shall be within the range of 50°F to 90°F (10°C to 32°C). The velocity of air across the unexposed surface of the sample, measured immediately before the test begins, shall not exceed 4.4 ft/sec (1.3 m/sec) as determined by an anemometer placed at right angles to the unexposed surface. If mechanical ventilation is used during the test, an airstream shall not be directed across the surface of the specimen.

3-2.1.1* Prior to the fire test, the construction shall be conditioned with the objective of providing, within a reasonable time, a moisture condition within the specimen approximately representative of that likely to exist in similar construction in buildings. For purposes of standardization, this condition shall be considered to be that which would exist at equilibrium as a result of drying in an ambient atmosphere of 50 percent relative humidity at 73°F (23°C). However, with some constructions, it could be difficult or impossible to achieve such uniformity within a reasonable time. Accordingly, where this is the case, specimens shall be permitted to be tested when the dampest portion of the structure [i.e., the portion at 6 in. (152 mm) depth

below the surface of massive constructions] has achieved a moisture content corresponding to drying to equilibrium with air in the range of 50 percent to 75 percent relative humidity at $73^{\circ}\text{F} \pm 5^{\circ}\text{F}$ ($23^{\circ}\text{C} \pm 3^{\circ}\text{C}$). In the event that specimens dried in a heated building fail to meet these requirements after a 12-month conditioning period, or in the event that the nature of the construction is such that it is evident that drying of the specimen interior is prevented by hermetic sealing, these requirements shall be permitted to be waived.

Exception: The requirement for testing of the specimen only after nearing its full strength shall not be permitted to be waived.

3-2.1.2 If, during the conditioning of the specimen it appears desirable or is necessary to use accelerated drying techniques, it is the responsibility of the laboratory conducting the test to avoid procedures that significantly alter the structural or fire endurance characteristics of the specimen, or both, from those produced as the result of drying in accordance with procedures in 3-2.1.1.

3-2.1.3* Within 72 hours prior to the fire test, information on the actual moisture content and distribution within the specimen shall be obtained. The information shall be included in the test report.

Chapter 4 Conduct of Fire Tests

4-1 Fire Endurance Test.

4-1.1 A fire endurance test on the specimen, including its applied load, if any, shall be continued until failure occurs, or until the specimen has withstood the test conditions for a period equal to that herein specified in the conditions of acceptance for the given type of construction.

4-1.2 For the purpose of obtaining additional performance data, the test shall be permitted to be continued beyond the time the fire endurance classification is determined.

4-2 Hose Stream Test.

4-2.1 Where required by the conditions of acceptance, a duplicate specimen shall be subjected to a fire exposure test for a period equal to one-half of that indicated as the resistance period in the fire endurance test, but not for more than 1 hour, immediately after which the specimen shall be subjected to the impact, erosion, and cooling effects of a hose stream directed first at the middle and then at all parts of the exposed face, with changes in direction made slowly.

Exception: The hose stream test shall not be required in the case of construction having a resistance period, as specified in the fire endurance test, of less than 1 hour.

4-2.2 The stream shall be delivered through a $2\frac{1}{2}$ -in. (64-mm) hose discharging through a national standard play pipe as specified in ANSI/UL 385, *Standard for Safety Play Pipes for Water Supply Testing in Fire Protection Service*. The play pipe shall have an overall length of 30 in. (762 mm) and shall be equipped with a $1\frac{1}{8}$ -in. (28.4-mm) discharge tip of the standard-taper, smooth bore pattern without shoulder at the orifice. The play pipe shall be fitted with a $2\frac{1}{2}$ -in. (64-mm) inside diameter \times 6-in. (153-mm) long nipple mounted between the hose and the

base of the play pipe. The pressure tap for measuring the water pressure at the base of the nozzle shall be normal to the surface of the nipple, centered in its length, and shall not protrude into the water stream. The water pressure shall be measured with a suitable pressure gauge [as a minimum 0 psi to 50 psi (0 kPa to 345 kPa)] graduated in no more than 2 psi (13.8 kPa) increments. The water pressure and duration of application shall be as specified in Table 4-2.2.

Table 4-2.2 Hose Stream Test

Resistance Period	Water Pressure at Base of Nozzle		Duration of Application Exposed Area	
	(psi)	(kPa)	(min/100 ft ²)	(min/m ²)
8 hr and over	45	310	6	0.65
4 hr and over if less than 8 hr	45	310	5	0.54
2 hr and over if less than 4 hr	30	207	2½	0.27
1½ hr and over if less than 2 hr	30	207	1½	0.16
1 hr and over if less than 1½ hr	30	207	1	0.11
Less than 1 hr, if desired	30	207	1	0.11

4-2.3 Nozzle Distance. The nozzle orifice shall be 20 ft (6 m) from the center of the exposed surface of the test sample if the nozzle is so located that, when directed at the center, its axis is normal to the surface of the test sample. If otherwise located, its distance from the center shall be less than 20 ft (6 m) by a distance equal to 1 ft (0.3 m) for each 10 degrees of deviation from normal.

Chapter 5 Tests of Bearing Walls and Partitions

5-1 Size of Specimen. The area exposed to fire shall be not less than 100 ft² (9.3 m²), with neither dimension less than 9 ft (2.7 m). The test specimen shall not be restrained on its vertical edges.

5-2* Loading. Throughout the fire endurance and fire and hose stream tests, a constant superimposed load shall be applied to simulate a maximum load condition. The applied load shall be, as nearly as practicable, the maximum load permitted by design under nationally recognized structural design criteria. The tests also shall be permitted to be conducted by applying to the specimen a load less than the maximum. Such tests shall be identified in the test report as having been conducted under restricted load conditions. The applied load, and the applied load expressed as a percentage of the maximum permitted design load, shall be included in the report. A double-wall assembly shall be loaded during the test to simulate field use conditions, with either side loaded separately or both sides loaded together. The method used shall be reported.

5-3 Conditions of Acceptance. The test shall be regarded as valid if the following conditions are met:

(a) The wall or partition shall have sustained the applied load during the fire endurance test, without passage of flame or gases hot enough to ignite cotton waste, for a period equal to that required for the classification desired.

(b) The wall or partition shall have sustained the applied load during the fire and hose stream test, as specified in Section 4-2, without passage of flame, of gases hot enough to ignite cotton waste, or of the hose stream. The assembly shall be considered to have failed the hose stream test if an opening develops that allows a projection of water from the stream beyond the unexposed surface during the hose stream test.

(c) Transmission of heat through the wall or partition during the fire endurance test shall not be sufficient to raise the temperature on its unexposed surface more than 250°F (121°C) above its initial temperature.

Chapter 6 Tests of Nonbearing Walls and Partitions

6-1 Size of Specimen. The area exposed to fire shall be not less than 100 ft² (9.3 m²), with neither dimension less than 9 ft (2.7 m). The test specimen shall be restrained on all four edges.

6-2 Conditions of Acceptance. The test shall be regarded as valid if the following conditions are met:

(a) The wall or partition shall have withstood the fire endurance test, without passage of flame or gases hot enough to ignite cotton waste, for a period equal to that required for the classification desired.

(b) The wall or partition shall have withstood the fire and hose stream tests, as specified in Section 4-2, without passage of flame, of gases hot enough to ignite cotton waste, or of the hose stream. The assembly shall be considered to have failed the hose stream test if an opening develops that allows a projection of water from the stream beyond the unexposed surface during the hose stream test.

(c) Transmission of heat through the wall or partition during the fire endurance test shall not be sufficient to raise the temperature on its unexposed surface more than 250°F (121°C) above its initial temperature.

Chapter 7 Tests of Columns

7-1 Size of Specimen. The length of the column exposed to fire shall, where practicable, approximate the maximum clear length contemplated by the design and, for building columns, shall be not less than 9 ft (2.7 m). The contemplated details of connections, and their protection, if any, shall be applied according to the methods of acceptable field practice.

7-2 Loading.

7-2.1 Throughout the fire endurance test, the column shall be exposed to fire on all sides and shall be loaded in a manner calculated to develop as nearly as practicable, in theory, the working stresses contemplated by the design. Provision shall be made for transmitting the load to the exposed portion of the column without unduly increasing the effective column length.

7-2.2 If the submitter and the testing body jointly so decide, the column shall be permitted to be subjected to

1¾ times its designed working load before the fire endurance test is undertaken. The fact that such a test has been performed shall not be construed as having had a deleterious effect on the fire endurance test performance.

7-3 Conditions of Acceptance. The test shall be regarded as valid if the column sustains the applied load during the fire endurance test for a period equal to that required for the classification desired.

Chapter 8 Alternative Test of Protection for Structural Steel Columns

8-1 Application. This test procedure shall not require column loading at any time and shall be permitted to be used at the discretion of the testing laboratory to evaluate steel column protection that is not required by design to carry any of the column load.

8-2 Size and Character of Specimen.

8-2.1 The size of the steel column used as a specimen shall be a true representation of the design, materials, and workmanship required for the classification desired. The protection shall be applied in accordance with the methods of acceptable field practice. The length of the protected column shall be at least 8 ft (2.4 m). The column shall be vertical during application of the protection and during the fire exposure.

8-2.2 The applied protection shall be restrained against longitudinal temperature expansion greater than that of the steel column by rigid steel plates or reinforced concrete attached to the ends of the steel column before the protection is applied. The size of the plates or amount of concrete shall be adequate to provide direct bearing for the entire transverse area of the protection.

8-2.3 The ends of the specimen, including the means for restraint, shall be provided with sufficient thermal insulation to prevent appreciable direct heat transfer from the furnace.

8-3 Temperature Measurement. The temperature of the steel in the column shall be measured by at least three thermocouples located at each of four levels. The upper and lower levels shall be 2 ft (0.6 m) from the ends of the steel column, and the two intermediate levels shall be spaced equally. The thermocouples at each level shall be placed to measure significant temperatures of the component elements of the steel section.

8-4 Exposure to Fire. Throughout the fire endurance test, the specimen shall be exposed to fire on all sides for its full length.

8-5 Conditions of Acceptance. The test shall be considered to be valid if the transmission of heat through the protection during the period of fire exposure required for the classification desired does not raise the average (arithmetic) temperature of the steel at any one of the four levels above 1000°F (530°C) or does not raise the temperature above 1200°F (649°C) at any one of the measured points.

Chapter 9 Tests of Floor and Roof Assemblies

9-1 Application.

9-1.1 This test procedure shall apply to floor and roof assemblies with or without attached, furred, or suspended ceilings and requires application of fire exposure to the underside of the specimen under test.

9-1.2* Two fire endurance classifications shall be determined for assemblies restrained against thermal expansion:

(a) A restrained assembly classification based upon the conditions of acceptance specified in Sections 9-5(a), (b), (c), (d), and (e); and

(b) An unrestrained assembly classification based upon the conditions of acceptance specified in Sections 9-6(a) and (b) in addition to Section 9-6(c), (d), (e), or (f).

9-1.3 One fire endurance classification shall be determined from tests of assemblies not restrained against thermal expansion based on the conditions of acceptance specified in Sections 9-6(a) and (b).

9-1.4 Individual unrestrained classifications shall be permitted to be determined for beams tested in accordance with this test method using the conditions of acceptance specified in Section 11-3(a), (b), or (c).

9-2 Size and Characteristics of Specimen.

9-2.1 The area exposed to fire shall be not less than 180 ft² (16.7 m²) with neither dimension less than 12 ft (3.6 m). Structural members, if a part of the construction under test, shall lie within the combustion chamber and shall have a side clearance of not less than 8 in. (203 mm) from its walls.

9-2.2 The specimen shall be installed in accordance with recommended fabrication procedures for the type of construction and shall be representative of the design for which classification is desired. Where a restrained classification is desired, specimens representing forms of construction in which restraint to thermal expansion occurs shall be reasonably restrained in the furnace.

9-3 Loading. Throughout the fire endurance test, a superimposed load shall be applied to the specimen to simulate a maximum load condition. The maximum load condition shall be as nearly as practicable the maximum load allowed by the limiting condition of design under nationally recognized structural design criteria. A fire endurance test shall be permitted to be conducted by applying a restricted load condition to the specimen that shall be identified for a specific load condition other than the maximum permitted load condition.

9-4 Temperature Measurement.

9-4.1 For specimens using structural members (e.g., beams, open-web steel joists) spaced at more than 4 ft (1.2 m) on center, the temperature of the steel in these structural members shall be measured by thermocouples at three or more sections spaced along the length of the members, with one section preferably located at midspan.

Exception: In cases where the cover thickness is not uniform along the specimen length, at least one of the sections at which temperatures are measured shall include the point of minimum cover.

9-4.2 For specimens using structural members (e.g., beams, open-web steel joists) spaced at 4 ft (1.2 m) on center or less, the temperature of the steel in these structural members shall be measured by four thermocouples placed on each member. No more than four members shall be so instrumented. The thermocouples shall be placed at significant locations, such as at midspan, over joints in the ceiling, and over light fixtures.

9-4.3 For reinforced or prestressed concrete structural members, thermocouples shall be located on each of the tension-reinforcing elements unless there are more than eight such elements, in which case thermocouples shall be placed on eight elements selected to obtain representative temperatures of all the elements.

9-4.4 For steel structural members, there shall be four thermocouples located at each section. Where only four thermocouples are required on a member, the thermocouples shall be permitted to be distributed along the member at significant locations as specified in 9-4.2. Two shall be located on the bottom of the bottom flange or chord, one on the web at the center, and one on the top flange or chord. Examples of thermocouple distribution at each section are shown in Figure 9-4.4.

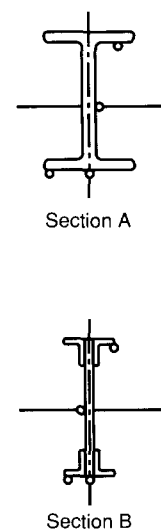


Figure 9-4.4 Examples of thermocouple distribution.

9-4.5 For steel floor or roof units, four thermocouples shall be located on each section (a section shall equal the width of one unit). One shall be located on the bottom plane of the unit at an edge joint, one on the bottom plane of the unit remote from the edge, one on a sidewall of the unit, and one on the top plane of the unit. The thermocouples shall be applied, where practicable, to the surface of the units that are remote from fire and shall be spaced across the width of the unit. Not more than four nor fewer than two sections shall be required to be so instrumented in each representative span. The groups of four thermocouples shall be placed in representative locations. Typical thermocouple locations for a unit section are shown in Figure 9-4.5.

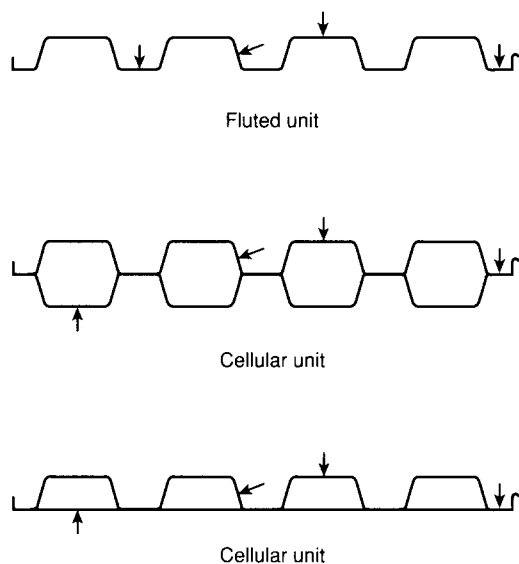


Figure 9-4.5 Typical location of thermocouples.

9-5 Conditions of Acceptance — Restrained Assembly. In obtaining a restrained assembly classification, the following conditions shall be met:

(a) The specimen shall sustain the applied load during the classification period without developing unexposed surface conditions that ignite cotton waste.

(b) The transmission of heat through the specimen during the classification period shall not raise the average temperature on its unexposed surface more than 250°F (121°C) above its initial temperature.

(c) For specimens using steel structural members (e.g., beams, open-web steel joists) spaced more than 4 ft (1.2 m) on center, the beams shall achieve a fire endurance classification on the basis of the temperature criteria specified in Section 9-6(c), (d), (e), or (f) for assembly classifications up to and including 1 hour. For classifications greater than 1 hour, these temperature criteria shall apply for a period equal to one-half the period for the classification of the assembly or 1 hour, whichever is greater.

(d) For specimens using steel structural members (e.g., beam, open-web steel joists) spaced 4 ft (1.2 m) or less on center, the assembly shall achieve a fire endurance classification on the basis of the temperature criteria specified in 9-6(d) for assembly classifications up to and including 1 hour. For classifications greater than 1 hour, these temperature criteria shall apply for a period equal to one-half the period for the classification of the assembly or 1 hour, whichever is greater.

(e) For specimens using conventionally designed concrete beams spaced more than 4 ft (1.2 m) on center, the assembly shall achieve a fire endurance classification on the basis of the temperature criteria specified in 9-6(e) for assembly classifications up to and including 1 hour. For classifications greater than 1 hour, these temperature criteria shall apply for a period equal to one-half the period for the classification of the assembly or 1 hour, whichever is greater.

9-6 Conditions of Acceptance — Unrestrained Assembly. In obtaining an unrestrained assembly classification, the following conditions shall be met:

(a) The specimen shall sustain the applied load during the classification period without developing unexposed surface conditions that ignite cotton waste.

(b) The transmission of heat through the specimen during the classification period shall not raise the average temperature on its unexposed surface more than 250°F (121°C) above its initial temperature.

(c) For specimens using steel structural members (e.g., beams, open-web steel joists) spaced more than 4 ft (1.2 m) on center, the temperature of the steel shall not exceed 1300°F (704°C) at any location during the classification period, nor shall the average temperature recorded by four thermocouples at any section exceed 1100°F (593°C) during the classification period.

(d) For specimens using steel structural members (e.g., beams, open-web steel joists) spaced 4 ft (1.2 m) or less on center, the average temperature recorded by all joist or beam thermocouples shall not exceed 1100°F (593°C) during the classification period.

(e) For specimens using conventionally designed concrete structural members (excluding cast-in-place concrete slabs having spans equal to or less than those tested), the average temperature of the tension steel at any section shall not exceed 800°F (426°C) for cold-drawn prestressing steel or 1100°F (593°C) for reinforcing steel during the classification period.

(f) For specimens using steel floor or roof units intended for use in spans greater than those tested, the average temperature recorded by all thermocouples located on any one span of the floor or roof unit shall not exceed 1100°F (593°C) during the classification period.

Chapter 10 Tests of Loaded Restrained Beams

10-1 Application. An individual classification of a restrained beam shall be permitted to be determined by this test procedure and shall be based on the conditions of acceptance specified in Section 10-4. This fire endurance classification shall apply to the beam where used with a floor or roof construction that has a comparable or greater capacity for heat dissipation from the beam than the floor or roof with which it is tested. The fire endurance classification determined by this method shall not apply to beams smaller than those tested.

10-2 Size and Characteristics of Specimen. The test specimen shall be installed in accordance with the recommended fabrication procedures for the type of construction and shall be representative of the design for which classification is to be determined. The length of beam exposed to the fire shall be not less than 12 ft (3.7 m), and the member shall be tested in its normal horizontal position. A section of a representative floor or roof construction not more than 7 ft (2.1 m) wide, symmetrically located with reference to the beam, shall be permitted to be included with the test specimen and exposed to the fire from below. The beam, including that part of the floor or roof element forming the complete beam as designed (such as composite steel or concrete construction), shall be restrained against longitudinal thermal expansion in a manner simulating the restraint in the construction represented. The perimeter of the floor or roof element of the specimen shall not be supported or restrained.

Exception: That part of the perimeter of the floor or roof element specimen that forms part of a beam as designed shall be required to be supported or restrained.

10-3 Loading. Throughout the fire endurance test a superimposed load shall be applied to the specimen. This load, together with the weight of the specimen, shall be as nearly as practicable the maximum theoretical dead and live loads permitted by nationally recognized design standards.

10-4 Conditions of Acceptance. The following conditions shall be met:

(a) The specimen shall sustain the applied load during the classification period.

(b) The specimen shall achieve a fire endurance classification on the basis of the temperature criteria specified in Section 9-6(c), (d), or (e) equal to one-half the period for the classification of the assembly or 1 hour, whichever is greater.

Chapter 11 Alternative Classification Procedure for Loaded Beams

11-1 Application. Individual unrestrained classifications shall be permitted to be determined for beams tested as part of a floor or roof assembly as described in Sections 9-1 through 9-4 (except 9-1.3) or for restrained beams tested in accordance with the procedure described in Sections 10-1 through 10-3. These fire endurance classifications shall apply to beams where used with a floor or roof construction that has a comparable or greater capacity for heat dissipation from the beam than the floor or roof with which it is tested. The fire endurance classification determined by this method shall not apply to beams smaller than those tested.

11-2 Temperature Measurement.

11-2.1 The temperature of the steel in structural members shall be measured by thermocouples at three or more sections spaced along the length of the members, with one section preferably located at midspan.

Exception: In cases where cover thickness is not uniform along the specimen length, at least one of the sections at which temperatures are measured shall include the point of minimum cover.

11-2.2 For steel beams, four thermocouples shall be placed at each section; two shall be located on the bottom of the bottom flange, one on the web at the center, and one on the bottom of the top flange.

11-2.3 For reinforced or prestressed concrete structural members, thermocouples shall be located on each of the tension-reinforcing elements unless there are more than eight such elements, in which case thermocouples shall be placed on eight elements selected to obtain representative temperatures of all the elements.

11-3 Conditions of Acceptance. In obtaining an unrestrained beam classification the following conditions shall be met:

(a) The specimen shall sustain the applied load during the classification period.

(b) For steel beams, the temperature of the steel shall not exceed 1300°F (704°C) at any location during the classification period nor shall the average temperature

recorded by four thermocouples at any section exceed 1100°F (593°C) during this period.

(c) For conventionally designed concrete beams, the average temperature of the tension steel at any section shall not exceed 800°F (426°C) for cold-drawn prestressing steel or 1100°F (593°C) for reinforcing steel during the classification period.

Chapter 12 Alternative Test of Protection for Solid Structural Steel Beams and Girders

12-1 Application. Where the loading required in Section 9-3 is not feasible, this alternative test procedure shall be permitted to be used to evaluate the protection of steel beams and girders without application of design load, provided that the protection is not required by design to function structurally in resisting applied loads. The conditions of acceptance of this alternative test do not apply to tests performed under design load as provided in tests for floors and roofs in Sections 9-2, 9-5, and 9-6.

12-2 Size and Character of Specimen.

12-2.1 The size of the steel beam or girder shall be a true representation of the design, materials, and workmanship required for the classification desired. The protection shall be applied in accordance with the methods of acceptable field practice, and the projection below the ceiling, if any, shall be representative of the conditions of intended use. The length of the beam or girder exposed to the fire shall be not less than 12 ft (3.7 m), and the member shall be tested in a horizontal position. A section of a representative floor construction not less than 5 ft (1.5 m) wide, symmetrically located with reference to the beam or girder and extending its full length, shall be included in the test assembly and exposed to fire from below. The rating of performance shall not apply to beams or girders smaller than those tested.

12-2.2 The applied protection shall be restrained against longitudinal expansion greater than that of the steel beam or girder by rigid steel plates or reinforced concrete attached to the ends of the specimen before the protection is applied. The ends of the specimen, including the means for restraint, shall be provided with sufficient thermal insulation to prevent appreciable direct heat transfer from the furnace to the unexposed ends of the specimen or from the ends of the specimen to the outside of the furnace.

12-3 Temperature Measurement. The temperature of the steel in the beam or girder shall be measured with not less than four thermocouples located at each of four sections equally spaced along the length of the beam and symmetrically disposed and not nearer than 2 ft (0.6 m) from the inside face of the furnace. The thermocouples at each section shall be placed symmetrically so as to measure significant temperatures of the component elements of the steel section.

12-4 Conditions of Acceptance. The test shall be accepted as valid if the transmission of heat through the protection during the period of fire exposure required for the classification desired does not raise the average (arithmetical) temperature of the steel at any one of the four sections above 1000°F (538°C) or does not raise the temperature above 1200°F (649°C) at any one of the measured points.

Chapter 13 Performance of Protective Membranes in Wall, Partition, Floor, or Roof Assemblies

13-1 Application. Where determining the thermal protection afforded by membrane elements in wall, partition, floor, or roof assemblies, the nonstructural performance of protective membranes shall be obtained by following the procedure outlined in Sections 13-2 through 13-4. The performance of protective membranes is supplementary information only and shall not be used as a substitute for the fire endurance classification determined by Chapters 5 through 12.

13-2 Characteristics and Size of Sample.

13-2.1 The characteristics of the sample shall conform to 3-1.1.

13-2.2 The size of the sample shall conform to Section 5-1 for bearing walls and partitions, Section 6-1 for nonbearing walls and partitions, or 9-2.1 for floors or roofs.

13-3 Temperature Performance of Protective Membranes.

13-3.1 The temperature performance of protective membranes shall be measured with thermocouples, the measuring junctions of which shall be in intimate contact with the exposed surface of the elements being protected. The diameter of the wires used to form the thermo-junction shall not be greater than the thickness of sheet metal framing or panel members to which they are attached and in no case shall be greater than No. 18 AWG gauge [0.040 in. (1.02 mm)]. The lead shall be electrically insulated with heat-resistant and moisture-resistant coatings.

13-3.2 For each class of elements protected, temperature readings shall be taken at not less than five representative points. None of the thermocouples shall be located nearer to the edges of the test assembly than 12 in. (30.5 cm). An exception shall be permitted to be made. None of the thermocouples shall be located opposite, on top of, or adjacent to fasteners such as screws, nails, or staples where such locations are excluded for thermocouple placement on the unexposed surface of the test assembly in 2-3.2.

Exception: In those cases in which there exists an element or feature of the construction that is not otherwise represented in the test assembly, thermocouples shall be permitted to be located closer to the edges of the test assembly than 12 in. (30.5 cm).

13-3.3 Thermocouples shall be located to obtain representative information on the temperature of the interface between the exposed membrane and the substratum or element being protected.

13-3.4 Temperature readings shall be taken at intervals not exceeding 1 minute for the duration of the test.

13-4 Conditions of Performance. Unless otherwise specified, the performance of protective membranes shall be considered to be the time at which the following conditions occur:

(a) The average temperature rise of any set of thermocouples for each class of element protected is more than 250°F (121°C) above the initial temperature; or

(b) The temperature rise of any one thermocouple of the set for each class of element protected is more than 325°F (163°C) above the initial temperature.

Chapter 14 Report of Results

14-1 Classification as Determined by Test.

14-1.1 Results shall be reported in accordance with the performance specifications in the tests prescribed in these methods. The time of resistance shall be expressed as the nearest integral minute.

Reports shall include observations of significant details of the behavior of the material or construction during the test and after the furnace fire is cut off, including information on deformation, spalling, cracking, burning of the specimen or its component parts, continued flaming, and production of smoke.

14-1.2 Reports of tests involving wall, floor, beam, or ceiling constructions in which restraint is provided against expansion, contraction, or rotation of the construction shall describe the method used to provide this restraint.

14-1.3 Reports of tests in which other than maximum load conditions (*see Section 9-3*) are imposed shall define the conditions of loading used in the test fully and shall be designated in the title of the test report as a restricted load condition.

14-1.4* Where the indicated resistance period is 1/2 hour or more, as determined by the average or maximum temperature rise on the unexposed surface or within the test specimen, or by failure under load, an adjustment shall be made for variation of the furnace exposure from that prescribed, in those cases where it will affect the classification, by multiplying the indicated resistance period by two-thirds of the difference in the area between the curve of the average furnace temperature and the standard curve for the first three-fourths of the period and then dividing the product by the area between the standard curve and a baseline of 68°F (20°C) for the same portion of the indicated period. The latter area shall be increased by 54° Fahrenheit-hour or 30° Centigrade-hour (3240° Fahrenheit-minute or 1800° Centigrade-minute) to compensate for the thermal lag of the furnace thermocouples during the first part of the test. For fire exposure that occurs during the test that is higher than standard, the indicated resistance period shall be increased by the amount of the correction and shall similarly be decreased for fire exposure below standard.

14-1.5 Asymmetrical wall assemblies shall be permitted to be tested with either side exposed to the fire, and the report shall indicate the side so exposed. Both sides shall be permitted to be tested, and the report shall indicate the fire endurance classification applicable to each side.

14-2 Test of Floor and Roof Assemblies.

14-2.1 The fire endurance classification of a restrained assembly shall be reported as that developed by applying the conditions of acceptance specified in Sections 9-5(a), (b), (c), (d), and (e).

14-2.2 The fire endurance classification of an unrestrained assembly shall be reported as that determined by

applying the conditions of acceptance to a specimen tested in accordance with this test procedure as specified in Sections 9-6(a) and (b) and, where applicable, Section 9-6(c), (d), (e), or (f).

14-3 Performance of Protective Membranes.

14-3.1 The protective membrane performance for each class of element being protected shall be reported to the nearest integral minute.

14-3.2 The test report shall identify each class of element being protected and shall show the location of each thermocouple.

14-3.3 The test report shall show the time—temperature data recorded for each thermocouple and the average temperature for the set of thermocouples on each element being protected.

14-3.4 The test report shall record any visual observations that are pertinent to the performance of the protective membrane.

14-4 Tests of Load-Bearing Assemblies.

14-4.1 Reports of tests in which loading is used shall describe how the applied load was calculated, the design standard used, the governing stress in each structural member (e.g., bending, shear), the details of the system used to apply the load, and the time of load application relative to the start and finish of the test.

Chapter 15 Referenced Publications

15-1 The following document or portions thereof are referenced within this standard and shall be considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

15-1.1 UL Publication. Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062.

ANSI/UL 385, *Standard for Safety Plug Pipes for Water Supply Testing in Fire Protection Service*, 1994.

Appendix A Explanatory Material

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

A-1-1 The performance of walls, columns, floors, and other building members under fire exposure conditions is an issue of major importance in ensuring construction that is safe and not a menace to neighboring structures or the public. This is recognized by the codes of many authorities, municipal and otherwise. It is important to create a balance among the many units in a single building, and in buildings of like character and use in a community, and also to promote uniformity in the requirements of the various authorities throughout the country. Therefore, it is necessary that the fire-resistive properties of materials and assemblies be measured and specified in accordance with a common standard expressed in terms that are applicable to a wide variety of materials, situations, and conditions of exposure.

These test methods are such a standard. They prescribe a standard exposing fire of controlled extent and severity. Performance is defined as the period of resistance to standard exposure elapsing before the first critical point in behavior is observed. Results are reported in units in which field exposures can be judged and expressed.

The methods are cited as the "Standard Fire Tests," and the performance or exposure is expressed as "2-hr.," "6-hr.," "1/2-hr.," etc.

Where a factor of safety exceeding that inherent in the test conditions is desired, a proportional increase should be made in the specified time-classification period.

A-1-1.2 A method of fire hazard classification based on rate of flame spread is covered in NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*.

A-2-2 The following provides guidance on the desired characteristics of instrumentation for recording the flow of fuel to the furnace burners. Fuel flow data is useful for a furnace heat balance analysis, for measuring the effect of furnace or control changes, and for comparing the performance of assemblies of different properties in the fire endurance test.

The integrated (cumulative) flow of gas (or other fuel) to the furnace burners should be recorded at 10 minutes, 20 minutes, 30 minutes, and every 30 minutes thereafter or more frequently. The total gas consumed during the test period also should be determined. A recording flow meter has advantages over periodic readings on an instantaneous or totalizing flow meter. A measuring and recording system should be selected to provide flow rate readings accurate to within ± 5 percent.

The type of fuel, its higher (gross) heating value, and the fuel flow [corrected to standard conditions of 60°F (16°C) and 30.0 in Hg] as a function of time should be reported.

A-2-2.1 A typical thermocouple assembly meeting specified time constant requirements can be fabricated by fusion-welding the twisted ends of No. 18 AWG Chromel-Alumel wires, mounting the leads in porcelain insulators, and inserting the assembly so the thermocouple bead is 1/2 in. (13 mm) from the sealed end of a standard weight nominal 1/2-in. (13-mm) iron, steel, or Inconel pipe. The time constant for this and for several other thermocouple assemblies was measured in 1976. The time constant is also calculated from knowledge of the thermocouple assembly's physical and thermal properties.

A-2-3.1 Under certain conditions, it is unsafe or impracticable to use thermometers.

For the purpose of testing roof assemblies, the unexposed surface is defined as the surface exposed to ambient air.

A-3-2.1.1 A recommended method for determining the relative humidity within a hardened concrete specimen with electric sensing elements is described in Appendix I of "A Method for Determining the Moisture Condition of Hardened Concrete in Terms of Relative Humidity." A similar procedure with electric sensing elements can be used to determine the relative humidity within fire test specimens made with other materials.

With wood constructions, the moisture meter based on the electrical resistance method can be used, where appropriate, as an alternative to the relative humidity method to

indicate when wood has attained the proper moisture control. Electrical methods are described on pages 320 and 321 of the 1955 edition of the "Wood Handbook of the Forest Products Laboratory," U.S. Department of Agriculture. The relationships between relative humidity and moisture content are illustrated by the graphs in Figure 23 on p. 327 of this publication. They indicate that wood has a moisture content of 13 percent at a relative humidity of 70 percent for a temperature of 70°F to 80°F (21°C to 27°C).

A-3-2.1.3 If the moisture condition of the fire test assembly is likely to change drastically from the sample taken 72 hours prior to this test, the sample should be taken not later than 24 hours prior to the test.

A-5-2 The choice depends on the intended use and whether the load on the exposed side will be transferred to the unexposed side after it has failed. If, in the intended use, the load from the structure above is supported by both walls as a unit and would be or is transferred to the unexposed side in the event of collapse of the exposed side, both walls should be loaded for the test by a single unit. If, in the intended use, the load from the structure above each wall is supported by each wall separately, the walls should be loaded separately for the test by separate load sources. If the intended use of the construction system being tested involves situations of both loading conditions described

above, the walls should be loaded separately for the test by separate load sources. In tests conducted with the walls loaded separately, the condition of acceptance requiring the walls to maintain the applied load is based on the time at which the first wall fails to sustain the load.

A-9-1.2 Appendix E should be consulted for guidance in determining the conditions of thermal restraint that apply to floor and roof constructions and individual beams in actual building construction.

A-14-1.4 The correction can be expressed by the following formula:

$$C = \frac{2I(A - A_s)}{3(A_s + L)}$$

where:

C = correction in the same units as I

I = indicated fire resistance period

A = area under the curve of the indicated average furnace temperature for the first three-fourths of the indicated period

A_s = area under the standard furnace curve for the same part of the indicated period

L = lag correction in the same units as A and A_s [54°F-hr or 30°C-hr (3240°F-min or 1800°C-min)].

Appendix B Standard Temperature–Time Curve for Control of Fire Tests

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

Time (hr:min)	Temperature (°F)	Area Above 68°F Base		Temperature (°C)	Area Above 20°C Base	
		(°F-min)	(°F-hr)		(°C-min)	(°C-hr)
0:00	68	00	0	20	00	0
0:05	1000	2330	39	538	1290	22
0:10	1300	7740	129	704	4300	72
0:15	1399	14,150	236	760	7860	131
0:20	1462	20,970	350	795	11 650	194
0:25	1510	28,050	468	821	15 590	260
0:30	1550	35,360	589	843	19 650	328
0:35	1584	42,860	714	862	23 810	397
0:40	1613	50,510	842	878	28 060	468
0:45	1638	58,300	971	892	32 390	540
0:50	1661	66,200	1103	905	36 780	613
0:55	1681	74,220	1287	916	41 230	687
1:00	1700	82,330	1372	927	45 740	762
1:05	1718	90,540	1509	937	50 300	838
1:10	1735	98,830	1647	946	54 910	915
1:15	1750	107,200	1787	955	59 560	993
1:20	1765	115,650	1928	963	64 250	1071
1:25	1779	124,180	2070	971	68 990	1150
1:30	1792	132,760	2213	978	73 760	1229
1:35	1804	141,420	2357	985	78 560	1309
1:40	1815	150,120	2502	991	83 400	1390
1:45	1826	158,890	2648	996	88 280	1471
1:50	1835	167,700	2795	1001	93 170	1553
1:55	1843	176,550	2942	1006	98 080	1635
2:00	1850	185,440	3091	1010	103 020	1717
2:10	1862	203,330	3389	1017	112 960	1882
2:20	1875	221,330	3689	1024	122 960	2049
2:30	1888	239,470	3991	1031	133 040	2217
2:40	1900	257,720	4295	1038	143 180	2386
2:50	1912	276,110	4602	1045	153 390	2556
3:00	1925	294,610	4910	1052	163 670	2728
3:10	1938	313,250	5221	1059	174 030	2900
3:20	1950	332,000	5533	1066	184 450	3074
3:30	1962	350,890	5848	1072	194 940	3249
3:40	1975	369,890	6165	1079	205 500	3425
3:50	1988	389,030	6484	1086	216 130	3602
4:00	2000	408,280	6805	1093	226 820	3780
4:10	2012	427,670	7128	1100	237 590	3960
4:20	2025	447,180	7453	1107	248 430	4140
4:30	2038	466,810	7780	1114	259 340	4322
4:40	2050	486,560	8110	1121	270 310	4505
4:50	2062	506,450	8441	1128	281 360	4689
5:00	2075	526,450	8774	1135	282 470	4874
5:10	2088	546,580	9110	1142	303 660	5061
5:20	2100	566,840	9447	1149	314 910	5248
5:30	2112	587,220	9787	1156	326 240	5437
5:40	2125	607,730	10,129	1163	337 630	5627
5:50	2138	628,360	10,473	1170	349 090	5818
6:00	2150	649,120	10,819	1177	360 620	6010
6:10	2162	670,000	11,167	1184	372 230	6204
6:20	2175	691,010	11,517	1191	383 900	6398
6:30	2188	712,140	11,869	1198	395 640	6594
6:40	2200	733,400	12,223	1204	407 450	6791
6:50	2212	754,780	12,580	1211	419 330	6989
7:00	2225	776,290	12,938	1218	431 270	7188
7:10	2238	797,920	13,299	1225	443 290	7388
7:20	2250	819,680	13,661	1232	455 380	7590
7:30	2262	841,560	14,026	1239	467 540	7792
7:40	2275	863,570	14,393	1246	479 760	7996
7:50	2288	885,700	14,762	1253	492 060	8201
8:00	2300	907,960	15,133	1260	504 420	8407

Appendix C Recommendations for Thermocouple Pads

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

C-1 Refractory Fiber Pads. Comparative fire tests have demonstrated that a refractory fiber material designated Ceraform 126®,¹ placed with the softer surfaces in contact with the thermocouple, can be substituted for the previously specified asbestos pad where the distortion of the unexposed face of the sample is minimal. The pads are relatively rigid and should not be used on surfaces subject to sharp distortions or discontinuities during the test.² The properties of Ceraform 126® material are as follows:

- (a) Length and width, 6 in. \pm 1/8 in. (152 mm \pm 3 mm).
- (b) Thickness, 0.375 in. \pm 0.063 in. (9.5 mm \pm 1.6 mm). The thickness measurement is made under the light load of a 1/2-in. (13-mm) diameter pad of a dial micrometer gauge.
- (c) Dry weight, 0.147 lb \pm 0.053 lb (67 g \pm 24 g).
- (d) Thermal conductivity [at 150°F (66°C)], 0.37 Btu in./hr ft²-F \pm 0.03 Btu in./hr ft²-F (0.053 W/m-k \pm 0.004 W/m-K).
- (e) Hardness indentation on soft face should be 0.075 in. \pm 0.025 in. (1.9 mm \pm 0.6 mm). Indentation is determined in accordance with ASTM C569, *Test for Indentation Hardness of Performed Thermal Insulations*. Modified Brinell values of hardness are obtained from the following equation:

$$\text{Hardness} = \frac{2.24}{y}$$

- (f) The pads are shaped by wetting, forming, and then drying to constant weight to provide complete contact on sharply contoured surfaces.

Appendix D Sample Report Form

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

NFPA 251

(Title Page, Preferably Cover)

Laboratory _____

Project number _____

NFPA 251 (edition)

Standard Fire Endurance Test

Fire endurance time _____

Construction _____

Date tested _____

Sponsor _____

Material _____

Material _____

Maximum load condition, or restricted load conditions (as the conditions of the test dictate) _____

(Identify if test is part of a research program)

(Add table of contents)

¹ Ceraform 126® is a registered trade name of Manville Specialty Products Group, P.O. Box 5108, Denver, CO 80217.

² Supporting data are available from American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103. Request RR:E05-1004.

D-1 Description of Laboratory Test Facility. Describe items such as the furnace, restraining frame, and details of end conditions, including wedges, and bearing.

(a) If construction is to be tested under load, indicate how the load is applied and controlled (provide loading diagram). Indicate whether the load is a maximum load condition or a restricted load condition, and, for either condition, report the specific loads and the basis for limitation, such as bending stress, and shear. A restricted load condition is reported as a percentage of the maximum load condition.

(b) If construction is to be tested as nonload-bearing, indicate whether the frame is rigid or moves during the test, or whether the test is for temperature rise only.

D-2 Description of All Materials. Describe type, size, class, strength, densities, trade name, and any additional data necessary to define materials. The testing laboratory should indicate whether materials meet NFPA standards by markings, by statement of sponsor, or by physical or chemical test by the testing laboratory.

D-3 Description of Test Assembly.

- (a) Provide size of test specimen.
- (b) Provide details of structural design, including safety factors of all structural members in test assembly.
- (c) Include plan, elevation, principal cross section, and other sections as needed for clarity.
- (d) Provide details of attachment of test panel in frame.
- (e) Provide location of thermocouples, deflection points, and other items for test.
- (f) Describe general ambient conditions for all of the following times:
 1. Time of construction
 2. During curing (time from construction to test)
 3. Time of test.

D-4 Description of Test.

(a) Report temperature at start of test and every 1 minute thereafter. If charts are included in report, clearly indicate time and temperature for all of the following:

- 1. In furnace space
- 2. On unexposed surface
- 3. On protected framing members as stipulated in standard.

NOTE: It is recommended that temperature observations that are not required by the standard, but that are useful, be reported in the appendix to the report. These include temperatures on the face of framing members in back of protection and others that are required by various building codes.

(b) Report furnace pressure at start of test and every 1 minute thereafter.

(c) Report deflections every 5 minutes for first 15 minutes of test and during the last hour. In between, report every 10 minutes.

(d) Report appearance of exposed face as follows:

- 1. Every 15 minutes
- 2. At any noticeable development, provide details and time (e.g., cracks, buckling, flaming, smoke, loss of material)
- 3. At end of test, include items such as amount of dropout, condition of fasteners, and sag.

- (e) Report appearance of unexposed face as follows:
 1. Every 15 minutes
 2. At any noticeable development, including cracking, smoking, and buckling, provide details and time
 3. At end of test.
- (f) Report time of failure caused by the following:
 1. Temperature rise
 2. Failure to carry load
 3. Passage of flame, heat, and smoke.
- (g) If a hose stream test is required, repeat appropriate parts of Sections D-1 and D-3. If failure occurs in hose stream test, provide description.

D-5 Official Comments.

- (a) Include a statement to the effect that the construction is a true representation of field construction. If the construction does not represent typical field construction, note the deviations.
- (b) If construction is asymmetrical (different details on each face), be sure to specify face exposed to fire with comments on fire resistance from opposite side.
- (c) Comment on fire test.

D-6 Summarize Results. A summary of results should include the following:

- (a) Endurance time
- (b) Nature of failure
- (c) Hose stream test results.

D-7 List Official Observers. Provide signatures of responsible persons.

D-8 Appendix. Include all data not specifically required by test standard but useful to better understanding of test results. Special observations for building code approvals should be included in appendix.

D-9 Photographs. Photographs should be used to show items not covered in report or to clarify and should include the following:

- (a) Assembly in construction
- (b) Exposed face prior to fire test
- (c) Unexposed face at start of endurance test; include recording equipment where possible
- (d) Unexposed face at end of fire endurance test
- (e) Exposed face at end of fire endurance test
- (f) Unexposed face at end of fire exposure before hose test
- (g) Exposed face at end of fire exposure before hose test
- (h) Exposed face after hose stream test
- (i) Unexposed face after hose stream test.

D-10 Other Pertinent Information. It is essential to include the following:

- (a) Detailed drawing of test assembly
- (b) Photographs [see Sections D-9(a), (d), (h), and (i)] for every test report.

Appendix E Guide for Determining Conditions of Restraint for Floor and Roof Assemblies and for Individual Beams

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

E-1 Introduction. The revisions adopted in 1970 introduced, for the first time in the history of the standard, the concept of fire endurance classifications based on two conditions of support: restrained and unrestrained. As a result, most specimens are fire tested in a manner that seeks to derive these two classifications.

E-1.1 A restrained condition in fire tests, as used in this method, is one in which expansion at the supports of a load-carrying element resulting from the effects of fire is resisted by forces external to the element. An unrestrained condition is one in which the load-carrying element is free to expand and rotate at its supports.

E-1.2 It is recognized that there can be some difficulty in determining the condition of restraint that is anticipated at elevated temperatures in actual structures. Until a more satisfactory method is developed, this guide recommends that all construction should be classified temporarily as either restrained or unrestrained. This classification enables the architect, engineer, or building official to correlate the fire endurance classification, based on conditions of restraint, with the construction type under consideration.

E-1.3 For the purpose of this guide, restraint in buildings is defined as follows: Floor and roof assemblies and individual beams in buildings are considered restrained where the surrounding or supporting structure is capable of resisting substantial thermal expansion throughout the range of anticipated elevated temperatures. Construction not complying with this definition is assumed to be free to rotate and expand and therefore is considered as unrestrained.

E-1.4 This definition of restraint in buildings necessitates the exercise of engineering judgment to determine what constitutes restraint to substantial thermal expansion. Restraint can be provided by the lateral stiffness of supports for floor and roof assemblies and intermediate beams forming part of the assembly. In order to develop restraint, connections must adequately transfer thermal thrusts to such supports. The rigidity of adjoining panels or structures should be considered in assessing the capability of a structure to resist thermal expansion. Continuity, such as that occurring in beams acting continuously over more than two supports, induces rotational restraint that usually adds to the fire resistance of structural members.

E-1.5 Table E-1.5 specifies only the common types of constructions. These classifications, as well as the philosophy expressed in A-1-1, are helpful in determining the less common types of construction.

E-1.6 The foregoing methods of establishing the presence or absence of restraint according to type and detail of construction are considered to be temporary but necessary for the determination of dual fire endurance classifications. It is anticipated that methods for realistically predetermining the degree of restraint applicable to a particular fire endurance classification will be developed soon after this predetermination.

**Table E-1.5 Construction Classifications,
Restrained and Unrestrained****I. Wall Bearing**Single span and simply supported end spans of multiple bays:¹

- (1) Open-web steel joists or steel beams, supporting concrete slab, precast units, or metal decking
- (2) Concrete slabs, precast units, or metal decking

unrestrained

unrestrained

Interior spans of multiple bays:

- (1) Open-web steel joists, steel beams or metal decking, supporting continuous concrete slab
- (2) Open-web steel joists or steel beams, supporting precast units or metal decking
- (3) Cast-in-place concrete slab systems
- (4) Precast concrete where the potential thermal expansion is resisted by adjacent construction²

restrained

unrestrained

restrained

restrained

II. Steel Framing.

- (1) Steel beams welded, riveted, or bolted to the framing members
- (2) All types of cast-in-place floor and roof systems (such as beams-and-slabs, flat slabs, pan joists, and waffleslabs) in which the floor or roof system is secured to the framing members
- (3) All types of prefabricated floor or roof systems in which the structural members are secured to the framing members and the potential thermal expansion of the floor or roof system is resisted by the framing system or the adjoining floor or roof construction²

restrained

restrained

restrained

III. Concrete Framing.

- (1) Beams securely fastened to the framing members
- (2) All types of cast-in-place floor or roof systems (such as beam-and-slabs, flat slabs, pan joists, and waffle slabs) where the floor system is cast with the framing members
- (3) Interior and exterior spans of precast systems with cast-in-place joints resulting in restraint equivalent to that which exists in condition III(1)
- (4) All types of prefabricated floor or roof systems in which the structural members are secured to such systems and the potential thermal expansion of the floor or roof system is resisted by the framing system or the adjoining floor or roof construction²

restrained

restrained

restrained

restrained

IV. Wood Construction.

All types.

unrestrained

¹Floor and roof systems can be considered restrained where they are tied to walls with or without tie beams, the walls being designed and detailed to resist thermal thrust from the floor or roof system.

²Resistance to potential thermal expansion is considered to be achieved where:

- (a) Continuous structural concrete topping is used.
- (b) The space between the ends of precast units or between the ends of the units and the vertical face of supports is filled with concrete or mortar.
- (c) The space between the ends of precast units and the vertical faces of supports, or between the ends of solid or hollow core slab units does not exceed 0.25 percent of the length for normal weight concrete members or 0.1 percent of the length for structural lightweight concrete members.

Appendix F Method of Correcting Fire Endurance for Concrete Slabs Determined by Unexposed Surface Temperature Rise for Nonstandard Moisture Content

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

F-1 Scope.

(a) The standard fire endurance is the time determined by the unexposed surface temperature rise of a test specimen at a standard moisture level.

(b) This appendix provides a procedure for correction of the fire endurance of unprotected vertical or horizontal slabs (solid or hollow), made from essentially inorganic building materials and conditioned on both sides, where moisture content at the time of test is other than at a standard moisture level.

(c) Among the common inorganic building materials, only the hydrated Portland cement products can hold (after due conditioning in accordance with Section 3-2) sufficient amounts of moisture to affect the result of the fire test significantly. Consequently, correcting the experimental fire endurance of constructions containing less than 5 volume percent of Portland cement paste is not necessary.

F-2 Symbols. The symbols used in this appendix are defined as follows:

A = factor characterizing the drying conditions (see Table F-2)

b = factor characterizing the permeability of the specimen (see Table F-3)

FE = fire endurance of specimen, h

RH = relative humidity

m = moisture content, volume fraction ft^3/ft^3 or cm^3/cm^3

m_a = average moisture content of test specimen

m_c = average moisture content of cement paste

m_e = nominal equilibrium moisture content of cement paste for a given RH (see Table F-1)

m_{e_s} = equilibrium moisture content of cement paste at the standard RH level (see Table F-1)

m_s = average moisture content of a standard conditioned concrete specimen of same concrete and cement paste volume as the test specimen

v = volume fraction of cement paste, ft^3/ft^3 or cm^3/cm^3 .

F-3 Calculation of Moisture Content.

(a) The average moisture content, m_a , is the volume fraction of moisture [ft^3/ft^3 (cm^3/cm^3)] in the material relative to its dry condition, where dry condition is defined as that resulting when the material is heated in an oven at $221^\circ\text{F} \pm 1^\circ\text{F}$ ($105^\circ\text{C} \pm 0.5^\circ\text{C}$) until no further weight loss occurs.

(b) The average moisture content of the cement paste can be estimated from the known value of RH at middepth (assuming the material has never been subject to rewetting) by calculating first the moisture content in the cement paste as follows:

$$m_c = A \cdot m_r$$

(c) The average moisture content of the test specimen then is calculated as follows:

$$m_a = v \cdot m_c$$

(d) The average moisture content of a standard conditioned specimen is calculated as follows:

$$m_s = v \cdot m_{rs}$$

where m_{rs} is the value of m_r in Table F-1 pertaining to the standard RH level.

F-4 Correction Procedure. The correction procedure begins with the selection of an empirical factor to reflect the permeability of the material as suggested in Table F-3. The known values of m_a and m_c are used to calculate the products bm_a and bm_c . On the nomograph (see Figure F-1) lines are drawn from point R to values of bm_a and bm_c on the right-hand scale. From the point representing the actual fire endurance time (FE) on the left-hand scale, a line is drawn parallel to $R-bm_a$ to intersect the curve. From this point on the curve, a line is drawn parallel to $R-bm_c$ and the corrected fire endurance is determined from the FE scale.

F-5 Example. A wall made from normal weight concrete having 23.2 volume percent of paste is conditioned at 200°F (93°C) and 5 percent RH until the RH at its middepth is reduced to 70 percent. It has a 2.90-hour fire endurance. The adjusted fire endurance is calculated as follows:

1. Calculate m_a as follows:

For 70 percent RH :

$$m_r = 0.225 \quad (\text{see Table F-1})$$

For 200°F (93°C) and 5 percent RH conditioning, for normal weight concrete:

$$A = 0.45 \quad (\text{see Table F-2})$$

$$m_c = 0.45 \times 0.225 = 0.101 \quad [\text{see F-3(b)}]$$

For $v = 0.232$:

$$m_a = 0.232 \times 0.101 = 0.0234 \quad [\text{see F-3(c)}]$$

that is, the concrete contains 2.34 volume percent moisture at time of test.

2. Calculate m_s as follows:

Example: If the standard moisture level is assumed to correspond to a middepth RH of 75 percent, $m_r = 0.24$

$$m_s = 0.232 \times 0.24 = 0.0557 \quad [\text{see F-3(d)}]$$

that is, the standard moisture level is 5.57 volume percent.

3. Calculate b_m as follows:

$$b = 5.5 \quad (\text{see Table F-3})$$

$$bm_a = 5.5 \times 0.0234 = 0.129$$

$$bm_s = 5.5 \times 0.0557 = 0.306$$

4. Draw lines on the nomogram from point R to bm_a and bm_s (see Figure F-1).

5. Draw a line from the FE ordinate, 2.90, parallel to line $R-bm_a$ to intersect the curve.

6. Draw a line parallel to $R-bm_s$ from a point on the curve to intersect the FE ordinate scale. The value, $FE = 3.19$, is the adjusted fire endurance; that is, the fire endurance if the specimen had been tested at the standard moisture level, which is assumed in this example to correspond to 75 percent RH at middepth.

Table F-1 Equilibrium Moisture Content (Desorption) of Cement Paste at Given Relative Humidity

RH at Middepth (%)	m_r
90	0.30
85	0.274
80	0.255
75	0.24
70	0.225
65	0.21
60	0.195
55	0.185
50	0.175
45	0.16
40	0.15

Table F-2 Factor Characterizing Drying Conditions

Conditioning Environment	Middepth RH of Test Specimen (%)	Factor A for Portland Cement	
		Normal Weight Concrete	Lightweight Concrete
60°F to 80°F (15.6°C to 26.7°C) atmospheric conditions	any	1.0	1.0
120°F to 160°F (48.9°C to 71.1°C) 20 to 35 percent RH	70 to 75	0.7	0.7
190°F to 200°F (87.8°C to 93.3°C) 0 to 5 percent RH	70 to 75	0.45	0
120°F to 200°F (48.9°C to 93.3°C) 5 to 35 percent RH	less than 70	0	0

Table F-3 Factor Characterizing Permeability of Test Specimen

Material	b
Normal weight and gun-applied concrete [dry unit weight greater than 135 lb/ft ³ (2162 kgm/m ³)]	5.5
Lightweight concrete [dry unit weight 85 lb/ft ³ to 115 lb/ft ³ (1361 kgm/m ³ to 1841 kgm/m ³)]	8.0
Lightweight insulating concrete [dry unit weight less than 50 lb/ft ³ (801 kg/m ²)]	10.0

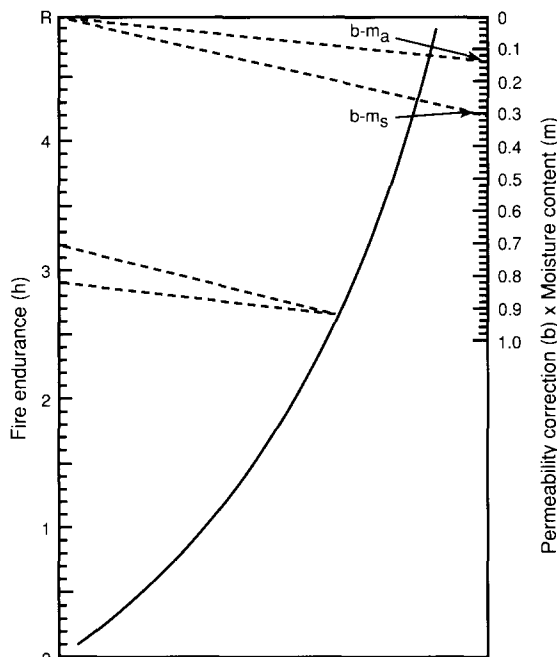


Figure F-1 Nomograph for correcting fire endurance for nonstandard moisture content.

Appendix G Commentary

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

G-1 Introduction.

G-1.1 This commentary has been prepared to provide the user of this standard with background information on the development of the standard and its application in the fire protection of buildings. It also provides guidance in the planning and performance of fire tests and in the reporting of results. No attempt has been made to incorporate all the available information on fire testing in this commentary. The serious student of fire testing is strongly urged to consult the referenced documents for a better appreciation of the history of fire-resistant design and the intricate problems associated with testing and with interpretation of test results.^{1, 2}

G-1.2 Floors and walls designed as fire separations have been recognized for many years as efficient tools in restricting fires to the area of origin or limiting their

spread.^{3, 4, 5, 6, 7, 8, 9, 10, 11} Prior to 1900, relative fire safety was achieved by mandating use of specific materials. By the year 1900, the appearance of a multitude of new materials and innovative designs and constructions accelerated the demand for performance standards. The British Fire Prevention Committee, established in 1894, was the first to produce tables that provided fire-resistive floors, ceilings, doors, and partitions.⁵ Test furnaces in the United States were constructed shortly after 1900 at the Underwriters Laboratories Inc., Columbia University, and the National Bureau of Standards (NBS).^{1, 12} These early furnaces eventually led to the development of ASTM E119, *Standard Test Methods for Fire Tests of Building Construction and Materials*, and its counterpart, NFPA 251.

G-2 Historical Aspects. ASTM E119, *Standard Test Methods for Fire Tests of Building Construction and Materials*, was first published as ASTM C19 in 1918. A number of refinements have been made in the standard since that time. However, several provisions, including the temperature—time curve, the major apparatus, and the acceptance criteria remain essentially unchanged. The roots of fire testing as defined today can be traced back to about 1800. A comprehensive review of early fire testing has been published.¹

G-3 Fire Load Concept.

G-3.1 Specifications for fire resistance in regulatory documents continue to be based largely on the fire load concept developed by NBS in the 1920s and reported in the 1928 NFPA *Quarterly* by S. H. Ingberg. The concept incorporates the premise that the duration of a fire is proportional to the fire loading (i.e., the mass of combustible materials per unit floor area). The relationship between the mass of combustible materials and fire duration was established on the basis of burnout tests in structures incorporating materials having calorific or potential heat values equivalent to wood and paper, [i.e., 7000 Btu/lb to 8000 Btu/lb (16.3 MJ/kg to 18.6 MJ/kg)]. The fire loads of noncellulosic materials, such as oils, waxes, and flammable liquids, were interpreted on the basis of their equivalent calorific content.^{5, 13, 14, 15} In the simplest terms, the above premise states that 10 lb (50 kg) of combustible materials per ft² (m²) of floor area produce a fire of 1-hour duration.

G-3.2 Increasing sophistication in the understanding of materials and the fire process is the result of numerous research activities.^{9, 11, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27} It is now generally conceded that fire severity as well as the temperature—time relationship of a fire depends on several factors, including:

- (a) Amount and type of the fire load.
- (b) Distribution of the fire load.
- (c) Specific surface characteristics of the fire load.^{5, 27}
- (d) Ventilation, as determined by the size and shape of openings.^{17, 18, 19, 21, 27, 28, 29}
- (e) Geometry (the size and shape) of the fire compartment.
- (f) Thermal characteristics of the enclosure boundaries.
- (g) Relative humidity of the atmosphere.

For the purposes of this appendix, fire severity is defined in terms of temperature (one measure of an effect of fire intensity) and fire duration. It is expressed in terms of minutes or hours of fire exposure and, in NFPA 251, is assumed to be equivalent to that defined by the standard temperature—time (*T-t*) curve, (i.e., the area under the *T-t* curve).²⁷

G-4 Scope and Significance.

G-4.1 This standard is intended to evaluate, in terms of endurance time, the ability of an assembly to contain a fire or to retain its structural integrity, or both, during the test conditions imposed by the standard. It also contains standard conditions for measuring heat transfer through membrane elements protecting combustible framing or surfaces.

G-4.2 The end-point criteria by which the test result is assessed are related to the following:

- (a) Transmission of heat through the test assembly;
- (b) Ability of the test assembly to withstand the transmission of flames or gases hot enough to ignite combustible material;
- (c) Ability of the assembly to carry the load and withstand restraining forces during the fire test period;
- (d) Temperature of the steel under some conditions.

G-4.3 It is the intent that classifications should reflect performance during the period of exposure and performance should not be construed as having determined suitability for use after the exposure.

G-4.4 This standard, although specific regarding the assembly to be tested, enables the testing laboratory to determine whether the specimen is a true representation of the assembly intended for evaluation. This is necessary because of the wide variation in assemblies. For instance, wall test specimens generally do not contain electric switches and outlets, which in some designs can affect test results. Floor test specimens might or might not contain electrical raceways and outlets or pull boxes for power and communication wiring. Cover plates over trench headers also are present in some designs. The testing laboratory is in the best position to judge the effects of such components.

G-5 Test Furnaces. This standard does not provide specific construction details for the furnace. Users are urged to consult reference documents for a more comprehensive review of furnace design and performance.²⁵

G-6 Temperature—Time Curve.

G-6.1 A specific temperature—time relationship for the test fire is defined in the standard and in Appendix B. The actual recorded temperatures in the furnace are required to be within specified percentages of those of the standard curve. Accuracy in measuring temperature generally is easier to achieve after 1 hour due to stabilizing of the furnace and the slope of the $T-t$ curve. The number and type of temperature-measuring devices are outlined in the standard. Specific standard practices for location and use of these temperature-measuring devices also are outlined in the standard. However, no uniformity of the temperatures within the fire chamber is specified.

G-6.2 The standard $T-t$ curve used in this standard represents a severe building fire.⁵ The curve was adopted in 1918 as a result of several conferences by eleven technical organizations, including testing laboratories, insurance underwriters, fire protection associations, and technical societies.^{1, 16, 30} The $T-t$ relationship of these test methods represents only one fire situation. Data is available to evaluate the performance of assemblies under fire exposure conditions that are more representative of particular fire situations (i.e., using different $T-t$ relationships to simulate specific fire conditions).^{9, 11, 16, 19, 22, 23, 27, 29, 31, 32}

G-6.3 Furnace pressure is not specified and is generally slightly negative. The pressure can have an effect on the test results, and the test conditions always should be controlled carefully.

G-7 Test Specimen.

G-7.1 The test specimen is required to represent as closely as possible the actual construction in the field subject to the limits imposed by the test facilities.

G-7.2 All specimens are required to be conditioned so as to attain a moisture content comparable to that in the field prior to testing. For uniformity, the standard moisture content is defined as that in equilibrium with an atmosphere of 50 percent relative humidity at 73°F (23°C). Massive concrete units that need unusually long drying periods can be fire tested after a 12-month conditioning period. Appendix F describes how the test result should be corrected to account for any variation from the standard moisture condition.³³

G-7.3 With few exceptions, only the interior face of exterior wall assemblies and the ceiling portion or underside of floor or roof assemblies are exposed to the standard fire.^{24, 25} This practice is rationalized based on the assumption that the outside face of exterior walls is not usually subjected to the same fire as the interior face and that the fire exposure of the upper side of a floor or roof assembly is seldom as intense as that of the underside.

G-7.4 Although this standard does not contain specific criteria for judging the impact of through-joints or “poke-through” devices, such as electrical or telephone outlets, it should be recognized that these components should be evaluated with respect to structural performance and temperature-rise criteria if they constitute a significant part of the tested assembly.

G-7.5 For obvious reasons, symmetrical walls and partitions are tested only on one side. Asymmetrical walls and partitions might be required to be tested with either or both sides individually exposed to the fire. If both sides are exposed, the report should indicate the fire endurance classification for each case.

G-8 Loading.

G-8.1 Floors and roofs generally are loaded during tests to provide a maximum load condition determined by the applicable nationally recognized design criteria. This practice is intended to accommodate those designs that are loaded to maximum design conditions in actual intended use. Through the application of engineering principles, those fire endurance ratings developed can be applied to assemblies having spans greater than those tested.

G-8.2 Where a floor or roof assembly is designed for a specific use, such as in prefabricated housing units, the assembly can be tested with a restricted load condition. The loading condition used for such tests is to be defined in the test report. This standard does not require specific loading devices. Some laboratories use large containers of water; others use a system of hydraulic rams for floor and roof assemblies. Where a uniformly distributed load is simulated by point-loading (several small-area loads), it is recommended that the load at any such area not exceed

25 percent of the total load and that the individual load have a width at least equal to the depth of the floor. Wall furnaces generally are equipped with hydraulic rams.

G-8.3 This standard requires that load-bearing walls and partitions sustain the applied test load during the fire endurance and hose stream tests. A former provision that required load-bearing walls and partitions to sustain twice the specified superimposed test load after cooling but within 72 hours of the test period has been deleted from the method as being unrealistic. Nonbearing walls and partitions are not loaded during the test but are restrained on all sides. This restraint could impose more stress than a load on top. The ASTM Committee E-5 has reviewed the loading procedures for framed walls and partitions several times. It was the committee's unanimous decision that such a wall be tested either with calculated maximum design load or with a load expected to occur in practice. The method used to compute the design loads needs to be reported.

G-8.4 Some important stresses, such as those caused by creep and shrinkage in the wall itself and its supporting frame, are present, and the designer should recognize these stresses in the analysis. The ASTM Committee E-5 has investigated the possibility of openings occurring in joints at the corners of nonload-bearing enclosures due to differential movement. While the possibility exists that this will occur, the committee has not found it feasible to amend the test based on available data.

G-8.5 Double walls pose a unique problem for load application. Which wall should be loaded? Should both walls be loaded simultaneously? The ASTM Committee E-5 devoted considerable time to debating this problem and recommends the decision be made by the user after an analysis of the loading conditions anticipated in service both before and after a fire. Such loading conditions are to be reported.

G-9 Integrity. All walls and partitions that qualify for a fire endurance classification of 1 hour or more are required to be subjected to the cooling impact and erosion effects of a stream of water from a 2½-in. (63.5-mm) hose discharging through a standard playpipe equipped with a 1½-in. (28.6-mm) tip under specified pressures. In this hose stream test, the ability of the construction to resist disintegration under adverse conditions is examined. The requirement for a hose stream test was removed from the test procedure for columns and floor or roof assemblies because of impracticality and the possibility of excessive damage to the furnace.

G-10 Conditions of Tests.

G-10.1 Columns generally are tested with all four sides exposed to the test fire. However, it is possible to test a column with three sides exposed (with the fourth side against a wall). This standard requires that specimens be tested under conditions contemplated in the design. The former general practice of testing columns with pin connection at the top and bottom to simulate the most critical condition is no longer a criterion.

G-10.2 Columns are required to sustain successfully the design load during the test period. This standard also permits columns to be loaded up to 1¾ times the design load prior to the fire test if desired by the submitter. Such loading, however, should not be construed as having had a deleterious effect on the fire endurance test performance.

Instead of loading, steel columns, whose protective covering does not carry a load, can be assigned a fire resistance classification on the basis of the temperature of the steel only. With such columns, the protective cover should be restrained against longitudinal expansion. Wood columns are tested for load-carrying ability only.

G-10.3 Test results have established that variations of restraint conditions can influence the time of fire resistance for a structure or a structural element considerably. Restraints generally are beneficial to fire resistance; however, there are conditions under which restraint can have a detrimental effect on the performance of a specimen during a fire resistance test.^{34, 35} The users of test results are advised to study the reference documents as well as Appendix E and Table E-6.

G-10.4 An unrestrained classification for a steel beam or a reinforced concrete beam used as part of an assembly tested in restrained condition can be assessed from the temperature records obtained for the steel or the reinforcing steel, respectively (*see Chapter 11*). It is also possible to evaluate the protective cover of steel beams by measuring the temperature of the steel that is protected (*see Chapter 12*). The fire endurance classification determined under the provisions of Chapter 11 is applicable only to beams used with a floor or roof construction that has a comparable or greater capacity for heat dissipation from the beam than the floor or roof with which it is tested.

G-11 Other Observations.

G-11.1 No limitation is imposed on the deformation of the specimen during or after the test period. It is assumed that the deflection or deformation of an assembly is limited only by its ability to stay in place (under load, where specified) during the test period.

G-11.2 A complete record of deformation during the endurance test is helpful in the application of test results and should be reported.

G-11.3 Other observations, such as the evolution of unusual quantities of visible smoke, vapors, or gases that could affect the proper decision regarding use of the test results, should be reported.

G-12 Protective Membranes. This standard provides criteria for evaluating the protection that membrane elements can offer to combustible framing and paneling (e.g., joists, wall studs, and paneling or boards on the unexposed side of an assembly and other combustible materials). The results of these tests are reported as protective membrane ratings.

¹Vytenis Babrauskas and Robert Brady Williamson, "Historical Basis of Fire Resistance Testing," Part I and Part II, *Fire Technology*, Vol. 14, No. 3 and No. 4, 1978, pp. 184-194, 304-316.

²Harry Shoub, "Early History of Fire Endurance Testing in the United States," *Symposium on Fire Test Methods*, ASTM STP 301, American Society for Testing and Materials, 1961, pp. 1-9.

³C. H. Dilam et al., *Modern Building Inspection*, R. C. Coling and Associates, Los Angeles, CA, 1942.

⁴*Facts About Fires*, National Fire Protection Assn., Quincy, MA, 1971.

⁵Bird and Docking, *Fire in Buildings*, D. Van Nostrand Co., Inc., New York, 1949.

- ⁶R. S. Ferguson, "Principles of Fire Protection," *National Building Code of Canada*, Technical Paper No. 272, Division of Building Research, National Research Council of Canada, Ottawa, 1970.
 - ⁷L. Konicek and T. T. Lie, "Temperature Tables for Ventilation Controlled Fires," Building Research Note No. 94, National Research Council of Canada, Sept. 1974.
 - ⁸C. C. Gordon, *Considerations of Life Safety and Building Use*, DBR Paper No. 699, National Research Council of Canada, Ottawa, Jan. 1977.
 - ⁹G. W. Shorter, "Fire Protection Engineer and Modern Building Design," *Fire Technology*, Vol. 4, No. 3, Aug. 1968, pp. 206-213.
 - ¹⁰T. Z. Harmathy, *Performance of Building Elements in Spreading Fire*, DBR Paper No. 752, National Research Council of Canada, NRCC 16437, Fire Research Vol. 1, 1977/78, pp. 119-132.
 - ¹¹T. Z. Harmathy, "Design Approach to Fire Safety in Buildings," *Progressive Architecture*, NRCC 14076, Apr. 1974, pp. 82-87.
 - ¹²"Rule 508 — Industrial Code," New York State Labor Law, *New York City Building Code*, p. 513, 1934 Edition.
 - ¹³A. E. Robertson and D. Gross, "Fire Load, Fire Severity, and Fire Endurance," *Fire Test Performance*, ASTM STP 464, American Society for Testing and Materials, 1970, pp. 3-29.
 - ¹⁴BMS 92, *Building Materials and Standards*, National Bureau of Standards, Washington, DC, Oct. 1942.
 - ¹⁵S. H. Ingberg et al., "Combustible Contents in Buildings," BMS 149, National Bureau of Standards, Washington, DC, Jul. 1957.
 - ¹⁶L. G. Seigel, *The Severity of Fires in Steel Framed Buildings*, Her Majesty's Stationary Office, 1968, London, Proceedings of the Symposium held at the Fire Research Station, Boreham Woods, Herts (England), Jan. 24, 1967, pp. 59-63.
 - ¹⁷D. Gross, *Field Burnout Tests of Apartment Dwelling Units*, Building Science Series 10, U. S. Dept. of Commerce, National Bureau of Standards, Sept. 29, 1967.
 - ¹⁸Margaret Law, *Radiation from Fires in a Compartment*, Fire Research Technical Paper No. 20, Her Majesty's Stationary Office, London, 1968.
 - ¹⁹A. J. M. Heselden, *Parameters Determining the Severity of Fire*, Symposium No. 2, Her Majesty's Stationary Office, 1968, London, Proceedings of the Symposium held at the Fire Research Station, Boreham Woods, Herts (England), Jan. 24, 1967, pp. 19-27.
 - ²⁰D. Sfintesco, *Furnace Tests and Fire Resistance*, Building Science Series 10, U. S. Dept. of Commerce, National Bureau of Standards, Sept. 29, 1967.
 - ²¹D. Gross and A. F. Robertson, *Experimental Fires in Enclosures*, Tenth Symposium (International) on Combustion, The Combustion Institute, 1965, pp. 931-942.
 - ²²Kai Odeen, *Theoretical Study of Fire Characteristics in Enclosed Spaces*, Division of Building Construction, Royal Institute of Technology, Stockholm, Sweden, 1965.
 - ²³J. E. Ryan, "Perspective on Methods of Assessing Fire Hazards in Buildings," *Ignition, Heat Release, and Noncombustibility of Materials*, ASTM STP 502, American Society for Testing and Materials, 1972, pp. 11-23.
 - ²⁴T. Z. Harmathy, *Performance of Building Elements in Spreading Fire*, DBR Paper No. 752, National Research Council of Canada, NRCC 16437, Fire Research Vol. 1, 1977/78, pp. 119-132.
 - ²⁵T. Z. Harmathy, "Design of Fire Test Furnaces," *Fire Technology*, Vol. 5, No. 2, May 1969, pp. 146-150.
 - ²⁶T. Z. Harmathy, "Fire Resistance versus Flame Spread Resistance," *Fire Technology*, Vol. 12, No. 4, Nov. 1976, pp. 290-302, 330.
 - ²⁷T. Z. Harmathy, "A New Look at Compartment Fires," Part I and Part II, *Fire Technology*, Vol. 8, No. 3 and No. 4, Aug. and Nov. 1972, pp. 196-217; 326-351.
 - ²⁸F. Satsberg, Illinois Institute of Technology Research Institute Limited release on research data conducted for U. S. Dept. of Civil Defense.
 - ²⁹T. Z. Harmathy, *Designers Option Fire Resistance on Ventilation*, Technical Paper No. 436, Division of Building Research, National Research Council of Canada, Ottawa, NRCC 14746.
 - ³⁰*Fire Protection Handbook*, Sixteenth edition, National Fire Protection Assn., Quincy, MA, 1986.
 - ³¹Sven-Erik Magusson and Ove Petersson, ISO/TE-WG5 Report, March 9-10, 1967, Copenhagen, Denmark (Sweden-B)-Exhibit 14. Preliminary report on some theoretical studies for structural elements of the effect on their fire resistance of variations of T-t curve for cooling down period.
 - ³²J. E. Ryan and A. F. Robertson, "Proposed Criteria for Defining Load Failure of Beams, Floors, and Roof Construction During Fire Tests," *Journal of Research of the National Bureau of Standards*, Washington, DC, Vol. 63C, No. 2, 1959.
 - ³³T. Z. Harmathy, "Experimental Study on Moisture and Fire-Endurance," *Fire Technology*, Vol. 2, No. 1, Feb. 1966.
 - ³⁴C. C. Carlson, S. L. Selvaggio, and A. H. Gustaferro, *A Review of Studies of the Effects of Restraint on the Fire-Resistance of Prestressed Concrete*, Feuerwiderstandsfähigkeit von Spannbeton, Ergebnisse einer Tagung der F.I.P. in Braunschweig, Jun. 1965, Wiesbaden-Berlin, 1966, p. 32.
 - ³⁵L. A. Issen, A. H. Gustaferro, and C. C. Carlson, "Fire Tests of Concrete Members; An Improved Method for Estimating Thermal Restraint Forces," *Fire Test Performance*, ASTM STP 464, American Society for Testing and Materials, 1970, pp. 153-185.
- Additional references used in the development of this appendix:
- G. K. Castle, "The Nature of Various Fire Environments and the Application of Modern Material Approaches for Fire Protection of Exterior Structural Steel," presented at American Institute of Chemical Engineers Loss Prevention Symposium, Nov. 1973, Philadelphia, PA.
 - D. Crowley et al., "Test Facilities for Measuring the Thermal Response of Materials to the Fire Environment," *Journal of Testing and Evaluation*, Vol. 1, No. 5.
 - S. H. Ingberg, "The Hose-Stream Test as a Part of Fire-Testing Procedure," Symposium on Fire Test Methods 1962, ASTM STP 344, American Society for Testing and Materials, 1963, pp. 57-68.
 - Richard Stone, "Danger-Flammable," *Wall Street Journal*, New York, NY, Dec. 8, 1970.
 - J. H. Warren and A. A. Corona, "This Method Tests Fire Protective Coatings," *Hydrocarbon Processing*, Jan. 1975.

Appendix H Referenced Publications

H-1 The following documents or portions thereof are referenced within this standard for informational purposes only and thus are not considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

H-1.1 NFPA Publication. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*, 1990 edition.

H-1.2 Other Publication.

H-1.2.1 ASTM Publication. American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103

ASTM C569, *Test for Indentation Hardness of Performed Thermal Insulations*, 1989.

H-1.3 Additional References.

Carl A. Menzel, "A Method for Determining the Moisture Condition of Hardened Concrete in Terms of Relative Humidity," *Proceedings, American Society for Testing and Materials*, Vol. 55, p. 1085 (1955).

U.S. Department of Agriculture, "Wood Handbook of the Forest Products Laboratory," pp. 320-321 (1955).

Index

© 1995 National Fire Protection Association, All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document which it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of the National Fire Protection Association, Inc.

<p>-B-</p> <p>Beams</p> <p>Loaded</p> <p>Alternative classification for Chap. 11</p> <p>Restrained, tests of Chap. 10</p> <p>Report of results 14-4</p> <p>Restrained</p> <p>Guide for determining conditions of restraint A-9-1.2, App. E</p> <p>Loaded restrained, tests of Chap. 10</p> <p>Solid structural steel, alternate test of protection for Chap. 12, G-10.4</p> <p>Unrestrained G-10.4</p> <p>Bearing walls and partitions, tests of Chap. 5, 14-4, A-5-2</p>	<p>-D-</p> <p>Definitions 1-4</p>
<p>-C-</p> <p>Classification</p> <p>Alternative, for loaded beams Chap. 11</p> <p>As determined by test 14-1</p> <p>Restrained and unrestrained Table E-1.5, G-10.4</p> <p>Columns, tests of Chap. 7</p> <p>Report of results 14-4</p> <p>Structural steel, alternate test of protection for Chap. 8, G-10.1 to 10.2</p> <p>Commentary on standard App. G</p> <p>Concrete slabs, method of correcting fire endurance for App. F</p> <p>Conditions of acceptance/performance</p> <p>Beams</p> <p>Loaded, alternative classification for 11-3</p> <p>Loaded restrained 10-4</p> <p>Solid structural steel, alternate test of protection for ... 12-4</p> <p>Columns 7-3</p> <p>Structural steel, alternate test of protection for 8-5</p> <p>Floor and roof assemblies</p> <p>Protective membranes 13-4</p> <p>Restrained assembly 9-5</p> <p>Unrestrained assembly 9-6</p> <p>Walls and partitions</p> <p>Bearing 5-3</p> <p>Nonbearing 6-2</p> <p>Protective membranes 13-4</p> <p>Construction classifications, restrained and unrestrained Table E-1.5</p>	<p>-F-</p> <p>Fire endurance test 4-1, G-3 to G-4</p> <p>Floor and roof assemblies, tests of Chap. 9, A-9-1.2, G-7.3</p> <p>Performance of protective membranes Chap. 13</p> <p>Report of results 14-2, 14-4</p> <p>Restrained assembly</p> <p>Conditions of acceptance 9-5</p> <p>Guide for determining conditions of restraint A-9-1.2, App. E</p> <p>Unrestrained assembly, conditions of acceptance of 9-6</p> <p>Floors, temperature of unexposed surfaces 2-3, A-2-3.1</p> <p>Furnaces</p> <p>Burners, recording fuel flow to A-2-2</p> <p>Pressure 2-4, G-6.3</p> <p>Temperature 2-2, A-2-2</p> <p>Test G-5</p> <p>-G-</p> <p>Girders, solid structural steel, alternate test of protection for Chap. 12</p> <p>-H-</p> <p>Hose stream test 4-2, G-9</p> <p>-I-</p> <p>Integrity, test of G-9</p> <p>-L-</p> <p>Loaded beams</p> <p>Alternative classification for Chap. 11</p> <p>Report of results 14-4</p> <p>Restrained, tests of Chap. 10</p>

Loading G-3, G-8
 Bearing walls and partitions, tests of ... 5-2, A-5-2, G-8.3 to G-8.5
 Columns, tests of 7-2
 Floor and roof assemblies, tests of 9-3, G-8.1 to G-8.2
 Loaded restrained beams, tests of 10-3
 Report of results 14-4

-M-

Membranes, protective
 Report of results 14-3
Membranes, protective, in wall, partition, floor, or roof assemblies Chap. 13, G-12

-N-

Nonbearing walls and partitions, tests of Chap. 6
Nozzle distance, hose stream test 4-2.3

-P-

Partitions *see* Walls and partitions
Pressure, furnace 2-4, G-6.3
Protective membranes *see* Membranes, protective
Purpose of standard 1-2

-R-

Referenced publications Chap. 15, App. H
Report of results Chap. 14, A-14-1.4, G-11.2 to 11.3
 Suggested form App. D
Restraint G-10.3 to G-10.4
 Construction classifications Table E-1.5
 Guide for determining conditions of A-9-1.2, App. E
Roof assemblies *see* Floor and roof assemblies, tests of
Roof coverings 3-1.3
Roofs, temperature of unexposed surfaces 2-3, A-2-3.1

-S-

Scope of standard 1-1, A-1-1, G-4
Shall (definition) 1-4
Should (definition) 1-4
Significance of standard 1-3, G-4
Specimens, test Chap. 3, G-7
 Protection and conditioning 3-2, A-3-2.1, G-7.2

Size and characteristics 3-1, G-7.1
 Bearing walls and partitions, tests of 5-1
 Columns, tests of 7-1
 Floor and roof assemblies, tests of 9-2
 Loaded restrained beams, tests of 10-2
 Membranes, protective 13-2
 Nonbearing walls and partitions, tests of 6-1
 Steel columns and beams, alternate tests of
 protection for 8-2, 12-2

Steel, structural, alternate tests of protection for

Beams and girders Chap. 12
 Columns Chap. 8

-T-

Temperature *see also* Temperature—time curve
 Fire severity defined by G-3
 Furnace 2-2, A-2-2
 Measurement
 Beams 11-2, 12-3
 Floor and roof assemblies, tests of 9-4
 Steel columns and beams, alternate tests of
 protection for 8-3, 12-3
 Membranes, protective, performance of 13-3
 Unexposed surfaces of floors, roofs, walls, and partitions 2-3,
 A-2-3.1

Temperature—time curve 2-1, App. B, G-6

Test specimens *see* Specimens, test

Tests *see also* specific type such as Fire endurance test
 Classification as determined by 14-1
 Conditions of G-10
 Conduct of Chap. 4
 Control of Chap. 2, A-2

Thermocouple pads, recommendations for App. C

-W-

Walls and partitions

Bearing, tests of Chap. 5, 14-4, A-5-2
 Double G-8.5
 Exterior G-7.3
 Hose stream tests G-9
 Nonbearing, tests of Chap. 6
 Performance of protective membranes Chap. 13
 Report of results 14-4
 Symmetrical/asymmetrical G-7.5
 Temperature of unexposed surfaces 2-3, A-2-3.1
 Through-joints, effect of G-7.4

The NFPA Codes and Standards Development Process

Since 1896, one of the primary purposes of the NFPA has been to develop and update the standards covering all areas of fire safety.

Calls for Proposals

The code adoption process takes place twice each year and begins with a call for proposals from the public to amend existing codes and standards or to develop the content of new fire safety documents.

Report on Proposals

Upon receipt of public proposals, the technical committee members meet to review, consider, and act on the proposals. The public proposals – together with the committee action on each proposal and committee-generated proposals – are published in the NFPA's Report on Proposals (ROP). The ROP is then subject to public review and comment.

Report on Comments

These public comments are considered and acted upon by the appropriate technical committees. All public comments – together with the committee action on each comment – are published as the Committee's supplementary report in the NFPA's Report on Comments (ROC).

The committee's report and supplementary report are then presented for adoption and open debate at either of NFPA's semi-annual meetings held throughout the United States and Canada.

Association Action

The Association meeting may, subject to review and issuance by the NFPA Standards Council, (a) adopt a report as published, (b) adopt a report as amended, contingent upon subsequent approval by the committee, (c) return a report to committee for further study, and (d) return a portion of a report to committee.

Standards Council Action

The Standards Council will make a judgement on whether or not to issue an NFPA document based upon the entire record before the Council, including the vote taken at the Association meeting on the technical committee's report.

Voting Procedures

Voting at an NFPA Annual or Fall Meeting is restricted to members of record for 180 days prior to the opening of the first general session of the meeting, except that individuals who join the Association at an Annual or Fall Meeting are entitled to vote at the next Fall or Annual Meeting.

"Members" are defined by Article 3.2 of the Bylaws as individuals, firms, corporations, trade or professional associations, institutes, fire departments, fire brigades, and other public or private agencies desiring to advance the purposes of the Association. Each member shall have one vote in the affairs of the Association. Under Article 4.5 of the Bylaws, the vote of such a member shall be cast by that member individually or by an employee designated in writing by the member of record who has registered for the meeting. Such a designated person shall not be eligible to represent more than one voting privilege on each issue, nor cast more than one vote on each issue.

Any member who wishes to designate an employee to cast that member's vote at an Association meeting in place of that member must provide that employee with written authorization to represent the member at the meeting. The authorization must be on company letterhead signed by the member of record, with the membership number indicated, and the authorization must be recorded with the President of NFPA or his designee before the start of the opening general session of the Meeting. That employee, irrespective of his or her own personal membership status, shall be privileged to cast only one vote on each issue before the Association.