

NFPA 318

Standard for the Protection of Cleanrooms 1995 Edition



NOTICE

All questions or other communications relating to this document should be sent only to NFPA headquarters, addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable federal, state and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action that is not in compliance with applicable laws, and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision—This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference—Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders, or similar instruments. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription—A. Public authorities with lawmaking or rule-making powers only upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders, or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rule-making process. B. Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rule-making powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately, provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rule-making powers may apply for and may receive a special royalty where the public interest will be served thereby.

3. Scope of License Grant—The terms and conditions set forth above do not extend to the index to this document.

(For further explanation, see the Policy Concerning the Adoption, Printing, and Publication of NFPA Documents, which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accept any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document, and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

Copyright © 1995 NFPA, All Rights Reserved

NFPA 318
Standard for the
Protection of Cleanrooms
1995 Edition

This edition of NFPA 318, *Standard for the Protection of Cleanrooms*, was prepared by the Technical Committee on Cleanrooms and acted on by the National Fire Protection Association, Inc., at its Fall Meeting held November 14-16, 1994, in Toronto, Ontario, Canada. It was issued by the Standards Council on January 13, 1995, with an effective date of February 7, 1995, and supersedes all previous editions.

The 1995 edition of this document has been approved by the American National Standards Institute.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

Origin and Development of NFPA 318

The Committee on Cleanrooms was formed in 1988 and held its first meeting during May of that year. The Committee was organized into Chapter Subcommittees that separately prepared individual chapters and related appendix material for review by the full Committee at meetings held October 1988, March 1989, September 1989, March 1990, September 1990, and June 1991.

The standard was submitted and adopted at the Fall Meeting in Montréal, Québec, Canada, November 18-20, 1991. The 1992 edition was the first edition of this standard.

The standard was revised in 1995.

Technical Committee on Cleanrooms

Richard M. Lemons, Chair
Lester B. Knight & Assoc., NM

Dennis Kirson, Vice Chair
U.S. Dept. of Energy, NM

Patrick J. Robinson, Secretary
Motorola Inc.-Semiconductor Prod Sec, AZ

Roger B. Benson, Factory Mutual Engr Assn., CA
John T. Booth, IBM, VT
Aimee Bordeaux, Semiconductor Equipment & Materials
Int'l., CA
Carl A. Caves, U.S. Dept. of Energy, MD
Marvin Charney, Kidde-Fenwal Inc., CA
Rep. Fire Suppression Systems Assn.
Dennis H. Collins, Intel Corp., OR
Dennis M. Crinnion, Bollins Hudig Hall of Northern CA,
Inc., CA
William K. Deeks, Wausau Insurance Cos., OR
Rep. The Alliance of American Insurers

Steve C. Dryden, Black & Veatch, MO
Richard L. Koski, Santa Clara Plastics, ID
Lawrence A. McKenna, Jr., AT&T Co., NJ
Lee Neal, Semiconductor Industry Assn., CA
Robert J. Pearce, Industrial Risk Insurers, CA
Robert M. Rogers, Kemper Nat'l Insurance Cos., CA
Larry M. Romine, Schirmer Engr Corp., TX
Lawrence E. Shea, Shea Technology, NV
Robert D. Sherman, San Leandro, CA

Alternates

Louis H. Greuling, Industrial Risk Insurers, CT
(Alt. to R. J. Pearce)
Darryl E. Ives, Nat'l Semiconductor Corp., CA
(Alt. to L. Neal)
Michael W. Lynch, IBM, VT
(Alt. to J. T. Booth)
William B. Marshall, AT & T Microelectronics, FL
(Alt. to L. A. McKenna, Jr.)

Michael J. Prowse, Cerberus Pyrotronics, NJ
(Alt. to M. Charney)
Robert V. Scholes, Kemper Nat'l Insurance Cos., CA
(Alt. to R. M. Rogers)
Samir Shiban, Intel Corp., OR
(Alt. to D. H. Collins)

Mark T. Conroy, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on fire protection for cleanrooms.

Contents

Chapter 1 General	318- 4	6-4 Silane and Silane/Nontoxic Mixes Storage and Dispensing Areas	318- 9
1-1 Scope	318- 4	6-5 Silane/Toxic Mixes Storage and Dispensing Areas	318-10
1-2 Purpose	318- 4	6-6 Flammable or Toxic Gases	318-10
1-3 Applicability	318- 4	6-7 Vent Headers	318-11
1-4 Definitions	318- 4	6-8 Training	318-11
Chapter 2 Fire Protection	318- 5	Chapter 7 Production and Support Equipment	318-11
2-1 Automatic Fire Extinguishing Systems . . .	318- 5	7-1 General	318-11
2-2 Alarm Systems	318- 6	7-2 Interlocks	318-11
2-3 Detection Systems	318- 6	7-3 Electrical Design	318-11
Chapter 3 Ventilation and Exhaust Systems . . .	318- 6	7-4 Process Liquid Heating Equipment	318-11
3-1 Air Supply and Recirculation Systems . . .	318- 6	7-5 Materials of Construction	318-12
3-2 Local Exhaust System	318- 6	7-6 Vacuum Pumps	318-12
3-3 Local Exhaust System Construction	318- 6	7-7 Hazardous Gas Delivery Systems	318-12
3-4 Duct Velocities	318- 7	7-8 Tools Using Flammable or Combustible Chemicals	318-12
3-5 Controls	318- 7	Chapter 8 Means of Egress	318-12
Chapter 4 Construction	318- 7	Chapter 9 Referenced Publications	318-12
Chapter 5 Chemical Storage and Handling . . .	318- 8	Appendix A Explanatory Material	318-13
5-1 Hazardous Chemicals	318- 8	Appendix B	318-16
5-2 Flammable and Combustible Liquid Delivery Systems	318- 8	Appendix C Referenced Publications	318-16
5-3 Container Delivery	318- 8	Index	318-17
5-4 Waste Disposal	318- 9		
5-5 Spill Protection	318- 9		
Chapter 6 Hazardous Gas Cylinder Storage and Distribution	318- 9		
6-1 Packaging	318- 9		
6-2 Transport to the Semiconductor Facility	318- 9		
6-3 Distribution Systems	318- 9		

NFPA 318

Standard for the Protection of Cleanrooms

1995 Edition

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates explanatory material on that paragraph in Appendix A.

Information on referenced publications can be found in Chapter 9 and Appendix C.

Chapter 1 General

1-1 Scope. This standard applies to all semiconductor facilities containing what is herein defined as a cleanroom or clean zone, or both.

1-2* Purpose. This standard is intended to provide reasonable safeguards for the protection of facilities containing cleanrooms from fire and related hazards. These safeguards are intended to provide protection against injury, loss of life, and property damage.

1-3 Applicability. The provisions of this document are considered necessary to provide a reasonable level of protection from loss of life and property from fire and explosion. They reflect situations and the state of the art at the time the standard was issued.

Unless otherwise noted, it is not intended that the provisions of this document be applied to facilities, equipment, structures, or installations that were existing or approved for construction or installation prior to the effective date of the document, except in those cases where it is determined by the authority having jurisdiction that the existing situation involves a distinct hazard to life or adjacent property.

1-4 Definitions.

Access Floor System. An assembly consisting of panels mounted on pedestals to provide an under-floor space for the installations of mechanical, electrical communication, or similar systems or to serve as an air-supply or return-air plenum.

Approved. Acceptable to the authority having jurisdiction.

NOTE: The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization concerned with product evaluations that is in a position to determine compliance with appropriate standards for the current production of listed items.

Authority Having Jurisdiction. The organization, office, or individual responsible for approving equipment, an installation, or a procedure.

NOTE: The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities.

Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

Clean Zone. A defined space in which the concentration of airborne particles is controlled to specified limits.

Cleanroom. A room in which the concentration of airborne particles is controlled to specified limits.

Compressed Gas. Any material or mixture having in the container an absolute pressure exceeding 40 psi (pounds per square inch) at 70°F (275.8 kPa at 21.1°C) or, regardless of the pressure at 70°F (21.1°C), having an absolute pressure exceeding 104 psi at 130°F (717 kPa at 54.4°C), or flammable liquid having a vapor pressure exceeding 40 psi absolute at 100°F (275.8 kPa at 37.8°C) as determined by ASTM D323, *Standard Test Method for Vapor Pressure of Petroleum Products*.

Explosion. An effect produced by the sudden violent expansion of gases, which can be accompanied by a shock-wave or disruption, or both, of enclosing materials or structures. An explosion might result from chemical changes such as rapid oxidation, deflagration, or detonation; decomposition of molecules, and runaway polymerization (usually detonations); or physical changes (e.g., pressure tank ruptures).

Flammable Vapors. A concentration of flammable constituents in air that exceeds 10 percent of its lower flammable limit (LFL).

Hazardous Chemical.* Any solid, liquid, or gas that has a degree-of-hazard rating in health, flammability, or reactivity of Class 3 or 4 as ranked by NFPA 704, *Standard System for the Identification of the Fire Hazards of Materials*.

Interface. That place at which independent systems meet and act on or communicate with each other.

Interlock. An arrangement in which the operation of one part or mechanism automatically brings about or prevents the operation of another.

Liquid. For the purpose of this code, any material that has a fluidity greater than that of 300 penetration asphalt when tested in accordance with ASTM D5, *Standard Test Method for Penetration of Bituminous Materials*. When not otherwise identified, the term liquid shall mean both flammable and combustible liquids.

Combustible Liquid. A liquid having a flash point at or above 100°F (37.8°C).

Combustible liquids shall be subdivided as follows:

Class II liquids shall include those having flash points at or above 100°F (37.8°C) and below 140°F (60°C).

Class IIIA liquids shall include those having flash points at or above 140°F (60°C) and below 200°F (93°C).

Class IIIB liquids shall include those having flash points at or above 200°F (93°C).

Flammable Liquid. A liquid having a flash point below 100°F (37.8°C) and having a vapor pressure not exceeding 40 psia (2 068 mm Hg) at 100°F (37.8°C) shall be known as a Class I liquid.

Class I liquids shall be subdivided as follows:

Class IA liquids shall include those having flash points below 73°F (22.8°C) and having a boiling point below 100°F (37.8°C).

Class IB liquids shall include those having flash points below 73°F (22.8°C) and having a boiling point at or above 100°F (37.8°C).

Class IC liquids shall include those having flash points at or above 73°F (22.8°C) and below 100°F (37.8°C).

Listed. Equipment or materials included in a list published by an organization acceptable to the authority having jurisdiction and concerned with product evaluation that maintains periodic inspection of production of listed equipment or materials and whose listing states either that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.

NOTE: The means for identifying listed equipment may vary for each organization concerned with product evaluation, some of which do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

Noncombustible. A material that, in the form in which it is used and under the conditions anticipated, will not ignite, burn, support combustion, or release flammable vapors when subjected to fire or heat. Materials that are reported as passing ASTM E136, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750 Degrees C*, shall be considered noncombustible. (See NFPA 220, *Standard on Types of Building Construction*.)

Pass-through. An enclosure installed in a wall with a door on each side that allows chemicals, production materials, equipment, and parts to be transferred from one side of the wall to the other.

Pyrophoric. A chemical with an autoignition temperature in air at or below 130°F (54.4°C).

Restricted Flow Orifice. A device located in the gas cylinder valve body that restricts the maximum flow rate to 1.06 ft³/min (30 L/min).

Smoke. The airborne solid and liquid particulates and gases evolved when a material undergoes pyrolysis or combustion, together with the quantity of air that is entrained or otherwise mixed into the mass.

Standby Mode. A mode wherein all flow of flammable gas or liquid ceases and heaters have power removed.

Third Party. A professional, qualified as the result of training, education, and experience, who can perform a compliance and hazardous analysis of process equipment in accordance with this standard.

Tool. Any device, storage container, work station, or process machine used in the cleanroom.

Work Station. A defined space or an independent principal piece of equipment using hazardous chemicals within a cleanroom or clean zone, where a specific function, a laboratory procedure, or a research activity occurs.

The work station might include connected cabinets and contain ventilation equipment, fire protection devices, sensors for gas and other hazards, electrical devices, and other processing and scientific equipment.

Chapter 2 Fire Protection

2-1 Automatic Fire Extinguishing Systems.

2-1.1 General. Wet pipe automatic sprinkler protection shall be provided throughout facilities containing cleanrooms and clean zones.

2-1.2 Automatic Sprinkler Systems.

2-1.2.1* Automatic sprinklers for cleanrooms or clean zones shall be installed in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*, and shall be hydraulically designed for a density of 0.20 gpm/ft² [8.15 (L/min)/m²] over a design area of 3000 ft² (278.8 m²).

2-1.2.2* Approved quick response sprinklers shall be utilized for sprinkler installations within down-flow airstreams in cleanrooms and clean zones.

2-1.2.3* Sprinklers shall be installed in gas cylinder cabinets containing flammable gases.

2-1.2.4* Automatic deluge water spray protection shall be provided over silane gas cylinders in open dispensing systems described in 6-4.2.1(b). This protection shall be activated by ultraviolet/infrared detectors.

Exception: Where the open dispensing system is remotely located from structures and designed to mitigate the effects of detonation, the automatic deluge water spray system shall not be required.

2-1.2.5 Automatic sprinkler protection shall be designed and installed in the plenum and interstitial space above cleanrooms in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*, for a density of 0.20 gpm/ft² [8.15 (L/min)/m²] over a design area of 3000 ft² (278.8 m²).

2-1.2.6 All combustible exhaust ducts shall have interior automatic sprinklers when the largest interior cross-sectional diameter is equal to or greater than 10 in. (254 mm).

Exception: Ducts approved for use without internal automatic sprinklers.

2-1.2.6.1* Sprinklers installed in duct systems shall be hydraulically designed to provide 0.5 gpm (1.9 L/min) over an area derived by multiplying the distance between the sprinklers in a horizontal duct by the width of the duct. Minimum discharge shall be 20 gpm (76 L/min) per sprinkler from the five hydraulically most remote sprinklers. Sprinklers shall be spaced a maximum of 20 ft (6.1 m) apart horizontally and 12 ft (3.7 m) apart vertically.

2-1.2.6.2 A separate indicating control valve shall be provided for sprinklers installed in ductwork.

2-1.2.6.3* Drainage shall be provided to remove all sprinkler water discharged in ductwork.

2-1.2.6.4 Where corrosive atmospheres exist, duct sprinklers and pipe fittings shall be manufactured of corrosion resistant materials or coated with approved materials.

2-1.2.6.5 The sprinklers shall be accessible for periodic inspection and maintenance.

2-1.2.7* Automatic sprinklers shall be provided in pass-throughs used to convey combustible chemicals.

2-1.2.8* Combustible Tools.

2-1.2.8.1 Where the horizontal surface of a combustible tool is obstructed from ceiling sprinkler discharge, automatic sprinkler protection that covers the horizontal surface of the tool shall be provided.

Exception: An automatic gaseous-fire-suppression local surface application system shall be permitted as an alternative to sprinklers. Gaseous extinguishing systems shall be actuated by IR or UV/IR optical detectors. Detectors shall be tested monthly.

2-1.2.8.2 Where the work station is of combustible construction, automatic sprinkler protection shall be provided in the exhaust transition piece.

Exception: An automatic gaseous-fire-suppression interior application system shall be permitted as an alternative to sprinklers.

2-1.2.8.3* Where the branch exhaust ductwork is constructed of combustible material, automatic sprinkler protection shall be provided within the work station transition piece or the branch exhaust duct.

2-1.2.8.4 Where the branch exhaust ductwork is subject to combustible residue buildup, regardless of the material of construction, automatic sprinkler protection shall be provided.

2-2 Alarm Systems.

2-2.1 The discharge of an automatic fire suppression system shall activate an audible fire alarm system on the premises and an audible or visual alarm at a constantly attended location.

2-2.2* Where the potential exists for flammable gas concentrations to exceed 20 percent of the LFL, a continuous gas detection system shall be provided.

2-2.3 Signal transmission for alarms designed to activate signals at more than one location shall be verified at each location during each test of the alarm system.

2-2.4 A manual notification system shall be provided to result in an audible alarm as in 2-2.1.

2-3 Detection Systems.

2-3.1* A listed or approved air sampling smoke detection system shall be provided in the cleanroom return airstream at a point before dilution from make-up air occurs. The system shall have a minimum sensitivity of 0.03 percent per ft obscuration. The system shall be capable of monitoring particles to 10 microns or less. Where the system is of the light-scattering type, it shall have a minimum sensitivity of 0.03 percent per ft obscuration; where the system is of the cloud chamber type, it shall have a minimum sensitivity of 50,000 particles per millimeter.

2-3.2* Smoke detection within a cleanroom air system shall result in an alarm transmission to a constantly attended location as well as a local alarm signal within the cleanroom that is distinctive from both the facility evacuation alarm signal and any process equipment alarm signals in the cleanroom.

2-3.3 Detection shall be provided at silane gas cylinders in open dispensing systems described in 6-4.2.1(b). Activation of detectors shall result in the closing of the cylinder automatic shutoff valves described in 6-1.2.

Chapter 3 Ventilation and Exhaust Systems

3-1 Air Supply and Recirculation Systems.

3-1.1 The location of outside air intakes shall be chosen to avoid drawing in hazardous chemicals or products of combustion coming either from the building itself or from other structures and devices.

3-1.2 High Efficiency Particulate Air (HEPA) and Ultra Low Penetration Air (ULPA) filter modules shall meet the combustibility requirements outlined in UL 586, *High-Efficiency, Particulate, Air Filter Units*.

3-1.3 Air supply and recirculation ducts, connectors, and appurtenances shall be constructed of noncombustible material such as aluminum steel or of Class 0 or Class 1 materials as tested in accordance with UL 181, *Standard for Safety Factory-Made Air Ducts and Air Connectors*.

3-1.4 Supply air ducts shall have a flame spread index of not more than 25 and a smoke-developed rating of not more than 50 when tested in accordance with NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*.

3-2 Local Exhaust System.

3-2.1 Exhaust air discharged from cleanrooms shall not be recirculated. Ducts shall lead to the outside as directly as practicable and shall discharge above the roof at a location, height, and velocity sufficient to prevent reentry of hazardous chemicals.

3-2.2 Energy conservation devices that create a risk of returning contaminants to the cleanroom air supply shall not be used in fume exhaust systems.

3-2.3 Air containing hazardous chemicals shall be conveyed through duct systems maintained at a negative pressure relative to the pressure of normally occupied areas of the building.

Exception: Downstream of fans, scrubbers, and treatment devices.

3-2.4 Work station exhaust ventilation shall be designed to capture and exhaust contaminants generated in the station.

3-3 Local Exhaust System Construction.

3-3.1* Ribbed flexible connections shall not be used in exhaust duct connected to combustible work stations nor to work stations where combustible chemicals are used.

3-3.2 The entire exhaust duct system shall be self-contained. No portions of the building shall be used as an integral part of the system.

3-3.3 Two or more operations shall not be connected to the same exhaust system when the combination of the substances removed might create a fire, explosion, or chemical reaction hazard within the duct system.

3-3.4 Exhaust ducts penetrating fire resistance-rated construction shall be contained in an enclosure of equivalent fire-resistive construction.

3-3.5 Fire dampers shall not be installed in exhaust ducts.

3-3.6* Exhaust duct systems shall be constructed of noncombustible materials or protected with sprinklers in accordance with 2-1.2.6.

Exception: Ducts approved for use without automatic sprinklers.

3-3.7 The exterior surface of nonmetallic exhaust ducts shall have a smoke developed rating of 25 or less when either the interior or exterior of the duct is exposed to fire, when tested in accordance with NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*.

3-4 Duct Velocities. Airflow in cleanroom exhaust systems shall be designed to ensure dilution such that flammable vapors are not conveyed in the ducts. (See definition of flammable vapors.)

3-5 Controls.

3-5.1 The exhaust ventilation system shall have an automatic emergency back-up source of power. The emergency power shall be designed and installed in accordance with NFPA 70, *National Electrical Code*®.

3-5.2* The emergency power shall operate the exhaust system at not less than 50 percent capacity when it is demonstrated that the level of exhaust maintains a safe atmosphere.

3-5.3 Fire detection and alarm systems shall not be interlocked to shut down local exhaust fans automatically.

3-5.4 Dampers, where required for balancing or control of the exhaust system, shall be of a locking type.

3-5.5 The air-handling system shall be designed to provide smoke exhaust, or a dedicated smoke control system shall be provided.

Exception No. 1: Where contamination within the cleanroom is limited and recirculation will not affect adjoining areas, the above shall not be required.

Exception No. 2: Where the cleanroom is not Class 1000 or cleaner as defined in Federal Standard 209E, Cleanroom and Work Station Requirements, Controlled Environment, the above shall not be required.

Exception No. 3: Where the fume exhaust system is capable of smoke removal or preventing smoke migration, the above shall not be required.


3-5.6 A manually operated remote switch(es) to shut off the affected areas of the cleanroom air recirculation system(s) shall be provided at an approved location(s).

Chapter 4 Construction

4-1* Cleanrooms rated Class 100 or cleaner in accordance with Federal Standard 209E, *Cleanroom and Work Station Requirements, Controlled Environment*, or cleanrooms having clean zones rated Class 100 or cleaner, shall have approved, noncombustible components for walls, floors, ceilings, and partitions.

4-2 Cleanrooms shall be separated from adjacent occupancies by 1-hour fire resistance-rated construction.

4-3 Cleanroom access floors shall be designed to resist a force of 0.5 G magnitude in seismic zones 1, 2, and 3, depicted in Figure 4-3.

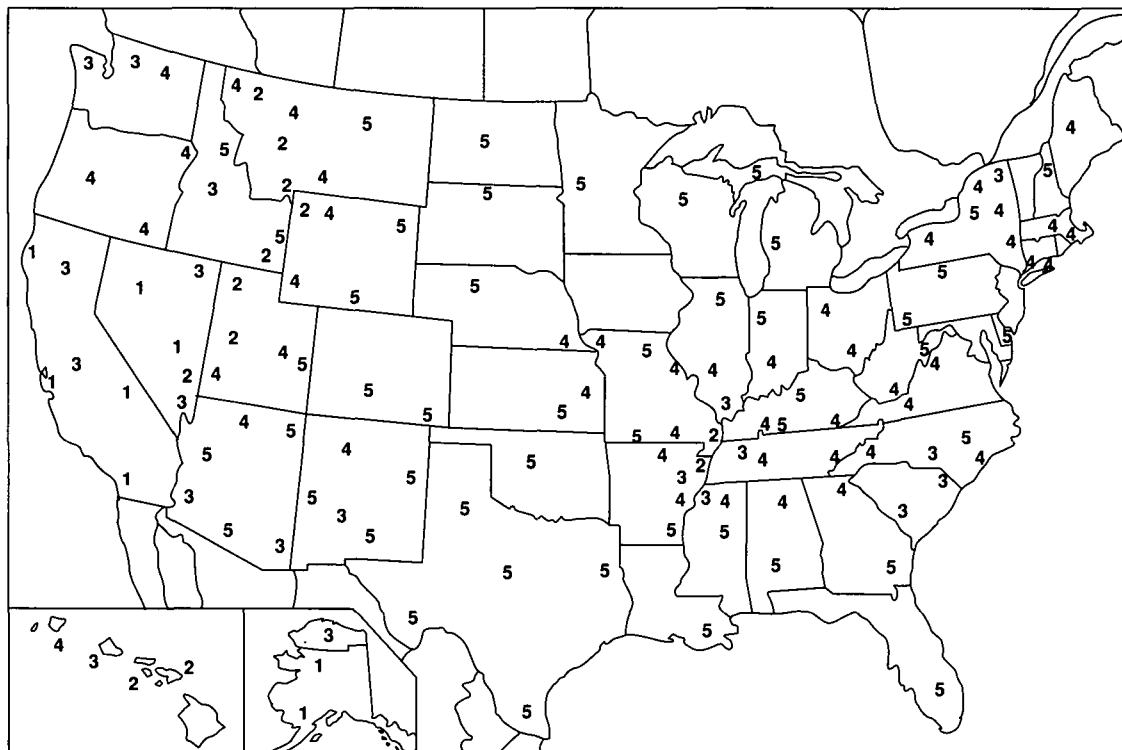

Earthquake Zones

1—Maximum potential for earthquake damage
2—Reasonable potential

3—Slight potential
4 and 5—Earthquake protection not required

Figure 4-3 Seismic map.

Chapter 5 Chemical Storage and Handling

5-1 Hazardous Chemicals.

5-1.1* Storage and handling of hazardous chemicals shall comply with applicable NFPA standards, including the following:

NFPA 30, *Flammable and Combustible Liquids Code*;

NFPA 33, *Standard for Spray Application Using Flammable and Combustible Materials*;

NFPA 43A, *Code for the Storage of Liquid and Solid Oxidizers*;

NFPA 43B, *Code for the Storage of Organic Peroxide Formulations*;

NFPA 70, *National Electrical Code*;

NFPA 385, *Standard for Tank Vehicles for Flammable and Combustible Liquids*; and

NFPA 386, *Standard for Portable Shipping Tanks for Flammable and Combustible Liquids*.

5-1.1.1 Hazardous chemicals storage and dispensing rooms shall be separated from the cleanroom by 1-hour fire resistance-rated construction.

5-1.1.2 Hazardous chemicals storage and dispensing rooms shall have a drainage system to an approved location, or the room shall serve as secondary containment for a hazardous chemical spill and fire protection water for a period of 20 minutes.

5-1.1.3 Hazardous chemicals in the cleanroom shall be limited to those needed for operations and maintenance. Quantities of hazardous chemicals shall be limited to those within the tool or the daily (24 hours) supply of chemicals needed.

5-1.1.4 Hazardous chemicals storage and dispensing rooms shall have mechanical exhaust ventilation as follows:

- (a) Mechanical exhaust ventilation shall be at a minimum rate of one cu ft per min (cfm) per sq ft of floor area.
- (b) Exhaust and inlet openings shall be arranged to prevent accumulation of vapors.
- (c) For dispensing rooms, the mechanical exhaust ventilation system shall be connected to an automatic emergency back-up source of power.

5-1.1.5 Accidental Mixing.

5-1.1.5.1 Hazardous chemicals shall be stored within enclosed storage cabinets or work stations.

Exception: Within hazardous materials storage or dispensing rooms.

5-1.1.5.2 Incompatible chemicals shall not be stored in the same cabinet.

5-1.1.5.3 Storage cabinets shall be constructed of not less than 18 gauge steel. Doors shall be self-closing and shall be provided with a latching device.

5-1.1.6 Approved safety containers shall be used to store flammable liquids.

Exception: Where needed for purity, glass or plastic containers shall be permitted for quantities of 1 gal (4 L) or less per individual container.

5-1.1.7 Containers of chemicals shall be labeled as to their contents.

5-2 Flammable and Combustible Liquid Delivery Systems.

5-2.1 Class I and II liquids shall not be piped to deliver by gravity from tanks, drums, barrels, or similar containers. Dispensing devices for flammable and combustible liquids shall be of an approved type.

5-2.2 When pressurized systems are utilized, all materials used in the system will be compatible with the chemicals being dispensed.

5-2.3 The pressurized system shall be equipped with the following safeguards:

- (a) Automatic depressurization vents in the case of fire. Vent to a safe location.
- (b) Manual vents to allow for the removal of canisters. Vent to a safe location.
- (c) Manual shutoff valves at the point of use.
- (d) Only inert gas shall be used.

5-2.4 For pressurized delivery systems of 10 gal (38.8 L) or less, inert gases shall be used at 15 psi (1 bar) or less.

5-2.5 Pressurized delivery systems for flammable or combustible liquids shall be hydrostatically tested to 150 percent of the working pressure for 2 hours with no visible leakage or loss of pressure.

Exception: An inert gas shall be permitted to be used to pressure test systems in which water or water residue would be damaging or cost restrictive.

5-2.6 Pressurized delivery systems for flammable and combustible liquids shall be constructed of a ferrous metal.

5-2.7 Delivery pressure at the tool shall not exceed 15 psi (103 kPa).

5-2.8 Bulk delivery systems shall be equipped with the following safeguards:

- (a) Excess flow protection.
- (b) Secondary containment for spills.
- (c) Manual shutdown at point of use and dispensing.
- (d) Fill level monitors and automatic shutoff.
- (e) Preset meter for automated delivery systems.

5-3 Container Delivery.

5-3.1* In new buildings, hazardous chemicals shall not be permitted within an exit corridor. In existing buildings, hazardous chemicals shall be transported in approved chemical carts.

5-3.2 Hazardous chemicals shall not be dispensed or stored in exit access corridors.

5-3.3* Chemical carts transporting or containing hazardous chemicals shall be designed so that the contents will be fully enclosed. They shall be capable of containing a spill from the largest single container transported, with a maximum individual container size of 5 gal (19 L). The capacity of carts used for transportation of hazardous chemicals shall not exceed 55 gal (208 L).

5-3.4 Incompatible chemicals shall not be transported simultaneously on the same hazardous chemical cart.

5-4 Waste Disposal.

5-4.1 Separate drainage systems shall be provided for incompatible materials.

5-4.2* Drainage systems shall be labeled as to their intended contents in an approved manner.

5-4.3 Collection of chemicals shall be directed to containers compatible with the material being collected.

5-4.4 Flammable liquids shall be collected in approved containers.

5-4.5 During collection of flammable liquids the waste container shall be within secondary containment.

5-4.6 Chemical containers shall be labeled as to their contents in an approved manner.

5-4.7 Incompatible chemicals shall not be transported simultaneously on the same hazardous chemical cart.

5-5 Spill Protection.

5-5.1 Spill protection for liquid hazardous chemicals shall be provided where leakage from a fitting or tool terminates in an unoccupied or below-grade area.

5-5.2 Spill protection shall include secondary containment and a method of detecting a spill.

Chapter 6 Hazardous Gas Cylinder Storage and Distribution

6-1 Packaging.

6-1.1 Container Data. The supplier shall accumulate and provide upon request the following information:

(a) Cylinder contents with description of the components.

(b) Cylinder serial number, material of construction, and standards used for construction and testing.

(c) Cylinder valve with restricted orifice, when provided. Date of manufacture, material of construction, and flow curve for the orifice.

(d) Description and date of last hydrostatic test.

6-1.2* Cylinders containing pyrophoric gases shall be equipped with normally closed automatic shutoff valves that incorporate restricted flow orifices.

6-2 Transport to the Semiconductor Facility. The operator of a vehicle transporting hazardous compressed and liquefied gases shall be trained in the handling of containers and the use of portable fire extinguishers. The operator shall be familiar with the site gas delivery procedures.

6-2.1 A leak check shall be performed on all gas cylinders prior to unloading from the transport vehicle.

6-2.2* An emergency response program shall be developed to handle accidents connected with the delivery of gases.

6-3 Distribution Systems.

6-3.1 Material for tubing, piping, and fittings used for distribution of compressed and liquefied gases shall be compatible with those gases. The entire system shall be

subjected to a pressure test at a minimum pressure of 20 percent over the maximum pressure available to the system but not less than 80 psi (552 kPa) for 2 hours with no discernible pressure drop.

6-3.2* Materials for tubing, piping, and fittings used for the distribution of compressed and liquefied gases shall be of noncombustible construction or of combustible construction contained in a noncombustible outer jacket.

Exception: When double containment of highly corrosive gases is used, the use of combustible piping and a combustible outer jacket shall be permitted.

6-3.3 Tubing, piping, and fittings shall be welded.

Exception: Nonwelded connections and fittings shall be permitted to be used when housed in an exhausted enclosure or in an outside enclosure.

6-3.4 Distribution piping shall be leak tested in accordance with SEMI F1-90, *Specification for Leak Testing Toxic Gas Piping Systems*.

6-3.5* Welders and pipefitters shall be trained and qualified for the specific function they are performing.

6-3.6* Purge panels shall be provided at the cylinders on all compressed hazardous process gases when in use. (See 6-4.3(j) for silane and silane mixes.)

6-3.7 Gas cabinets or purge panels not located in gas cabinets shall be labeled with the process tools they serve, the type of gas, and the type of purge gas.

6-3.8* Purge panels shall be constructed of materials compatible with gases conveyed, minimize leakage potential, provide for control of excess flow, and be equipped with an appropriate emergency shutoff.

6-3.9 Purge panels shall be designed to prevent backflow and cross contamination of purge gas or other process gases.

6-3.10 Check valves shall not be exposed to cylinder pressure if a cylinder has a pressure greater than 80 psi (552 kPa).

6-3.11 A manual isolation valve shall be provided on the process delivery line at the purge panel to permit removal of the purge panel for repair and maintenance.

6-3.12 Incompatible process gases shall not occupy the same gas cabinet.

6-3.13 Hazardous gas cylinder purge panels shall be provided with dedicated purge gas cylinders. Only purge panels serving compatible gases shall be permitted to share a purge cylinder.

6-3.14 Bulk gas systems shall not be used as the purge source for hazardous gas cylinder purge panels.

6-4 Silane and Silane/Nontoxic Mixes Storage and Dispensing Areas.

6-4.1 Cylinders shall be stored in storage areas external to the building.

6-4.1.1 Cylinders not located in bunkers shall be provided with a security open chain-link fence. The cylinders shall be separated from adjacent structures and the fence by a minimum distance of 9 ft (2.7 m).

6-4.1.2 The storage area shall be open on at least three sides with cylinders secured to steel frames. Where a canopy is provided, the height shall be a minimum of 12 ft (3.7 m).

6-4.2 Gases shall be dispensed from open dispensing racks.

6-4.3 Dispensing areas shall be provided with the following safeguards:

(a) Dispensing racks shall be located external to the building.

Exception: Where the weather conditions do not permit, the dispensing racks shall be in an approved bunker.

(b) Cylinders shall be separated from each other by a steel plate $\frac{1}{4}$ in. (6.3 mm) thick, extending 3 in. (76 mm) beyond the footprint of the cylinder. The steel plate shall extend from the top of the purge panel to 12 in. (305 mm) below the cylinder valve.

(c) Mechanical or natural ventilation at a minimum of 1 cfm/ft² (0.00047 m³/s per 0.09 m²) of storage and dispensing area shall be provided.

(d) Cylinders shall be provided with protection and detection in accordance with 2-1.2.5 and 2-3.3.

(e) Remote manual shutdown of process gas flow shall be provided near each gas panel. The dispensing area shall have an emergency shutdown for all gases that can be operated at a minimum distance of 15 ft (4.6 m) from the dispensing area.

(f) Exterior dispensing areas shall be separated from structures in accordance with Figure 6-4. The dispensing area shall be open on at least three sides with cylinders secured to steel frames. Where a canopy is provided, the height shall be a minimum of 12 ft (3.7 m).

(g) Gas vent headers or individual purge panel vent lines shall have a continuous flow of nitrogen. To prevent back diffusion of air into the vent line, a nitrogen flow shall be introduced. The nitrogen shall be introduced upstream of the first vent or exhaust connection to the header.

(h) Cylinders not located in bunkers shall be provided with a security open chain-link fence. The cylinders shall be separated from adjacent structures and the fence by a minimum distance of 9 ft (2.7 m).

(i) If mechanical ventilation is provided, the ventilation system shall be provided with an automatic emergency back-up source of power to operate at full capacity.

(j) Silane and silane mixes shall be equipped with automated purge panels.

6-5* Silane/Toxic Mixes Storage and Dispensing Areas.

6-5.1 The storage area shall be located external to the building.

6-5.1.1 Cylinders not located in bunkers shall be provided with a security open chain-link fence. The cylinders shall be separated from adjacent structures and the fence by a minimum distance of 9 ft (2.7 m).

6-5.1.2 The storage area shall be open on at least three sides with cylinders secured to steel frames. Where a canopy is provided, the height shall be a minimum of 12 ft (3.7 m).

6-5.1.3 Where gas cabinets are used, only single-cylinder cabinets shall be used.

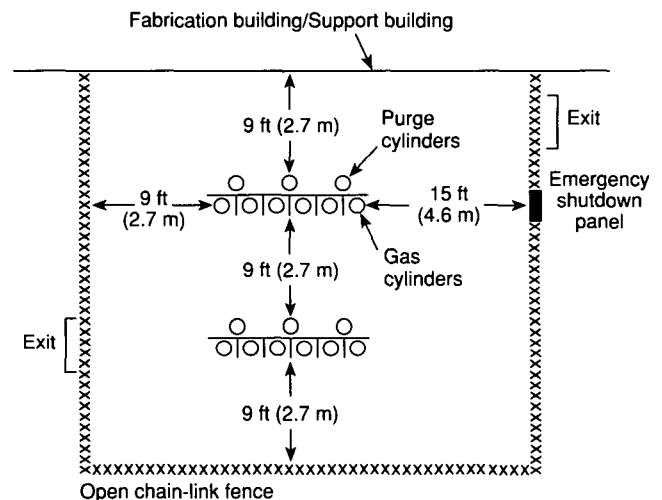


Figure 6-4 Silane dispensing area.

6-5.2 Silane/toxic mixes shall be dispensed from single-cylinder gas cabinets.

6-5.3 Dispensing areas shall be provided with the following safeguards:

(a) The dispensing areas shall be located external to the building.

Exception: Where the weather conditions do not permit, the dispensing area shall be in an approved bunker.

(b)* Silane/toxic mixes located in cabinets shall be provided with mechanical ventilation at a minimum of 200 ft per min (fpm) (0.762 m/s) across the cylinder neck and the purge panel. The ventilation system shall be provided with an automatic emergency back-up source of power to operate at full capacity.

(c) Remote manual shutdown of process gas flow shall be provided outside each gas cabinet.

(d) Gas vent headers or individual purge panel vent lines shall have a continuous flow of nitrogen. To prevent back diffusion of air into the vent line, a nitrogen flow shall be introduced. The nitrogen shall be introduced upstream of the first exhaust connection to the header.

(e) Exterior dispensing areas shall be separated from structures in accordance with Figure 6-5. The dispensing area shall be open on at least three sides with cylinders in single-cylinder cabinets. Where a canopy is provided, the height shall be a minimum of 12 ft (3.7 m).

(f) Gas cabinets not located in bunkers shall be provided with a security open chain-link fence. Cabinets shall be separated from adjacent structures and the fence by a minimum of 12 ft (3.7 m).

6-6 Flammable or Toxic Gases.

6-6.1* Toxic or flammable gases in use shall be contained in cabinets provided with exhaust ventilation. Cabinets shall be provided with gas detection and automatic shutdown of the gas supply. Exhaust ventilation shall be continuous or activated automatically by gas detection.

Exception: Lecture cylinders in ion implanters need not be in gas cabinets. They shall be located in exhausted enclosures with gas detection and automatic shutdown of the gas supply.

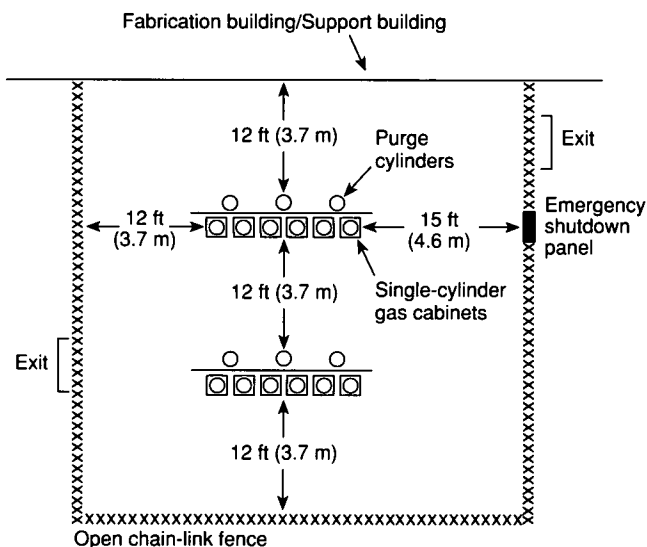


Figure 6-5 Silane/toxic mixes dispensing area.

6-6.2 Exhaust ventilation shall be provided where there is potential for gas release and for the area containing valves, fittings or connections, transfer stations, or vacuum pumps. Detection of toxic or flammable gases shall activate a local alarm and shut down the gas supply. Alarms shall be monitored continuously.

6-6.3 Exhaust ventilation, detection, and shutdown systems shall be provided with an automatic emergency source of back-up power.

6-6.4 Welding and other activities that might produce ignition shall be minimized in areas where there is potential flammable gas release. Welding or other activities that might produce a spark shall be allowed only through a special internal permit procedure that calls for monitoring in the area for 20 percent of the LEL and a fire watch and ventilation to reduce the potential of explosive concentrations.

6-6.5 "No Smoking" signs shall be provided in the flammable gas storage area, in areas where there is a potential for flammable gas release, and within 25 ft (7.6 m) of those areas.

6-6.6 Open flames shall not be used in the flammable gas storage or dispensing areas. All sources of electrical heat shall comply with NFPA 70, *National Electrical Code*. Compressed and liquefied gases in storage or dispensing shall be protected from uncontrolled heat sources.

6-7 Vent Headers.

6-7.1 Purge panel vent line headers, where used, shall be designed to prevent the mixing of incompatible gases and silane with air. Vent header inert gas purge shall be monitored and provided with a local alarm when flow falls below a required set point.

6-7.2 Silane vent headers or individual purge panel vent lines shall have a continuous flow of nitrogen. To prevent back diffusion of air into the vent line, a nitrogen flow shall be introduced. The nitrogen shall be introduced upstream of the first exhaust connection to the header.

6-7.3 Vents shall terminate at a safe location or in treatment systems.

6-7.4 Process delivery lines used for hazardous gases shall be dedicated to those gases.

6-8* Training. Operators working with hazardous gases and handling hazardous compressed and liquefied gas containers shall be trained for that function. Training shall be provided annually.

Chapter 7 Production and Support Equipment

7-1* General. Production and support equipment shall be designed and installed in accordance with Sections 7-2 through 7-8.

7-2 Interlocks.

7-2.1* Hardware interlocks that will automatically bring the tool to standby mode shall be interfaced with the tool's operating system.

7-2.2 A local visual and audible alarm shall be provided to indicate activation of any interlock.

Exception: Panel interlocks.

7-2.3 Each interlock and its operation shall be described in both the operations and maintenance manuals for the tool.

7-2.4 Tools utilizing hazardous chemicals shall be designed to accept inputs from monitoring equipment. An alarm signal from the monitoring equipment shall automatically stop the flow of hazardous chemicals to the tool.

7-2.5 Interlocks shall be designed to require manual reset and to permit restart only after fault correction.

7-3 Electrical Design.

7-3.1 Electrical components and wiring shall be in accordance with NFPA 70, *National Electrical Code*, and NFPA 79, *Electrical Standard for Industrial Machinery*. The tool or associated equipment as a complete system shall be approved.

7-3.1.1 Process tools and associated equipment shall meet the requirements of NFPA 70, *National Electrical Code*, Section 90-7, Examination of Equipment for Safety.

7-3.1.2 All electrical components and wiring shall be listed.

7-3.2 Electrical equipment and devices within 5 ft (1.5 m) of work stations in which flammable liquids or gases are used shall comply with the requirements of NFPA 70, *National Electrical Code*, for Class I, Division 2 locations.

Exception: The requirements for Class I, Division 2 locations shall not apply when the air removal from the work station or dilution will ensure nonflammable atmospheres on a continuous basis.

7-3.3 Work stations using flammable chemicals shall not be capable of being energized without adequate exhaust ventilation.

7-4 Process Liquid Heating Equipment. Electric immersion heaters and hot plates shall not be used in combustible tools or tools using combustible or flammable liquids.

Exception: Stand-alone electric water heaters, external to combustible wet stations, or bonded heaters shall be permitted.

7-4.1 Where stand-alone electric water heaters are used, they shall include:

- (a) Ground fault interrupters,
- (b) Overcurrent protection,
- (c) Power interrupts,
- (d) Manual resets,
- (e) Temperature controllers,
- (f) Redundant liquid level sensors,
- (g) Redundant over-temperature protection.

7-4.2 Electrically heated baths shall have the following interlocks to activate both shutdown and alarms:

- (a) Ground fault interrupters,
- (b) Overcurrent protection,
- (c) Power interrupts,
- (d) Manual resets,
- (e) Temperature controllers,
- (f) Redundant liquid level sensors,
- (g) Redundant over-temperature protection.

7-4.3* Those baths heating flammable or combustible liquids shall have high-temperature limit switches.

7-4.4* Liquid level sensors shall be tested after maintenance but at least monthly.

7-5 Materials of Construction. Tools shall be of noncombustible construction.

Exception: That part of the work station that comes into contact with corrosive materials.

7-6 Vacuum Pumps.

7-6.1* Vacuum pumps using combustible oils shall use a control device to remove oils prior to their discharge into the exhaust duct system.

7-6.2 Exhaust Conditioning.

7-6.2.1* Vacuum pumps that handle flammable gases in excess of 20 percent of LFL shall discharge into a control device to treat the flammable gases from the airstream prior to discharge into exhaust system ductwork.

7-6.2.2 Vacuum pumps handling flammable or pyrophoric chemicals or high concentration oxygen shall not use combustible pump oils.

7-6.2.3 Vacuum pumps that handle flammable or pyrophoric gases shall be equipped with a nitrogen purge and interlocked with the process tool operating system.

7-7 Hazardous Gas Delivery Systems.

7-7.1 Hazardous gas piping, controls, and valves that are internal to tools using hazardous gases shall be contained within a noncombustible enclosure that is exhausted at a minimum airflow of 100 cfm per ft² (0.047 m³/s per 0.09 m²) of average transverse cross-sectional area of the enclosure.

7-7.2 Mass flow controller bypass valves shall be designed to prevent excess flow of silane and to prevent them from being left in the open position.

7-8* Tools Using Flammable or Combustible Chemicals. All tools using flammable or combustible chemicals shall be provided with exhaust to reduce the concentration of flammable gases and vapors to less than 20 percent of the LFL.

Chapter 8 Means of Egress

8-1* Means of egress shall be designed in accordance with NFPA 101®, *Life Safety Code*®, Chapters 5 and 28.

Chapter 9 Referenced Publications

9-1 The following documents or portions thereof are referenced within this standard and shall be considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

9-1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 1994 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 1993 edition.

NFPA 33, *Standard for Spray Application Using Flammable and Combustible Materials*, 1989 edition.

NFPA 43A, *Code for the Storage of Liquid and Solid Oxidizers*, 1990 edition.

NFPA 43B, *Code for the Storage of Organic Peroxide Formulations*, 1993 edition.

NFPA 70, *National Electrical Code*, 1993 edition.

NFPA 79, *Electrical Standard for Industrial Machinery*, 1994 edition.

NFPA 101, *Life Safety Code*, 1994 edition.

NFPA 220, *Standard on Types of Building Construction*, 1992 edition.

NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*, 1990 edition.

NFPA 385, *Standard for Tank Vehicles for Flammable and Combustible Liquids*, 1990 edition.

NFPA 386, *Standard for Portable Shipping Tanks for Flammable and Combustible Liquids*, 1990 edition.

NFPA 704, *Standard System for the Identification of the Fire Hazards of Materials*, 1990 edition.

9-1.2 Other Publications.

9-1.2.1 ASTM Publications. American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103.

ASTM D5-1986, *Standard Test Method for Penetration of Bituminous Materials*.

ASTM D323-1990, *Standard Test Method for Vapor Pressure of Petroleum Products*.

ASTM E136-1993, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750 Degrees C*.

9-1.2.2 FED STD Publication. Superintendent of Documents, U.S. Government Printing Office, Washington, DC 20402.

FED STD 209E, 1992, *Cleanroom and Work Station Requirements, Controlled Environment*.

9-1.2.3 SEMI Publication. Semiconductor Equipment and Materials International, 805 East Middlefield Road, Mountain View, CA 94043-4080.

SEMI F1-90, *Specification for Leak Testing Toxic Gas Piping Systems*.

9-1.2.4 UL Publications. Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062.

UL 181-1990, *Standard for Safety Factory-Made Air Ducts and Air Connectors*.

UL 586-1990, *High-Efficiency, Particulate, Air Filter Units*.

Appendix A Explanatory Material

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

A-1-2 A systems approach to risk management was attempted throughout this standard. These fire safety objectives are achieved through the proper management of fire prevention and fire response activities.

A-1-4 Hazardous Chemical. The terms "hazardous materials," "hazardous chemicals," and "hazardous wastes" are often used interchangeably, and in most context, it is properly understood that they have the same meaning. In the United States, however, these terms actually have quite different definitions under the U.S. Code of Federal Regulations (CFR):

(a) Hazardous materials are raw materials in transit to the user and are governed by the U.S. Department of Transportation (DOT) under Title 49 CFR, Transportation.

(b) By definition, a hazardous material becomes a hazardous chemical once it arrives at a plant and is used in the work place, at which time its use is governed by the Occupational Safety and Health Administration (OSHA) under Title 29 CFR, Labor.

(c) Waste is generated by a process. A chemical becomes waste once it completes its useful life in-plant, and disposal is classified as ignitable, corrosive, reactive, or toxic. Where it is considered hazardous waste it is regulated by the Environmental Protection Agency (EPA) under Title 40 CFR, Protection of the Environment.

While ignitable wastes are of particular interest to NFPA, all hazardous waste should be protected to avoid adverse impact to the environment.

A-2-1.2.1 Typical configurations of cleanrooms and their chases and plenums create numerous areas that might be sheltered from sprinkler protection. These areas can include air-mixing boxes, catwalks, hoods, protruding lighting, open waffle slabs, equipment, piping, ducting, and cable trays. Care should be taken to relocate or supplement sprinkler protection to ensure that sprinkler discharge covers all parts of the occupancy. Care should also be taken to ensure that sprinklers are located where heat will be satisfactorily collected for reliable operation of the sprinkler.

Gaseous fire suppression systems are not substitutes for automatic sprinkler protection. The large number of air changes in cleanrooms can cause dilution or stratification of the gaseous agent.

It is recommended that sprinkler systems be inspected at least semiannually by a qualified inspection service. (See

NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*.) The length of time between such inspections can be decreased due to ambient atmosphere, water supply, or local requirements of the authority having jurisdiction.

Prior to taking a sprinkler system out of service, one should be certain to receive permission from all authorities having jurisdiction and notify all personnel who might be affected during system shutdown. A fire watch during maintenance periods is a recommended precaution. Any sprinkler system taken out of service for any reason should be returned to service as promptly as possible.

A sprinkler system that has been activated should be thoroughly inspected for damage and components replaced or repaired promptly. Sprinklers that did not operate but were subjected to corrosive elements of combustion or elevated temperatures should be inspected, and replaced if necessary, in accordance with the minimum replacement requirements of the authority having jurisdiction. Such sprinklers should be destroyed to prevent their reuse.

A-2-1.2.2 The use of quick response sprinklers, while still delayed in opening by the downward airflow, would respond to a smaller size fire quicker than conventional sprinklers. (Glass bulb-type quick response sprinklers might be preferable to other types of quick response sprinklers.)

A-2-1.2.3 It is recommended that an approved 135°F (57°C) $\frac{3}{8}$ -in. (9.5-mm) orifice sprinkler be used. It is recommended that a sprinkler be installed in all gas cylinder cabinets.

A-2-1.2.4 The UV/IR detectors could also serve the function required in 2-3.3.

A-2-1.2.6.1 Small orifice sprinklers, $\frac{3}{8}$ in. (9.5 mm) or larger, can be used.

A-2-1.2.6.3 Drainage and placement of sprinklers should be designed to prevent water from flowing back into process equipment or the ductwork from collapsing under the weight of the water or both. Since water discharged into exhaust ductwork will most likely be contaminated, outflow from the drain lines should be piped in accordance with local environmental regulations.

A-2-1.2.7 It is recommended that an approved $\frac{3}{8}$ -in. (9.5-mm) orifice sprinkler be used. Drainage should be provided to remove all sprinkler water discharged in the pass-through.

A-2-1.2.8 Figure A-2-1.2.8 from FM Loss Prevention Data Sheet 7-7 "Semiconductor Fabrication Facilities" August 1991 illustrates various arrangements of a wet bench work station, the associated fume exhaust ductwork, and possible locations of fire protection devices. (See Figure A-2-1.2.8.)

A-2-1.2.8.3 To minimize the effect of automatic sprinkler water discharge on airflow in exhaust ducts, it is preferable to locate the sprinkler head in the work station transition piece. It is also acceptable to use a $\frac{3}{8}$ -in. (9.5-mm) orifice sprinkler.

A-2-2.2 Cleanroom hydrogen monitoring should use parts per million detectors to provide alarm and detection for hydrogen leaks.

A-2-3.1 The detectors may also be used to shut down the recirculating fans or activate a dedicated smoke control system, or both. See NFPA 90A, *Standard for the Installation of Air Conditioning and Ventilating Systems*.

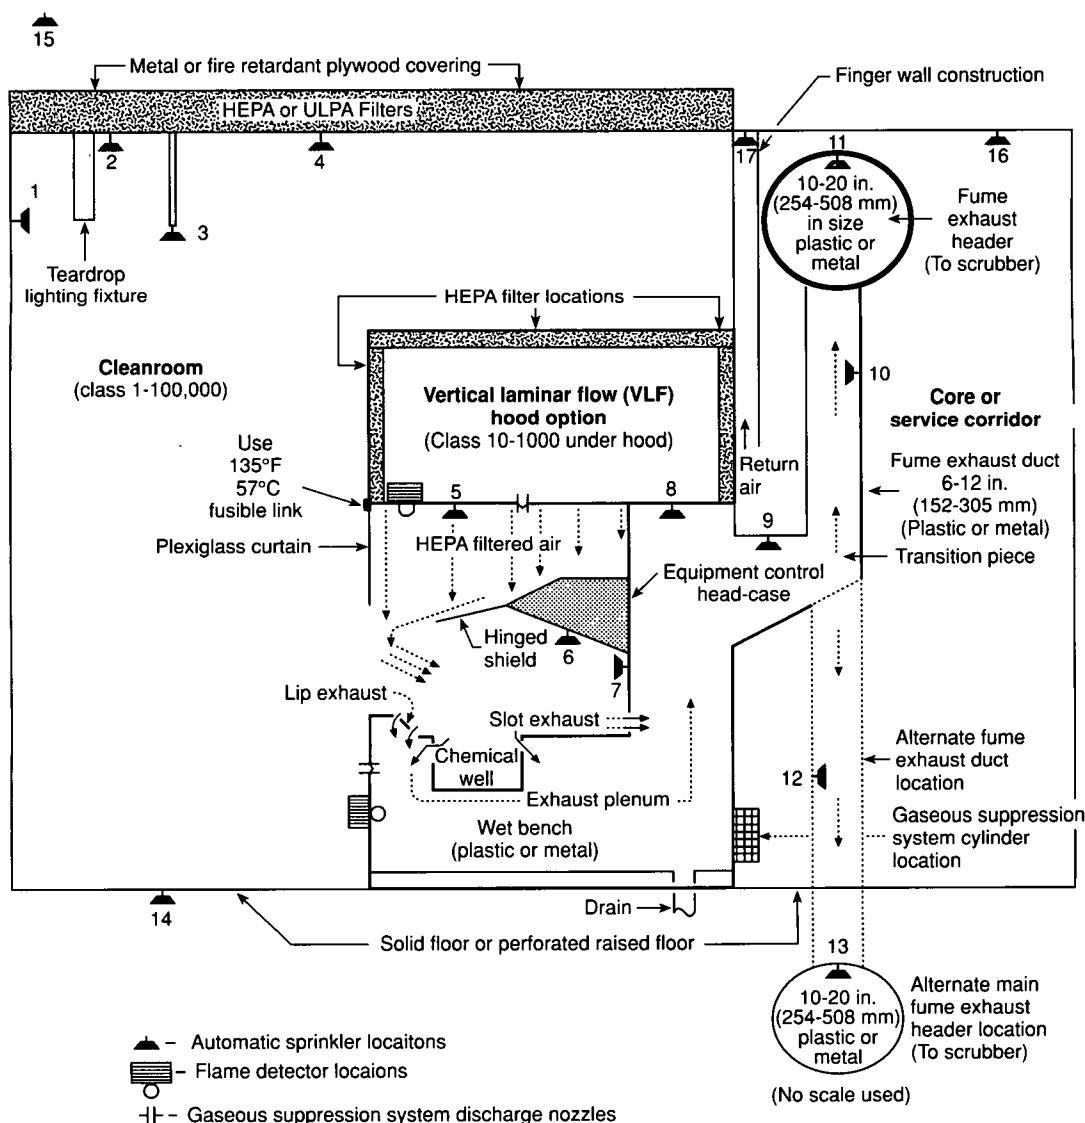


Figure A-2-1.2.8 Example of sprinkler locations for combustible tools.

A-2-3.2 Smoke detection need not result in an automatic facility evacuation alarm signal.

A-3-3.1 Ribbed flex duct is frequently used to connect a piece of equipment to the exhaust duct system. Trapped sections occur where ducts are routed under structural members or other mechanical ducts or piping. Transport velocities that are adequate in straight sections of ductwork might not be adequate in the above sections due to turbulence, and as a result, hazardous chemicals can deposit in the ductwork. Ribbed flex duct is frequently used to connect a piece of equipment to the exhaust duct system. Ribbed flex duct has the undesirable property of very rapid burn-through or collapse in the event of internal fire exposure.

The duct system should be designed and constructed to minimize the collection of hazardous chemicals.

A-3-3.6 Considering fire protection issues only, duct materials listed in descending order of preference are:

(a) Metallic.

(b) Approved coated metallic or nonmetallic not requiring fire sprinklers, fire dampers, or interrupters of any kind.

(c) Combustible with internal automatic sprinkler protection.

A-3-5.2 Emergency power systems are not intended to keep production equipment operating except in limited cases. When electrical utility power in a facility fails, most production equipment will shut down, thereby reducing the hazardous fumes transported in the fume exhaust duct system.

A-4-1 Buildings housing these cleanrooms should be of noncombustible or fire-resistive construction.

A-5-1.1 The following documents should be consulted for storage and handling of hazardous chemicals.

NFPA 68, *Guide for Venting of Deflagrations*, 1994 edition.

NFPA 329, *Recommended Practice for Handling Underground Releases of Flammable and Combustible Liquids*, 1992 edition.

A-5-3.1 New buildings are designed to provide chemical handling corridors.

A-5-3.3 Breakable individual chemical containers should be separated to avoid breakage.

A-5-4.2 Labeling of contents should be in accordance with ANSI B31.3, *Chemical Plant and Petroleum Refinery Piping*.

A-6-1.2 If a flow restricted orifice is placed in a system with an excess flow device, the excess flow device might not shut off.

A-6-2.2 This program should be coordinated with the fire department, the plant emergency response team, and the gas supply organization. A response time for all parties concerned should be a part of the procedure. Periodic drills should be performed with all parties involved to handle simulated accidents.

A-6-3.2 If the distribution piping is of noncombustible construction, a combustible outer jacket can be used for secondary containment.

A-6-3.5 Training should be as outlined in SEMI F3, *Guideline for Welding Stainless Steel Tubing for Semiconductor Manufacturing Applications*.

A-6-3.6.1 Automated purge panels are recommended because they reduce the potential for human error.

A-6-3.8 The basic components of purge panels should incorporate the following features:

- (a) Tied diaphragm regulators should be used.
- (b) All piping/tubing connections should be welded or of a metal gasket face seal fitting with zero clearance, except valve connection to cylinder.
- (c) Burst pressure components should be rated to at least 50 percent over the maximum pressure available to all components.
- (d) All components should have a helium leak rate no greater than 0.00001 cc/hr.
- (e) Regulators should be of the hand-loaded type. Dome loaded regulators should not be used on hazardous gases. Remotely operated gas delivery systems can use dome loaded regulators.
- (f) No check valves should be used as a primary control of potential cross contamination and backflow.
- (g) Electrical components on purge panels should be intrinsically safe.
- (h) Excess flow control (valve or switch) should be provided on the high pressure side of the purge panel.
- (i) Emergency high pressure shutoff valves should be provided and should operate upon the activation of an emergency off button, gas monitoring alarm (high alarm), or electronically monitored excess flow control switch.
- (j) All systems should be equipped with an emergency shutoff.

A-6-5 The use of silane/toxic mixes is discouraged due to the dangers inherent in these materials. Alternative methods should be sought to eliminate the use of these chemicals.

A-6-5.3(b) Exhaust airflow should be calculated by multiplying 200 fpm by the cross-sectional area of the cabinet.

A-6-6.1 Alternate substances should be considered for replacement of hazardous gases.

A-6-8 A certification program should be used to ensure adequate training.

A-7-1 Introduction. This chapter can be used to minimize known fire hazards inherent in the construction and operation of cleanroom tools.

Proper materials, regulatory requirements, and good practices should be considered in design, use, and maintainability of all tools.

Where hazards cannot be eliminated, no single failure should result in an exposure situation that places people in jeopardy. All fire prevention or protection systems used internal to, or with, equipment should be fail-safe.

General Recommendations. Tools should be designed to achieve fire prevention, or in the event of fire, to provide early detection and suppression adequate to prevent fire spread, explosion, or threat to life safety.

The completed system should have third-party review based on the requirements of this chapter.

Where available, components and subassemblies used should be listed.

Listed below is a guideline setting forth areas of consideration when tool design drawings are being reviewed. This list includes only recommendations. Design review should not be limited by, or to, these items:

- (a) Materials of construction (flammability, combustibility, and compatibility);
- (b) Electrical components, their mounting, and enclosures;
- (c) Electrical circuit protection;
- (d) Access to components within equipment;
- (e) Minimization and control of pyrophoric chemicals;
- (f) A review of process piping, connectors, and materials;
- (g) Methods of preventing excess flow of gases;
- (h) Earthquake stability where and when applicable;
- (i) Redundant controls of electrical heaters;
- (j) Software interlocks.

Tools should bear a nameplate identifying the manufacturer by name and address, and the model and serial number of the tool.

Tool manufacturers should notify owners of inherent defects that affect fire and safety, when they become known. Likewise, users should notify tool manufacturers of potential fire and safety considerations.

Tool manufacturers should conduct ongoing programs of quality assurance, safety research, and investigation to identify, correct, and inform users of any potential operating malfunctions that might constitute fire safety hazards that could exist in their products.

All known hazards that cannot be engineered out of a tool should be clearly identified and controlled. These conditions should be specifically addressed in the tool's operation and maintenance manuals or in a notice accompanying the tool.

Plans and specifications for tools, prior to their fabrication or use or both, should be reviewed and signed by a trained employee or independent third party using the requirements of Chapter 7.

The maintenance and operation manuals should provide guidance for the posting of appropriate signs on tools to indicate that maintenance is in process.

Administration. Owners should designate a responsible individual in their employ to review drawings of tool and system designs to ensure that tools will be in conformance with these requirements.

Owners should perform physical inspection of tools on receipt to ensure that the tool is in conformance with their design/review documents.

Owners should ensure that the tool is accompanied with adequate installation, maintenance, and operating instructions, which will include appropriate wiring details and facilitizing of the tool.

Owners should ensure that a proper hands-on training program is instituted in the safe operation of the tool and that standardized examinations are given to test knowledge and ability.

Owners should institute an appropriate maintenance program to ensure that all safety controls will work in a proper manner when required. Inspection and maintenance should be done on a sufficiently frequent basis against a checklist by qualified personnel to ensure continued safe operation of the tool. The name of the inspector should be posted on or close to the tool, as well as the date of last inspection.

Production and support equipment can be designed to comply with SEMI S2, *Product Safety Guidelines*, and designed and installed in accordance with Sections 7-2 through 7-8.

A-7-2.1 Interlock systems should be designed to prevent override during normal operation.

A-7-4.3 Wet benches that use combustible chemicals, heated above their flash points, or flammable chemicals should be provided with devices to detect fire.

A-7-4.4 A convenient way in which to test low liquid level sensors is to use them at least weekly to shut down the process by removing them from the bath; if they fail to shut off equipment, they prove they are not operating properly.

A-7-6.1 Such devices can be traps, condensers, demisters, or coalescing filters. As an alternative, noncombustible oils should be used, or dry-type pumps not requiring lubricant should be used.

A-7-6.2.1 Vacuum pumps whose construction is susceptible to backstreaming oil into tools should have foreline traps on their inlets.

A-7-8 Exhaust flow should be monitored and controlled by a sensor set at a negative static pressure to provide the minimum airflow specified in Chapter 5.

As an alternative to the above, the minimum airflow can be monitored by periodic inspection to preclude changes caused by modifications to the exhaust duct system.

In the event a low airflow condition results, a local audible and visual alarm should provide a signal at the tool. The sensor and alarm should be of the manual reset type.

Exhaust static pressure or flow monitoring should be provided on all exhausted tools. Local visual and audible alarms should also be provided. The sensor and alarm should be of the manual reset type.

A-8-1 Semiconductor facilities can be considered to be special purpose industrial occupancies containing ordinary hazard manufacturing operations. NFPA *Fire Protection Handbook*, 17th ed, Section 9, Chapter 14, Industrial Occupancies, points out that high hazard occupancies are lim-

ited to those industrial facilities that house extremely hazardous operations and do not include those buildings in which there is incidental or restricted use of chemicals and gases, such as semiconductor cleanrooms designed in accordance with this standard.

Appendix B

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

B-1 The following appendix contains useful and explanatory information about subjects related to the installation of fire protection systems that are not covered in the text.

B-2 Seismic Protection.

B-2.1 In seismic zones, where required by the authority having jurisdiction, approved seismic warning and control systems should be installed to mitigate the damage of an earthquake.

B-2.2 An approved seismically activated valve should be provided to automatically shut off piping systems conveying hazardous chemicals during significant seismic events. It should generate a signal to activate emergency shutoff valves on gas cabinets, hazardous gas supply lines, and appropriate utility services, such as natural or LP-Gas.

B-2.3 Seismic warning and control systems should be able to discriminate actual seismic activity from background industrial interference, such as a forklift operating in the area of the seismic sensors.

B-2.4 The optimal seismic warning and control system should react only to a ground acceleration of 0.05G–0.25G at the specific frequencies inherent to earthquakes (0.5 Hz–15 Hz).

B-2.5 Electrically operated seismic warning systems should be powered by an uninterruptible power supply.

Appendix C Referenced Publications

C-1 The following documents or portions thereof are referenced within this standard for informational purposes only and thus are not considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

C-1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*, 1995 edition.

NFPA 68, *Guide for Venting of Deflagrations*, 1994 edition.

NFPA 90A, *Standard for the Installation of Air Conditioning and Ventilating Systems*, 1993 edition.

NFPA 329, *Recommended Practice for Handling Underground Releases of Flammable and Combustible Liquids*, 1992 edition.

Fire Protection Handbook, 17th-edition.

C-1.2 Other Publications.

C-1.2.1 ANSI Publication. American National Standards Institute, Inc., 1430 Broadway, New York, NY 10018.

ANSI B31.3-1993, *Chemical Plant and Petroleum Refinery Piping*.

C-1.2.2 Factory Mutual Engineering Corp. Publication. 1151 Boston-Providence Turnpike, Norwood, MA 02062.

FM Loss Prevention Data Sheet 7-7, *Semiconductor Fabrication Facilities*.

C-1.2.3 SEMI Publications. Semiconductor Equipment and Materials International, 805 East Middlefield Road, Mountain View, CA 94043-4080.

SEMI F3-90, *Guideline for Welding Stainless Steel Tubing for Semiconductor Manufacturing Applications*.

SEMI S2-93, *Product Safety Guidelines*.

C-1.2.4 U.S. Government Publications. Superintendent of Documents, U.S. Government Printing Office, Washington, DC 20402.

Code of Federal Regulations, Title 29, Labor, 1993.

Code of Federal Regulations, Title 40, Protection of Environment, 1993.

Code of Federal Regulations, Title 49, Transportation, 1993.

Index

© 1995 National Fire Protection Association, All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document which it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of the National Fire Protection Association, Inc.

-A-

Access floor system 4-3
 Definition 1-4
Air supply 3-1
Alarm systems 2-2, A-2-2.2
 Exhaust fan shutdown and 3-5.3
 Hardware interlocks 7-2.2, 7-2.4
 Seismic warning B-2
Application of standard 1-3
Approved (definition) 1-4
Authority having jurisdiction (definition) 1-4
Automatic sprinkler systems *see* Sprinkler systems

-C-

Cabinets, storage *see* Storage cabinets
Carts, chemical 5-3, A-5-3
Chemicals, hazardous *see* Hazardous chemicals
Clean zone (definition) 1-4
Cleanrooms
 Construction Chap. 4, A-4-1
 Definition 1-4
Compressed gas 6-3, 6-6.6, A-6-3
 Definition 1-4
Construction
 Cleanrooms Chap. 4, A-4-1
 Local exhaust systems 3-3, A-3-3
 Materials 7-5, A-7-1
Containers, chemical 5-1.1.6, 5-1.1.7
 Delivery 5-3, A-5-3.1
Cylinders, storage and distribution of Chap. 6
 Distribution systems 6-3, A-6-3
 Flammable or toxic gases 6-6, A-6-6.1
 Packaging 6-1, A-6-1.2
 Process delivery lines for 6-7.4
 Silane and silane/nontoxic mixes 6-4
 Silane/toxic mixes 6-5, A-6-5
 Training of personnel for 6-8, A-6-8
 Transport to semiconductor facility 6-2, A-6-2.2
 Vent headers 6-7

-D-

Dampers
 Fire 3-3.5
 Locking 3-5.4
Definitions 1-4, A-1-4

Delivery systems

Bulk 5-2.8
 Compressed and liquefied gas distribution 6-3, A-6-3
 Flammable and combustible liquids 5-2
 Hazardous gases for tools 7-7
 Pressurized 5-2.2 to 5-2.6

Detection systems

Combustible tools 2-1.2.8.1
 Deluge water spray systems 2-1.2.4, A-2-1.2.4
 Exhaust fan shutdown and 3-5.3
 Flammable or toxic gas 2-2.2, 6-6.1 to 6-6.3, A-2-3
 Silane gas cylinders 2-3.3, 6-4.3(d)

Distribution systems, compressed and liquefied gases

..... 6-3, A-6-3

Drainage

Sprinkler discharge in ducts 2-1.2.6.3, A-2-1.2.6.3
 Sprinkler discharge in pass-throughs A-2-1.2.7
 Waste chemicals 5-1.1.2, 5-4, A-5-4.2

Duct systems *see also* Ventilation and exhaust systems

Sprinklers in 2-1.2.6, 2-1.2.8.3, A-2-1.2.6, A-2-1.2.8.3
 Supply air 3-1.3, 3-1.4

Duct velocities 3-4**-E-****Earthquakes**

Protection for 4-3, App. B
 Zones Fig. 4-3

Egress, means of Chap. 8, A-8-1**Electrical design** 7-3, A-7-1**Emergency power systems** 3-5.1 to 3-5.2, 5-1.1.4(c), 6-5.3(b), 6-6.3, A-3-5.2**Emergency response programs** 6-2.2, A-6-2.2**Exhaust systems** *see* Ventilation and exhaust systems**Explosion (definition)** 1-4**-F-****Fences, enclosing cylinders** 6-4.3(h), 6-5.1.1, 6-5.3(f)**Fire protection** Chap. 2, A-2**Fire watch** A-2-1.2.1**Flammable and combustible liquids**

Classification of 1-4
 Definition 1-4
 Delivery systems 5-2
 Process liquid heating equipment 7-4, A-7-4
 Spill protection 5-5

Flammable gas	6-6, 6-7.4, 7-8, A-6-6.1
Flammable vapors	3-4, 7-8
Definition	1-4
Floor system, access	4-3
Definition	1-4

-G-

Gas	
Compressed	6-3, 6-6.6, A-6-3
Definition	1-4
Flammable or toxic	6-6, 6-7.4, 7-8, A-6-6.1
Hazardous, cylinder storage of	<i>see</i> Cylinders, storage and distribution of
Liquefied	6-3, 6-6.6, A-6-3
Gaseous extinguishing systems	2-1.2.8.1 to 2-1.2.8.2

-H-

Hazardous chemicals	5-1
Definition	1-4, A-1-4
Storage and handling	Chap. 5
Accidental mixing	5-1.1.5
Chemical carts	5-3, A-5-3
Flammable and combustible liquid delivery systems	5-2
Spill protection	5-5
Waste disposal	5-4, A-5-4.2
Hazardous gases	<i>see</i> Cylinders, storage and distribution of
Heating equipment, electrical	
In flammable gas storage and dispensation areas	6-6.6
Process liquid	7-4, A-7-4
Tool design	A-7-1

-I-

Inspection, sprinkler system	A-2-1.2.1
Interface (definition)	1-4
Interlocks	3-5.3, 7-2, A-7-1, A-7-2.1
Definition	1-4

-L-

Liquefied gas	6-3, 6-6.6, A-6-3
Liquids	<i>see</i> Flammable and combustible liquids
Listed (definition)	1-4

-M-

Means of egress	Chap. 8, A-8-1
------------------------------	----------------

-N-

Noncombustible (definition)	1-4
--	-----

-O-

Open flames	6-6.6
Orifice, restricted flow	6-1.1(c), 6-1.2, A-6-1.2
Definition	1-4

-P-

Packaging, hazardous gas cylinders	6-1, A-6-1.2
Pass-throughs	
Definition	1-4
Sprinklers in	2-1.2.7, A-2-1.2.7
Piping materials	6-3.1 to 6-3.4, A-6-3.2, A-7-1
Production and support equipment	Chap. 7, A-7
Pumps, vacuum	7-6, A-7-6
Purge panels	6-3.6 to 6-3.14, 6-4.3(g), 6-4.3(j), 6-5.3(d), A-6-3.6.1, A-6-3.8
Vent headers	<i>see</i> Vent headers
Purpose of standard	1-2, A-1-2
Pyrophoric	
Definition	1-4
Gases	6-1.2

-R-

Recirculation systems	3-1
Referenced publications	Chap. 9, App. C
Remote shutdown	3-5.6, 6-4.3(e), 6-5.3(c)
Restricted flow orifice	<i>see</i> Orifice, restricted flow

-S-

Scope of standard	1-1
Seismic map	Fig. 4-3
Seismic protection	4-3, B-2
Shutdown systems	6-6.2 to 6-6.3
Silane and silane/nontoxic mixes storage and dispensing areas	6-4
Silane/toxic mixes storage and dispensing areas	6-5, A-6-5
Smoke (definition)	1-4
Smoke detection	2-3, A-2-3
Smoking	6-7
Spill protection	5-1.1.2, 5-3.3, 5-5
Sprinkler systems	2-1.2, A-2-1.2
Inspection	A-2-1.2.1
Installation	2-1.2.3 to 2-1.2.6.2, A-2-1.2.1, A-2-1.2.3
Sprinklers	
Locations for combustible tools	Fig. A-2-1.2.8
Quick response	2-1.2.2, A-2-1.2.2
Standby mode	7-2.1, A-7-2.1
Definition	1-4
Storage, chemicals	Chap. 5
Storage cabinets	5-1.1.5.3
Flammable or toxic gases	6-6.1
Silane/toxic mixes	6-5.1.3, 6-5.2, 6-5.3(b) to (c), 6-5.3(f), A-6-5.3(b)

-T-

Third party (definition)	1-4
Tools	A-7-1
Combustible	2-1.2.8, 7-4, A-2-1.2.8
Definition	1-4
Noncombustible	7-5
Utilizing hazardous chemicals	7-2.4, 7-8, A-7-8
Toxic gas	6-6, 6-7.4, A-6-6.1
Training	
Cylinder handling	6-8, A-6-8
Emergency response	A-6-2.2
Welders and pipefitters	6-3.5, A-6-3.5
Transportation, hazardous gas cylinder	6-2, A-6-2.2

-V-

Vacuum pumps	7-6, A-7-6
Valves	6-3.10 to 6-3.11, B-2-2
Vapors, flammable	3-4, 7-8
Definition	1-4
Vent headers	6-4.3(g), 6-5.3(d), 6-7
Ventilation and exhaust systems	Chap. 3
Air supply and recirculation	3-1
Chemical storage and dispensing rooms	5-1.1.4
Controls	3-5, A-3-5.2
Duct velocities	3-4
Flammable or toxic gas storage or distribution	6-6.1 to 6-6.3
Local exhaust systems	3-2 to 3-3, A-3-3
Silane and silane/nontoxic mixes, storage and dispensing areas	6-4.3(c), 6-4.3(i)
Silane/toxic mixes, storage and dispensing areas	6-5.3(b)
Tools using hazardous chemicals	7-8, A-7-8
Vacuum pumps, exhaust conditioning of	7-6.2, A-7-6.2.1

-W-

Waste disposal, chemical	5-4, A-5-4.2
Welding	6-3.5, 6-6.4, A-6-3.5
Work stations	2-1.2.8.2, 3-2.4, 7-3.2 to 7-3.3
Definition	1-4

NFPA 318

Standard for the Protection of Cleanrooms

1995 Edition

Reference: 2-3.1
TIA 95-1 (NFPA 318)

Pursuant to Section 5 of the NFPA Regulations Governing Committee Projects, the National Fire Protection Association has issued the following Tentative Interim Amendment to NFPA 318, *Standard for the Protection of Cleanrooms*, 1995 edition. The TIA was processed by the Cleanrooms Committee, and was issued by the Standards Council on July 22, 1997, with an effective date of August 11, 1997.

A Tentative Interim Amendment is tentative because it has not been processed through the entire standards-making procedures. It is interim because it is effective only between editions of the standard. A TIA automatically becomes a proposal of the proponent for the next edition of the standard; as such, it then is subject to all of the procedures of the standards-making process.

1. Revise 2-3.1 to read as follows:

2-3.1 A listed or approved smoke detection system shall be provided in the cleanroom return airstream at a point before dilution from make-up air occurs. The system shall have a minimum sensitivity of 0.03 percent per ft obscuration. The system shall be capable of monitoring particles to 10 microns or less. Smoke detection systems which are non-air-sampling shall be listed for the airflow rate of the return airstream. Where the system is of the light-scattering type, it shall have a minimum sensitivity of 0.03 percent per ft obscuration; where the system is of the cloud chamber type, it shall have a minimum sensitivity of 50,000 particles per millimeter.

The NFPA Codes and Standards Development Process

Since 1896, one of the primary purposes of the NFPA has been to develop and update the standards covering all areas of fire safety.

Calls for Proposals

The code adoption process takes place twice each year and begins with a call for proposals from the public to amend existing codes and standards or to develop the content of new fire safety documents.

Report on Proposals

Upon receipt of public proposals, the technical committee members meet to review, consider, and act on the proposals. The public proposals – together with the committee action on each proposal and committee-generated proposals – are published in the NFPA's Report on Proposals (ROP). The ROP is then subject to public review and comment.

Report on Comments

These public comments are considered and acted upon by the appropriate technical committees. All public comments – together with the committee action on each comment – are published as the Committee's supplementary report in the NFPA's Report on Comments (ROC).

The committee's report and supplementary report are then presented for adoption and open debate at either of NFPA's semi-annual meetings held throughout the United States and Canada.

Association Action

The Association meeting may, subject to review and issuance by the NFPA Standards Council, (a) adopt a report as published, (b) adopt a report as amended, contingent upon subsequent approval by the committee, (c) return a report to committee for further study, and (d) return a portion of a report to committee.

Standards Council Action

The Standards Council will make a judgement on whether or not to issue an NFPA document based upon the entire record before the Council, including the vote taken at the Association meeting on the technical committee's report.

Voting Procedures

Voting at an NFPA Annual or Fall Meeting is restricted to members of record for 180 days prior to the opening of the first general session of the meeting, except that individuals who join the Association at an Annual or Fall Meeting are entitled to vote at the next Fall or Annual Meeting.

"Members" are defined by Article 3.2 of the Bylaws as individuals, firms, corporations, trade or professional associations, institutes, fire departments, fire brigades, and other public or private agencies desiring to advance the purposes of the Association. Each member shall have one vote in the affairs of the Association. Under Article 4.5 of the Bylaws, the vote of such a member shall be cast by that member individually or by an employee designated in writing by the member of record who has registered for the meeting. Such a designated person shall not be eligible to represent more than one voting privilege on each issue, nor cast more than one vote on each issue.

Any member who wishes to designate an employee to cast that member's vote at an Association meeting in place of that member must provide that employee with written authorization to represent the member at the meeting. The authorization must be on company letterhead signed by the member of record, with the membership number indicated, and the authorization must be recorded with the President of NFPA or his designee before the start of the opening general session of the Meeting. That employee, irrespective of his or her own personal membership status, shall be privileged to cast only one vote on each issue before the Association.

Sequence of Events Leading to Publication of an NFPA Committee Document

Call for proposals to amend existing document or for recommendations on new document.



Committee meets to act on proposals, to develop its own proposals, and to prepare its report.



Committee votes on proposals by letter ballot. If two-thirds approve, report goes forward.
Lacking two-thirds approval, report returns to committee.



Report is published for public review and comment. (Report on Proposals - ROP)



Committee meets to act on each public comment received.



Committee votes on comments by letter ballot. If two-thirds approve, supplementary report goes forward. Lacking two-thirds approval, supplementary report returns to committee.



Supplementary report is published for public review. (Report on Comments - ROC).



NFPA membership meets (Annual or Fall Meeting) and acts on committee report (ROP and ROC).



Committee votes on any amendments to report approved at NFPA Annual or Fall Meeting.



Complaints to Standards Council on Association action must be filed
within 20 days of the NFPA Annual or Fall Meeting.



Standards Council decides, based on all evidence, whether or not to issue standard
or to take other action, including hearing any complaints.



Appeals to Board of Directors on Standards Council action must be filed
within 20 days of Council action.