

# NFPA® 652

## Standard on the Fundamentals of Combustible Dust

### 2016 Edition



NFPA, 1 Batterymarch Park, Quincy, MA 02169-7471  
An International Codes and Standards Organization

## **IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS**

### **NOTICE AND DISCLAIMER OF LIABILITY CONCERNING THE USE OF NFPA STANDARDS**

NFPA® codes, standards, recommended practices, and guides (“NFPA Standards”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

### **REMINDER: UPDATING OF NFPA STANDARDS**

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that NFPA Standards may be amended from time to time through the issuance of Tentative Interim Amendments or corrected by Errata. An official NFPA Standard at any point in time consists of the current edition of the document together with any Tentative Interim Amendment and any Errata then in effect.

In order to determine whether an NFPA Standard has been amended through the issuance of Tentative Interim Amendments or corrected by Errata, visit the Document Information Pages on NFPA’s website. The Document Information Pages provide up-to-date, document specific information including any issued Tentative Interim Amendments and Errata.

To access the Document Information Page for a specific NFPA Standard, go to <http://www.nfpa.org/docinfo> to choose from the list of NFPA Standards or use the search feature on the right to select the NFPA Standard number (e.g., NFPA 101). In addition to posting all existing Tentative Interim Amendments and Errata, the Document Information Page also includes the option to sign-up for an “Alert” feature to receive an email notification when new updates and other information are posted regarding the document.

## IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

### ADDITIONAL NOTICES AND DISCLAIMERS

#### Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of new editions or may be amended from time to time through the issuance of Tentative Interim Amendments or corrected by Errata. An official NFPA Standard at any point in time consists of the current edition of the document together with any Tentative Interim Amendments and any Errata then in effect. In order to determine whether a given document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments or corrected through the issuance of Errata, consult appropriate NFPA publications such as the National Fire Codes® Subscription Service, visit the NFPA website at [www.nfpa.org](http://www.nfpa.org), or contact the NFPA at the address listed below.

#### Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

#### Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

**NOTICE:** The user’s attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

#### Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

#### Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

#### For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: [stds\\_admin@nfpa.org](mailto:stds_admin@nfpa.org)

For more information about NFPA, visit the NFPA website at [www.nfpa.org](http://www.nfpa.org). All NFPA codes and standards can be viewed at no cost at [www.nfpa.org/freeaccess](http://www.nfpa.org/freeaccess).

Copyright © 2015 National Fire Protection Association®. All Rights Reserved.

## NFPA® 652

### Standard on the Fundamentals of Combustible Dust

#### 2016 Edition

This edition of NFPA 652, *Standard on the Fundamentals of Combustible Dust*, was prepared by the Technical Committee on Fundamentals of Combustible Dusts, released by the Correlating Committee on Combustible Dusts, and acted on by NFPA at its June Association Technical Meeting held June 22–25, 2015, in Chicago, IL. It was issued by the Standards Council on August 18, 2015, with an effective date of September 7, 2015.

This edition of NFPA 652 was approved as an American National Standard on September 7, 2015.

#### Origin and Development of NFPA 652

NFPA 652, *Standard on the Fundamentals of Combustible Dust*, provides the general requirements for management of combustible dust fire and explosion hazards and directs the user to NFPA's industry- or commodity-specific standards, as appropriate: NFPA 61, *Standard for the Prevention of Fires and Dust Explosions in Agricultural and Food Processing Facilities*; NFPA 484, *Standard for Combustible Metals*; NFPA 654, *Standard for the Prevention of Fire and Dust Explosions from the Manufacturing, Processing, and Handling of Combustible Particulate Solids*; NFPA 655, *Standard for Prevention of Sulfur Fires and Explosions*; and NFPA 664, *Standard for the Prevention of Fires and Explosions in Wood Processing and Woodworking Facilities*. This new standard establishes the relationship and hierarchy between it and any of the industry- or commodity-specific standards, ensuring that fundamental requirements are addressed consistently across industries, processes, and dust types.

While NFPA has addressed combustible dust hazards and safeguards for flour and pulverized fuels, such as coal, as far back as 1920, it was not until 2003 that users from all sectors comprehensively examined the specific requirements contained in the five commodity-specific NFPA standards. Those documents apply broadly to varied facilities, processes, equipment types, and dust types to protect against the hazards from combustible dust fires and explosions.

A basis for safety embedded in each of those standards requires the fuel — in this case dust — to be managed, ignition sources to be controlled, and impact from an explosion to be limited through construction, protection, isolation, and housekeeping.

Some users of the NFPA commodity-specific standards believed that the requirements were inconsistent between the various industry sectors and the dust types, leading to confusion in determining which standard applied and how to protect similar hazards within a given process. In response to that perceived challenge to the longstanding NFPA combustible dust standards, NFPA staff addressed the question of whether there was a better way to structure the committees and standards. Working through the direction of the NFPA Standards Council, a task group chaired by a member of the Council explored options for restructuring the combustible dust project. The task group consisted of the chairs of the technical committees for the four existing commodity-specific standards, an additional member from each committee, and NFPA staff liaisons. A report presented to the Standards Council at its March 2011 meeting contained two key recommendations: the establishment of a correlating committee to oversee the work of the four existing combustible dust committees, as well as the work of a proposed new Technical Committee on Fundamentals of Combustible Dusts, and the establishment of a new committee whose scope would permit it to develop documents on the management of hazards from combustible dusts and combustible particulate solids.

The Technical Committee on Fundamentals of Combustible Dusts began its work in earnest in early 2012, using task groups to develop draft chapters based on a straw-man outline proposed by the committee. A preliminary draft was developed and approved by the committee to serve as the basis for requesting approval from the NFPA Standards Council to establish

a specific revision cycle. The Council initially approved the development of NFPA 652 for the Fall 2014 cycle; during the second draft stage of the process, however, the committee requested more time to review and process the extensive public comments received. That request was approved, and the standard was moved to the Annual 2015 cycle.

Hazard awareness appears prominently in the standard through the inclusion of chapters on hazard identification, hazard analysis or evaluation, and hazard management involving hazard prevention or mitigation. The committee made some of the requirements in NFPA 652 apply retroactively, including dust hazards analysis (DHA). For existing facilities, a DHA is permitted to be phased in and completed not later than 3 years from the effective date of the standard. Because so many of the investigation findings conclude that owners/operators appear to be unaware of the hazards posed by combustible particulate solids that have the potential to form combustible dusts when processed, stored, or handled, the Committee believed it essential to establish the DHA as a fundamental step in creating a plan for safeguarding such facilities.

Together with this first edition of NFPA 652, the combustible dust standards speak directly to such critical factors as dust containment and collection, hazard analysis, testing, ventilation, air flow, housekeeping, and fire suppression. The provisions of this new standard incorporate many of the lessons learned and recommendations issued as part of the combustible dust incident investigation findings reported by the Chemical Safety Board. In addition, this new standard complements the efforts of the Occupational Safety and Health Administration and its National Emphasis Program on combustible dust.

This first edition of NFPA 652 is dedicated to the memory of workers who have suffered and lost their lives from the hazards of combustible dusts, in the hope that it will help prevent such tragedies in the future.

## Correlating Committee on Combustible Dusts

**Kevin Kreitman**, *Chair*

City of Redding Fire Department, CA [E]

**Chris Aiken**, Cargill, Inc., MN [U]

**Matthew J. Bujewski**, MJB Risk Consulting, MO [SE]

**John M. Cholin**, J. M. Cholin Consultants Inc., NJ [SE]

**Gregory F. Creswell**, Titanium Metals Corporation (TIMET), PA [M]

**Scott G. Davis**, GexCon U.S., MD [SE]

**Henry L. Febo, Jr.**, FM Global, MA [I]

**Walter L. Frank**, Frank Risk Solutions, Inc., DE [SE]

**Donald Hayden**, Closure Systems International, IN [U]

**Edward R. LaPine**, Aon Fire Protection Engineering Corporation, AZ [I]

**Jack E. Osborn**, Airdusco, Inc., TN [M]

**Bill Stevenson**, CV Technology, Inc., FL [M]

**Jérôme R. Taveau**, Fike Corporation, MO [M]

### Alternates

**Amy Brown**, FM Global, MA [I]

(Alt. to H. L. Febo, Jr.)

**Craig Froehling**, Cargill, Inc., MN [U]

(Alt. to C. Aiken)

**Jason Krbec**, CV Technology, Inc., FL [M]

(Alt. to B. Stevenson)

**Steve McAlister**, Michelin Tire Corporation, SC [U]

(Alt. to Michelin Rep.)

**Adam Morrison**, Fike Corporation, MO [M]

(Alt. to J. R. Taveau)

### Nonvoting

**Matthew I. Chibbaro**, U.S. Department of Labor, DC [E]

**Mark W. Drake**, Liberty Mutual, KS [I]

Rep. TC on Combustible Metals and Metal Dusts

**Paul F. Hart**, American International Group, Inc. (AIG), IL [I]

Rep. TC on Fundamentals of Combustible Dusts

**Timothy J. Myers**, Exponent, Inc., MA [SE]

Rep. TC on Agricultural Dusts

**Jason P. Reason**, Lewellyn Technology, IN [SE]

Rep. TC on Wood and Cellulosic Materials Processing

**Mark L. Runyon**, Marsh Risk Consulting, OR [I]

Rep. TC on Handling and Conveying of Dusts, Vapors, and Gases

**William R. Hamilton**, U.S. Department of Labor, DC [E]

**Susan Bershad**, NFPA Staff Liaison

*This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.*

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

**Committee Scope:** This Committee shall have primary responsibility for documents on the hazard identification, prevention, control, and extinguishment of fires and explosions in the design, construction, installation, operation, and maintenance of facilities and systems used in manufacturing, processing, recycling, handling, conveying, or storing combustible particulate solids, combustible metals, or hybrid mixtures.

## Technical Committee on Fundamentals of Combustible Dusts

**Paul F. Hart, Chair**

American International Group, Inc. (AIG), IL [I]

**Elizabeth C. Buc,** Fire & Materials Research Laboratory, LLC, MI [RT]

**Brad D. Burrige,** Novelis, Inc., KY [U]

**Cheryl B. Carbone,** JELD-WEN, Inc., OR [U]

**Brice Chastain,** Georgia-Pacific LLC, GA [U]

**John M. Cholin,** J. M. Cholin Consultants Inc., NJ [SE]

**Tom Christman,** Caryville, TN [SE]

**Randal R. Davis,** IEP Technologies, MA [M]

**Lee C. DeVito,** FIREPRO Incorporated, MA [SE]

**Mark W. Drake,** Liberty Mutual, KS [I]

**Robert J. Feldkamp,** Nordson Corporation, OH [M]

**Walter L. Frank,** Frank Risk Solutions, Inc., DE [SE]

**Robert C. Gombar,** Baker Engineering & Risk Consultants, Inc., MD [U]

Rep. U.S. Beet Sugar Association

**Dale C. Hansen,** Harrington Group, Inc., GA [SE]

**David M. House,** I.C. Thomasson Associates, Inc., TN [SE]

**James F. Koch,** The Dow Chemical Company, MI [U]  
Rep. American Chemistry Council

**Arthur P. Mattos, Jr.,** XL Global Asset Protection Services, NC [I]

**Bruce McLelland,** Fike Corporation, MO [M]

**Timothy J. Myers,** Exponent, Inc., MA [SE]

**Jim E. Norris,** Bunge North America, MO [U]  
Rep. International Oil Mill Superintendents Assn.

**Jack E. Osborn,** Airdusco, Inc., TN [M]

**Niels H. Pedersen,** Nederman LLC, NC [M]

**Jason P. Reason,** Lewellyn Technology, IN [SE]

**Samuel A. Rodgers,** Honeywell, Inc., VA [U]

**Steve Sallman,** United Steelworkers, PA [L]

**Thomas C. Scherpa,** The DuPont Company, Inc., NH [U]

**Denise N. Statham,** VF Imagewear/Bulwark Protective Apparel, TN [M]

**Bill Stevenson,** CV Technology, Inc., FL [M]

**Robert D. Taylor,** PRB Coal Users Group, IN [U]

**Erdem A. Ural,** Loss Prevention Science & Technologies, Inc., MA [SE]

**Robert G. Zalosh,** Firexplo, MA [SE]

### Alternates

**Glenn W. Baldwin,** The Dow Chemical Company, WV [U]  
Rep. American Chemistry Council  
(Alt. to J. F. Koch)

**Robert C. Berry,** Liberty Mutual Insurance Company, NC [I]  
(Alt. to M. W. Drake)

**Robert F. Bitter,** Honeywell, Inc., MO [U]  
(Alt. to S. A. Rodgers)

**David Grandaw,** Fenwal/IEP Technologies, IL [M]  
(Alt. to R. R. Davis)

**Edward L. Jones,** Nordson Corporation, OH [M]  
(Alt. to R. J. Feldkamp)

**Jason Krbec,** CV Technology, Inc., FL [M]  
(Alt. to B. Stevenson)

**Kevin C. Marr,** Exponent, Inc., MA [SE]  
(Alt. to T. J. Myers)

**Richard F. Masta,** Georgia-Pacific LLC, GA [U]  
(Alt. to B. Chastain)

**Van Mitchell,** Logan Aluminum Inc., KY [U]  
(Alt. to B. D. Burrige)

**Kurt A. Ruchala,** FIREPRO Incorporated, MA [SE]  
(Alt. to L. C. DeVito)

**Jérôme R. Taveau,** Fike Corporation, MO [M]  
(Alt. to B. McLelland)

### Nonvoting

**Matthew I. Chibbaro,** U.S. Department of Labor, DC [E]

**William R. Hamilton,** U.S. Department of Labor, DC [E]

**Susan Bershad,** NFPA Staff Liaison

*This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.*

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

**Committee Scope:** This Committee shall have primary responsibility for information and documents on the management of fire and explosion hazards from combustible dusts and particulate solids.



## Contents

<b>Chapter 1 Administration</b> .....	<b>652- 6</b>	<b>Chapter 7 Dust Hazards Analysis (DHA)</b> .....	<b>652-15</b>
1.1 Scope .....	652- 6	7.1 General Requirements .....	652-15
1.2 Purpose .....	652- 6	7.2 Criteria .....	652-16
1.3 Application .....	652- 6	7.3 Methodology .....	652-16
1.4 Conflicts .....	652- 6		
1.5 Retroactivity .....	652- 6	<b>Chapter 8 Hazard Management: Mitigation and Prevention</b> .....	<b>652-16</b>
1.6 Equivalency .....	652- 9	8.1 Inherently Safe Designs. (Reserved) .....	652-16
1.7 Units and Formulas .....	652- 9	8.2 Building Design .....	652-16
<b>Chapter 2 Referenced Publications</b> .....	<b>652- 9</b>	8.3 Equipment Design .....	652-17
2.1 General .....	652- 9	8.4 Housekeeping .....	652-19
2.2 NFPA Publications .....	652- 9	8.5 Ignition Source Control .....	652-20
2.3 Other Publications .....	652- 9	8.6 Personal Protective Equipment .....	652-22
2.4 References for Extracts in Mandatory Sections .....	652-10	8.7 Pyrophoric Dusts. (Reserved) .....	652-23
<b>Chapter 3 Definitions</b> .....	<b>652-10</b>	8.8 Dust Control .....	652-23
3.1 General .....	652-10	8.9 Explosion Prevention/Protection .....	652-23
3.2 NFPA Official Definitions .....	652-10	8.10 Fire Protection .....	652-23
3.3 General Definitions .....	652-10	<b>Chapter 9 Management Systems</b> .....	<b>652-24</b>
<b>Chapter 4 General Requirements</b> .....	<b>652-12</b>	9.1 Retroactivity .....	652-24
4.1 General .....	652-12	9.2 General .....	652-24
4.2 Objectives .....	652-12	9.3 Operating Procedures and Practices .....	652-24
<b>Chapter 5 Hazard Identification</b> .....	<b>652-12</b>	9.4 Inspection, Testing, and Maintenance .....	652-24
5.1 Responsibility .....	652-12	9.5 Training and Hazard Awareness .....	652-25
5.2 Screening for Combustibility or Explosibility .....	652-12	9.6 Contractors .....	652-25
5.3 Self-Heating and Reactivity Hazards. (Reserved) .....	652-13	9.7 Emergency Planning and Response .....	652-25
5.4 Combustibility and Explosibility Tests .....	652-13	9.8 Incident Investigation .....	652-25
5.5 Sampling .....	652-13	9.9 Management of Change .....	652-25
<b>Chapter 6 Performance-Based Design Option</b> .....	<b>652-13</b>	9.10 Documentation Retention .....	652-25
6.1 General Requirements .....	652-13	9.11 Management Systems Review .....	652-25
6.2 Risk Component and Acceptability .....	652-14	9.12 Employee Participation .....	652-25
6.3 Performance Criteria .....	652-14	<b>Annex A Explanatory Material</b> .....	<b>652-26</b>
6.4 Design Scenarios .....	652-15	<b>Annex B Dust Hazards Analysis — Example</b> .....	<b>652-59</b>
6.5 Evaluation of Proposed Design .....	652-15	<b>Annex C Accumulated Fugitive Dust</b> .....	<b>652-65</b>
6.6 Retained Prescriptive Requirements .....	652-15	<b>Annex D Informational References</b> .....	<b>652-65</b>
		<b>Index</b> .....	<b>652-68</b>



**NFPA 652****Standard on****the Fundamentals of Combustible Dust****2016 Edition**

**IMPORTANT NOTE:** This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading “Important Notices and Disclaimers Concerning NFPA Standards.” They can also be obtained on request from NFPA or viewed at [www.nfpa.org/disclaimers](http://www.nfpa.org/disclaimers).

**UPDATES, ALERTS, AND FUTURE EDITIONS:** New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with any TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by any TIAs or Errata, please consult the National Fire Codes® Subscription Service or visit the Document Information (DocInfo) pages on the NFPA website at [www.nfpa.org/docinfo](http://www.nfpa.org/docinfo). In addition to TIAs and Errata, the DocInfo pages also include the option to sign up for Alerts for each document and to be involved in the development of the next edition.

**NOTICE:** An asterisk (\*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [ ] following a section or paragraph indicates material that has been extracted from another NFPA document. As an aid to the user, the complete title and edition of the source documents for extracts in mandatory sections of the document are given in Chapter 2 and those for extracts in informational sections are given in Annex D. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced publications can be found in Chapter 2 and Annex D.

**Chapter 1 Administration**

**1.1 Scope.** This standard shall provide the basic principles of and requirements for identifying and managing the fire and explosion hazards of combustible dusts and particulate solids.

**1.2 Purpose.** This standard shall provide the minimum general requirements necessary to manage the fire, flash fire, and explosion hazards posed by combustible dusts and directs the user to other NFPA standards for industry- and commodity-specific requirements.

**1.3 Application.**

**1.3.1** The user shall be permitted to use Figure 1.3.1 for guidance when using this standard. See Figure 1.3.1.

**1.3.2** This standard shall apply to all facilities and operations that manufacture, process, blend, convey, repack, gener-

ate, or handle combustible dusts or combustible particulate solids.

**1.3.3** This standard shall not apply to the following:

- (1) Storage or use of consumer quantities of such materials on the premises of residential or office occupancies
- (2) Storage or use of commercially packaged materials at retail facilities
- (3) Such materials displayed in original packaging in mercantile occupancies and intended for personal or household use or as building materials
- (4) Warehousing of sealed containers of such materials when not associated with an operation that handles or generates combustible dust
- (5) Such materials stored or used in farm buildings or similar occupancies for on-premises agricultural purposes

**1.3.4** Where an industry- or commodity-specific NFPA standard exists, its requirements shall be applied in addition to those in this standard.

**1.4 Conflicts.**

**1.4.1\*** For the purposes of this standard, the industry- or commodity-specific NFPA standards shall include the following:

- (1) NFPA 61, *Standard for the Prevention of Fires and Dust Explosions in Agricultural and Food Processing Facilities*
- (2) NFPA 484, *Standard for Combustible Metals*
- (3) NFPA 654, *Standard for the Prevention of Fire and Dust Explosions from the Manufacturing, Processing, and Handling of Combustible Particulate Solids*
- (4) NFPA 655, *Standard for Prevention of Sulfure Fires and Explosions*
- (5) NFPA 664, *Standard for the Prevention of Fires and Explosions in Wood Processing and Woodworking Facilities*

**1.4.2** Where a requirement in an industry- or commodity-specific NFPA standard differs from the requirement specified in this standard, the requirement in the industry- or commodity-specific NFPA standard shall be permitted to be used.

**1.4.3** Where an industry- or commodity-specific NFPA standard specifically prohibits a requirement specified in this standard, the prohibition in the industry- or commodity-specific NFPA standard shall be applied.

**1.4.4** Where an industry- or commodity-specific NFPA standard neither prohibits nor provides a requirement, the requirement in this standard shall be applied.

**1.4.5** Where a conflict between a general requirement of this standard and a specific requirement of this standard exists, the specific requirement shall apply.

**1.5 Retroactivity.**

**1.5.1** The provisions of this standard reflect a consensus of what is necessary to provide an acceptable degree of protection from the hazards addressed in this standard at the time the standard was issued.

**1.5.2** Unless otherwise specified, the provisions of this standard shall not apply to facilities, equipment, structures, or installations that existed or were approved for construction or installation prior to the effective date of the standard. Where specified, the provisions of this standard shall be retroactive.



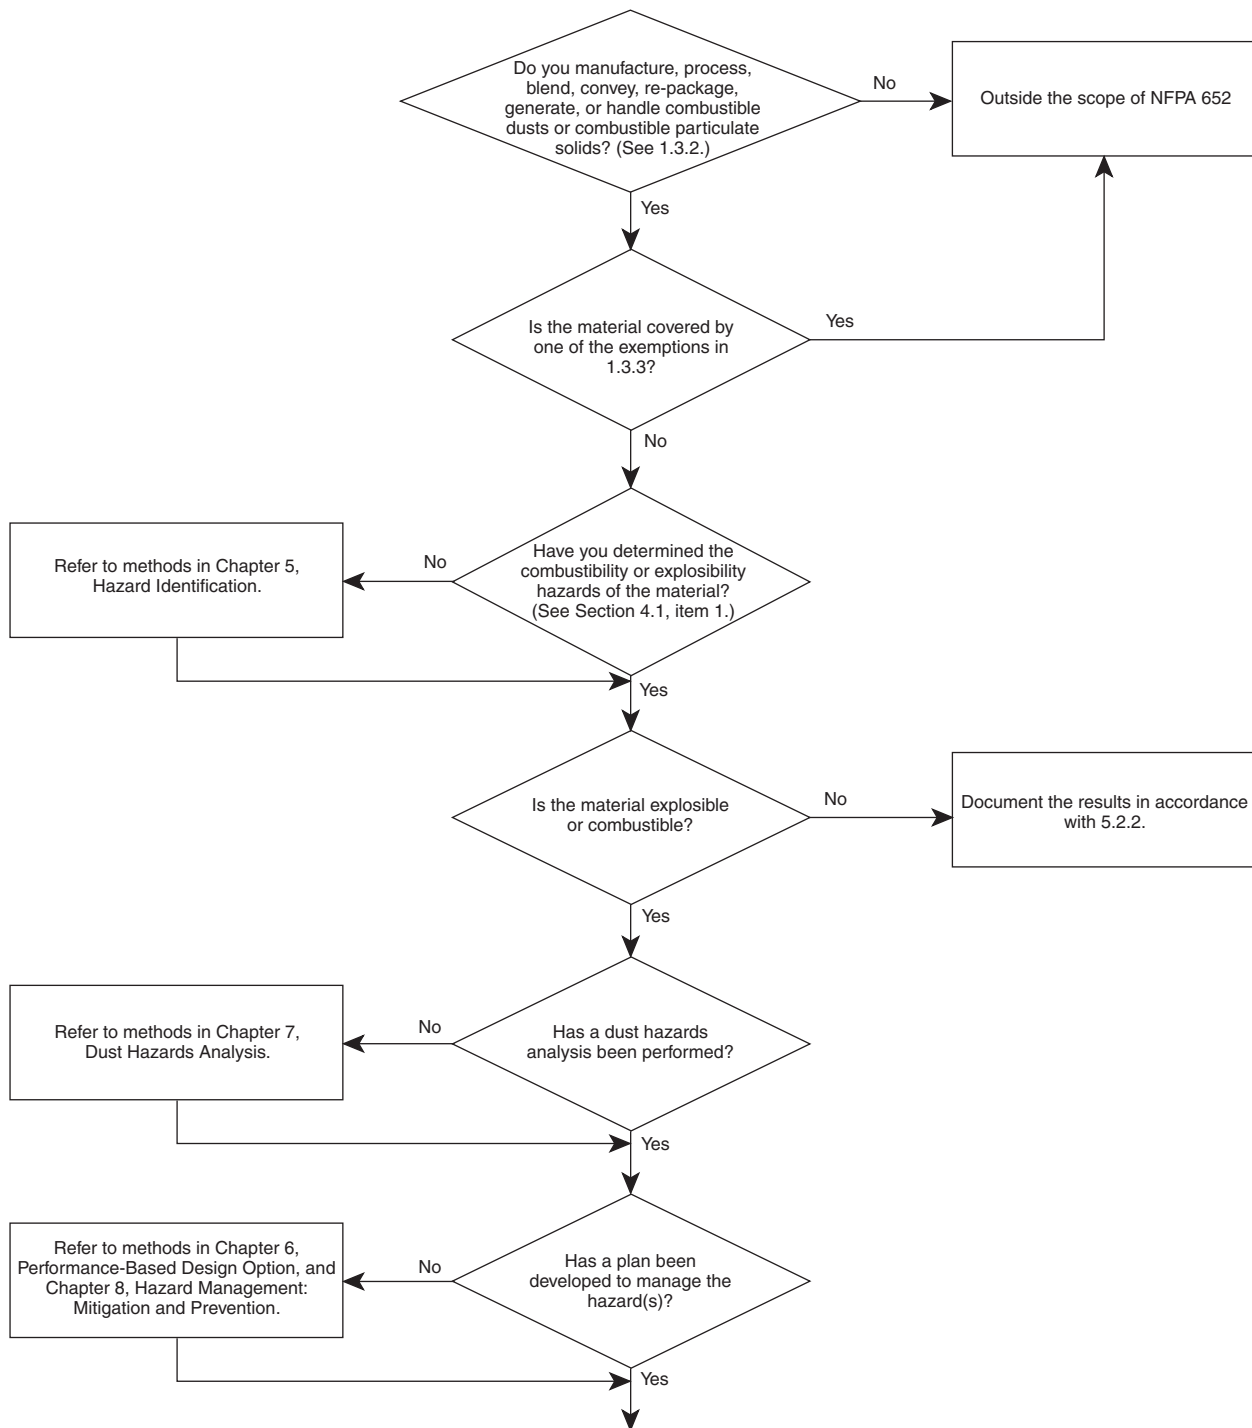


FIGURE 1.3.1 Document Flow Diagram for Combustible Dust Hazard Evaluation.

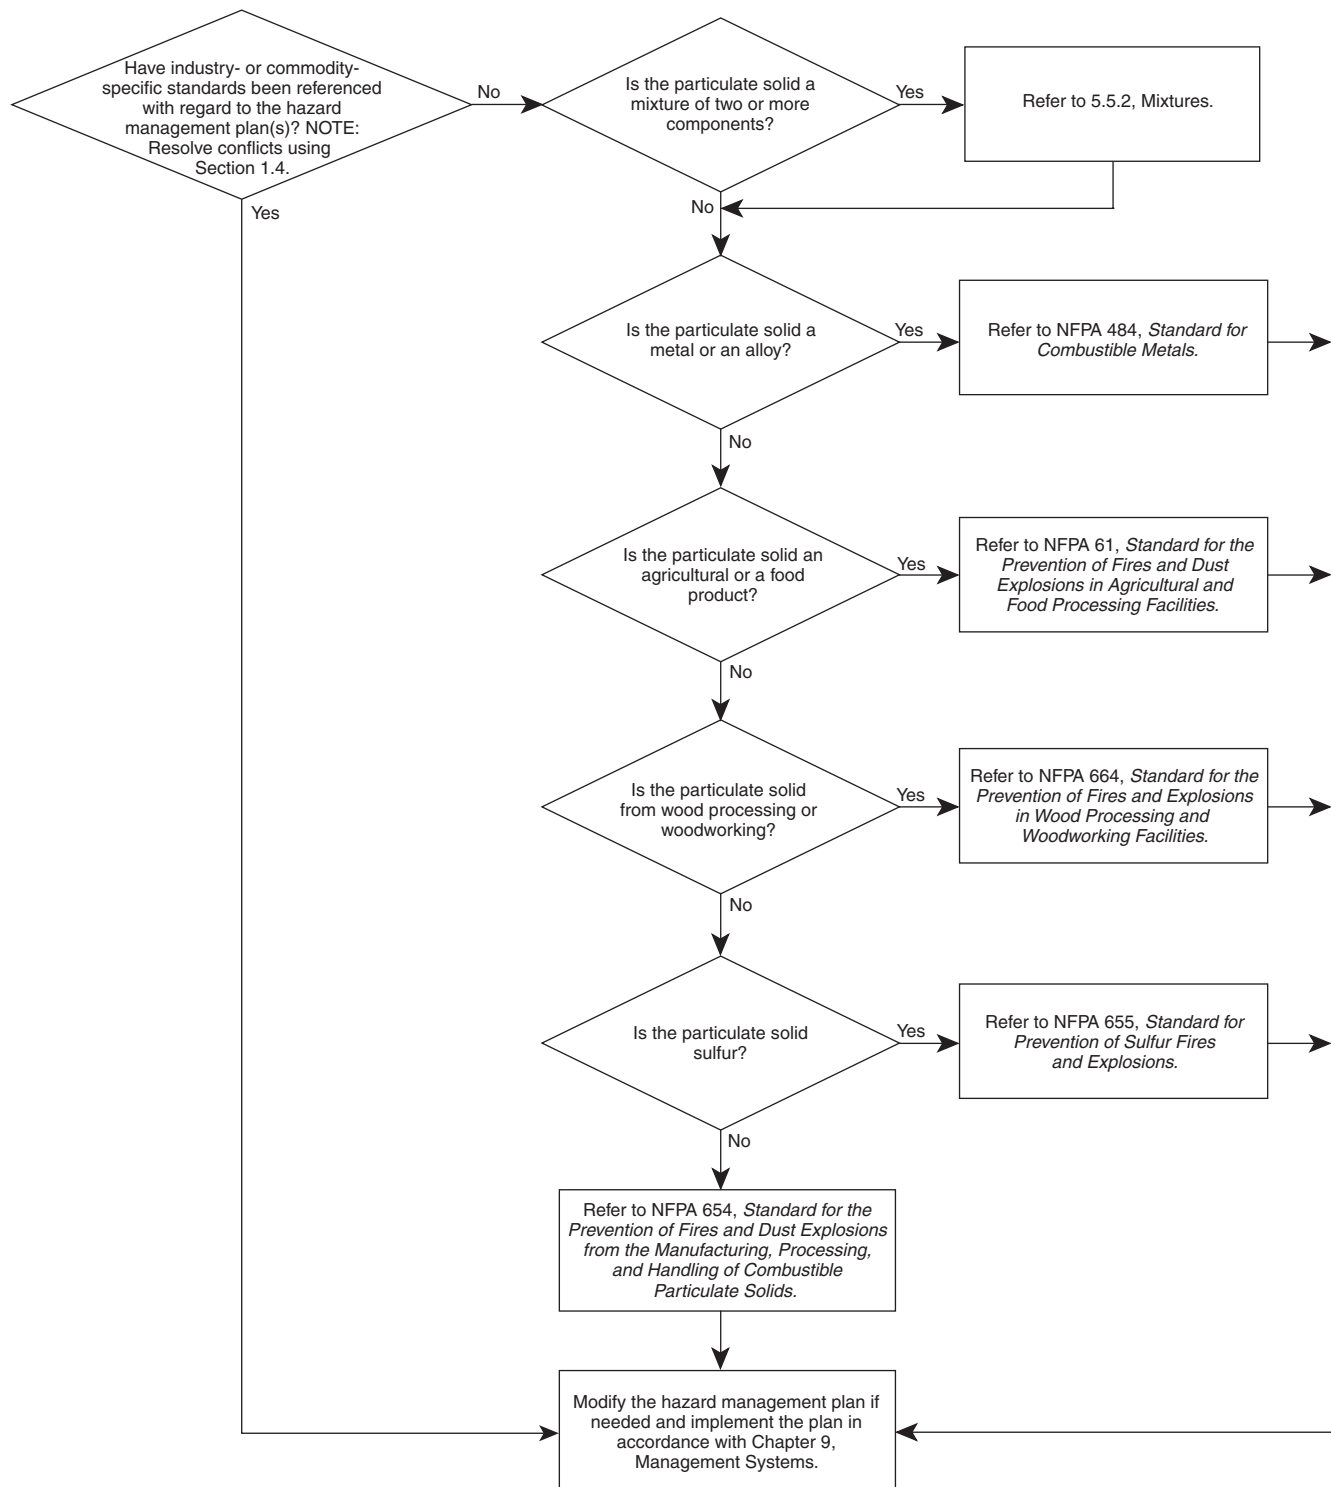


FIGURE 1.3.1 Continued.

**1.5.3** In those cases where the authority having jurisdiction (AHJ) determines that the existing situation presents an unacceptable degree of risk, the AHJ shall be permitted to apply retroactively any portions of this standard that, based on the application of clear criteria derived from the objectives in this standard, the AHJ determines to be necessary to achieve an acceptable degree of risk.

**1.5.4** The retroactive requirements of this standard shall be permitted to be modified if their application clearly would be impractical in the judgment of the authority having jurisdiction, and only where it is clearly evident that the modification does not result in an unacceptable degree of risk.

## 1.6 Equivalency.

**1.6.1** Nothing in this standard is intended to prevent the use of systems, methods, or devices of equivalent or superior quality, strength, fire resistance, effectiveness, durability, and safety over those prescribed by this standard.

**1.6.2** Technical documentation shall be made available to the authority having jurisdiction to demonstrate equivalency.

**1.6.3** The system, method, or device shall be approved for the intended purpose by the authority having jurisdiction.

## 1.7 Units and Formulas.

**1.7.1 SI Units.** Metric units of measurement in this standard shall be in accordance with the modernized metric system known as the International System of Units (SI).

**1.7.2\* Primary and Equivalent Values.** If a value for a measurement as given in this standard is followed by an equivalent value in other units, the first stated value shall be regarded as the requirement.

**1.7.3 Conversion Procedure.** SI units shall be converted by multiplying the quantity by the conversion factor and then rounding the result to the appropriate number of significant digits.

## Chapter 2 Referenced Publications

**2.1 General.** The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

**2.2 NFPA Publications.** National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 10, *Standard for Portable Fire Extinguishers*, 2013 edition.

NFPA 11, *Standard for Low-, Medium-, and High-Expansion Foam*, 2016 edition.

NFPA 12, *Standard on Carbon Dioxide Extinguishing Systems*, 2015 edition.

NFPA 12A, *Standard on Halon 1301 Fire Extinguishing Systems*, 2015 edition.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 2016 edition.

NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*, 2013 edition.

NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*, 2012 edition.

NFPA 16, *Standard for the Installation of Foam-Water Sprinkler and Foam-Water Spray Systems*, 2015 edition.

NFPA 17, *Standard for Dry Chemical Extinguishing Systems*, 2013 edition.

NFPA 20, *Standard for the Installation of Stationary Pumps for Fire Protection*, 2016 edition.

NFPA 22, *Standard for Water Tanks for Private Fire Protection*, 2013 edition.

NFPA 24, *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*, 2016 edition.

NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*, 2014 edition.

NFPA 31, *Standard for the Installation of Oil-Burning Equipment*, 2011 edition.

NFPA 51B, *Standard for Fire Prevention During Welding, Cutting, and Other Hot Work*, 2014 edition.

NFPA 54, *National Fuel Gas Code*, 2015 edition.

NFPA 61, *Standard for the Prevention of Fires and Dust Explosions in Agricultural and Food Processing Facilities*, 2013 edition.

NFPA 68, *Standard on Explosion Protection by Deflagration Venting*, 2013 edition.

NFPA 69, *Standard on Explosion Prevention Systems*, 2014 edition.

NFPA 70®, *National Electrical Code*, 2014 edition.

NFPA 72®, *National Fire Alarm and Signaling Code*, 2016 edition.

NFPA 85, *Boiler and Combustion Systems Hazards Code*, 2015 edition.

NFPA 86, *Standard for Ovens and Furnaces*, 2015 edition.

NFPA 91, *Standard for Exhaust Systems for Air Conveying of Vapors, Gases, Mists, and Particulate Solids*, 2015 edition.

NFPA 221, *Standard for High Challenge Fire Walls, Fire Walls, and Fire Barrier Walls*, 2015 edition.

NFPA 484, *Standard for Combustible Metals*, 2015 edition.

NFPA 505, *Fire Safety Standard for Powered Industrial Trucks Including Type Designations, Areas of Use, Conversions, Maintenance, and Operations*, 2013 edition.

NFPA 654, *Standard for the Prevention of Fire and Dust Explosions from the Manufacturing, Processing, and Handling of Combustible Particulate Solids*, 2013 edition.

NFPA 655, *Standard for Prevention of Sulfur Fires and Explosions*, 2012 edition.

NFPA 664, *Standard for the Prevention of Fires and Explosions in Wood Processing and Woodworking Facilities*, 2012 edition.

NFPA 750, *Standard on Water Mist Fire Protection Systems*, 2015 edition.

NFPA 2001, *Standard on Clean Agent Fire Extinguishing Systems*, 2015 edition.

NFPA 2112, *Standard on Flame-Resistant Garments for Protection of Industrial Personnel Against Flash Fire*, 2012 edition.

NFPA 2113, *Standard on Selection, Care, Use, and Maintenance of Flame-Resistant Garments for Protection of Industrial Personnel Against Short-Duration Thermal Exposures from Fire*, 2015 edition.

## 2.3 Other Publications.

**2.3.1 ASME Publications.** American Society of Mechanical Engineers, Three Park Avenue, New York, NY 10016-5990.

ASME B31.3, *Process Piping*, 2012.

*Boiler and Pressure Vessel Code*, 2010.

**2.3.2 ASTM Publications.** ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM E1226, *Standard Test Method for Explosibility of Dust Clouds*, 2012a.

ASTM E1515, *Standard Test Method for Minimum Explosible Concentration of Combustible Dusts*, 2007.

**2.3.3 IEC Publications.** International Electrotechnical Commission, 3, rue de Varembe, P.O. Box 131, CH-1211 Geneva 20, Switzerland.

IEC 61340-4-4, *Electrostatics — Part 4-4: Standard Test Methods for Specific Applications — Electrostatic Classification of Flexible Intermediate Bulk Containers (FIBC)*, 2005.

**2.3.4 NEMA Publications.** National Electrical Manufacturers Association, 1300 North 17th Street, Suite 1847, Rosslyn, VA 22209.

NEMA 250, *Enclosures for Electrical Equipment*, 2008.

**2.3.5 UN Publications.** United Nations Publications, Room DC2-853, 2 UN Plaza, New York, NY 10017.

*UN Recommendations on the Transport of Dangerous Goods: Model Regulations – Manual of Tests and Criteria*, 13th edition.

**2.3.6 U.S. Government Publications.** U.S. Government Printing Office, Washington, DC 20402.

Title 29, Code of Federal Regulations, Part 1910.242(b), “Hand and Portable Powered Tools and Equipment, General.”

**2.3.7 Other Publications.**

*Merriam-Webster’s Collegiate Dictionary*, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

## 2.4 References for Extracts in Mandatory Sections.

NFPA 51B, *Standard for Fire Prevention During Welding, Cutting, and Other Hot Work*, 2014 edition.

NFPA 68, *Standard on Explosion Protection by Deflagration Venting*, 2013 edition.

NFPA 69, *Standard on Explosion Prevention Systems*, 2014 edition.

NFPA 221, *Standard for High Challenge Fire Walls, Fire Walls, and Fire Barrier Walls*, 2015 edition.

NFPA 484, *Standard for Combustible Metals*, 2015 edition.

NFPA 654, *Standard for the Prevention of Fire and Dust Explosions from the Manufacturing, Processing, and Handling of Combustible Particulate Solids*, 2013 edition.

NFPA 921, *Guide for Fire and Explosion Investigations*, 2014 edition.

NFPA 1250, *Recommended Practice in Fire and Emergency Services Organization Risk Management*, 2015 edition.

NFPA 1451, *Standard for a Fire and Emergency Service Vehicle Operations Training Program*, 2013 edition.

## Chapter 3 Definitions

**3.1 General.** The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster’s Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

### 3.2 NFPA Official Definitions.

**3.2.1\* Approved.** Acceptable to the authority having jurisdiction.

**3.2.2\* Authority Having Jurisdiction (AHJ).** An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

**3.2.3 Labeled.** Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

**3.2.4\* Listed.** Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

**3.2.5 Shall.** Indicates a mandatory requirement.

**3.2.6 Should.** Indicates a recommendation or that which is advised but not required.

**3.2.7 Standard.** An NFPA Standard, the main text of which contains only mandatory provisions using the word “shall” to indicate requirements and that is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered a part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA Manuals of Style. When used in a generic sense, such as in the phrase “standards development process” or “standards development activities,” the term “standards” includes all NFPA Standards, including Codes, Standards, Recommended Practices, and Guides.

### 3.3 General Definitions.

**3.3.1\* Air-Material Separator (AMS).** A device designed to separate the conveying air from the material being conveyed. [654, 2013]

**3.3.1.1 Enclosureless AMS.** An air-material separator designed to separate the conveying air from the material being conveyed where the filter medium is not enclosed or in a container.

**3.3.2\* Air-Moving Device (AMD).** A power-driven fan, blower, or other device that establishes an airflow by moving a given volume of air per unit time. [654, 2013]

**3.3.3 Bonding.** For the purpose of controlling static electric hazards, the process of connecting two or more conductive objects by means of a conductor so that they are at the same electrical potential but not necessarily at the same potential as the earth.

**3.3.4\* Centralized Vacuum Cleaning System.** A fixed-pipe system utilizing variable-volume negative-pressure (i.e., vacuum) air flows from remotely located hose connection stations to allow the removal of dust accumulations from surfaces and conveying those dusts to an air-material separator (AMS). [654, 2013]

**3.3.5\* Combustible Dust.** A finely divided combustible particulate solid that presents a flash-fire hazard or explosion hazard when suspended in air or the process-specific oxidizing medium over a range of concentrations. [654, 2013]





**3.3.6\* Combustible Metal.** Any metal composed of distinct particles or pieces, regardless of size, shape, or chemical composition, that will burn. [484, 2015]

**3.3.7\* Combustible Particulate Solid.** Any solid material composed of distinct particles or pieces, regardless of size, shape, or chemical composition, that, when processed, stored, or handled in the facility, has the potential to produce a combustible dust.

**3.3.8 Compartment.** A subdivision of an enclosure.

**3.3.9 Conductive Dusts.** Dusts with a volume resistivity of less than  $10^8$  ohms-m.

**3.3.10\* Deflagration.** Propagation of a combustion zone at a velocity that is less than the speed of sound in the unreacted medium. [68, 2013]

**3.3.11 Detachment.** Location in a separate building or an outside area removed from other structures to be protected by a distance as required by this standard.

**3.3.12 Duct.** Pipes, tubes, or other enclosures used to convey materials pneumatically or by gravity.

**3.3.13\* Dust Collection System.** A combination of equipment designed to capture, contain, and pneumatically convey fugitive dust to an air-material separator (AMS) in order to remove the dust from the process equipment or surrounding area.

**3.3.14 Dust Deflagration Hazard.** A condition that presents the potential for harm or damage to people, property, or the environment due to the combustion of a sufficient quantity of combustible dust suspended in air or another oxidizing medium.

**3.3.15 Dust Explosion Hazard.** A dust deflagration hazard in an enclosure that is capable of bursting or rupturing the enclosure due to the development of internal pressure from the deflagration.

**3.3.16\* Dust Hazards Analysis (DHA).** A systematic review to identify and evaluate the potential fire, flash fire, or explosion hazards associated with the presence of one or more combustible particulate solids in a process or facility.

**3.3.17\* Enclosure.** A confined or partially confined volume. [68, 2013]

**3.3.18 Explosion.** The bursting or rupture of an enclosure or container due to the development of internal pressure from a deflagration. [69, 2014]

**3.3.19 Fire Hazard.** Any situation, process, material, or condition that, on the basis of applicable data, can cause a fire or provide a ready fuel supply to augment the spread or intensity of a fire and poses a threat to life or property.

**3.3.20\* Flash Fire.** A fire that spreads by means of a flame front rapidly through a diffuse fuel, such as dust, gas, or the vapors of an ignitable liquid, without the production of damaging pressure. [921, 2014]

**3.3.21 Fuel Object.** A combustible object or mass of particulate that can serve as a source of fuel for a fire or deflagration; sometimes referred to as a *fuel package*.

**3.3.22 Fugitive Dusts. (Reserved)**

**3.3.23 Grounding.** The process of bonding one or more conductive objects to the ground so that all objects are at zero electrical potential; also referred to as *earthing*.

**3.3.24 Hot Work.** Work involving burning, welding, or a similar operation that is capable of initiating fires or explosions. [51B, 2014]

**3.3.25\* Hybrid Mixture.** An explosible heterogeneous mixture, comprising gas with suspended solid or liquid particulates, in which the total flammable gas concentration is  $\geq 10$  percent of the lower flammable limit (LFL) and the total suspended particulate concentration is  $\geq 10$  percent of the minimum explosible concentration (MEC). [68, 2013]

**3.3.26\* Industry- or Commodity-Specific NFPA Standard.** An NFPA code or standard whose intent as documented within its purpose or scope is to address fire and explosion hazards of a combustible particulate solid.

**3.3.27 Intermediate Bulk Containers.**

**3.3.27.1\* Flexible Intermediate Bulk Container (FIBC).** Large bags typically made from nonconductive woven fabric that are used for storage and handling of bulk solids. [654, 2013]

**3.3.27.1.1 Type A FIBC.** An FIBC made from nonconductive fabric with no special design features for control of electrostatic discharge hazards. [654, 2013]

**3.3.27.1.2 Type B FIBC.** An FIBC made from nonconductive fabric where the fabric or the combination of the fabric shell, coating, and any loose liner has a breakdown voltage of less than 6000 volts. [654, 2013]

**3.3.27.1.3 Type C FIBC.** An FIBC made from conductive material or nonconductive woven fabric incorporating interconnected conductive threads of specified spacing with all conductive components connected to a grounding tab. [654, 2013]

**3.3.27.1.4 Type D FIBC.** An FIBC made from fabric and/or threads with special static properties designed to control electrostatic discharge energy without a requirement for grounding the FIBC. [654, 2013]

**3.3.27.2\* Rigid Intermediate Bulk Container (RIBC).** An intermediate bulk container (IBC) that can be enclosed in or encased by an outer structure consisting of a steel cage, a single-wall metal or plastic enclosure, or a double wall of foamed or solid plastic. [654, 2013]

**3.3.27.2.1 Insulating RIBC.** An RIBC constructed entirely of solid plastic or solid plastic and foam composite that cannot be electrically grounded. [654, 2013]

**3.3.28\* Minimum Explosible Concentration (MEC).** The minimum concentration of a combustible dust suspended in air, measured in mass per unit volume, that will support a deflagration. [654, 2013]

**3.3.29\* Minimum Ignition Energy (MIE).** The lowest capacitive spark energy capable of igniting the most ignition-sensitive concentration of a flammable vapor-air mixture or a combustible dust-air mixture as determined by a standard test procedure. [654, 2013]

**3.3.30\* Pneumatic Conveying System.** An equipment system that transfers a controlled flow of solid particulate material from one location to another using air or other gases as the conveying medium, and that is comprised of the following components: a material feeding device; an enclosed ductwork, piping, or tubing network; an air-material separator; and an air-moving device.

**3.3.31 Pyrophoric Material.** A chemical with an autoignition temperature in air at or below 130°F (54.4°C). [5000, 2015]

**3.3.32 Qualified Person.** A person who, by possession of a recognized degree, certificate, professional standing, or skill, and who, by knowledge, training, and experience, has demonstrated the ability to deal with problems related to the subject matter, the work, or the project. [1451, 2013]

**3.3.33 Replacement-in-Kind.** A replacement that satisfies the design specifications of the replaced item.

**3.3.34\* Risk Assessment.** An assessment of the likelihood, vulnerability, and magnitude of the incidents that could result from exposure to hazards. [1250, 2010]

**3.3.35 Segregation.** The establishment of a physical barrier between the hazard area and an area to be protected.

**3.3.36 Separation.** The interposing of distance between the combustible particulate solid process and other operations that are in the same [compartment]. [654, 2013]

**3.3.37 Spark.** A moving particle of solid material that emits radiant energy due to either its temperature or the process of combustion on its surface. [654, 2013]

**3.3.38 Threshold Housekeeping Dust Accumulations.** The maximum quantity of dust permitted to be present before cleanup is required.

**3.3.39 Transient Releases. (Reserved)**

**3.3.40 Ullage Space.** The open space above the surface of the stored solids in a storage vessel.

**3.3.41 Wall.**

**3.3.41.1 Fire Barrier Wall.** A wall, other than a fire wall, having a fire resistance rating. [221, 2015]

**3.3.41.2 Fire Wall.** A wall separating buildings or subdividing a building to prevent the spread of fire and having a fire resistance rating and structural stability. [221, 2015]

## Chapter 4 General Requirements

**4.1\* General.** The owner/operator of a facility with potentially combustible dust shall be responsible for the following activities:

- (1) Determining the combustibility and explosibility hazards of materials in accordance with Chapter 5
- (2) Identifying and assessing any fire, flash fire, and explosion hazards in accordance with Chapter 7
- (3) Managing the identified fire, flash fire, and explosion hazards in accordance with 4.2.4
- (4) Communicating the hazards to affected personnel in accordance with Section 9.5

### 4.2 Objectives.

#### 4.2.1 Life Safety.

**4.2.1.1\*** The facility, processes, and equipment shall be designed, constructed, equipped, and maintained and management systems shall be implemented to reasonably protect occupants not in the immediate proximity of the ignition from the effects of fire for the time needed to evacuate, relocate, or take refuge.

**4.2.1.2** The facility, processes, and equipment shall be designed, constructed, equipped, and maintained and management

systems shall be implemented to reasonably prevent serious injury from flash fires.

**4.2.1.3** The facility, processes, and equipment shall be designed, constructed, equipped, and maintained and management systems shall be implemented to reasonably prevent injury from explosions.

**4.2.1.4** The structure shall be located, designed, constructed, and maintained to reasonably protect adjacent properties and the public from the effects of fire, flash fire, or explosion.

**4.2.2\* Mission Continuity.** The facility, processes, and equipment shall be designed, constructed, equipped, and maintained and management systems shall be implemented to limit damage to levels that ensure the ongoing mission, production, or operating capability of the facility to a degree acceptable to the owner/operator.

**4.2.3\* Mitigation of Fire Spread and Explosions.** The facility and processes shall be designed to prevent or mitigate fires and explosions that can cause failure of adjacent buildings or building compartments or other enclosures, emergency life safety systems, adjacent properties, adjacent storage, or the facility's structural elements.

**4.2.4\* Compliance Options.** The objectives in Section 4.2 shall be achieved by either of the following means:

- (1) A prescriptive approach in accordance with Chapters 5, 7, 8, and 9 in conjunction with any prescriptive provisions of applicable commodity-specific NFPA standards
- (2) A performance-based approach in accordance with Chapter 6

**4.2.5** Where a dust fire, deflagration, or explosion hazard exists within a process system, the hazards shall be managed in accordance with this standard.

**4.2.6** Where a dust fire, deflagration, or explosion hazard exists within a building or building compartment, the effects of the fire, deflagration, or explosion shall be managed in accordance with this standard.

## Chapter 5 Hazard Identification

**5.1 Responsibility.** The owner/operator of a facility with potentially combustible dusts shall be responsible for determining whether the materials are combustible or explosible, and, if so, for characterizing their properties as required to support the DFA.

**5.1.1** Where dusts are determined to be combustible or explosible, the hazards associated with the dusts shall be assessed in accordance with Chapter 7.

**5.1.2** Where dusts are determined to be combustible or explosible, controls to address the hazards associated with the dusts shall be identified and implemented in accordance with 4.2.4.

### 5.2\* Screening for Combustibility or Explosibility.

**5.2.1** The determination of combustibility or explosibility shall be permitted to be based upon either of the following:

- (1) Historical facility data or published data that are deemed to be representative of current materials and process conditions
- (2) Analysis of representative samples in accordance with the requirements of 5.4.1 and 5.4.3



**5.2.2\*** Test results, historical data, and published data shall be documented and, when requested, provided to the authority having jurisdiction (AHJ).

**5.2.3** The absence of previous incidents shall not be used as the basis for deeming a particulate to not be combustible or explosible.

**5.2.4** Where dusts are determined to not be combustible or explosible, the owner/operator shall maintain documentation to demonstrate that the dusts are not combustible or explosible.

### **5.3\* Self-Heating and Reactivity Hazards. (Reserved)**

**5.4 Combustibility and Explosibility Tests.** Where combustibility or explosibility screening tests are required, they shall be conducted on representative samples obtained in accordance with Section 5.5.

#### **5.4.1 Determination of Combustibility.**

**5.4.1.1** Where the combustibility is not known, determination of combustibility shall be determined by one of the following tests:

- (1) A screening test based on the *UN Recommendations on the Transport of Dangerous Goods: Model Regulations — Manual of Tests and Criteria*, Part III, Subsection 33.2.1, Test N.1, “Test Method for Readily Combustible Solids”
- (2) Other equivalent fire exposure test methods

**5.4.1.2\*** For the purposes of determining combustibility, if the dust in the form tested ignites and propagates combustion or ejects sparks from the heated zone after the heat source is removed, the material shall be considered combustible.

**5.4.1.3** If the dust is known to be explosible, it shall be permitted to assume that the dust is combustible and the requirements of 5.4.1.1 shall not apply.

#### **5.4.2 Determination of Flash-Fire Hazard. (Reserved)**

#### **5.4.3 Determination of Explosibility.**

**5.4.3.1** Where the explosibility is not known, determination of explosibility of dusts shall be determined according to one of the following tests:

- (1) The “Go/No-Go” screening test methodology described in ASTM E1226, *Standard Test Method for Explosibility of Dust Clouds*
- (2) ASTM E1515, *Standard Test Method for Minimum Explosible Concentration of Combustible Dusts*
- (3) An equivalent test methodology

**5.4.3.2\*** When determining explosibility, it shall be permitted to test a sample sieved to less than 200 mesh (75  $\mu\text{m}$ ).

**5.4.3.3\*** When determining explosibility, it shall be permitted to test the as-received sample.

**5.4.3.4** It shall be permitted to assume a material is explosible, forgoing the requirements of 5.4.3.1.

**5.4.3.5\*** When the representative sample has a characteristic particle size smaller than 0.5  $\mu\text{m}$ , the explosibility screening test method shall account for possible ignitions in the sample injection apparatus.

#### **5.4.4 Quantification of Combustibility and Explosibility Characteristics.**

**5.4.4.1\*** Where dusts are determined to be combustible or explosible, additional testing shall be performed, as required,

to acquire the data necessary to support the performance-based design method described in Chapter 6; the DHA described in Chapter 7; the risk assessments described in Chapter 8; or specification of the hazard mitigation and prevention described in Chapter 8.

**5.4.4.2** The owner/operator shall be permitted to use the worst-case characteristics of the various materials being handled as a basis for design.

### **5.5 Sampling.**

#### **5.5.1 Sampling Plan.**

**5.5.1.1** A sampling plan shall be developed and documented to provide data as needed to comply with the requirements of this chapter.

**5.5.1.2** Representative samples of dusts shall be identified and collected for testing according to the sampling plan.

**5.5.1.3** The sampling plan shall include the following:

- (1) Identification of locations where fine particulates and dust are present
- (2) Identification of representative samples
- (3) Collection of representative samples
- (4)\*Preservation of sample integrity
- (5) Communication with the test laboratory regarding sample handling
- (6) Documentation of samples taken
- (7) Safe sample collection practices

**5.5.2\* Mixtures.** If the dust sample is a mixture, the approximate proportions of each general category of particulate solid shall be determined and documented on the basis of available information and shall be used to assist in determining representative samples.

**5.5.3\* Representative Samples.** Samples collected from each location shall be representative of material used in the process or equipment or found on surfaces at that location.

**5.5.4\* Sample Collection.** Dust samples shall be collected in a safe manner without introducing an ignition source, dispersing dust, or creating or increasing the risk of injury to workers.

**5.5.4.1\*** Samples shall be uniquely identified using identifiers such as lot, origin, composition (pure, mixture), process, age, location, and date collected.

## **Chapter 6 Performance-Based Design Option**

### **6.1 General Requirements.**

**6.1.1\*** It shall be permitted to use performance-based alternative designs for a process or part of a process, specific material, or piece of equipment in lieu of the prescriptive requirements found in Chapter 8.

**6.1.2 Approved Qualifications.** The performance-based design shall be prepared by a person with qualifications acceptable to the owner/operator.

**6.1.2.1\* General.** All applicable aspects of the design, including those described in 6.1.3.1 through 6.1.3.13, shall be documented in a format and content acceptable to the AHJ.

**6.1.3\* Document Requirements.** Performance-based designs shall be documented to include all calculations, references, assumptions, and sources from which material characteristics



and other data have been obtained, or on which the designer has relied for some material aspect of the design in accordance with 6.1.3.

**6.1.3.1\* Technical References and Resources.** When requested by the AHJ, the AHJ shall be provided with sufficient documentation to support the validity, accuracy, relevance, and precision of the proposed methods. The engineering standards, calculation methods, and other forms of scientific information provided shall be appropriate for the particular application and methodologies used.

**6.1.3.2 Building Design Specifications.** All details of the proposed building, facilities, equipment, and process designs that affect the ability of the facility to meet the stated goals and objectives shall be documented.

**6.1.3.3 Performance Criteria.** Performance criteria, with sources, shall be documented.

**6.1.3.4 Occupant Characteristics.** Assumptions about occupant characteristics shall be documented.

**6.1.3.5 Design Fire and Explosion Scenarios.** Descriptions of combustible dust fire and explosion design scenarios shall be documented.

**6.1.3.6 Input Data.** Input data to models and assessment methods, including sensitivity analyses, shall be documented.

**6.1.3.7 Output Data.** Output data from models and assessment methods, including sensitivity analyses, shall be documented.

**6.1.3.8 Safety Factors.** The safety factors utilized shall be documented.

**6.1.3.9 Prescriptive Requirements.** Retained prescriptive requirements shall be documented.

**6.1.3.10 Modeling Features.**

**6.1.3.10.1** Assumptions made by the model user and descriptions of models and methods used, including known limitations, shall be documented.

**6.1.3.10.2** Documentation shall be provided to verify that the assessment methods have been used validly and appropriately to address the design specifications, assumptions, and scenarios.

**6.1.3.11 Evidence of Modeler Capability.** The design team's relevant experience with the models, test methods, databases, and other assessment methods used in the performance-based design proposal shall be documented.

**6.1.3.12 Performance Evaluation.** The performance evaluation summary shall be documented.

**6.1.3.13 Use of Performance-Based Design Option.** Design proposals shall include documentation that provides anyone involved in the ownership or management of the building with notification of the following:

- (1) Approval of the building, facilities, equipment or processes, in whole or in part, as a performance-based design with certain specified design criteria and assumptions
- (2) Need for required re-evaluation and reapproval in cases of remodeling, modification, renovation, change in use, or change in established assumptions

**6.1.4\*** Performance-based designs and documentation shall be updated and subject to re-approval if any of the assumptions on which the original design was based are changed.

**6.1.5 Sources of Data.**

**6.1.5.1** Data sources shall be identified and documented for each input data requirement that must be met using a source other than a design fire scenario, an assumption, or a building design specification.

**6.1.5.2** The degree of conservatism reflected in such data shall be specified, and a justification for the sources shall be provided.

**6.1.6\* Maintenance of the Design Features.** To continue meeting the performance goals and objectives of this standard, the design features required for each hazard area shall be maintained for the life of the facility subject to the management of change provisions of Section 9.9.

**6.1.6.1\*** This shall include complying with originally documented design assumptions and specifications.

**6.1.6.2\*** Any variation from the design shall be acceptable to the AHJ.

**6.2 Risk Component and Acceptability.** The specified performance criteria of Section 6.3 and the specified fire and explosion scenarios of Section 6.4 shall be permitted to be modified by a documented risk assessment acceptable to the AHJ. The final performance criteria, fire scenarios, and explosion scenarios established for the performance-based design shall be documented.

**6.3 Performance Criteria.** A system and facility design shall be deemed to meet the objectives specified in Section 4.2 if its performance meets the criteria in 6.3.1 through 6.3.5.

**6.3.1 Life Safety.**

**6.3.1.1\*** The life safety objectives of 4.2.1 with respect to a fire hazard shall be achieved if either of the following conditions is met:

- (1) Ignition has been prevented.
- (2) Under all fire scenarios, no person, other than those in the immediate proximity of the ignition, is exposed to untenable conditions due to the fire, and no critical structural element of the building is damaged to the extent that it can no longer support its design load during the time necessary to effect complete evacuation.

**6.3.1.2** The life safety objectives of 4.2.1 with respect to an explosion hazard shall be achieved if either of the following conditions is met:

- (1) Ignition has been prevented.
- (2) Under all explosion scenarios, no person, other than those in the immediate proximity of the ignition, is exposed to untenable conditions, including missile impact or overpressure, due to an explosion, and no critical structural element of the building is damaged to the extent that it can no longer support its design load during the time necessary to effect complete evacuation.

**6.3.2 Structural Integrity.** The structural integrity objectives embodied in 4.2.1 and 4.2.2 with respect to fire and explosion shall be achieved when no critical structural element of the building is damaged to the extent that it can no longer support its design load under all fire and explosion scenarios.



**6.3.3 Mission Continuity.** The mission continuity objectives of 4.2.3 shall be achieved when damage to equipment and the facility has been limited to a level of damage acceptable to the owner/operator.

**6.3.4 Mitigation of Fire Spread and Explosions.** When limitation of fire spread is to be achieved, all of the following criteria shall be demonstrated:

- (1) Adjacent combustibles shall not attain their ignition temperature.
- (2) Building design and housekeeping shall prevent combustibles from accumulating exterior to the enclosed process system to a concentration that is capable of supporting propagation.
- (3) Particulate processing systems shall prevent fire or explosion from propagating from one process system to an adjacent process system or to the building interior.

**6.3.5 Effects of Explosions.** Where the prevention of damage due to explosion is to be achieved, deflagrations shall not produce any of the following conditions:

- (1) Internal pressures in the building or building compartment or equipment sufficient to threaten its structural integrity
- (2) Extension of the flame front outside the building or building compartment or equipment of origin except where intentionally vented to a safe location
- (3) Rupture of the building or building compartment or equipment of origin and the ejection of fragments that can constitute missile hazards

#### **6.4\* Design Scenarios.**

##### **6.4.1 Fire Scenarios.**

**6.4.1.1\*** Each fuel object in the building or building compartment or equipment of origin shall be considered for inclusion as a fire scenario.

**6.4.1.2** The fuel object that produces the most rapidly developing fire during startup, normal operating conditions, or shutdown shall be included as a fire scenario.

**6.4.1.3** The fuel object that produces the most rapidly developing fire under conditions of a production upset or single equipment failure shall be included as a fire scenario.

**6.4.1.4** The fuel object that produces the greatest total heat release during startup, normal operating conditions, or shutdown shall be included as a fire scenario.

**6.4.1.5** The fuel object that produces the greatest total heat release under conditions of a production upset or single equipment failure shall be included as a fire scenario.

**6.4.1.6** Each fuel object that can produce a deep-seated fire during startup, normal operating conditions, or shutdown shall be included as a fire scenario.

**6.4.1.7** Each fuel object that can produce a deep-seated fire under conditions of a production upset or single equipment failure shall be included as a fire scenario.

##### **6.4.2 Explosion Scenarios.**

**6.4.2.1** Each duct, enclosed conveyor, silo, bunker, cyclone, dust collector, or other vessel containing a combustible dust in sufficient quantity or conditions to support the propagation of a flame front during startup, normal operating conditions, or shutdown shall be included as an explosion scenario.

**6.4.2.2** Each duct, enclosed conveyor, silo, bunker, cyclone, dust collector, or other vessel containing a combustible dust in sufficient quantity or conditions to support the propagation of a flame front under conditions of production upset or single equipment failure shall be included as an explosion scenario.

**6.4.2.3** Each building or building compartment containing a combustible dust in sufficient quantity or conditions to support the propagation of a flame front during startup, normal operating conditions, or shutdown shall be included as an explosion scenario.

**6.4.2.4** Each building or building compartment containing a combustible dust in sufficient quantity or conditions to support the propagation of a flame front under conditions of production upset or single equipment failure shall be included as an explosion scenario.

**6.4.2.5\*** Where combustible dust can cause other explosion hazards, such as generation of hydrogen or other flammable gases, those hazards shall be included as explosion scenarios.

#### **6.5 Evaluation of Proposed Design.**

**6.5.1\*** A proposed design's performance shall be assessed relative to each documented performance criterion as established in Section 6.2 or in Section 6.3 and in each documented fire and explosion scenario established for the design, with the assessment conducted through the use of appropriate calculation methods acceptable to the AHJ.

**6.5.2** The designer shall establish numerical performance criteria for each of the documented performance objectives established for the design.

**6.5.3** The design professional shall use the assessment methods to demonstrate that the proposed design will achieve the goals and objectives, as measured by the performance criteria in light of the safety margins and uncertainty analysis, for each scenario, given the assumptions.

#### **6.6 Retained Prescriptive Requirements.**

**6.6.1** Portions of a facility design in accordance with Chapter 6 shall also meet the following requirements:

- (1) Housekeeping in accordance with Section 8.4
- (2) PPE in accordance with Section 8.6
- (3) Management systems in accordance with Chapter 9

## **Chapter 7 Dust Hazards Analysis (DHA)**

### **7.1\* General Requirements.**

**7.1.1 Responsibility.** The owner/operator of a facility where materials that have been determined to be combustible or explosible in accordance with Chapter 5 are present in an enclosure shall be responsible to ensure a DHA is completed in accordance with the requirements of this chapter.

**7.1.2\*** The requirements of Chapter 7 shall apply retroactively in accordance with 7.1.2.1 through 7.1.2.3.

**7.1.2.1** For existing processes and facility compartments that are undergoing material modification, the owner/operator shall complete DHAs as part of the project.

**7.1.2.2\*** For existing processes and facility compartments that are not undergoing material modification, the owner/operator shall schedule and complete DHAs of existing pro-

cesses and facility compartments within a 3-year period from the effective date of the standard. The owner/operator shall demonstrate reasonable progress in each of the 3 years.

**7.1.2.3** For the purposes of applying the provisions of 7.1.2, material modification shall include modifications or maintenance and repair activities that exceed 25 percent of the original cost.

## 7.2 Criteria.

**7.2.1\* Overview.** The DHA shall evaluate the fire, deflagration, and explosion hazards and provide recommendations to manage the hazards in accordance with Section 4.2.

**7.2.2\* Qualifications.** The DHA shall be performed or led by a qualified person.

**7.2.3 Documentation.** The results of the DHA review shall be documented, including any necessary action items requiring change to the process materials, physical process, process operations, or facilities associated with the process.

## 7.3 Methodology.

**7.3.1 General.** The DHA shall include the following:

- (1) Identification and evaluation of the process or facility areas where fire, flash fire, and explosion hazards exist
- (2) Where such a hazard exists, identification and evaluation of specific fire and deflagration scenarios shall include the following:
  - (a) Identification of safe operating ranges
  - (b)\*Identification of the safeguards that are in place to manage fire, deflagration, and explosion events
  - (c) Recommendation of additional safeguards where warranted, including a plan for implementation

### 7.3.2 Material Evaluation.

**7.3.2.1** The DHA shall be based on data obtained in accordance with Chapter 5 for material that is representative of the dust present.

### 7.3.3 Process Systems.

**7.3.3.1\*** Each part of the process system where combustible dust is present or where combustible particulate solids could cause combustible dust to be present shall be evaluated, and the evaluation shall address the following:

- (1) Potential intended and unintended combustible dust transport between parts of the process system
- (2) Potential fugitive combustible dust emissions into a building or building compartments
- (3) Potential deflagration propagation between parts of the process system

**7.3.3.2** Each part of the process that contains a combustible particulate solid and that can potentially include both of the following conditions shall be considered a fire hazard and shall be documented as such:

- (1) Oxidizing atmosphere
- (2) Credible ignition source

**7.3.3.3\*** Each part of the process that contains a sufficient quantity of combustible dust to propagate a deflagration and that can potentially include all the following conditions shall be considered a dust deflagration hazard and shall be documented as such:

- (1) Oxidizing atmosphere

- (2) Credible ignition source
- (3) Credible suspension mechanism

### 7.3.4 Building or Building Compartments.

**7.3.4.1** Each building or building compartment where combustible dust is present shall be evaluated.

**7.3.4.1.1** Where multiple buildings or building compartments present essentially the same hazard, a single evaluation shall be permitted to be conducted as representative of all similar buildings or building compartments.

**7.3.4.1.2** The evaluation shall address potential combustible dust migration between buildings or building compartments.

**7.3.4.1.3** The evaluation shall address potential deflagration propagation between buildings or building compartments.

**7.3.4.2\*** Each building or building compartment that contains a combustible particulate solid and that can potentially include both of the following conditions shall be considered a fire hazard and shall be documented as such:

- (1) Oxidizing atmosphere
- (2) Credible ignition source

**7.3.4.2.1\*** The evaluation of dust deflagration hazard in a building or building compartment shall include a comparison of actual or intended dust accumulation to the threshold housekeeping dust accumulation that would present a potential for flash-fire exposure to personnel or compartment failure due to explosive overpressure.

**7.3.4.2.2** Threshold housekeeping dust accumulation levels and nonroutine dust accumulation levels (e.g., from a process upset) shall be in accordance with relevant industry- or commodity-specific NFPA standards.

**7.3.4.3** Each building or building compartment that contains a sufficient quantity of combustible dust to propagate a deflagration and that can potentially include all of the following conditions shall be considered a dust deflagration hazard and shall be documented as such:

- (1) Oxidizing atmosphere
- (2) Credible ignition source
- (3) Credible suspension mechanism

## Chapter 8 Hazard Management: Mitigation and Prevention

### 8.1 Inherently Safe Designs. (Reserved)

### 8.2 Building Design.

**8.2.1 Risk Assessment.** A documented risk assessment acceptable to the AHJ shall be permitted to be conducted to determine the level of building design and protection features to be provided, including, but not limited to, the measures addressed in Section 8.2.

**8.2.2\* Construction.** The type of construction shall be in accordance with the building code adopted by the AHJ.

### 8.2.3 Building or Building Compartment Protection.

**8.2.3.1\*** Each building or building compartment where a dust deflagration hazard exists shall be protected from the consequence of deflagration.



**8.2.3.2\*** If a building or building compartment contains a dust explosion hazard outside of equipment, such areas shall be provided with deflagration venting to a safe area in accordance with NFPA 68.

**8.2.3.2.1** Venting to relieve pressure shall be located through an outside wall or roof.

**8.2.3.2.2** The fireball, blast hazards, and missile hazards that are created by deflagration venting shall not expose additional personnel or property assets.

**8.2.4 Life Safety.** Building configuration and appurtenances shall comply with the life safety requirements of the building and fire prevention codes adopted by the AHJ.

**8.2.4.1** Where a dust deflagration hazard exists in a building or building compartment outside of equipment, building configuration and appurtenances shall comply with the life safety requirements of the building and fire prevention codes for a hazardous occupancy adopted by the AHJ.

**8.2.4.2** Where a dust explosion hazard exists in a building or building compartment and an enclosed means of egress is provided, it shall be designed to withstand potential external overpressure from building deflagration.

#### **8.2.5 Construction Features to Limit Accumulation.**

**8.2.5.1\*** Interior surfaces where dust accumulations can occur shall be designed and constructed so as to facilitate cleaning and to minimize combustible dust accumulations.

**8.2.5.2** Enclosed building spaces inaccessible to routine housekeeping shall be sealed to prevent dust accumulation.

**8.2.5.3\*** Enclosed building spaces that are difficult to access for routine housekeeping shall be designed to facilitate routine inspection for the purpose of determining the need for periodic cleaning.

#### **8.2.6 Separation of Hazard Areas from Other Hazard Areas and from Other Occupancies.**

**8.2.6.1** Areas where a dust deflagration hazard exists in a building or building compartment (excluding hazard within equipment) shall be segregated, separated, or detached from other occupancies to minimize damage from a fire or an explosion.

##### **8.2.6.2 Use of Segregation.**

**8.2.6.2.1** Physical barriers erected for the purpose of limiting fire spread shall be designed in accordance with NFPA 221.

**8.2.6.2.2** Physical barriers erected to segregate fire hazard areas, including all penetrations and openings of floors, walls, ceilings, or partitions, shall have a minimum fire resistance rating based on the anticipated fire duration.

**8.2.6.2.3** Physical barriers, including all penetrations and openings of floors, walls, ceilings, or partitions, that are erected to segregate dust explosion hazard areas shall be designed to preclude failure of those barriers during a dust explosion in accordance with NFPA 68.

##### **8.2.6.3 Use of Separation.**

**8.2.6.3.1\*** Separation shall be permitted to be used to limit the dust explosion hazard or deflagration hazard area within a building when it is supported by a documented engineering evaluation acceptable to the AHJ.

**8.2.6.3.2\*** The required separation distance between the dust explosion hazard or deflagration hazard area and surrounding exposures shall be determined by an engineering evaluation that addresses the following:

- (1) Properties of the materials
- (2) Type of operation
- (3) Amount of material likely to be present outside the process equipment
- (4) Building and equipment design
- (5) Nature of surrounding exposures

**8.2.6.3.3** Either the separation area shall be free of dust or where dust accumulations exist on any surface, the color of the surface on which the dust has accumulated shall be readily discernible.

**8.2.6.3.4** Where separation is used to limit the dust explosion or deflagration hazard area determined in Chapter 7, the minimum separation distance shall not be less than 35 ft (11 m).

**8.2.6.3.5\*** Where separation is used, housekeeping, fixed dust collection systems employed at points of release, and the use of physical barriers shall be permitted to be used to limit the extent of the dust explosion hazard or flash-fire hazard area.

##### **8.2.6.4 Use of Detachment.**

**8.2.6.4.1** Detachment shall be permitted to be used to limit the dust hazard area to a physically separated adjacent building.

**8.2.6.4.2\*** The required detachment distance between the dust explosion hazard area or the deflagration hazard area and surrounding exposures shall be determined by an engineering evaluation that addresses the following:

- (1) Properties of the materials
- (2) Type of operation
- (3) Amount of material likely to be present outside the process equipment
- (4) Building and equipment design
- (5) Nature of surrounding exposures

#### **8.3 Equipment Design.**

**8.3.1\* Risk Assessment.** A documented risk assessment acceptable to the AHJ shall be permitted to be conducted to determine the level of protection to be provided, including, but not limited to, protection measures addressed in Section 8.3.

##### **8.3.2 Design for Dust Containment.**

**8.3.2.1** All components of enclosed systems that handle combustible particulate solids shall be designed to prevent the escape of dust, except for openings intended for intake and discharge of air and material.

**8.3.2.2** Where the equipment cannot be designed for dust containment, dust collection shall be provided. (*See also 8.3.3.*)

##### **8.3.3\* Pneumatic Conveying, Dust Collection, and Centralized Vacuum Cleaning Systems.**

###### **8.3.3.1 General Requirements.**

**8.3.3.1.1\*** Where used to handle combustible particulate solids, systems shall be designed by and installed under the supervision of qualified persons who are knowledgeable about these systems and their associated hazards.



**8.3.3.1.2\*** Where it is necessary to make changes to an existing system, all changes shall be managed in accordance with the management of change requirements in Section 9.9.

**8.3.3.1.3\*** The system shall be designed and maintained to ensure that the air-gas velocity used shall meet or exceed the minimum required to keep the interior surfaces of all piping or ducting free of accumulations under all normal operating modes.

#### **8.3.3.1.4\* Operations.**

**8.3.3.1.4.1 Sequence of Operation.** Pneumatic conveying, dust collection, and centralized vacuum cleaning systems shall be designed with the operating logic, sequencing, and timing outlined in 8.3.3.1.4.2 and 8.3.3.1.4.3.

**8.3.3.1.4.2\* Startup.** Pneumatic conveying, dust collection, and centralized vacuum cleaning systems shall be designed such that, on startup, the system achieves and maintains design air velocity prior to the admission of material to the system.

#### **8.3.3.1.4.3 Shutdown.**

(A) Pneumatic conveying, dust collection, and centralized vacuum cleaning systems shall be designed such that on normal shutdown of the process the system maintains design air velocity until material is purged from the system.

(B) The requirements of 8.3.3.1.4.3(A) shall not apply during emergency shutdown of the process, such as by activation of an emergency stop button or by activation of an automatic safety interlocking device.

(C) Pneumatic conveying systems shall be designed such that on restart after an emergency shutdown residual materials can be cleared and design air velocity can be achieved.

#### **8.3.3.2\* Specific Requirements for Pneumatic Conveying Systems.**

**8.3.3.2.1\*** The design of the pneumatic conveying system shall address required performance parameters and properties of the materials being conveyed.

**8.3.3.2.2\*** Where a pneumatic conveying system or any part of such a system operates as a positive-pressure-type system and the air-moving device's gauge discharge pressure is 15 psi (103 kPa) or greater, the system shall be designed in accordance with Section VIII of the ASME *Boiler and Pressure Vessel Code*, or ASME B31.3, *Process Piping*, or international equivalents.

**8.3.3.2.3\*** Pneumatic conveying systems conveying combustible particulate solids and posing an explosion hazard shall be protected in accordance with Section 8.9.

#### **8.3.3.3\* Specific Requirements for Dust Collection Systems.**

**8.3.3.3.1\*** At each collection point, the system shall be designed to achieve the minimum velocity required for capture, control, and containment of the dust source.

**8.3.3.3.2\*** The hood or pickup point for each dust source shall have a documented minimum air volume flow based upon the system design.

**8.3.3.3.3\*** Branch lines shall not be disconnected, and unused portions of the system shall not be blanked off without providing a means to maintain required and balanced airflow.

**8.3.3.3.4\*** The addition of branch lines shall not be made to an existing system without first confirming that the entire system will maintain the required and balanced airflow.

**8.3.3.3.5\*** Dust collection systems that remove material from operations that generate flames, sparks, or hot material under normal operating conditions shall not be interconnected with dust collection systems that transport combustible particulate solids or hybrid mixtures. (See 8.9.4.)

**8.3.3.3.6\*** The air-material separator (AMS) selected for the system shall be designed to allow for the characteristics of the combustible dust being separated from the air or gas flow.

**8.3.3.3.7\*** Air-moving devices (AMDs) shall be of appropriate type and sufficient capacity to maintain the required rate of air flow in all parts of the system.

**8.3.3.3.8\*** Control equipment controlling the operation of the AMS shall be installed in a location that is safe from the effects of a deflagration in the AMS.

#### **8.3.3.4\* Specific Requirements for Centralized Vacuum Cleaning Systems.**

**8.3.3.4.1\*** The system shall be designed to assure minimum conveying velocities at all times whether the system is used with a single or multiple simultaneous operators.

**8.3.3.4.2\*** The hose length and diameter shall be sized for the application and operation.

**8.3.3.4.3\*** Where ignition-sensitive materials are collected, vacuum tools shall be constructed of metal or static dissipative materials and provide proper grounding to the hose.

**8.3.3.4.4\*** Vacuum cleaning hose shall be static dissipative or conductive and grounded.

#### **8.3.4 AMS Locations.**

##### **8.3.4.1 AMS Indoor Locations.**

###### **8.3.4.1.1\* Dry AMS.**

**8.3.4.1.1.1** If the dirty side volume of the air-material separator is greater than 8 ft<sup>3</sup> (0.2 m<sup>3</sup>), it shall be protected in accordance with Section 8.9.

**8.3.4.1.1.2** Enclosureless AMS shall not be permitted to be located indoors unless specifically allowed by an industry- or commodity-specific NFPA standard.

###### **8.3.4.1.2 Wet AMS.**

**8.3.4.1.2.1** Wet air-material separators shall be permitted to be located inside when all of the following criteria are met:

- (1) Interlocks are provided to shutdown the system if the flow rate of the scrubbing medium is less than the designed minimum flow rate.
- (2) The scrubbing medium is not a flammable or combustible liquid.
- (3) The separator is designed to prevent the formation of a combustible dust cloud within the air-material separator.
- (4) The design of the separator addresses any reaction between the separated material and the scrubbing medium.

##### **8.3.4.2 AMS Outdoor Locations. (Reserved)**

#### **8.3.5 AMS Clean Air Exhaust.**

**8.3.5.1** Exhaust air from the final AMS shall be discharged outside of buildings to a restricted area separated from clean air intakes for the building.



**8.3.5.2\*** Air from AMSs shall be permitted to be recirculated directly back to the pneumatic conveying system.

**8.3.5.3\*** Recycling of AMS exhaust to buildings or building compartments shall be permitted when all the following conditions are met:

- (1) Combustible or flammable gases or vapors are not present in either the intake or the recycled air in concentrations above applicable industrial hygiene exposure limits or 1 percent of the lower flammable limit (LFL), whichever is lower.
- (2)\*Combustible particulate solids are not present in the recycled air in concentrations above applicable industrial hygiene exposure limits or 1 percent of the minimum explosive concentration (MEC), whichever is lower.
- (3)\*The oxygen concentration of the recycled air stream is between 19.5 percent and 23.5 percent by volume.
- (4) Provisions are incorporated to prevent transmission of flame and pressure effects from a deflagration in an AMS back to the facility unless a DHA indicates that those effects do not pose a threat to the facility or the occupants.
- (5) Provisions are incorporated to prevent transmission of smoke and flame from a fire in an AMS back to the facility unless a DHA indicates that those effects do not pose a threat to the facility or the occupants.
- (6) The system includes a method for detecting AMS malfunctions that would reduce collection efficiency and allow increases in the amount of combustible particulate solids returned to the building.
- (7) The building or building compartment to which the recycled air is returned meets the requirements of Section 8.4.
- (8) Recycled-air ducts are inspected and cleaned at least annually.

### **8.3.6 Transfer Points. (Reserved)**

## **8.4 Housekeeping.**

**8.4.1 General.** Unless otherwise specified, the requirements of Section 8.4 shall be applied retroactively.

### **8.4.2\* Methodology.**

#### **8.4.2.1 Procedure.**

**8.4.2.1.1\*** Housekeeping procedures shall be documented.

**8.4.2.1.2\*** The methods used for cleaning surfaces shall be selected on the basis of reducing the potential for creating a combustible dust cloud.

**8.4.2.1.3** Cleaning methods to be used shall be based on the characteristics of the material and quantity of material present.

#### **8.4.2.2 Vacuum Cleaning Method.**

**8.4.2.2.1\*** Portable vacuum cleaners that meet the following minimum requirements shall be permitted to be used to collect combustible particulate solids in unclassified (nonhazardous) areas:

- (1) Materials of construction shall comply with 8.5.7.1.
- (2) Hoses shall be conductive or static dissipative.
- (3) All conductive components, including wands and attachments, shall be bonded and grounded.
- (4) Dust-laden air shall not pass through the fan or blower.
- (5) Electrical motors shall not be in the dust-laden air stream unless listed for Class II, Division 1, locations.

- (6)\*Where liquids or wet materials are picked up by the vacuum cleaner, paper filter elements shall not be used.
- (7) Vacuum cleaners used for metal dusts shall meet the requirements of NFPA 484.

**8.4.2.2.2\*** In Class II electrically classified (hazardous) locations, electrically powered vacuum cleaners shall be listed for the purpose and location or shall be a fixed-pipe suction system with a remotely located exhaustor and an AMS installed in conformance with Section 8.3, and they shall be suitable for the dust being collected.

**8.4.2.2.3** Where flammable vapors or gases are present, vacuum cleaners shall be listed for Class I and Class II hazardous locations.

**8.4.2.3\* Sweeping, Shoveling, Scoop, and Brush Cleaning Method.** The use of scoops, brooms, and brushes for sweeping and shoveling shall be a permitted cleaning method.

#### **8.4.2.4\* Water Washdown Cleaning Method.**

**8.4.2.4.1** The use of water washdown shall be a permitted cleaning method.

**8.4.2.4.2** Where the combustible dust being removed is metal or metal-containing dust or powder within the scope of NFPA 484 the requirements of NFPA 484 shall be followed.

**8.4.2.4.3\*** Where the combustible dust being removed is a water-reactive material, additional precautions shall be taken to control the associated hazards.

#### **8.4.2.5 Water Foam Washdown Systems. (Reserved)**

#### **8.4.2.6 Compressed Air Blowdown Method.**

**8.4.2.6.1\*** Blowdowns using compressed air shall be permitted to be used as a cleaning method in accordance with the provisions of 8.4.2.6.2.

**8.4.2.6.2\*** Where blowdown using compressed air is used, the following precautions shall be followed:

- (1) Prior to using compressed air, vacuum cleaning, sweeping, or water washdown methods are used to clean surfaces that can be safely accessed.
- (2) Dust accumulations in the area after vacuum cleaning, sweeping, or water washdown do not exceed the threshold housekeeping dust accumulation.
- (3) Compressed air hoses are equipped with pressure relief nozzles limiting the discharge pressure to 30 psi (207 kPa) in accordance with OSHA requirements in 29 CFR 1910.242(b).
- (4) All electrical equipment, including lighting, potentially exposed to airborne dust in the area during cleaning is suitable for use in a Class II, Division 2, hazardous (classified) location in accordance with *NFPA 70*.
- (5) All ignition sources and hot surfaces capable of igniting a dust cloud or dust layer are shut down or removed from the area.
- (6) After blowdown is complete, residual dust on lower surfaces is cleaned prior to re-introduction of potential ignition sources.
- (7) Where metal or metal-containing dust or powder under the scope of NFPA 484 is present, the requirements of NFPA 484 apply.

#### **8.4.2.7 Steam Blow Down Method. (Reserved)**

**8.4.3 Training.** Employee and contractor training shall include housekeeping procedures, required personal protective

equipment (PPE) during housekeeping, and proper use of equipment.

#### 8.4.4 Equipment. (Reserved)

#### 8.4.5 Vacuum Trucks.

8.4.5.1 Vacuum trucks shall be grounded and bonded.

8.4.5.2 Vacuum truck hoses and couplings shall be static dissipative or conductive and grounded.

#### 8.4.6 Frequency and Goal.

8.4.6.1\* Housekeeping frequency and accumulation goals shall be established to ensure that the accumulated fugitive dust levels on surfaces do not exceed the threshold housekeeping dust accumulation limits.

8.4.6.2 The threshold housekeeping dust accumulation limits shall be in accordance with the industry- or commodity-specific NFPA standard. (*See 1.3.1.*)

8.4.6.3\* Provisions for unscheduled housekeeping shall include specific requirements establishing time to clean local dust spills or transient releases.

#### 8.4.7 Auditing and Documentation.

8.4.7.1\* Housekeeping effectiveness shall be assessed based on the results of routine scheduled cleaning and inspection, not including transient releases.

8.4.7.2 The owner/operator shall retain documentation that routine scheduled cleaning occurs in accordance with the frequency and accumulation goals established in 8.4.6.1.

### 8.5 Ignition Source Control.

8.5.1\* **General.** Unless otherwise specified, the requirements of Section 8.5 shall be applied retroactively.

8.5.2\* **Risk Assessment.** A documented risk assessment acceptable to the authority having jurisdiction shall be permitted to be conducted to determine the level of ignition source control to be provided including, but not limited to, the controls addressed in Section 8.5.

#### 8.5.3 Hot Work.

8.5.3.1\* All hot work activities shall comply with the requirements of NFPA 51B.

8.5.3.2\* The area affected by hot work shall be thoroughly cleaned of combustible dust prior to commencing any hot work.

8.5.3.3 Equipment that contains combustible dust and is located within the hot work area shall be shut down, shielded, or both.

8.5.3.4 When the hot work poses an ignition risk to the combustible dust within equipment, the equipment shall be shut down and cleaned prior to commencing such hot work.

8.5.3.5 Floor and wall openings within the hot work area shall be covered or sealed.

#### 8.5.3.6 Portable Electrical Equipment. (Reserved)

#### 8.5.4 Hot Surfaces.

8.5.4.1 This section shall not be required to be applied retroactively.

8.5.4.2\* Heated external surfaces of process equipment and piping in dust deflagration hazard areas shall be maintained at

a temperature at least 112°F (50°C) below the dust layer and dust cloud ignition temperatures measured in a standardized test acceptable to the AHJ.

#### 8.5.5 Bearings.

8.5.5.1 This section shall not be required to be applied retroactively.

8.5.5.2\* Bearings that are directly exposed to a combustible dust atmosphere or that are subject to dust accumulation, either of which poses a deflagration hazard, shall be monitored for overheating.

8.5.5.3 The owner/operator shall establish frequencies for monitoring bearings in 8.5.5.2.

8.5.5.4\* It shall be permitted to eliminate bearing monitoring based on a risk assessment acceptable to the AHJ.

#### 8.5.6 Electrical Equipment and Wiring.

8.5.6.1\* The identification of the possible presence and extent of Class II and Class III locations shall be made based on the criteria in NFPA 70 Article 500.5(C) and (D).

8.5.6.1.1\* The locations and extent of Class II and Class III areas shall be documented, and such documentation shall be preserved for access at the facility.

8.5.6.2 Electrical equipment and wiring within Class II locations shall comply with NFPA 70 Article 502.

8.5.6.3 Electrical equipment and wiring within Class III locations shall comply with NFPA 70 Article 503.

8.5.6.4\* Preventive maintenance programs for electrical equipment and wiring in Class II and Class III locations shall include provisions to verify that dusttight electrical enclosures are not experiencing significant dust ingress.

8.5.6.5\* Zone classification for dusts in accordance with Article 506 of NFPA 70 shall not be permitted.

#### 8.5.7 Electrostatic Discharges.

##### 8.5.7.1 Conductive Equipment.

8.5.7.1.1\* Particulate handling equipment shall be conductive unless the provisions of 8.5.7.1.2 are applicable.

8.5.7.1.2 Nonconductive system components shall be permitted where all of the following conditions are met:

- (1) Hybrid mixtures are not present.
- (2) Conductive dusts are not handled.
- (3)\*The MIE of the material being handled is greater than 3 mJ determined without inductance.
- (4) The nonconductive components do not result in isolation of conductive components from ground.
- (5)\*The breakdown strength across nonconductive sheets, coatings, or membranes does not exceed 4 kV when used in high surface charging processes.

8.5.7.1.3\* Bonding and grounding with a resistance of less than  $1.0 \times 10^6$  ohms to ground shall be provided for conductive components.

##### 8.5.7.1.4 Flexible Connectors.

8.5.7.1.4.1 This section shall not be required to be applied retroactively.

8.5.7.1.4.2 Flexible connectors longer than 6.6 ft (2 m) shall have an end-to-end resistance of less than  $1.0 \times 10^8$  ohms to



ground even where an internal or external bonding wire connects the equipment to which the flexible connector is attached.

**8.5.7.1.4.3\*** Where flammable vapors are not present, flexible connectors with a resistance equal to or greater than  $1.0 \times 10^8$  ohms shall be permitted under either of the following conditions:

- (1) The dust has an MIE greater than 2000 mJ.
- (2) The maximum powder transfer velocity is less than 2000 fpm (10 m/s).

#### **8.5.7.2 Maximum Particulate Transport Rates.**

**8.5.7.2.1\*** The maximum particulate transport rates in 8.5.7.2.3 shall apply when the volume of the vessel being filled is greater than  $35 \text{ ft}^3$  ( $1 \text{ m}^3$ ), and a single feed stream to the vessel meets both of the following conditions:

- (1)\*The suspendable fraction of the transported material has an MIE of less than or equal to 20 mJ.
- (2)\*The transported material has an electrical volume resistivity greater than  $1.0 \times 10^{10}$  ohm-m.

**8.5.7.2.2\*** The maximum particulate transport rate in 8.5.7.2.3 shall apply when the volume of the vessel being filled is greater than  $35 \text{ ft}^3$  ( $1 \text{ m}^3$ ) and either of the following conditions is met:

- (1)\*The transported material having an electrical volume resistivity greater than  $1.0 \times 10^{10}$  ohm-m is loaded into a vessel containing a powder or dust having an MIE less than or equal to 20 mJ.
- (2)\*The transported material having an electrical volume resistivity greater than  $1.0 \times 10^{10}$  ohm-m is loaded into a vessel containing a powder or dust having an MIE less than or equal to 20 mJ, followed by a powder or dust having an MIE less than or equal to 20 mJ.

**8.5.7.2.3\*** Where the conditions of 8.5.7.2.1 or 8.5.7.2.2 are met, the maximum permitted material transport rate of particles shall be limited by the following:

- (1) 3.1 lb/s (1.4 kg/s) for particulates larger than 0.08 in. (2 mm).
- (2) 12.3 lb/s (5.6 kg/s) for particulates between 0.016 in. (0.4 mm) and 0.08 in. (2 mm) in size.
- (3) 18.3 lb/s (8.3 kg/s) for particulates smaller than 0.016 in. (0.4 mm).

#### **8.5.7.3\* Grounding of Personnel.**

**8.5.7.3.1\*** Where an explosive atmosphere exists and is subject to ignition from an electrostatic discharge from ungrounded personnel, personnel involved in manually filling or emptying particulate containers or vessels shall be grounded during such operations.

**8.5.7.3.2** Personnel grounding shall not be required where both of the following conditions are met:

- (1) Flammable gases, vapors, and hybrid mixtures are not present.
- (2)\*The minimum ignition energy of the dust cloud is greater than 30 mJ.

**8.5.7.4\* Flexible Intermediate Bulk Containers (FIBCs).** FIBCs shall be permitted to be used for the handling and storage of combustible particulate solids in accordance with the requirements in 8.5.7.4.1 through 8.5.7.4.7.

**8.5.7.4.1\*** Electrostatic ignition hazards associated with the particulate and objects surrounding or inside the FIBC shall be included in the DHA required in Chapter 7.

**8.5.7.4.2** Type A FIBCs shall be limited to use with noncombustible particulate solids or combustible particulate solids having an MIE greater than 1000 mJ.

**8.5.7.4.2.1** Type A FIBCs shall not be used in locations where flammable vapors are present.

**8.5.7.4.2.2\*** Type A FIBCs shall not be used with conductive dusts.

**8.5.7.4.3** Type B FIBCs shall be permitted to be used where combustible dusts having an MIE greater than 3 mJ are present.

**8.5.7.4.3.1** Type B FIBCs shall not be used in locations where flammable vapors are present.

**8.5.7.4.3.2\*** Type B FIBCs shall not be used for conductive dusts.

**8.5.7.4.4** Type C FIBCs shall be permitted to be used with combustible particulate solids and in locations where flammable vapors having an MIE greater than 0.14 mJ are present.

**8.5.7.4.4.1** Conductive FIBC elements shall terminate in a grounding tab, and resistance from these elements to the tab shall be or less than  $10^8$  ohms.

**8.5.7.4.4.2** Type C FIBCs shall be grounded during filling and emptying operations with a resistance to ground of less than 25 ohms.

**8.5.7.4.4.3** Type C FIBCs shall be permitted to be used for conductive dusts.

**8.5.7.4.5** Type D FIBCs shall be permitted to be used with combustible particulate solids and in locations where flammable vapor atmospheres having an MIE greater than 0.14 mJ are present.

**8.5.7.4.5.1** Type D FIBCs shall not be permitted to be used for conductive dusts.

**8.5.7.4.6\*** Type B, Type C, and Type D FIBCs shall be tested and verified as safe for their intended use by a recognized testing organization in accordance with the requirements and test procedures specified in IEC 61340-4-4, *Electrostatics—Part 4-4: Standard Test Methods for Specific Applications — Electrostatic Classification of Flexible Intermediate Bulk Containers*, before being used in hazardous environments.

**8.5.7.4.6.1** Intended use shall include both the product being handled and the environment in which the FIBC will be used.

**8.5.7.4.6.2** Materials used to construct inner baffles, other than mesh or net baffles, shall meet the requirements for the bag type in which they are to be used.

**8.5.7.4.6.3** Documentation of test results shall be made available to the AHJ.

**8.5.7.4.6.4** FIBCs that have not been tested and verified for type in accordance with IEC 61340-4-4, *Electrostatics—Part 4-4: Standard Test Methods for Specific Applications — Electrostatic Classification of Flexible Intermediate Bulk Containers*, shall be not be used for combustible dusts or in flammable vapor atmospheres.



**8.5.7.4.7\*** Deviations from the requirements in 8.5.7.4.1 through 8.5.7.4.6 for safe use of FIBCs shall be permitted based on a documented risk assessment acceptable to the AHJ.

#### **8.5.7.5 Rigid Intermediate Bulk Containers (RIBCs).**

**8.5.7.5.1\*** Conductive RIBCs shall be permitted to be used for dispensing into any flammable vapor, gas, dust, or hybrid atmospheres provided that the RIBCs are electrically grounded.

**8.5.7.5.2\*** Nonconductive RIBCs shall not be permitted to be used for applications, processes, or operations involving combustible particulate solids or where flammable vapors or gases are present unless a documented risk assessment assessing the electrostatic hazards is acceptable to the AHJ.

#### **8.5.8 Open Flames and Fuel-Fired Equipment.**

**8.5.8.1\*** Production, maintenance, or repair activities that can release or lift combustible dust shall not be conducted within 35 ft (11 m) of an open flame or pilot flame.

**8.5.8.2** Fuel-fired space heaters drawing local ambient air shall not be located within a Class II hazardous (classified) area.

**8.5.8.3** Fuel-fired process equipment shall be operated and maintained in accordance with the pertinent NFPA standard for the equipment, including the following standards:

- (1) NFPA 31, *Standard for the Installation of Oil-Burning Equipment*
- (2) NFPA 54, *National Fuel Gas Code*
- (3) NFPA 85, *Boiler and Combustion Systems Hazards Code*
- (4) NFPA 86, *Standard for Ovens and Furnaces*

**8.5.8.4** Inspections and preventive maintenance for fuel fired process equipment shall include verification that there are no significant combustible dust accumulations within or around the equipment.

**8.5.8.5** Unless the equipment is operated within the limits of 8.5.4.2, provisions shall be made to prevent the accumulation of combustible dust on heated surfaces of heating units.

**8.5.8.6** In facility locations where airborne dust or dust accumulations on horizontal surfaces are apt to occur, heating units shall be provided with a source of combustion air ducted directly from the building exterior or from an unclassified location.

#### **8.5.9 Industrial Trucks.**

**8.5.9.1** Industrial trucks shall be listed or approved for the electrical classification of the area, as determined by 8.5.6, and shall be used in accordance with NFPA 505.

**8.5.9.2\*** Where industrial trucks, in accordance with NFPA 505 are not commercially available, a documented risk assessment shall be permitted to be used to specify the fire and explosion prevention features for the equipment being used.

#### **8.5.10 Process Air and Media Temperatures.**

**8.5.10.1\*** Heated process equipment containing combustible dust shall have operating controls arranged to maintain the temperature of equipment interiors within the prescribed limits.

#### **8.5.11 Self-Heating.**

**8.5.11.1\*** Material in silos and other large storage piles of particulates prone to self-heating shall be managed to control self-heating or have self-heating detection provisions.

**8.5.11.2** Where a self-heating hazard is identified, provisions shall be in place for managing the consequences of self-heating in storage silos or bins.

#### **8.5.12 Friction and Impact Sparks.**

**8.5.12.1** Means shall be provided to prevent foreign material from entering the system when such foreign material presents an ignition hazard.

**8.5.12.2\*** Foreign materials, such as tramp metal, that are capable of igniting combustible material being processed shall be removed from the process stream.

**8.5.12.3** Tramp materials that present an ignition potential shall be permitted to be in the material inlet stream if the equipment is provided with explosion protection.

**8.5.12.4\*** Clearances and alignment of high-speed moving parts in equipment that is processing combustible particulates shall be checked at intervals established by the owner/operator based on wear experience unless the equipment is equipped with vibration monitors and alarms or routine manual monitoring is performed.

**8.5.12.5** The alignment and clearance of buckets in elevators that are transporting combustible particulates shall be checked at intervals established by the owner/operator based on facility wear experience unless the elevators are equipped with belt alignment monitoring devices.

#### **8.6 Personal Protective Equipment.**

##### **8.6.1 Workplace Hazard Assessment.**

**8.6.1.1\*** An assessment of workplace hazards shall be conducted as described in NFPA 2113.

**8.6.1.2** When the assessment in 8.6.1.1 has determined that flame-resistant garments are needed, personnel shall be provided with and wear flame-resistant garments.

**8.6.1.3\*** When flame-resistant clothing is required for protecting personnel from flash fires, it shall comply with the requirements of NFPA 2112.

**8.6.1.4\*** Consideration shall be given to the following:

- (1) Thermal protective characteristics of the fabric over a range of thermal exposures
- (2) Physical characteristics of the fabric
- (3) Garment construction and components
- (4) Avoidance of static charge buildup
- (5) Design of garment
- (6) Conditions under which garment will be worn
- (7) Garment fit
- (8) Garment durability/wear life
- (9) Recommended laundering procedures
- (10) Conditions/features affecting wearer comfort

**8.6.1.5** Flame-resistant garments shall be selected, procured, inspected, worn, and maintained in accordance with NFPA 2113.

**8.6.1.6\*** The employer shall implement a policy regarding care, cleaning, and maintenance for flame-resistant garments.

##### **8.6.2 Limitations of PPE Application. (Flame-Resistant Garments)**

**8.6.2.1\*** When required by 8.6.1.2, flame-resistant or non-melting undergarments shall be used.



**8.6.2.2\*** When determined by 8.6.1.1 that flame-resistant garments are needed, only flame-resistant outerwear shall be worn over flame-resistant daily wear.

### **8.6.3 Limitations of PPE to Combustible Dust Flash Fires. (Reserved)**

### **8.6.4 Face, Hands, and Footwear Protection. (Reserved)**

### **8.7 Pyrophoric Dusts. (Reserved)**

### **8.8 Dust Control.**

**8.8.1\*** Continuous suction or some other means to control fugitive dust emissions shall be provided for processes where combustible dust is liberated in normal operation.

**8.8.1.1** Where continuous suction is used, the dust shall be conveyed to air-material separators designed in accordance with 8.3.2.

### **8.8.2\* Liquid Dust Suppression Methods for Dust Control.**

**8.8.2.1** Where liquid dust suppression is used to prevent the accumulation of dust or to reduce its airborne concentration, the liquid dust suppressant shall not result in adverse reaction with the combustible dust.

**8.8.2.2** Where liquid dust suppression is used, controls and monitoring equipment shall be provided to ensure the liquid dust suppression system is functioning properly.

### **8.8.3 Fans to Limit Accumulation. (Reserved)**

### **8.9 Explosion Prevention/Protection.**

**8.9.1 General.** Where a dust explosion hazard exists within an enclosure, measures shall be taken as specified in Section 8.9 to protect personnel from the consequences of a deflagration in that enclosure.

**8.9.2 Risk Assessment.** A documented risk assessment acceptable to the AHJ shall be permitted to be conducted to determine the level of protection to be provided, including, but not limited to, the measures addressed in Section 8.9.

### **8.9.3 Equipment Protection.**

**8.9.3.1\* General.** Where an explosion hazard exists within any operating equipment greater than 8 ft<sup>3</sup> (0.23 m) of containing volume, the equipment shall be protected from the effects of a deflagration.

**8.9.3.2** Explosion protection systems shall incorporate one or more of the following methods of protection:

- (1) Oxidant concentration reduction in accordance with NFPA 69
- (2) Deflagration venting in accordance with NFPA 68
- (3) Deflagration venting through listed flame-arresting devices in accordance with NFPA 68
- (4) Deflagration pressure containment in accordance with NFPA 69
- (5) Deflagration suppression system in accordance with NFPA 69
- (6) Dilution with a noncombustible dust to render the mixture noncombustible

**8.9.3.3** Enclosures and all interconnections protected in accordance with 8.9.3.2 shall be designed to withstand the resultant pressures produced during the deflagration event.

### **8.9.4 Equipment Isolation.**

**8.9.4.1\*** Where a dust explosion hazard exists, isolation devices shall be provided to prevent deflagration propagation between connected equipment in accordance with NFPA 69.

**8.9.4.2** The requirement of 8.9.4.1 shall not apply where all the following conditions are met:

- (1) The material being conveyed is not a metal dust or hybrid mixture.
- (2) The connecting ductwork is smaller than 4 in. (100 mm) nominal diameter.
- (3) The maximum concentration of dust conveyed through the duct is less than 25 percent of the MEC of the material.
- (4) The conveying velocity is sufficient to prevent accumulation of combustible dust in the duct.
- (5) All connected equipment is properly designed for explosion protection by means other than deflagration pressure containment.

**8.9.4.3** Isolation devices shall not be required where oxidant concentration has been reduced or where the dust has been rendered noncombustible in accordance with 8.9.3.2(1) or 8.9.3.2(6).

**8.9.4.4 Isolation of Upstream Work Areas.** Where a dust explosion hazard exists, isolation devices shall be provided to prevent deflagration propagation from equipment through upstream ductwork to the work areas in accordance with NFPA 69.

### **8.10 Fire Protection.**

#### **8.10.1 General.**

**8.10.1.1** Where a fire hazard exists in an enclosure as determined in Chapter 7, manual or automatic fire protection means shall be provided in accordance with Section 8.10.

**8.10.1.2\*** Automatic fire protection systems shall be provided when at least one of the following conditions exists:

- (1)\*Manual fire fighting poses an unacceptable risk to facility personnel and emergency responders.
- (2)\*Manual fire fighting is not expected to be effective for a fire hazard assessed in accordance with Chapter 7.
- (3) Automatic fire protection systems are required by the local building code adopted by the AHJ.

**8.10.2 System Requirements.** Fire protection systems where provided shall comply with 8.10.2.1 through 8.10.2.4.

**8.10.2.1\*** Fire-extinguishing agents shall be compatible with the conveyed, handled, and stored materials.

**8.10.2.2** Where fire detection systems are incorporated into pneumatic conveying, centralized vacuum, or dust collection systems, the DHA shall identify safe interlocking requirements for air-moving devices and process operations.

**8.10.2.3** Where fire-fighting water or wet product can accumulate in the system, the vessel, pipe supports, and drains shall be designed in accordance with NFPA 91.

**8.10.2.4\*** Extinguishing agents shall be applied to the combustible particulate fire at a sufficiently low momentum to avoid generating a suspended dust cloud.

#### **8.10.3 Fire Extinguishers.**

**8.10.3.1** Portable fire extinguishers shall be provided throughout all buildings in accordance with the requirements of NFPA 10.

**8.10.3.2\*** Personnel designated to use portable fire extinguishers shall be trained to use them in a manner that minimizes the generation of dust clouds during discharge.

#### **8.10.4 Hose, Standpipes, Hydrants, and Water Supply.**

**8.10.4.1** Standpipes and hose, where provided, shall comply with NFPA 14.

##### **8.10.4.2 Nozzles.**

**8.10.4.2.1\*** Portable spray hose nozzles that are listed or approved for use on Class C fires shall be provided in areas that contain dust, to limit the potential for generating unnecessary airborne dust during fire-fighting operations.

**8.10.4.2.2\*** Straight-stream nozzles and combination nozzles on the straight-stream setting shall not be used on fires in areas where dust clouds can be generated.

**8.10.4.2.3** It shall be permitted to use straight stream nozzles or combination nozzles to reach fires in locations that are otherwise inaccessible with nozzles specified in 8.10.4.2.1.

##### **8.10.4.3 Water Supply.**

**8.10.4.3.1** Private hydrants and underground mains, where provided, shall comply with NFPA 24.

**8.10.4.3.2** Fire pumps, where provided, shall comply with NFPA 20.

**8.10.4.3.3** Fire protection water tanks, where provided, shall comply with NFPA 22.

#### **8.10.5 Automatic Sprinklers.**

**8.10.5.1\*** Where a process that handles combustible particulate solids uses flammable or combustible liquids, a documented risk assessment that is acceptable to the AHJ shall be used to determine the need for automatic sprinkler protection in the enclosure in which the process is located.

**8.10.5.2\*** Automatic sprinkler protection shall not be permitted in areas where combustible metals are produced or handled unless permitted by NFPA 484.

**8.10.5.3** Automatic sprinklers, where provided, shall be installed in accordance with NFPA 13.

**8.10.5.4** Where automatic sprinklers are installed, dust accumulation on overhead surfaces shall be minimized to prevent an excessive number of sprinkler heads from opening in the event of a fire.

**8.10.6 Spark/Ember Detection and Extinguishing Systems.** Where provided, spark/ember detection and extinguishing systems shall be designed, installed, and maintained in accordance with NFPA 15, NFPA 69, and NFPA 72.

#### **8.10.7 Special Fire Protection Systems.**

**8.10.7.1** Automatic extinguishing systems or special hazard extinguishing systems, where provided, shall be designed, installed, and maintained in accordance with the following standards, as applicable:

- (1) NFPA 11, *Standard for Low-, Medium-, and High-Expansion Foam*
- (2) NFPA 12, *Standard on Carbon Dioxide Extinguishing Systems*
- (3) NFPA 12A, *Standard on Halon 1301 Fire Extinguishing Systems*
- (4) NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*

- (5) NFPA 16, *Standard for the Installation of Foam-Water Sprinkler and Foam-Water Spray Systems*
- (6) NFPA 17, *Standard for Dry Chemical Extinguishing Systems*
- (7) NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*
- (8) NFPA 750, *Standard on Water Mist Fire Protection Systems*
- (9) NFPA 2001, *Standard on Clean Agent Fire Extinguishing Systems*

**8.10.7.2** The extinguishing systems shall be designed and used in a manner that minimizes the generation of dust clouds during their discharge.

## **Chapter 9 Management Systems**

**9.1 Retroactivity.** This chapter shall apply to new and existing facilities and processes.

**9.2\* General.** The procedures and training in this chapter shall be delivered in a language that the participants can understand.

### **9.3 Operating Procedures and Practices.**

**9.3.1\*** The owner/operator shall establish written procedures for operating its facility and equipment to prevent or mitigate fires, deflagrations, and explosions from combustible particulate solids.

**9.3.2\*** The owner/operator shall establish safe work practices to address hazards associated with maintenance and servicing operations.

**9.3.2.1** The safe work practices shall apply to employees and contractors.

### **9.4 Inspection, Testing, and Maintenance.**

**9.4.1\*** Equipment affecting the prevention, control, and mitigation of combustible dust fires, deflagrations, and explosions shall be inspected and tested in accordance with the applicable NFPA standard and the manufacturers' recommendations.

**9.4.2** The inspection, testing, and maintenance program shall include the following:

- (1) Fire and explosion protection and prevention equipment in accordance with the applicable NFPA standards
- (2) Dust control equipment
- (3) Housekeeping
- (4) Potential ignition sources
- (5)\*Electrical, process, and mechanical equipment, including process interlocks
- (6) Process changes
- (7) Lubrication of bearings

**9.4.3** The owner/operator shall establish procedures and schedules for maintaining safe operating conditions for its facility and equipment in regard to the prevention, control, and mitigation of combustible dust fires and explosions.

**9.4.4\*** Where equipment deficiencies that affect the prevention, control, and mitigation of dust fires, deflagrations, and explosions are identified or become known, the owner/operator shall establish and implement a corrective action plan with an explicit deadline.



**9.4.5\*** Inspections and testing activities that affect the prevention, control, and mitigation of dust fires, deflagrations, and explosions shall be documented.

**9.4.6** A thorough inspection of the operating area shall take place on an as-needed basis to help ensure that the equipment is in safe operating condition and that proper work practices are being followed.

#### **9.5 Training and Hazard Awareness.**

**9.5.1\*** Employees, contractors, temporary workers, and visitors shall be included in a training program according to the potential exposure to combustible dust hazards and the potential risks to which they might be exposed or could cause.

**9.5.2\*** General safety training and hazard awareness training for combustible dusts and solids shall be provided to all affected employees.

**9.5.2.1\*** Job-specific training shall ensure that employees are knowledgeable about fire and explosion hazards of combustible dusts and particulate solids in their work environment.

**9.5.2.2** Employees shall be trained before taking responsibility for a task.

**9.5.2.3\*** Where explosion protection systems are installed, training of affected personnel shall include the operations and potential hazards presented by such systems.

**9.5.3** Refresher training shall be provided as required by the AHJ and as required by other relevant industry- or commodity-specific NFPA standards.

**9.5.4** The training shall be documented.

#### **9.6 Contractors.**

**9.6.1** Owner/operators shall ensure the requirements of Section 9.6 are met.

**9.6.2\*** Only qualified contractors shall be employed for work involving the installation, repair, or modification of buildings (interior and exterior), machinery, and fire and explosion protection equipment that could adversely affect the prevention, control, or mitigation of fires and explosions.

#### **9.6.3\* Contractor Training.**

**9.6.3.1** Contractors operating owner/operator equipment shall be trained and qualified to operate the equipment and perform the work.

**9.6.3.2** Contractor training shall be documented.

**9.6.3.3\*** Contractors working on or near a given process shall be made aware of the potential hazards from and exposures to fires and explosions.

**9.6.3.4** Contractors shall be trained and required to comply with the facility's safe work practices and policies in accordance with 9.3.2.

**9.6.3.5** Contractors shall be trained on the facility's emergency response and evacuation plan, including, but not limited to, emergency reporting procedures, safe egress points, and evacuation area.

#### **9.7 Emergency Planning and Response.**

**9.7.1\*** A written emergency response plan shall be developed for preparing for and responding to work-related emergencies including, but not limited to, fire and explosion.

**9.7.2** The emergency response plan shall be reviewed and validated at least annually.

#### **9.8\* Incident Investigation.**

**9.8.1\*** The owner/operator shall have a system to ensure that incidents that result in a fire, deflagration, or explosion are reported and investigated in a timely manner.

**9.8.2** The investigation shall be documented and include findings and recommendations.

**9.8.3** A system shall be established to address and resolve the findings and recommendations.

**9.8.4\*** The investigation findings and recommendations shall be reviewed with affected personnel.

#### **9.9 Management of Change.**

**9.9.1\*** Written procedures shall be established and implemented to manage proposed changes to process materials, staffing, job tasks, technology, equipment, procedures, and facilities.

**9.9.2** The procedures shall ensure that the following are addressed prior to any change:

- (1)\*The basis for the proposed change
- (2)\*Safety and health implications
- (3) Whether the change is permanent or temporary, including the authorized duration of temporary changes
- (4) Modifications to operating and maintenance procedures
- (5) Employee training requirements
- (6) Authorization requirements for the proposed change
- (7) Results of characterization tests used to assess the hazard, if conducted

**9.9.3\*** Implementation of the management of change procedure shall not be required for replacements-in-kind.

**9.9.4** Design and procedures documentation shall be updated to incorporate the change.

#### **9.10\* Documentation Retention.**

**9.10.1** The owner/operator shall establish a program and implement a process to manage the retention of documentation, including, but not limited to, the following:

- (1) Training records
- (2) Equipment inspection, testing, and maintenance records
- (3)\*Incident investigation reports
- (4) Dust hazards analyses
- (5)\*Process and technology information
- (6)\*Management of change documents
- (7) Emergency response plan documents
- (8)\*Contractor records

#### **9.11 Management Systems Review.**

**9.11.1** The owner/operator shall evaluate the effectiveness of the management systems presented in this standard by conducting a periodic review of each management system.

**9.11.2** The owner/operator shall be responsible for maintaining and evaluating the ongoing effectiveness of the management systems presented in this standard.

**9.12\* Employee Participation.** Owner/operators shall establish and implement a system to consult with and actively involve affected personnel and their representatives in the implementation of this standard.



## Annex A Explanatory Material

*Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.*

**A.1.4.1** Other industry- or commodity-specific NFPA documents that might be considered include NFPA 30B, NFPA 33, NFPA 85, NFPA 120, NFPA 495, NFPA 820, NFPA 850, and NFPA 1125.

**A.1.7.2** A given equivalent value could be approximate.

**A.3.2.1 Approved.** The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

**A.3.2.2 Authority Having Jurisdiction (AHJ).** The phrase “authority having jurisdiction,” or its acronym AHJ, is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

**A.3.2.4 Listed.** The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

**A.3.3.1 Air-Material Separator (AMS).** Examples include cyclones, bag filter houses, dust collectors, and electrostatic precipitators.

**A.3.3.2 Air-Moving Device (AMD).** An air-moving device is a fan or blower. A general description of each follows:

### (1) Fans

- (a) A range of devices that utilize an impeller, contained within a housing, that when rotated creates air/gas flow by negative (vacuum) or positive differential pressure.
- (b) These devices are commonly used to create comparatively high air/gas volume flows at relatively low differential pressures.
- (c) These devices are typically used with ventilation and/or dust collection systems.

- (d) Examples are centrifugal fans, industrial fans, mixed or axial flow fans, and inline fans.

### (2) Blowers

- (a) A range of devices that utilize various shaped rotating configurations, contained within a housing, that when rotated create air/gas flow by negative (vacuum) or positive differential pressure.
- (b) These devices are commonly used to create comparatively high differential pressures at comparatively low air/gas flows.
- (c) The most common use of these devices is with pneumatic transfer, high-velocity, low-volume (HVLV) dust collection and vacuum cleaning systems.
- (d) Examples are positive displacement (PD) blowers, screw compressors, multistage centrifugal compressors/blowers and regenerative blowers.

[654, 2013]

**A.3.3.4 Centralized Vacuum Cleaning System.** This system normally consists of multiple hose connection stations hard-piped to an AMS located out of the hazardous area. Positive displacement or centrifugal AMDs can be used to provide the negative pressure air flow. The hoses and vacuum cleaning tools utilized with the system should be designed to be conductive or static-dissipative in order to minimize any risk of generating an ignition source. Low MIE materials should be given special consideration in the system design and use. A primary and secondary AMS separator combination (e.g., cyclone and filter receiver) can be used if large quantities of materials are involved. However, most filter receivers are capable of handling the high material loadings without the use of a cyclone. [654, 2013]

**A.3.3.5 Combustible Dust.** The term *combustible dust* when used in this standard includes powders, fines, fibers, etc.

Dusts traditionally were defined as material 420 µm or smaller (capable of passing through a U.S. No. 40 standard sieve). For consistency with other standards, 500 µm (capable of passing through a U.S. No. 35 standard sieve) is now considered an appropriate size criterion. Particle surface area-to-volume ratio is a key factor in determining the rate of combustion. Combustible particulate solids with a minimum dimension more than 500 µm generally have a surface-to-volume ratio that is too small to pose a deflagration hazard. Flat platelet-shaped particles, flakes, or fibers with lengths that are large compared to their diameter usually do not pass through a 500 µm sieve, yet could still pose a deflagration hazard. Many particulates accumulate electrostatic charge in handling, causing them to attract each other, forming agglomerates. Often agglomerates behave as if they were larger particles, yet when they are dispersed they present a significant hazard. Consequently, it can be inferred that any particulate that has a minimum dimension less than or equal to 500 µm could behave as a combustible dust if suspended in air or the process specific oxidizer. If the minimum dimension of the particulate is greater than 500 µm, it is unlikely that the material would be a combustible dust, as determined by test. The determination of whether a sample of combustible material presents a flash-fire or explosion hazard could be based on a screening test methodology such as provided in the ASTM E1226, *Standard Test Method for Explosibility of Dust Clouds*. Alternatively, a standardized test method such as ASTM E1515, *Standard Test Method for Minimum Explosible Concentration of Combustible Dusts*, could be used to determine dust explosibility. [654, 2013]



There is some possibility that a sample will result in a false positive in the 20 L sphere when tested by the ASTM E1226 screening test or the ASTM E1515 test. This is due to the high energy ignition source overdriving the test. When the lowest ignition energy allowed by either method still results in a positive result, the owner/operator can elect to determine whether the sample is a combustible dust with screening tests performed in a larger scale ( $\geq 1 \text{ m}^3$ ) enclosure, which is less susceptible to overdriving and thus will provide more realistic results. [654, 2013]

This possibility for false positives has been known for quite some time and is attributed to “overdriven” conditions that exist in the 20 L chamber due to the use of strong pyrotechnic igniters. For that reason, the reference method for explosibility testing is based on a  $1 \text{ m}^3$  chamber, and the 20 L chamber test method is calibrated to produce results comparable to those from the  $1 \text{ m}^3$  chamber for most dusts. In fact, the U.S. standard for 20 L testing (ASTM E1226) states, “The objective of this test method is to develop data that can be correlated to those from the  $1 \text{ m}^3$  chamber (described in ISO 6184-1, and VDI 3673)...” ASTM E1226 further states, “Because a number of factors (concentration, uniformity of dispersion, turbulence of ignition, sample age, etc.) can affect the test results, the test vessel to be used for routine work must be standardized using dust samples whose  $K_{St}$  and  $P_{max}$  parameters are known in the  $1 \text{ m}^3$  chamber.” [654, 2013]

NFPA 68 also recognizes this problem and addresses it stating that “the 20 L test apparatus is designed to simulate results of the  $1 \text{ m}^3$  chamber; however, the igniter discharge makes it problematic to determine  $K_{St}$  values less than 50 bar-m/sec. Where the material is expected to yield  $K_{St}$  values less than 50 bar-m/sec, testing in a  $1 \text{ m}^3$  chamber might yield lower values.” [654, 2013]

Any time a combustible dust is processed or handled, a potential for deflagration exists. The degree of deflagration hazard varies, depending on the type of combustible dust and the processing methods used. [654, 2013]

A dust deflagration has the following four requirements:

- (1) Combustible dust
  - (2) Dust dispersion in air or other oxidant
  - (3) Sufficient concentration at or exceeding the minimum explosible concentration (MEC)
  - (4) Sufficiently powerful ignition source such as an electrostatic discharge, an electric current arc, a glowing ember, a hot surface, a welding slag, frictional heat, or a flame
- [654, 2013]

If the deflagration is confined and produces a pressure sufficient to rupture the confining enclosure, the event is, by definition, an “explosion.” [654, 2013]

Evaluation of the hazard of a combustible dust should be determined by the means of actual test data. Each situation should be evaluated and applicable tests selected. The following list represents the factors that are sometimes used in determining the deflagration hazard of a dust:

- (1) MEC
- (2) MIE
- (3) Particle size distribution
- (4) Moisture content as received and as tested
- (5) Maximum explosion pressure at optimum concentration
- (6) Maximum rate of pressure rise at optimum concentration
- (7)  $K_{St}$  (normalized rate of pressure rise) as defined in ASTM E1226, *Standard Test Method for Explosibility of Dust Clouds*

- (8) Layer ignition temperature
  - (9) Dust cloud ignition temperature
  - (10) Limiting oxidant concentration (LOC) to prevent ignition
  - (11) Electrical volume resistivity
  - (12) Charge relaxation time
  - (13) Chargeability
- [654, 2013]

It is important to keep in mind that as a particulate is processed, handled, or transported, the particle size generally decreases due to particle attrition. Consequently, it is often necessary to evaluate the explosibility of the particulate at multiple points along the process. Where process conditions dictate the use of oxidizing media other than air (nominally taken as 21 percent oxygen and 79 percent nitrogen), the applicable tests should be conducted in the appropriate process-specific medium. [654, 2013]

**A.3.3.6 Combustible Metal.** See NFPA 484 for further information on determining the characteristics of metals.

**A.3.3.7 Combustible Particulate Solid.** Combustible particulate solids include dusts, fibers, fines, chips, chunks, flakes, or mixtures of these. The term *combustible particulate solid* addresses the attrition of material as it moves within the process equipment. Particle abrasion breaks the material down and produces a mixture of large and small particulates, some of which could be small enough to be classified as dusts. Consequently, the presence of dusts should be anticipated in the process stream, regardless of the starting particle size of the material. [654, 2013]

The terms *particulate solid*, *dust*, and *fines* are interrelated. It is important to recognize that while these terms refer to various size thresholds or ranges, most particulate solids are composed of a range of particle sizes making comparison to a size threshold difficult. For example, a bulk material that is classified as a particulate solid could contain a significant fraction of dust as part of the particle size distribution.

While hazards of bulk material are addressed in this document using the provisions related to particulate solids, it might be necessary to apply the portions of the document relating to dust where there is potential for segregation of the material and accumulation of only the fraction of the material that fits the definition of dust. Furthermore, it is difficult to establish a fractional cutoff for the size threshold, such as 10 percent below the threshold size or median particle size below the threshold size, as the behavior of the material depends on many factors including the nature of the process, the dispersibility of the dust, and the shape of the particles.

For the purposes of this document, the term *particulate solid* does not include an upper size limitation. This is intended to encompass all materials handled as particulates, including golf balls, pellets, wood chunks and chips, etc.

The term *particulate solid* is intended to include those materials that are typically processed using bulk material handling techniques such as silo storage, pneumatic or mechanical transfer, etc. While particulate solids can present a fire hazard, they are unlikely to present a dust deflagration hazard unless they contain a significant fraction of dust, which can segregate and accumulate within the process or facility.

Dusts traditionally were defined as material  $420 \mu\text{m}$  or smaller (capable of passing through a U.S. No. 40 standard sieve). For consistency with other standards,  $500 \mu\text{m}$  (capable of passing through a U.S. No. 35 standard sieve) is now considered an appropriate size criterion. Particle surface area-to-volume ratio is a

key factor in determining the rate of combustion. Combustible particulate solids with a minimum dimension more than 500  $\mu\text{m}$  generally have a surface-to-volume ratio that is too small to pose a deflagration hazard. Flat platelet-shaped particles, flakes, or fibers with lengths that are large compared to their diameters usually do not pass through a 500  $\mu\text{m}$  sieve, yet could still pose a deflagration hazard. Many particulates accumulate electrostatic charges in handling, causing them to attract each other, forming agglomerates. Often, agglomerates behave as if they were larger particles, yet when they are dispersed they present a significant hazard. Consequently, it can be inferred that any particulate that has a minimum dimension less than or equal to 500  $\mu\text{m}$  could behave as a combustible dust if suspended in air or the process specific oxidizer. If the minimum dimension of the particulate is greater than 500  $\mu\text{m}$ , it is unlikely that the material would be a combustible dust, as determined by test.

Typically, the term *finer* refers to the fraction of material that is below 75  $\mu\text{m}$  or that will pass through a 200-mesh sieve. Alternately, fines can be characterized as the material collected from the final dust collector in a process or the material collected from the highest overhead surfaces in a facility. Fines typically represent a greater deflagration hazard than typical dusts of the same composition because they are more likely to remain suspended for an extended period of time and to have more severe explosion properties (higher  $K_{st}$ , lower MIE, etc.).

**A.3.3.10 Deflagration.** The primary concern of this document is a deflagration that produces a propagating flame front or pressure increase that can cause personnel injuries or the rupture of process equipment or buildings. Usually these deflagrations are produced when the fuel is suspended in the oxidizing medium.

**A.3.3.13 Dust Collection System.** A typical dust collection system consists of the following:

- (1) Hoods — devices designed to contain, capture, and control the airborne dusts by using an induced air flow in close proximity to the point of dust generation (local exhaust zone) to entrain fugitive airborne dusts.
- (2) Ducting — piping, tubing, fabricated duct, etc., used to provide the controlled pathway from the hoods to the dust collector (AMS). Maintaining adequate duct velocity (usually 4000 fpm or higher) is a key factor in the proper functioning of the system.
- (3) Dust collector — an AMS designed to filter the conveyed dusts from the conveying air stream. Usually these devices have automatic methods for cleaning the filter media to allow extended use without blinding. In some systems, a scrubber or similar device is used in place of the filter unit.
- (4) Fan package — an AMD designed to induce the air flow through the entire system.

The system is designed to collect only suspended dusts at the point of generation and not dusts at rest on surfaces. The system is also not designed to convey large amounts of dusts as the system design does not include friction loss due to solids loading in the pressure drop calculation. Thus, material loading must be minimal compared to the volume or mass of air flow. [654, 2013]

**A.3.3.16 Dust Hazards Analysis (DHA).** In the context of this definition it is not intended that the dust hazards analysis (DHA) must comply with the process hazards analysis (PHA) requirements contained in OSHA regulation 29 CFR 1910.119, “Process Safety Management of Highly Hazardous Chemicals.” While the DHA can comply with OSHA PHA requirements, other methods

can also be used (*see Annex B*). However, some processes might fall within the scope of OSHA regulation 29 CFR 1910.119, and there could be a legal requirement to comply with that regulation.

**A.3.3.17 Enclosure.** Examples of enclosures include a room, building, vessel, silo, bin, pipe, or duct. [68, 2013]

**A.3.3.20 Flash Fire.** A flash fire requires an ignition source and an atmosphere containing a flammable gas, a flammable vapor, or finely divided combustible particles (e.g., coal dust or grain) having a concentration sufficient to allow flame propagation. Flammable gas, flammable vapor, and dust flash fires typically generate temperatures from 1000°F to 1900°F (538°C to 1038°C). The extent and intensity of a flash fire depend on the size and concentration of the gas, vapor, or dust cloud. When ignited, the flame front expands outward in the form of a fireball. The resulting effect of the fireball’s energy with respect to radiant heat significantly enlarges the hazard areas around the point of ignition.

**A.3.3.25 Hybrid Mixture.** The presence of flammable gases and vapors, even at concentrations less than the lower flammable limit (LFL) of the flammable gases and vapors, adds to the violence of a dust-air combustion. [654, 2013]

The resulting dust-vapor mixture is called a *hybrid mixture* and is discussed in NFPA 68. In certain circumstances, hybrid mixtures can be deflagrable, even if the dust is below the MEC and the vapor is below the LFL. Furthermore, dusts determined to be nonignitable by weak ignition sources can sometimes be ignited when part of a hybrid mixture. [654, 2013]

Examples of hybrid mixtures are a mixture of methane, coal dust, and air or a mixture of gasoline vapor and gasoline droplets in air. [654, 2013]

**A.3.3.26 Industry- or Commodity-Specific NFPA Standard.** It is possible that within a single building or enclosure more than one industry- or commodity-specific NFPA standard could apply. The following documents are commonly recognized as commodity-specific standards:

- (1) NFPA 61, *Standard for the Prevention of Fires and Dust Explosions in Agricultural and Food Processing Facilities*
- (2) NFPA 120, *Standard for Fire Prevention and Control in Coal Mines*
- (3) NFPA 484, *Standard for Combustible Metals*
- (4) NFPA 654, *Standard for the Prevention of Fire and Dust Explosions from the Manufacturing, Processing, and Handling of Combustible Particulate Solids*
- (5) NFPA 655, *Standard for Prevention of Sulfur Fires and Explosions*
- (6) NFPA 664, *Standard for the Prevention of Fires and Explosions in Wood Processing and Woodworking Facilities*

**A.3.3.27.1 Flexible Intermediate Bulk Container (FIBC).** FIBCs are usually made from nonconductive materials. Electrostatic charges that develop as FIBCs are filled or emptied may result in electrostatic discharges, which can pose an ignition hazard for combustible dust or flammable vapor atmospheres within or outside the bag. The four types of FIBCs — Type A, Type B, Type C, and Type D — are based on their characteristics for control of electrostatic discharges. [654, 2013]

**A.3.3.27.2 Rigid Intermediate Bulk Container (RIBC).** These are often called *composite IBCs*, which is the term used by the U.S. Department of Transportation (DOT). The term *rigid nonmetallic intermediate bulk container* denotes an all-plastic single-wall IBC that might or might not have a separate plastic



base and for which the containment vessel also serves as the support structure. [654, 2013]

**A.3.3.28 Minimum Explosible Concentration (MEC).** Minimum explosible concentration is defined by the test procedure in ASTM E1515, *Standard Test Method for Minimum Explosible Concentration of Combustible Dusts*. [654, 2013]

**A.3.3.29 Minimum Ignition Energy (MIE).** The standard test procedure for MIE of combustible particulate solids is ASTM E2019, *Standard Test Method for Minimum Ignition Energy of a Dust Cloud in Air*, and the standard test procedure for MIE of flammable vapors is ASTM E582, *Standard Test Method for Minimum Ignition Energy and Quenching Distance in Gaseous Mixtures*. [654, 2013]

**A.3.3.30 Pneumatic Conveying System.** Pneumatic conveying systems include a wide range of equipment systems utilizing air or other gases to transport solid particles from one point to another. A typical system comprises the following:

- (1) A device used to meter the material into the conveying air stream
- (2) Piping, tubing, hose, etc., used to provide the closed pathway from the metering device to the AMS
- (3) An AMS designed for the separation of comparatively large amounts of material from the conveying air/gas stream
- (4) An additional metering device (typically a rotary airlock valve or similar device) that might be used to allow discharge of the separated material from the conveying air stream without affecting the differential pressure of the system
- (5) An AMD designed to produce the necessary pressure differential and air/gas flow in the system (positive or negative)

[654, 2013]

A pneumatic conveying system requires the amount of material conveyed by the system to be considered as a major factor in the system pressure drop calculations. [654, 2013]

Both positive and negative (i.e., vacuum) differential pressure are used for pneumatic conveying. The decision of which is the best for a specific application should be based upon a risk analysis, equipment layout, and other system operational and cost factors. [654, 2013]

Dense phase conveying can also be considered for the application, especially with more hazardous materials (e.g., low MIE). The inherent design and operational features of this approach can provide significant safety and operational advantages over other types of pneumatic conveying systems. [654, 2013]

**A.3.3.34 Risk Assessment.** A risk assessment is a process that performs the following:

- (1) Identifies hazards
- (2) Quantifies the consequences and probabilities of the identified hazards
- (3) Identifies hazard control options
- (4) Quantifies the effects of the options on the risks of the hazards
- (5) Establishes risk tolerance criteria (maximum tolerable levels of risk)
- (6) Selects the appropriate control options that meet or exceed the risk acceptability thresholds

Steps 1 through 3 are typically performed as part of a dust hazards analysis (DHA).

Risk assessments can be qualitative, semiquantitative, or quantitative. Qualitative methods are usually used to identify the most hazardous events. Semiquantitative methods are used to determine relative hazards associated with unwanted events and are typified by indexing methods or numerical grading. Quantitative methods are the most extensive and use a probabilistic approach to quantify the risk based on both frequency and consequences.

See SFPE *Engineering Guide to Fire Risk Assessment* or AICHe *Guidelines for Hazard Evaluation Procedures* for more information.

**A.4.1 Combustible particulate solids and dust hazard identification, assessment, and mitigation** should address known hazards, including the following:

- (1) Reactivity hazards (e.g., binary incompatibility or water reactivity)
- (2) Smoldering fire in a layer or a pile
- (3) Flaming fire of a layer or a pile
- (4) Deflagration resulting in flash fire (dust cloud combustion)
- (5) Deflagration resulting in dust explosion in equipment
- (6) Deflagration resulting in dust explosion in rooms and buildings

**A.4.2.1.1** Given the fast acting nature of flash fire, deflagration, and explosions, the stated Life Safety Objective recognizes the difficulty, if not the impossibility, of protecting occupants in the immediate proximity of the ignition. Thus, the stated objective is to protect occupants not in the immediate proximity of ignition. However, all available practices should be employed to ensure the safety of all persons both near and far from the ignition. An example of this might be the standard's prescriptive exception relative to the less than 8 ft<sup>3</sup> (0.2 m<sup>3</sup>) air-material separator not requiring protection; however, the intent of the objective is to consider the effect of deflagration to occupants in the immediate area of the small air-material separator and mitigate this hazard if possible. Likewise, the standard has not defined "immediate proximity" in that this could mean within just feet of the hazard or within the same building or structure and leaves that judgment to the user. The intent of the objective is to employ all available and reasonable protection, techniques, and practices to protect all occupants understanding that it might not always be achievable.

**A.4.2.2** Other stakeholders could also have mission continuity goals that will necessitate more stringent objectives as well as more specific and demanding performance criteria. The protection of property beyond maintaining structural integrity long enough to escape is actually a mission continuity objective.

The mission continuity objective encompasses the survival of both real property, such as the building, and the production equipment and inventory beyond the extinguishment of the fire. Traditionally, property protection objectives have addressed the impact of the fire on structural elements of a building as well as the equipment and contents inside a building. Mission continuity is concerned with the ability of a structure to perform its intended functions and with how that affects the structure's tenants. It often addresses post-fire smoke contamination, cleanup, and replacement of damaged equipment or raw materials.

**A.4.2.3** Adjacent compartments share a common enclosure surface (wall, ceiling, floor) with the compartment of fire or explosion origin. The intent is to prevent the collapse of the structure during the fire or explosion.

**A.4.2.4** Usually a facility or process system is designed using the prescriptive criteria until a prescribed solution is found to



be infeasible or impracticable. Then the designer can use the performance-based option to develop a design, addressing the full range of fire and explosion scenarios and the impact on other prescribed design features. Consequently, facilities are usually designed not by using performance-based design methods for all facets of the facility but rather by using a mixture of both design approaches as needed.

**A.5.2** Test data derived from testing material within a facility will result in the most accurate results for the DHA performance-based design, and hazard management options. Testing is not required to determine whether the material has combustibility characteristics where reliable, in-house commodity-specific testing data or published data of well-characterized samples (i.e., particle size, moisture content, and test conditions) are available. Published data should be used for preliminary assessment of combustibility only. However, for protection or prevention design methods, the data can be acceptable after a thorough review to ensure that they are representative of owner/operator conditions.

The protection or prevention designs are based on explosivity properties, which can vary based on the specific characteristics of the material. (See 5.2.2 for characteristics that can affect explosibility properties.) Historical knowledge and experience of occurrence or nonoccurrence of process incidents such as flash fires, small fires, sparkling fires, pops, or booms, or evidence of vessel, tank, or container overpressure should not be used as a substitute for hazard analysis. Process incidents are indications of a material or process resulting in combustibility or explosion propensity. Process incidents can be used to guide or select samples for and supplement testing.

The following material properties should be addressed by a DHA for the combustible particulate solids present:

- (1) *Particle Size*. Sieve analysis is a crude and unreliable system of hazard determination. Its greatest contribution in managing the hazard is the ease, economy, and speed at which it can be used to discover changes in the process particulate. In any sample of particulate, very rarely are all the particles the same size. Sieve analysis can be used to determine the fraction that would be generally suspected of being capable of supporting a deflagration. For a sub-500 micron fraction:
  - (a) Data presented in terms of the percent passing progressively smaller sieves.
  - (b) Particles that have high aspect ratios produce distorted, nonconservative results.
- (2) *Particle Size Distribution*. The particle size distribution of a combustible particulate solid must be known if the explosion hazard is to be assessed. Particle size implies a specific surface area (SSA) and affects the numerical measure of other parameters such as MEC, MIE,  $dP/dt_{max}$ ,  $P_{max}$  and  $K_{St}$ . Particles greater than 500 microns in effective mean particle diameter are generally not considered deflagratory. Most combustible particulate solids include a range of particle sizes in any given sample. The DHA should anticipate and account for particle attrition and separation as particulate is handled.
- (3) *Particle Shape*. Due to particle shape and agglomeration, some particulates cannot be sieved effectively. Particulates with nonspheric or noncubic shapes do not pass through a sieve as easily as spheric or cubic particles. For this purpose, fibers can behave just as explosively as spherical particulate. This leads to underestimation of small particle populations and to underassessment of

the hazard. Particulates with an aspect ratio greater than 3:1 should be suspect. When particulates are poured into vessels, it is common for the fine particles to separate from the large, creating a deflagration hazard in the ullage space.

- (4) *Particle Aging*. Some combustible particulate solid materials could undergo changes in their safety characteristics due to aging. Changes in morphology and chemical composition, for example, can occur from the time a sample is collected to the time it takes to get that sample into the lab for a test. For materials that are known to age, care must be taken in packaging and shipment. The use of vacuum seals, or an inert gas such as nitrogen, could be required to ensure that the tested sample has not changed appreciably due to aging. The lab should be notified in advance of shipment that the material is sensitive to change due to age so that they will know how to handle it and store it until it is tested.
- (5) *Particle Attrition*. The material submitted for testing should be selected to address the effects of material attrition as it is moved through the process. As particulates move through a process they usually break down into smaller particles. Reduction in particle size leads to an increase in total surface area to mass ratio of the particulate and increases the hazard associated with the unoxidized particulate.
- (6) *Particle Suspension*. Particle suspension maximizes the fuel-air interface. It occurs wherever particulate moves relative to the air or air moves relative to the particulate, such as in pneumatic conveying, pouring, fluidizing, mixing and blending, or particle size reduction.
- (7) *Particle Agglomeration*. Some particulates tend to agglomerate into clumps. Agglomerating particulates can be more hazardous than the test data imply if the particulate was not thoroughly deagglomerated when testing was conducted. Agglomeration is usually affected by ambient humidity.
- (8) *Triboelectric Attraction*. Particles with a chemistry that allows electrostatic charge accumulation will become charged during handling. Charged particles attract oppositely charged particles. Agglomeration causes particulate to exhibit lower explosion metrics during testing. Humidification decreases the triboelectric effect.
- (9) *Hydrogen Bonding*. Hydrophilic particulates attract water molecules that are adsorbed onto the particle surface. Adsorbed water provides hydrogen bonding to adjacent particles, causing them to agglomerate. Agglomeration causes particulate to exhibit lower explosion metrics during testing. Desiccation reduces this agglomerated effect.
- (10) *Entrainment Fraction*. The calculation for a dust dispersion from an accumulated layer should be corrected for the ease of entrainment of the dust. Fuel chemistry and agglomeration/adhesion forces should be considered. The dispersion is generally a function of humidity, temperature, and time. Particle shape and morphology and effective particle size should be considered.
- (11) *Combustible Concentration*. When particles are suspended, a concentration gradient will develop where concentration varies continuously from high to low. There is a minimum concentration that must exist before a flame front will propagate. This concentration depends on particle size and chemical composition and is measured in grams/cubic meter (ounces/cubic foot). This concentration is called the minimum explosible concentration (MEC). A dust dispersion can come from a layer of


accumulated fugitive dust. The concentration attained depends on bulk density of dust layer (measured in grams/m<sup>3</sup>), layer thickness, and the extent of the dust cloud. Combustible concentration is calculated as: Concentration = (bulk density)\*[(layer thickness)/(dust cloud thickness)]

- (12) *Competent Igniter*. Ignition occurs where sufficient energy per unit of time and volume is applied to a deflagratory particulate suspension. Energy per unit of mass is measured as temperature. When the temperature of the suspension is increased to the auto-ignition temperature, combustion begins. Ignitability is usually characterized by measuring the minimum ignition energy (MIE). The ignition source must provide sufficient energy per unit of time (power) to raise the temperature of the particulate to its autoignition temperature (AIT).
- (13) *Dustiness/dispersibility*. Ignition and sustained combustion occurs where a fuel and competent ignition course come together in an atmosphere (oxidant) that supports combustion. The fire triangle represents the three elements required for a fire. Not all dusts are combustible, and combustible dusts exhibit a range in degree of hazard. All dusts can exhibit explosion hazards accompanied by propagation away from the source. In the absence of confinement, a flash-fire hazard results. If confined, the deflagration can result in damaging overpressures. Deflagration is the process resulting in a flash fire or an explosion. The four elements for a flash fire are the following:
  - (a) A combustible dust sufficiently small enough to burn rapidly and propagate flame
  - (b) A suspended cloud at a concentration greater than the minimum explosion concentration
  - (c) The atmosphere to support combustion
  - (d) An ignition source of adequate energy or temperature to ignite the dust cloud

The heat flux from combustible metal flash fires is greater than organic materials (see Figure A.5.2). A dust explosion requires the following five conditions:

- (1) A combustible dust sufficiently small enough to burn rapidly and propagate flame
- (2) A suspended cloud at a concentration greater than the minimum explosion concentration
- (3) Confinement of the dust cloud by an enclosure or partial enclosure
- (4) The atmosphere to support combustion
- (5) An ignition source of adequate energy or temperature to ignite the dust cloud

**A.5.2.2** Such an assessment is to determine whether the dust is a combustible dust and if further assessment is necessary. Data can be from samples within the facility that have been tested or data can be based on whether the material is known to be combustible or not. There are some published data of commonly known ma-

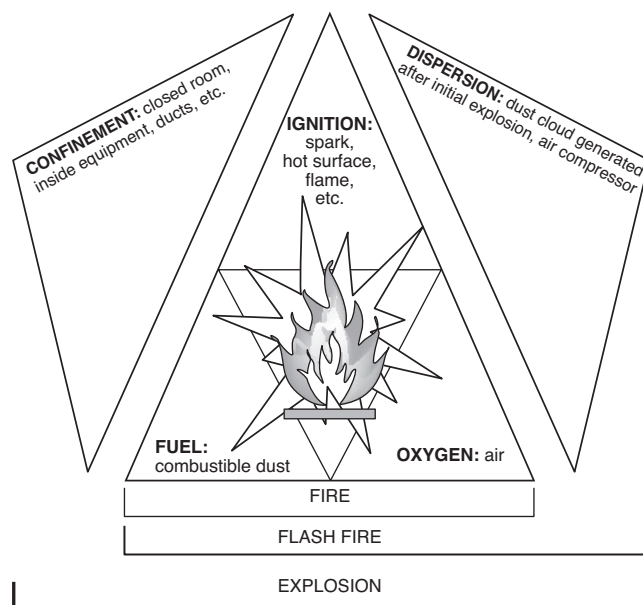

**FIGURE A.5.2 Elements Required for Fires, Flash Fires, and Explosions.**

terials, and the use of these data is adequate to determine whether the dust is a combustible dust. For well-known commodities, published data are usually acceptable. A perusal of published data illuminates that there is often a significant spread in values. It is useful, therefore, to compare attributes (such as particle distribution and moisture content) in published data with the actual material being handled in the system whenever possible. Doing so would help to verify that the data are pertinent to the hazard under assessment.

Subsection 5.2.2 does not require the user to know all these items for the assessment; rather, it reviews the important items in order to determine whether the material data are representative of the material in the facility. Even test data of material can be different from the actual conditions. Users should review the conditions of the test method as well to ensure that it is representative of the conditions of the facility. Where that is not possible, the use of worst-case values should be selected.

Composition and particle size are two parameters that are useful to identify the number and location of representative samples to be collected and tested. (See Section 5.5 for information on sampling.)

Refer to Table A.5.2.2(a) through Table A.5.2.2(k) for guidance only and not as substitutes for actual test data. These tables are not all-inclusive of all combustible dusts and non-combustible dusts. Additionally, material properties and testing methods can provide results that vary from those presented in these tables.

Table A.5.2.2(a) 20-L Sphere Test Data – Agricultural Dusts

Dust Name	$P_{max}$ (bar g)	(1) $K_{St}$ (bar m/sec)	Percent Moisture	Particle Size ( $\mu\text{m}$ )	Minimum Explosive Concentration (g/m <sup>3</sup> )	Percent Greater Than 200 Mesh
Alfalfa	6.7	94	2.1	36		
Apple	6.7	34		155	125	
Beet root	6.1	30		108	125	
Carrageen	8.5	140	3.8			98
Carrot	6.9	65		29		
Cocoa bean dust	7.5	152				
Cocoa powder	7.3	128				
Coconut shell dust	6.8	111	6.5			51
Coffee dust	6.9	55	4.8	321		
Corn meal	6.2	47	8.2	403		
Cornstarch	7.8	163	11.2			
Cotton	7.2	24		44	100	
Cottonseed	7.7	35		245	125	
Garlic powder	8.6	164				
Gluten	7.7	110		150	125	
Grass dust	8.0	47		200	125	
Green coffee	7.8	116	5.0	45		
Hops (malted)	8.2	90		490		
Lemon peel dust	6.8	125	9.5	38		
Lemon pulp	6.7	74	2.8	180		
Linseed	6.0	17		300		
Locust bean gum	7.8	78	1.7			53
Malt	7.5	170	10.5	72		
Oat flour	6.4	81	8.6			
Oat grain dust	6.0	14		295	750	
Olive pellets	10.4	74			125	
Onion powder	9.0	157				
Parlsey (dehydrated)	7.5	110	5.4		26	
Peach	8.4	81		140	60	
Peanut meal and skins	6.4	45	3.8			
Peat	8.3	51		74	125	
Potato	6.0	20		82	250	
Potato flour	9.1	69		65	125	
Potato starch	9.4	89		32		
Raw yucca seed dust	6.2	65	12.7	403		
Rice dust	7.7	118	2.5			4
Rice flour	7.4	57			60	
Rice starch	10.0	190		18		90
Rye flour	8.9	79		29		
Semolina	7.6	79				9
Soybean dust	7.5	125	2.1			59
Spice dust	6.9	65	10.0			
Spice powder	7.8	172	10.0			
Sugar (10×)	8.4	154				
Sunflower	7.9	44		420	125	
Tea	7.6	102	6.3	77	125	
Tobacco blend	8.8	124	1.0	120		
Tomato				200	100	

Table A.5.2.2(a) *Continued*

Dust Name	$P_{max}$ (bar g)	(1) $K_{St}$ (bar m/sec)	Percent Moisture	Particle Size ( $\mu\text{m}$ )	Minimum Explosive Concentration (g/m <sup>3</sup> )	Percent Greater Than 200 Mesh
Walnut dust	8.4	174	6.0			31
Wheat flour	8.3	87	12.9	57	60	6
Wheat grain dust	9.3	112		80	60	
Wheat starch	9.8	132		20	60	
Xanthan gum	7.5	61	8.6	45		

Notes:

(1) Normalized to 1 m<sup>3</sup> test vessel pressures, per ASTM E1226, *Standard Test Method for Explosibility of Dust Clouds*.(2) See also Table F.1(a) in NFPA 68, *Standard on Explosion Protection by Deflagration Venting*, for additional information on agricultural dusts with known explosion hazards.(3) For those agricultural dusts without known explosion data, the dust should be tested in accordance with ASTM E1226, *Standard Test Method for Explosibility of Dust Clouds*.

© 1995 FM Global. Reprinted with permission. All rights reserved.

[61: Table A.6.2.1]

Table A.5.2.2(b) 1 m<sup>3</sup> Vessel Test Data from Forschungsbericht Staubexplosionen – Agricultural Dusts

Material	Mass Median Diameter ( $\mu\text{m}$ )	Minimum Flammable Concentration (g/m <sup>3</sup> )	$P_{max}$ (bar)	$K_{St}$ (bar-m/s)	Dust Hazard Class
Cellulose	33	60	9.7	229	2
Cellulose pulp	42	30	9.9	62	1
Cork	42	30	9.6	202	2
Corn	28	60	9.4	75	1
Egg white	17	125	8.3	38	1
Milk, powdered	83	60	5.8	28	1
Milk, nonfat, dry	60	—	8.8	125	1
Soy flour	20	200	9.2	110	1
Starch, corn	7	—	10.3	202	2
Starch, rice	18	60	9.2	101	1
Starch, wheat	22	30	9.9	115	1
Sugar	30	200	8.5	138	1
Sugar, milk	27	60	8.3	82	1
Sugar, beet	29	60	8.2	59	1
Tapioca	22	125	9.4	62	1
Whey	41	125	9.8	140	1
Wood flour	29	—	10.5	205	2

[68: Table F.1(a)]

Table A.5.2.2(c) 1 m<sup>3</sup> Vessel Test Data from Forschungsbericht Staubexplosionen – Carbonaceous Dusts

Material	Mass Median Diameter ( $\mu\text{m}$ )	Minimum Flammable Concentration (g/m <sup>3</sup> )	$P_{max}$ (bar)	$K_{St}$ (bar-m/s)	Dust Hazard Class
Charcoal, activated	28	60	7.7	14	1
Charcoal, wood	14	60	9.0	10	1
Coal, bituminous	24	60	9.2	129	1
Coke, petroleum	15	125	7.6	47	1
Lampblack	<10	60	8.4	121	1
Lignite	32	60	10.0	151	1
Peat, 22% H <sub>2</sub> O	—	125	84.0	67	1
Soot, pine	<10	—	7.9	26	1

[68: Table F.1(b)]

**Table A.5.2.2(d) 1 m<sup>3</sup> Vessel Test Data from Forschungsbericht Staubexplosionen – Chemical Dusts**

Material	Mass Median Diameter (µm)	Minimum Flammable Concentration (g/m <sup>3</sup> )	$P_{max}$ (bar)	$K_{St}$ (bar-m/s)	Dust Hazard Class
Adipic acid	<10	60	8.0	97	1
Anthraquinone	<10	—	10.6	364	3
Ascorbic acid	39	60	9.0	111	1
Calcium acetate	92	500	5.2	9	1
Calcium acetate	85	250	6.5	21	1
Calcium stearate	12	30	9.1	132	1
Carboxy- methyl- cellulose	24	125	9.2	136	1
Dextrin	41	60	8.8	106	1
Lactose	23	60	7.7	81	1
Lead stearate	12	30	9.2	152	1
Methyl-cellulose	75	60	9.5	134	1
Paraformaldehyde	23	60	9.9	178	1
Sodium ascorbate	23	60	8.4	119	1
Sodium stearate	22	30	8.8	123	1
Sulfur	20	30	6.8	151	1

[68: Table F.1(c)]

**Table A.5.2.2(e) 1 m<sup>3</sup> Vessel Test Data from Forschungsbericht Staubexplosionen – Metal Dusts**

Material	Mass Median Diameter (µm)	Minimum Flammable Concentration (g/m <sup>3</sup> )	$P_{max}$ (bar)	$K_{St}$ (bar-m/s)	Dust Hazard Class
Aluminum	29	30	12.4	415	3
Bronze	18	750	4.1	31	1
Iron carbonyl	<10	125	6.1	111	1
Magnesium	28	30	17.5	508	3
Phenolic resin	55	—	7.9	269	2
Zinc	10	250	6.7	125	1
Zinc	<10	125	7.3	176	1

[68: Table F.1(d)]

**Table A.5.2.2(f) 1 m<sup>3</sup> Vessel Test Data from Forschungsbericht Staubexplosionen (except where noted) – Plastic Dusts**

Material	Mass Median Diameter (µm)	Minimum Flammable Concentration (g/m <sup>3</sup> )	$P_{max}$ (bar)	$K_{St}$ (bar-m/s)	Dust Hazard Class
(poly) Acrylamide	10	250	5.9	12	1
(poly) Acrylonitrile	25	—	8.5	121	1
(poly) Ethylene (low-pressure process)	<10	30	8.0	156	1
Epoxy resin	26	30	7.9	129	1
Melamine resin	18	125	10.2	110	1
Melamine, molded (wood flour and mineral filled phenol-formaldehyde)	15	60	7.5	41	1
Melamine, molded (phenol-cellulose)	12	60	10.0	127	1
(poly) Methyl acrylate	21	30	9.4	269	2
(poly) Methyl acrylate, emulsion polymer	18	30	10.1	202	2

Table A.5.2.2(f) *Continued*

Material	Mass Median Diameter ( $\mu\text{m}$ )	Minimum Flammable Concentration ( $\text{g}/\text{m}^3$ )	$P_{\text{max}}$ (bar)	$K_{St}$ (bar-m/s)	Dust Hazard Class
Phenolic resin	<10	15	9.3	129	1
	55		7.9	269	2
(poly) Propylene	25	30	8.4	101	1
Terpene-phenol resin	10	15	8.7	143	1
Urea-formaldehyde/ cellulose, molded	13	60	10.2	136	1
(poly) Vinyl acetate/ ethylene copolymer	32	30	8.6	119	1
(poly) Vinyl alcohol	26	60	8.9	128	1
(poly) Vinyl butyral	65	30	8.9	147	1
(poly) Vinyl chloride	107	200	7.6	46	1
(poly) Vinyl chloride/vinyl acetylene emulsion copolymer	35	60	8.2	95	1
(poly) Vinyl chloride/ethylene/vinyl acetylene suspension copolymer	60	60	8.3	98	1

[68: Table F.1(e)]

Table A.5.2.2(g) 20 L and 1 m<sup>3</sup> Vessel Test Data, PVC and Copolymer Plastic Resins and Dusts

PVC Resin Sample	GP <sup>a</sup> Dispersion	VA <sup>b</sup> Copolymer	Baghouse Dust from GP Pipe (as received)	GP Pipe Resin <sup>c</sup>	Baghouse Dust from GP Pipe (as received)	GP Pipe Resin (as received)	High Molecular Weight Resin (as received)
	Type of polymerization process						
	Emulsion		Suspension				
Plant designator	A	B	C	C	D	D	E
Test lab	Chilworth	Chilworth	Chilworth	Fike	Chilworth	Chilworth (20 L), Fike (1 m <sup>3</sup> )	Fike
Minimum Ignition Energy (MIE), Joules	>10 J	>10 J	>500 mJ	>4653 mJ	>10 J	>10 J	>4468 mJ
Explosion severity, $K_{St}$ (bar-m/s), 20 L test chamber	91	68	84	18	54	9	81
Dust explosion class in 20 L test chamber	ST 1	ST 1	ST 1	ST 1	ST 1	ST 1	ST 1
Explosion severity, $K_{St}$ (bar-m/s), 1 m <sup>3</sup> test chamber	Not tested	Not tested	Not tested	0	Not tested	0	0
Dust explosion class in 1 m <sup>3</sup> test chamber	Not tested	Not tested	Not tested	ST 0	Not tested	ST 0	ST 0
Particle size, avg. ( $\mu\text{m}$ )	1 (est.)	N.A.	N.A.	162	N.A.	158	128
Dust fraction (<75 $\mu\text{m}$ , %)	100	100	100	0.1	97	0	0.6

Note: Sponsored by the Vinyl Institute, 1737 King Street, Suite 390, Alexandria, VA 22314.

<sup>a</sup>GP: General Purpose<sup>b</sup>VA: Vinyl Acetate<sup>c</sup>Date for MIE and 20 L test were performed by Fike on sample screened to <150  $\mu\text{m}$  and data for 1 m<sup>3</sup> tests were performed by Fike on 'as received' sample.

Source: Krock, R., et. al., "OSHA's Combustible Dust National Emphasis Program and Combustibility Characteristics Testing of PVC Resins and PVC Dusts," SPE ANTEC, April, 2012.

Table A.5.2.2(h) Explosibility Properties of Metals

Material	Median Diameter (µm)	$K_{st}$ (bar-m/s)	$P_{max}$ (bar g)	Cloud Ign Temp (°C)	MIE (mJ)	MEC (g/m <sup>3</sup> )	UN Combustibility Category <sup>2</sup>	LOC <sup>1</sup> (v%)	Data Source
Aluminum	~7	—	8	—	—	90			Cashdollar & Zlochower4
Aluminum	22	—	—	—	—	—	—	5 (N)	BGIA3
Aluminum	<44	—	5.8	650	50	45		2 (C)	BuMines RI 6516
Aluminum flake	<44		6.1	650	20	45		<3 (C)	BuMines RI 6516
Aluminum	<10	515	11.2	560	—	60	—	—	BGIA3
Aluminum	580	Not Ignited	—	—	—	—	—	—	BGIA
Beryllium	4	Not Ignited	—	—	—	—	—	—	BuMines RI 6516
Boron	<44	—	—	470	60	<100	—	—	BuMines RI 6516
Boron	~3	—	6.0			≈110			Cashdollar & Zlochower
Bronze	18	31	4.1	390	—	750	BZ 4		Eckhoff
Chromium	6	—	3.3	660	5120	770		14 (C)	BuMines RI 6516
Chromium	3	—	3.9	580	140	230	—	—	BuMines RI 6517
Copper	~30	Not Ignited							Cashdollar & Zlochower
Hafnium	~8	—	4.2	—	—	~180	—	—	Cashdollar & Zlochower
Iron	12	50	5.2	580		500	—		Eckhoff
Iron	~45	—	2.1	—	—	~500	—	—	Cashdollar & Zlochower
Iron	<44	—	2.8	430	80	170	—	13 (C)	BuMines RI 6516
Iron, carbonyl	<10	111	6.1	310		125	BZ 3		Eckhoff
Manganese	<44	—	—	460	305	125		—	BuMines RI 6516
Manganese (electrolytic)	16	157	6.3	330	—	—	—	—	Eckhoff
Manganese (electrolytic)	33	69	6.6	—	—	—	—	—	Eckhoff
Magnesium	28	508	17.5	—	—	—	—		Eckhoff
Magnesium	240	12	7	760		500	BZ 5		Eckhoff
Magnesium	<44	—	—	620	40	40		—	BuMines RI 6516
Magnesium	<44	—		600	240	30	—	<3 (C)	BuMines RI 6516
Magnesium	~16	—	7.5	—	—	55	—	—	Cashdollar & Zlochower
Molybdenum	<10	Not Ignited							Eckhoff
Nickel	~6	Not Ignited							Cashdollar & Zlochower
Niobium	80	238	6.3	560	3	70		6 (Ar)	Industry
Niobium	70	326	7.1	591	3	50		5 (Ar)	Industry
Silicon	<10	126	10.2	>850	54	125	BZ 3		Eckhoff
Silicon, from dust collector	16	100	9.4	800	—	60	—		Eckhoff
Silicon, from filter	<10	116	9.5	>850	250	60	BZ 1		Eckhoff
Tantalum	<44	—	—	630	120	<200		3 (Ar)	BuMines RI 6516
Tantalum	~10		≈3			≈400			Cashdollar & Zlochower





Table A.5.2.2(h) *Continued*

Material	Median Diameter (µm)	$K_{st}$ (bar-m/s)	$P_{max}$ (bar g)	Cloud Ign Temp (°C)	MIE (mJ)	MEC (g/m <sup>3</sup> )	UN Combustibility Category <sup>2</sup>	LOC <sup>1</sup> (v%)	Data Source
Tantalum	100	149	6.0	460	<3	160		2 (Ar)	Industry
Tantalum	80	97	3.7	540	<3	160		2(Ar)	Industry
Tantalum	50	108	5.5	520	<3	160		2(Ar)	Industry
Tantalum	65	129	5.8	460	<3	160		2(Ar)	Industry
Tantalum	21		5.6	430	<3	125		<2(Ar)	Industry
Tantalum	25			400	>1<3	30		<2(Ar)	Industry
Tin	~8	—	3.3	—	—	~450	—	—	Cashdollar & Zlochower
Titanium	36	Not Ignited				BZ 2			BGIA
Titanium	30	—	—	450	—	—	—		Eckhof
Titanium	~25		4.7	—	—	70	—		Cashdollar & Zlochower
Titanium	10	—	4.8	330	25	45		6 (N) 4 (Ar)	BuMines RI 6515
Tungsten	≤1	—	~2.3	—	—	~700	—	—	Cashdollar & Zlochower
Tungsten	~10	Not Ignited							Cashdollar & Zlochower
Zinc (from collector)	<10	125	6.7	570	—	250	BZ 3		Eckhoff
Zinc (from collector)	10	176	7.3	—	—	125	BZ 2		Eckhoff
Zinc (from Zn coating)	19	85	6	800	—	—	BZ 2		Eckhoff
Zinc (from Zn coating)	21	93	6.8	790	—	250	—		Eckhoff
Zirconium	<44	—	5.2	20	5	45	—	Ignites in N <sub>2</sub> & CO <sub>2</sub>	BuMines RI 6516
Zirconium (Zircalloy-2)	50	—	3.0	420	30	—	—	—	BuMines RI 6516

(1) Limiting Oxygen Concentration. The letter in parenthesis in the LOC column denotes the inert gas used to reduce the oxygen concentration as follows: Ar = argon, C = carbon dioxide, N = nitrogen

(2) UN Dust Layer Combustibility Categories are as follows:

BZ1 No self-sustained combustion;

BZ2 Local combustion of short duration;

BZ3 Local sustained combustion, but no propagation;

BZ4 Propagating smoldering combustion;

BZ5 Propagating open flame;

BZ6 Explosive combustion.

(3) BGIA is the GESTIS-DUST-EX database maintained by BGIA-online.hvbg.de

(4) Cashdollar, Kenneth, and Zlochower, Isaac, "Explosion Temperatures and Pressures of Metals and Other Elemental Dust Clouds," *J. Loss Prevention in the Process Industries*, v 20, 2007.

[484: Table A.1.1.3(b)]



Table A.5.2.2(i) Atomized Aluminum Particle Ignition and Explosion Data

Particle Size ( $d_{50}$ ) ( $\mu\text{m}$ )	BET ( $\text{m}^2/\text{g}$ )	MEC ( $\text{g}/\text{m}^3$ )	$P_{\text{max}}$ (psi)	$dP/dt_{\text{max}}$ (psi/sec)	$K_{\text{St}}$ (bar-m/sec)	Sample Concentration That Corresponds to $P_{\text{max}}$ and $dP/dt_{\text{max}}$ ( $\text{g}/\text{m}^3$ )	MIE (mJ)	LOC (%)	Most Easily Ignitable Concentration ( $\text{g}/\text{m}^3$ )
<b>Nonspherical, Nodular, or Irregular Powders</b>									
53	0.18	170	123	3,130	59	1,250			
42	0.19	70	133	5,720	107	1,250 ( $P_{\text{max}}$ ), 1,000 ( $dP/dt_{\text{max}}$ )			
32	0.34	60	142	7,950	149	1,250	10		
32	0.58	65	133	8,880	167	750 ( $P_{\text{max}}$ ), 1,500 ( $dP/dt_{\text{max}}$ )	11	Ignition @ 8.0% Nonignition @ 7.5%	1,000
30	0.10	60					10		
28	0.11	55	140	6,360	119	1,000 ( $P_{\text{max}}$ ), 1,250 ( $dP/dt_{\text{max}}$ )	11		
28	0.21	55	146	8,374	157	1,500	11		
9	0.90	65	165	15,370	288	750 ( $P_{\text{max}}$ ), 1,000 ( $dP/dt_{\text{max}}$ )	4		
7	0.74	90	153	17,702	332	1,000 ( $P_{\text{max}}$ ), 500 ( $dP/dt_{\text{max}}$ )	12		
6	0.15	80	176	15,580	292	750	3.5		
6	0.70	75	174	15,690	294	500 ( $P_{\text{max}}$ ), 1,000 ( $dP/dt_{\text{max}}$ )	3		
5	1.00	70					4		
4	0.78	75	167	15,480	291	1,000 ( $P_{\text{max}}$ ), 750 ( $dP/dt_{\text{max}}$ )	3.5		
<b>Spherical Powders</b>									
63	0.15	120	101	1,220	23	1,250 ( $P_{\text{max}}$ ), 1,000 ( $dP/dt_{\text{max}}$ )	N.I.	Ignition @ 8.0% Nonignition @ 7.5%	1,750
36	0.25	60	124	4,770	90	1,250	13		
30	0.10	60	140	5,940	111	1,000	13		
15	0.50	45	148	10,812	203	1,000	7		
15	0.30	55					8		
6	0.53	75	174	16,324	306	750	6		
5	1.30		167	14,310	269	750		Ignition @ 6.0% Nonignition @ 5.5%	750
5	1.00	70	155	14,730	276	1,250	6	Ignition @ 6.0% Nonignition @ 5.5%	1,250
3	2.50	95	165	15,900	298	1,250	4		
2	3.00	130							

For U.S. conversions:  $1 \text{ m}^2/\text{g} = 4884 \text{ ft}^2/\text{lb}$ ;  $1 \text{ g}/\text{m}^3 = 0.000062 \text{ lb}/\text{ft}^3$ ;  $1 \text{ bar}/\text{sec} = 14.5 \text{ psi}/\text{sec}$ ;  $1 \text{ bar}\cdot\text{m}/\text{sec} = 0.226 \text{ psi}\cdot\text{ft}/\text{sec}$ .

BET: surface area per unit mass; MEC: minimum explosible concentration; MIE: minimum ignition energy; LOC: limiting oxygen ( $\text{O}_2$ ) concentration.

Notes:

(1) The powders tested are representative samples produced by various manufacturers utilizing a variety of methods of manufacture, submitted for testing to a single, nationally recognized testing laboratory, at the same time.

(2) Data for each characteristic were obtained using the following ASTM methods: MEC: ASTM E1515, *Standard Test Method for Minimum Explosible Concentration of Combustible Dusts*; MIE: ASTM E2019, *Standard Test Method for Minimum Ignition Energy of a Dust Cloud in Air*; maximum pressure rise ( $P_{\text{max}}$ ), maximum pressure rise rate ( $dP/dt$ ), and deflagration index ( $K_{\text{St}}$ ): ASTM E1226, *Standard Test Method for Explosibility of Dust Clouds*; LOC: ASTM E2079, *Standard Test Methods for Limiting Oxygen (Oxidant) Concentration in Gases and Vapors*.

(3) Particle size data represent the  $d_{50}$  measurement determined by the laser light-scattering technique.

(4) Test results represent only the characteristics of those samples tested and should not be considered to be universally applicable. Users are encouraged to test samples of powders obtained from their individual process.

[484: Table A.4.3.1]



**Table A.5.2.2(j) Explosion Characteristics of Unalloyed Magnesium Dust in Air [200 mesh (75 µm)]**

Explosion Characteristics	Values
Explosibility index <sup>a</sup>	10
Ignition sensitivity <sup>b</sup>	3.0
Explosion severity <sup>c</sup>	7.4
Maximum explosion pressure (gauge)	793 kPa (115 psi)
Maximum rate of pressure rise (gauge)	793 kPa/sec (15,000 psi/sec)
Ignition temperature cloud	1040°F (560°C)
Minimum cloud ignition energy	0.04 J (26.4 W/sec)
Minimum explosion concentration	0.328 kg/m <sup>3</sup> (0.03 oz/ft <sup>3</sup> )
Limiting oxygen percent for spark ignition <sup>d</sup>	—

Note:  $K_{St}$  values vary for specific particle sizes.

<sup>a</sup>Explosibility index = ignition sensitivity × explosion severity.

<sup>b</sup>Ignition sensitivity =

$$\frac{\left[ \begin{array}{l} \text{Ignition temp. cloud} \times \text{min. cloud-ignition energy} \\ \times \text{min. explosion concentration (LEL)} \end{array} \right]}{\text{Pittsburgh coal dust}} \\ \frac{\left[ \begin{array}{l} \text{Ignition temp.} \times \text{min. cloud ignition energy} \\ \times \text{min. explosion concentration} \end{array} \right]}{\text{Sample dust}}$$

<sup>c</sup>Explosion severity =

$$\frac{\left[ \begin{array}{l} \text{Max. explosion pressure} \times \text{max. rate of pressure rise} \end{array} \right]}{\text{Pittsburgh coal dust}} \\ \frac{\left[ \begin{array}{l} \text{Max. explosion pressure} \times \text{max. rate of pressure rise} \end{array} \right]}{\text{Sample dust}}$$

<sup>d</sup>Burns in carbon dioxide, nitrogen, and halons.

[484: Table D.2]

**Table A.5.2.2(k) Selected Combustible Dusts Layer or Cloud Ignition Temperature**

Chemical Name	CAS No.	NEC Group	Code	Layer or Cloud Ignition Temperature (°C)
Acetal, linear		G	NL	440
Acetoacet-p-phenetidine	122-82-7	G	NL	560
Acetoacetanilide	102-01-2	G	M	440
Acetylamino-t-nitrothiazole		G		450
Acrylamide polymer		G		240
Acrylonitrile polymer		G		460
Acrylonitrile-vinyl chloride-vinylidenechloride copolymer (70-20-10)		G		210
Acrylonitrile-vinyl pyridine copolymer		G		240
Adipic acid	124-04-9	G	M	550
Alfalfa meal		G		200
Alkyl ketone dimer sizing compound		G		160
Allyl alcohol derivative (CR-39)		G	NL	500
Almond shell		G		200
Aluminum, A422 flake	7429-90-5	E		320
Aluminum, atomized collector fines		E	CL	550
Aluminum—cobalt alloy (60-40)		E		570
Aluminum—copper alloy (50-50)		E		830
Aluminum—lithium alloy (15% Li)		E		400
Aluminum—magnesium alloy (dowmetal)		E	CL	430

(continues)

Table A.5.2.2(k) *Continued*

Chemical Name	CAS No.	NEC Group	Code	Layer or Cloud Ignition Temperature (°C)
Aluminum—nickel alloy (58-42)		E		540
Aluminum—silicon alloy (12% Si)		E	NL	670
Amino-5-nitrothiazole	121-66-4	G		460
Anthranilic acid	118-92-3	G	M	580
Apricot pit		G		230
Aryl-nitrosomethylamide		G	NL	490
Asphalt	8052-42-4	F		510
Aspirin [acetol (2)]	50-78-2	G	M	660
Azelaic acid	109-31-9	G	M	610
Azo-bis-butyronitrile	78-67-1	G		350
Benzethonium chloride		G	CL	380
Benzoic acid	65-85-0	G	M	620
Benzotriazole	95-14-7	G	M	440
Beta-naphthalene-axo- dimethylaniline		G		175
Bis(2-hydroxy- 5-chlorophenyl) methane	97-23-4	G	NL	570
Bisphenol-A	80-05-7	G	M	570
Boron, commercial amorphous (85% B)	7440-42-8	E		400
Calcium silicide		E		540
Carbon black (more than 8% total entrapped volatiles)		F		
Carboxymethyl cellulose	9000-11-7	G		290
Carboxypolymethylene		G	NL	520
Cashew oil, phenolic, hard		G		180
Cellulose		G		260
Cellulose acetate		G		340
Cellulose acetate butyrate		G	NL	370
Cellulose triacetate		G	NL	430
Charcoal (activated)	64365-11-3	F		180
Charcoal (more than 8% total entrapped volatiles)		F		
Cherry pit		G		220
Chlorinated phenol		G	NL	570
Chlorinated polyether alcohol		G		460
Chloroacetoacetanilide	101-92-8	G	M	640
Chromium (97%) electrolytic, milled	7440-47-3	E		400
Cinnamon		G		230
Citrus peel		G		270
Coal, Kentucky bituminous		F		180
Coal, Pittsburgh experimental		F		170
Coal, Wyoming		F		180
Cocoa bean shell		G		370
Cocoa, natural, 19% fat		G		240
Coconut shell		G		220
Coke (more than 8% total entrapped volatiles)		F		
Cork		G		210
Corn		G		250
Corn dextrine		G		370
Corn cob grit		G		240
Cornstarch, commercial		G		330
Cornstarch, modified		G		200
Cottonseed meal		G		200
Coumarone-indene, hard		G	NL	520

Table A.5.2.2(k) *Continued*

Chemical Name	CAS No.	NEC Group	Code	Layer or Cloud Ignition Temperature (°C)
Crag No. 974	533-74-4	G	CL	310
Cube root, South America	83-79-4	G		230
Di-alpha cumyl peroxide, 40-60 on CA	80-43-3	G		180
Diallyl phthalate	131-17-9	G	M	480
Dicyclopentadiene dioxide		G	NL	420
Dieldrin (20%)	60-57-1	G	NL	550
Dihydroacetic acid		G	NL	430
Dimethyl isophthalate	1459-93-4	G	M	580
Dimethyl terephthalate	120-61-6	G	M	570
Dinitro-o-toluidide	148-01-6	G	NL	500
Dinitrobenzoic acid		G	NL	460
Diphenyl	92-52-4	G	M	630
Ditertiary-butyl-paracresol	128-37-0	G	NL	420
Dithane m-45	8018-01-7	G		180
Epoxy		G	NL	540
Epoxy-bisphenol A		G	NL	510
Ethyl cellulose		G	CL	320
Ethyl hydroxyethyl cellulose		G	NL	390
Ethylene oxide polymer		G	NL	350
Ethylene-maleic anhydride copolymer		G	NL	540
Ferbam™	14484-64-1	G		150
Ferromanganese, medium carbon	12604-53-4	E		290
Ferrosilicon (88% Si, 9% Fe)	8049-17-0	E		800
Ferrotitanium (19% Ti, 74.1% Fe, 0.06% C)		E	CL	380
Flax shive		G		230
Fumaric acid	110-17-8	G	M	520
Garlic, dehydrated		G	NL	360
Gilsonite	12002-43-6	F		500
Green base harmon dye		G		175
Guar seed		G	NL	500
Gulonic acid, diacetone		G	NL	420
Gum, arabic		G		260
Gum, karaya		G		240
Gum, manila		G	CL	360
Gum, tragacanth	9000-65-1	G		260
Hemp hurd		G		220
Hexamethylene tetramine	100-97-0	G	S	410
Hydroxyethyl cellulose		G	NL	410
Iron, 98% H2 reduced		E		290
Iron, 99% carbonyl	13463-40-6	E		310
Isotoic anhydride		G	NL	700
L-sorbose		G	M	370
Lignin, hydrolized, wood-type, fine		G	NL	450
Lignite, California		F		180
Lycopodium		G		190
Malt barley		G		250
Manganese	7439-96-5	E		240
Magnesium, grade B, milled		E		430
Manganese vancide		G		120
Mannitol	69-65-8	G	M	460
Methacrylic acid polymer		G		290
Methionine (l-methionine)	63-68-3	G		360
Methyl cellulose		G		340
Methyl methacrylate polymer	9011-14-7	G	NL	440
Methyl methacrylate-ethyl acrylate		G	NL	440

(continues)

Table A.5.2.2(k) *Continued*

Chemical Name	CAS No.	NEC Group	Code	Layer or Cloud Ignition Temperature (°C)
Methyl methacrylate-styrene- butadiene		G	NL	480
Milk, skimmed		G		200
N,N-dimethylthio- formamide		G		230
Nitropyridone	100703-82-0	G	M	430
Nitrosamine		G	NL	270
Nylon polymer	63428-84-2	G		430
Para-oxy-benzaldehyde	123-08-0	G	CL	380
Paraphenylene diamine	106-50-3	G	M	620
Paratertiary butyl benzoic acid	98-73-7	G	M	560
Pea flour		G		260
Peach pit shell		G		210
Peanut hull		G		210
Peat, sphagnum	94114-14-4	G		240
Pecan nut shell	8002-03-7	G		210
Pectin	5328-37-0	G		200
Pentaerythritol	115-77-5	G	M	400
Petrin acrylate monomer	7659-34-9	G	NL	220
Petroleum coke (more than 8% total entrapped volatiles)		F		
Petroleum resin	64742-16-1	G		500
Phenol formaldehyde	9003-35-4	G	NL	580
Phenol formaldehyde, polyalkylene-p	9003-35-4	G		290
Phenol furfural	26338-61-4	G		310
Phenylbetanaphthylamine	135-88-6	G	NL	680
Phthalic anhydride	85-44-9	G	M	650
Phthalimide	85-41-6	G	M	630
Pitch, coal tar	65996-93-2	F	NL	710
Pitch, petroleum	68187-58-6	F	NL	630
Polycarbonate		G	NL	710
Polyethylene, high pressure process	9002-88-4	G		380
Polyethylene, low pressure process	9002-88-4	G	NL	420
Polyethylene terephthalate	25038-59-9	G	NL	500
Polyethylene wax	68441-04-8	G	NL	400
Polypropylene (no antioxidant)	9003-07-0	G	NL	420
Polystyrene latex	9003-53-6	G		500
Polystyrene molding compound	9003-53-6	G	NL	560
Polyurethane foam, fire retardant	9009-54-5	G		390
Polyurethane foam, no fire retardant	9009-54-5	G		440
Polyvinyl acetate	9003-20-7	G	NL	550
Polyvinyl acetate/alcohol	9002-89-5	G		440
Polyvinyl butyral	63148-65-2	G		390
Polyvinyl chloride-diethyl phthalate		G	NL	320
Potato starch, dextrinated	9005-25-8	G	NL	440
Pyrethrum	8003-34-7	G		210
Rayon (viscose) flock	61788-77-0	G		250
Red dye intermediate		G		175
Rice		G		220
Rice bran		G	NL	490
Rice hull		G		220
Rosin, DK	8050-09-7	G	NL	390
Rubber, crude, hard	9006-04-6	G	NL	350
Rubber, synthetic, hard (33% S)	64706-29-2	G	NL	320
Safflower meal		G		210
Salicylanilide	87-17-2	G	M	610
Sevin	63-25-2	G		140



Table A.5.2.2(k) *Continued*

Chemical Name	CAS No.	NEC Group	Code	Layer or Cloud Ignition Temperature (°C)
Shale, oil	68308-34-9	F		
Shellac	9000-59-3	G	NL	400
Sodium resinate	61790-51-0	G		220
Sorbic acid (copper sorbate or potash)	110-44-1	G		460
Soy flour	68513-95-1	G		190
Soy protein	9010-10-0	G		260
Stearic acid, aluminum salt	637-12-7	G		300
Stearic acid, zinc salt	557-05-1	G	M	510
Styrene modified polyester-glass fiber	100-42-5	G		360
Styrene-acrylonitrile (70-30)	9003-54-7	G	NL	500
Styrene-butadiene latex (>75% styrene)	903-55-8	G	NL	440
Styrene-maleic anhydride copolymer	9011-13-6	G	CL	470
Sucrose	57-50-1	G	CL	350
Sugar, powdered	57-50-1	G	CL	370
Sulfur	7704-34-9	G		220
Tantalum	7440-25-7	E		300
Terephthalic acid	100-21-0	G	NL	680
Thorium (contains 1.2% O)	7440-29-1	E	CL	270
Tin, 96%, atomized (2% Pb)	7440-31-5	E		430
Titanium, 99% Ti	7440-32-6	E	CL	330
Titanium hydride (95% Ti, 3.8% H)	7704-98-5	E	CL	480
Trithiobisdimethylthio- formamide		G		230
Tung, kernels, oil-free	8001-20-5	G		240
Urea formaldehyde molding compound	9011-05-6	G	NL	460
Urea formaldehyde-phenol formaldehyde	25104-55-6	G		240
Vanadium, 86.4%	7440-62-2	E		490
Vinyl chloride-acrylonitrile copolymer	9003-00-3	G		470
Vinyl toluene-acrylonitrile butadiene	76404-69-8	G	NL	530
Violet 200 dye		G		175
Vitamin B1, mononitrate	59-43-8	G	NL	360
Vitamin C	50-81-7	G		280
Walnut shell, black		G		220
Wheat		G		220
Wheat flour	130498-22-5	G		360
Wheat gluten, gum	100684-25-1	G	NL	520
Wheat starch		G	NL	380
Wheat straw		G		220
Wood flour		G		260
Woodbark, ground		G		250
Yeast, torula	68602-94-8	G		260
Zirconium hydride	7704-99-6	E		270
Zirconium (contains 0.3% O)	7440-67-7	E	CL	330

## Notes:

(1) Normally, the minimum ignition temperature of a layer of a specific dust is lower than the minimum ignition temperature of a cloud of that dust. Since this is not universally true, the lower of the two minimum ignition temperatures is listed. If no symbol appears in the "Code" column, then the layer ignition temperature is shown. "CL" means the cloud ignition temperature is shown. "NL" means that no layer ignition temperature is available, and the cloud ignition temperature is shown. "M" signifies that the dust layer melts before it ignites; the cloud ignition temperature is shown. "S" signifies that the dust layer sublimates before it ignites; the cloud ignition temperature is shown.

(2) Certain metal dusts might have characteristics that require safeguards beyond those required for atmospheres containing the dusts of aluminum, magnesium, and their commercial alloys. For example, zirconium and thorium dusts can ignite spontaneously in air, especially at elevated temperatures.

(3) Due to the impurities found in coal, its ignition temperatures vary regionally, and ignition temperatures are not available for all regions in which coal is mined.

[499: Table 5.2.2]

**A.5.3** Some materials have multiple potential physical hazards such as combustibility, explosibility, reactivity, and propensity to self-heat. This standard does not specifically address reactivity hazards of solid particulate materials. Users should consult SDS for specific information and guidance on safe handling, personal protective equipment, and storage and transportation of chemicals.

**A.5.4.1.2** Results of the preliminary screening test can have one of the following four results:

- (1) No reaction
- (2) Glowing but no propagation along the powder train
- (3) Propagation, but too slow to include the test material in Division 4.1
- (4) Propagation sufficiently fast to qualify for inclusion in Division 4.1

If the results of the screening test show no reaction or glowing in the specific form, that material can be considered noncombustible and does not fall under the requirements of this document. If the results of the screening test show glowing but no propagation along the powder train, the material in the specific form should be considered a limited-combustible material. Hazard analysis should be conducted to determine the extent to which the requirements of this document are applicable.

It is recommended for general safety that the full requirements be met. If the results of the screening test show propagation of the powder train, the material in the specific form should be considered a limited-combustible material and full compliance with the requirements of this document be met. If the results of the screening test show propagation of the powder train sufficiently fast that the form is classified as a Division 4.1 material, hazard analysis should focus on additional protocols and compliance with other NFPA standards.

**A.5.4.3.2** Testing a worst-case (finest) particle size distribution will provide a conservative determination of the combustibility of the material. (See Table A.5.4.3.2.)

**A.5.4.3.3** Tests should typically be performed in accordance with the test standard recommendations. For example, most ASTM combustible dust test methods recommend testing the sample at less than 5 percent moisture by weight and particle size that is at least 95 percent sub-200 mesh (75  $\mu\text{m}$ ) screen by weight. This might require drying and grinding or sieving of samples. The thought behind this approach is to obtain near worst-case test data for accumulations that could be found within a facility [i.e., accumulations of dry fines, typically sub-200 mesh (75  $\mu\text{m}$ ), at some locations or changes in processes] and by doing so ensure conservatism in the hazard assessment and design of protection equipment.

This typically produces a built-in safety factor for the tests, as the testing laboratory does not know if the samples are a good representation of the dust from the facility. By performing the test in this manner, it typically assumes a worst-case scenario to account for dust accumulations not factored in by the facility.

On the other hand, testing material “as received” can result in a more realistic determination of the true nature of the hazard under assessment. Additionally, in some cases the as-received material could present a greater hazard than the dried fine fraction of the material. For instance, some samples might consist of a mixture of fine noncombustible material and coarse combustible material, where the fine fraction is a lower hazard than the as received material. Similarly, some

**Table A.5.4.3.2 Standard Test Methods to Determine Explosibility Properties**

Method	Property
ASTM E2019, <i>Standard Test Method for Minimum Ignition Energy of a Dust Cloud in Air</i>	Minimum ignition energy (MIE) of dust cloud in air
ASTM E1491, <i>Standard Test Method for Minimum Autoignition Temperature of Dust Clouds</i>	Minimum ignition temperature ( $T_i$ ) of dust clouds
ASTM E1226, <i>Standard Test Method for Explosibility of Dust Clouds</i>	Maximum explosion pressure ( $P_{max}$ ), rate and maximum rate of pressure rise ( $dP/dt$ ), and explosion severity ( $K_{St}$ )
ASTM E1515, <i>Test Method for Minimum Explosible Concentration of Combustible Dusts</i>	Minimum explosible concentration (MEC)
ASTM E2021, <i>Standard Test Method for Hot-Surface Ignition Temperature of Dust Layers</i>	Minimum ignition temperature ( $T_i$ ) of dust layers
ASTM WK1680, <i>Test Method for Limiting Oxygen (Oxidant) Concentration of Combustible Dust Clouds</i>	Limiting oxygen concentration (LOC)

water reactive materials could present a greater hazard with some moisture present than they would when dried. Determining the moisture content and particle size fraction of a dust sample is of considerable importance and should be done in consultation with experts or someone familiar with the process and material.

**A.5.4.3.5** Tests conducted on iron and titanium nanoparticles using the standard 20 L test method described in ASTM E1226, *Standard Test Method for Explosibility of Dust Clouds*, have resulted in ignitions in the sample auxiliary chamber and the injection piping rather than the test vessel, where pressures are measured. (See papers by Bouillard and Wu.)

Many nanoparticle materials are produced with special manufacturing equipment to obtain a narrow particle size distribution with a maximum particle size of 0.1  $\mu\text{m}$  (100 nm). However, there are some applications in which nanoparticles can be produced inadvertently. For example, micromilling or air attrition milling are processes that can create nanoparticles. In those infrequent cases where there is a mix of particles smaller and larger than 0.5  $\mu\text{m}$ , there do not seem to be test data to specify the precise percentage of nanoparticles needed to require special test methods or special interpretations of standard test data. Based on data for mixtures of inert and combustible dust particulates, an approximate percentage of at least 10 weight percent would be expected to produce results dominated by the more readily explosible material.

The applicability of other combustibility and explosibility test methods to nanoparticles has yet to be determined; therefore, no prescriptions are offered here. However, users of this standard should be aware of the possibility of special behavior of the nanoparticles.



**A.5.4.4.1** Refer to Table A.5.4.4.1 for standard test methods for determining explosibility characteristics of dusts that are used for the DHA, performance-based design method risk assessments, and hazard management of combustible dusts.

**Table A.5.4.4.1 Standard Test Methods to Determine Explosibility Properties**

Method	Property
ASTM E2019, <i>Standard Test Method for Minimum Ignition Energy of a Dust Cloud in Air</i>	Minimum ignition energy (MIE) of dust cloud in air
ASTM E1491, <i>Standard Test Method for Minimum Autoignition Temperature of Dust Clouds</i>	Minimum ignition temperature ( $T_c$ ) of dust clouds
ASTM E1226, <i>Standard Test Method for Explosibility of Dust Clouds</i>	Maximum explosion pressure ( $P_{max}$ ), rate and maximum rate of pressure rise ( $dP/dt$ ), and explosion severity ( $K_{St}$ )
ASTM E1515, <i>Test Method for Minimum Explosible Concentration of Combustible Dusts</i>	Minimum explosible concentration (MEC)
ASTM E2021, <i>Standard Test Method for Hot-Surface Ignition Temperature of Dust Layers</i>	Minimum ignition temperature ( $T_c$ ) of dust layers
ASTM WK1680, <i>Test Method for Limiting Oxygen (Oxidant) Concentration of Combustible Dust Clouds</i>	Limiting oxygen concentration (LOC)

ASTM E2021, *Standard Test Method for Hot-Surface Ignition Temperature of Dust Layers*, uses a constant temperature hot plate to heat the dust on one side only. Routine tests use a 12.7 mm (0.5 in.) thick layer, which might simulate a substantial build-up of dust on the outside of hot equipment. However, since the ignition temperature normally decreases markedly with increased dust layer thickness, the method allows layer thickness to be varied according to the application.

ASTM E2019, *Standard Test Method for Minimum Ignition Energy of a Dust Cloud in Air*, is used to determine the MIE for any given fuel concentration. The method uses the lowest energy, stored by a capacitor, that when released as a spark will ignite dust cloud-oxidant mixtures. By testing a range of concentrations, the lowest MIE is determined for the optimum mixture. Observed MIE and MIE values are highly sensitive to the test method, particularly the spark electrode geometry and characteristics of the capacitor discharge circuit. Dust ignition energy standard ASTM E2019 describes test methods in current use that have been found to yield comparable results; however, it is a “performance standard,” whereby the methodology adopted must produce data within the expected range for a series of reference dusts.

ASTM E1491, *Standard Test Method for Minimum Autoignition Temperature of Dust Clouds*, is used to determine the dust cloud autoignition temperature (AIT). The test involves blowing dust into a heated furnace set at a predetermined temperature. The dust concentration is systematically varied to find the lowest temperature at which self-ignition occurs at ambient pressure, known as the minimum autoignition temperature (MAIT). A vis-

ible flame exiting the furnace provides evidence for ignition. Four different furnaces are described in ASTM E1491 (0.27-L Godbert-Greenwald Furnace, 0.35-L BAM Oven, 1.2-L Bureau of Mines Furnace, and 6.8-L Bureau of Mines Furnace). Each yields somewhat different MAIT data, the largest deviations occurring at the greatest MAIT values. However, the lower AIT range is of more practical importance and here the agreement is better (for example  $265 \pm 25^\circ\text{C}$  for sulfur).

ASTM E1226, *Standard Test Method for Explosibility of Dust Clouds*, is used to determine the pressure and rate of pressure rise for suspended combustible dusts. The measurement of the explosibility parameters ( $P_{max}$  and  $K_{St}$ ) requires the reproducible generation of a near homogeneous dust cloud inside a containment vessel of known volume. The explosibility parameters  $P_{max}$  (maximum pressure) and  $K_{St}$  (maximum rate of pressure rise of the worst-case concentration times the cube root of the test volume) are obtained from such measurements. The determination of a  $P_{max}$  and  $K_{St}$  for a material first establishes that it is an explosible dust. A bench scale test method in ASTM E1226 involves a vessel at least 20 L in volume in which a dust cloud is formed using the discharge of a small cylinder of compressed air. After a prescribed time delay, the highly turbulent dust cloud is ignited using a strong ignition source of known energy. Pressure is monitored versus time by appropriate transducers and expressed as pressure,  $P_{ex}$ , and pressure rate of rise,  $dP/dt_{ex}$ . Dust concentration is varied to determine the maxima of both parameters. Particle size and moisture are other variables that must be considered. Particle size should be less than 75  $\mu\text{m}$  ensuring a design that is conservative.

The primary use of the test data  $P_{max}$  and  $K_{St}$  is for the design of explosion protection systems: venting, suppression, and isolation. Vent designs provide a relief area that will limit damage to the process equipment to an acceptable level. The required vent area is calculated using equations from NFPA 68 and requires knowledge of the process — volume, temperature, operating pressure, design strength, vent relief pressure — and of the fuel,  $P_{max}$  and  $K_{St}$ . Suppression is the active extinguishment of the combustion and again limits the explosion pressure to an acceptable level. Suppression designs require similar process and hazard data in order to determine the hardware requirements such as size, number, and location of containers, detection conditions, and the final or reduced explosion pressure. Isolation — the prevention of flame propagation through interconnections — requires the same process and hazard data to determine hardware needs and locations. The extent of testing should depend on what the scenario or evaluation such as explosion venting for a dust collector would require  $K_{St}$  and  $P_{max}$ .

Published data can be used for preliminary assessment only; they should not be used for design. While some materials are well-characterized, tables with explosibility properties often lack specific information such as particle size; therefore, it is recommended that literature values that do not provide particle size information be used with extreme caution. NFPA 61, NFPA 499, NFPA 68, and NFPA 484 have lists of combustible and explosible metals and dusts that are used for guidance or as informational references only and are not to be used for design purposes. Composition, particle size and distribution, and moisture content are the three factors known to strongly influence test results. It is recognized that some industries have historical data on the same material; therefore, the frequency, number, and extent of testing where historical data exists should be made by informed judgment. The owner/operator assumes the risk of using data from

tables and historical data. A person or team performing a DHA should scrutinize and make informed judgments about historical and published data and its applicability to the process.

**A.5.5.1.3(4)** Some materials are subject to change, such as oxidation or other chemical reaction, that could affect the test results. Precautions such as inerting or vacuum packing should be taken to preserve the test sample integrity. Other sample preservation considerations include the possibility of moisture reactions and polymerization reactions.

**A.5.5.2** If the dust sample is a mixture of organic, inorganic, or combustible metals, the amount or concentration of each constituent should be determined by laboratory analysis. Common methods for an analysis of mixture composition include material separation, mass fraction analysis, energy dispersive x-ray spectroscopy, Fourier transform infrared spectroscopy, inductively coupled plasma spectroscopy, and x-ray fluorescence spectroscopy. Unique chemical reactivity issues could include water reactivity, reactivity with extinguishing agents, or other mixture constituents, pyrophoricity, chemical instability, oxidizer, and so forth. For example, for a mixture that contains some metal powder or dust, its potential for water reactivity should be considered based on the safety data sheet (SDS) or other public or company resources. If the potential for water reactivity exists, the entire mixture should be analyzed to determine whether it is water reactive.

**A.5.5.3** Special consideration should be given to samples from equipment in facilities such as dust collectors, impact equipment, silos and bins, processing equipment, ovens, furnaces, dryers, conveyors, bucket elevators, and grain elevators.

If a sample is from a dust collection or pneumatic conveying system, the sample should be a representative of the hazard subject to evaluation.

Samples should be collected from rooms and building facilities where combustible dusts can exist, including rooms where abrasive blasting, cutting, grinding, polishing, mixing, conveying, sifting, screening, bulk handling or storage, packaging, agglomeration, and coating are performed.

Where there are numerous or a range of products and processes, worst-case samples can be used with DHA to assess the hazards. Performance-based design allows the user to identify and sample select materials instead of the prescriptive approach where all materials are collected and tested. Where multiple pieces of process equipment are present and contain essentially the same material, a single representative sample can be acceptable. While the composition can be constant, attrition and separation based on particle size should be assessed. If and where attrition occurs, samples should be collected from such process equipment from start to finish and representative of the material with reduced particle size. For example, a belt conveyor can have larger particles on the belt but finer dusts along the sides or under or at the bottom of the conveyor. The sampling plan should include samples of the accumulated fines as one sample and a sample from the center of the belt as a second separate sample. Material to be used for the screening tests and for the determination of material hazard characteristics such as  $K_{St}$ , MIE,  $T_c$ , and so forth, should be collected from the areas or inside equipment presenting the worst-case risk.

Some processes, such as grinding, require further evaluation. Grinding can result in a broad range of particle sizes. A representative sample should be tested. Combustible par-

ticulate solids include dusts, fibers, fines, chips, chunks, flakes, or mixtures of these. The term *combustible particulate solid* addresses the attrition of material as it moves within the process equipment. Particle abrasion breaks the material down and produces a mixture of large and small particulates, some of which could be small enough to be classified as dusts. Consequently, the presence of dusts should be anticipated in the process stream, regardless of the starting particle size of the material.

**A.5.5.4** Samples should be collected in a safe manner without introducing an ignition source, dispersing dust, or creating or increasing the risk of injury to workers.

**A.5.5.4.1** The more information about a sample that is collected and tested, the more useful it is to manage, monitor stability, or track changes in the process and materials where a hazard is present or absent. Changes in the process or materials that require further testing will have a baseline for explaining any difference in physical hazard. Any dust sample collected from on top of a press should be identified as different from a sample collected from inside a vessel or container if the sample is susceptible to chemical changes (i.e., oxidation, hygroscopic) over time.

**A.6.1.1** See A.4.2.4.

**A.6.1.2.1** The *SFPE Engineering Guide to Performance-Based Fire Protection Analysis and Design of Buildings* describes the documentation that will be provided for a performance-based design.

Proper documentation of a performance-based design is critical to design acceptance and construction. Proper documentation will ensure that all parties involved understand the factors necessary for the implementation, maintenance, and continuity of the fire protection design. If attention to detail is maintained in the documentation, there should be little dispute during approval, construction, startup, and use.

Poor documentation could result in rejection of an otherwise good design, poor implementation of the design, inadequate system maintenance and reliability, and an incomplete record for future changes or for testing the design forensically.

**A.6.1.3** Chapter 5 of NFPA 101 provides a more complete description of the performance-based design process and requirements. In addition, the *SFPE Engineering Guide to Performance-Based Fire Protection Analysis and Design of Buildings* outlines a process for developing, evaluating, and documenting performance-based designs.

**A.6.1.3.1** The sources, methodologies, and data used in performance-based designs should be based on technical references that are widely accepted and used by the appropriate professions and professional groups. This acceptance is often based on documents that are developed, reviewed, and validated under one of the following processes:

- (1) Standards developed under an open consensus process conducted by recognized professional societies, codes or standards organizations, or governmental bodies
- (2) Technical references that are subject to a peer-review process and published in widely recognized peer-reviewed journals, conference reports, or other publications
- (3) Resource publications, such as the *SFPE Handbook of Fire Protection Engineering*, are widely recognized technical sources of information





The following factors are helpful in determining the acceptability of the individual method or source:

- (1) Extent of general acceptance in the relevant professional community, including peer-reviewed publications, widespread citations in technical literature, and adoption by or within a consensus document
- (2) Extent of documentation of the method, including the analytical method itself, assumptions, scope, limitations, data sources, and data reduction methods
- (3) Extent of validation and analysis of uncertainties, including comparison of the overall method with experimental data to estimate error rates, as well as analysis of the uncertainties of input data, uncertainties and limitations in the analytical method, and uncertainties in the associated performance criteria
- (4) Extent to which the method is based on sound scientific principles
- (5) Extent to which the proposed application is within the stated scope and limitations of the supporting information, including the range of applicability for which there is documented validation, and considering factors such as spatial dimensions, occupant characteristics, and ambient conditions, which can limit valid applications

In many cases, a method will be built from and include numerous component analyses. Such component analyses should be evaluated using the same acceptability factors that are applied to the overall method, as outlined in items A.6.1.3.1(1) through A.6.1.3.1(5).

A method to address a specific fire or explosion safety issue, within documented limitations or validation regimes, might not exist. In such a case, sources and calculation methods can be used outside of their limitations, provided that the design team recognizes the limitations and addresses the resulting implications.

The technical references and methodologies to be used in a performance-based design should be closely evaluated by the design team, the AHJ, and possibly a third-party reviewer. The strength of the technical justification should be judged using criteria in items A.6.1.3.1(1) through A.6.1.3.1(5). This justification can be strengthened by the presence of data obtained from fire or explosion testing.

**A.6.1.4** Relevant aspects that could require a re-evaluation include, but are not limited to, changes to the following:

- (1) Information about the hazardous characteristics of the materials
- (2) Information about the performance capabilities of protective systems
- (3) Heretofore unrecognized hazards

Intentional changes to process materials, technology, equipment, procedures, and facilities are controlled by Section 9.9.

**A.6.1.6** As used in this section, maintenance includes the preventive maintenance required for the design features that are part of the performance-based design and the requirement to maintain the design itself.

**A.6.1.6.1** Design features, including protection methods and means and administrative controls, should be included in preventive maintenance programs to ensure their continued operability.

**A.6.1.6.2** This is not intended to prohibit future variations in the design features but only that when modified these features are again subject to AHJ review.

**A.6.3.1.1** When evaluating tenable conditions, the toxicity of hazardous materials released as a result of a fire or explosion should be considered.

**A.6.4** The dust hazard analysis conducted according to the requirement in Chapter 7 might be useful in identifying the scenarios for Section 6.4. The fire and explosion scenarios defined in Section 6.4 assume the presence of an ignition source, even those scenarios limited by administrative controls (such as a hot work permit program). It is the responsibility of the design professional to document any scenario that has been excluded on the basis of the absence of an ignition source.

**A.6.4.1.1** A compartment is intended to include the area within fire-rated construction.

**A.6.4.2.5** For instance, some combustible metals can generate hydrogen when in contact with water. See NFPA 484 for additional information.

**A.6.5.1** The SFPE *Engineering Guide to Performance-Based Fire Protection Analysis and Design of Buildings* outlines a process for evaluating whether trial designs meet the performance criteria.

**A.7.1** This chapter provides the minimum requirements for performing a hazard assessment to identify and analyze the hazards presented by the presence of combustible particulate solids for the purpose of identifying relevant management strategies necessary to provide a reasonable degree of protection to life and property.

The intent of this chapter is to establish a requirement to analyze the potential hazards of an operation regardless of size. The dust hazard analysis methodology is not necessarily the same as that in the OSHA process safety management (PSM) regulation and is not intended to trigger such a requirement. Annex B provides an example of how one might perform a DHA.

**A.7.1.2** A DHA is a careful review of the fire and explosion hazards to determine the consequences of what could go wrong and to determine what safeguards could be implemented to prevent or mitigate those consequences. DHA should be completed as soon as possible. For existing facilities, those processes with the greatest perceived risk should be evaluated first.

**A.7.1.2.2** It is not the intent of this requirement to permit a delay in the completion of all DHA until the third year.

**A.7.2.1** NFPA standards rely on the determination of “where an explosion hazard or deflagration hazard exists.” There are other physical and health hazards to consider such as toxicity, reactivity with water, and so forth that can be considered when conducting a DHA. The DHA should consider the four conditions that are required for a deflagration:

- (1) A combustible particulate solid of sufficiently small particle size to deflagrate
- (2) A combustible particulate solid suspended in air to deflagrate (or other oxidizing medium)
- (3) A combustion particulate solid suspension of sufficiently high concentration to deflagrate
- (4) A competent igniter applied to the suspension of combustible particulate solids where the concentration is sufficient for flame propagation.

A deflagration leading to an explosion will occur whenever all four criteria occur within a compartment or container at



the same time. Since gravity is a concentrating effect and we always assume an ignition source is present unless we can prove one cannot exist, even under conditions of equipment failure, this list reduces to:

- (1) A combustible particulate solid of sufficiently small particle size to deflagrate
- (2) A means for suspending the combustible particulate solid in air (or other oxidizing medium)
- (3) A sufficient concentration can be achieved

Most dust explosions occur as a series of deflagrations leading to a series of explosions in stages. While a single explosion is possible, it is the exception rather than the rule. Most injuries are the result of the “secondary” deflagrations rather than the initial event. Most “explosion” events are a series of deflagrations each causing a portion of the process or facility to explode. Primary deflagrations lead to secondary deflagrations, usually fueled by accumulated fugitive dust that has been suspended by the following:

- (1) Acoustic impulse waves of the initial, primary, deflagration
- (2) Entrainment by deflagration pressure front

The majority of the property damage and personnel injury is due to the fugitive dust accumulations within the building or process compartment. The elimination of accumulated fugitive dust is CRITICAL and the single most important criterion for a safe workplace.

**A.7.2.2** The qualified person who is leading or performing the DHA should be familiar with conducting a DHA. The qualified person should also be familiar with the hazards of combustible dusts. Typically, a team performs a DHA. For some processes this team may be a little as two persons, or for larger and more complex processes, the team might require a many more than two persons. This team is made of a variety of persons whose background and expertise can include the following:

- (1) Familiarity with the process
- (2) Operations and maintenance
- (3) Process equipment
- (4) Safety systems
- (5) History of operation
- (6) The properties of the material
- (7) Emergency procedures

The individuals involved in the DHA could include facility operators, engineers, owners, equipment manufacturers, or consultants.

**A.7.3.1(2)(b)** The hazard management document for all the areas of the process or facility compartment determined to be combustible dust hazards should include, but not be limited to, the following:

- (1) Test reports
- (2) Drawings
- (3) Sizing calculations

Methods to prevent or mitigate the consequences of combustible dust hazards can be developed by using the methods permitted in this standard or other industry- or commodity-specific NFPA standards. Subsection 7.3.1 outlines the minimum steps of a dust hazards analysis.

**A.7.3.3.1** This includes the process systems and ancillary equipment such as dust collection systems. Where multiple compartments present essentially the same hazard, a single evaluation might be appropriate.

**A.7.3.3.3** Each and every process component should be evaluated, including ducts, conveyors, silos, bunkers, vessels, fans, and other pieces of process equipment. Each point along the process should be described, and hazards at each point should be identified. Remedial measures for each hazard should be identified and documented. The means by which the hazard should be managed is then determined. Usually the relevant industry or commodity-specific NFPA standard will provide options. The process and process equipment will often determine which option is most appropriate. (*Refer to Annex B for an example of a process hazard analysis.*)

**A.7.3.4.2** Each and every facility compartment containing combustible particulate solids should be evaluated. The complete contents of the compartment should be considered, including hidden areas. Each area in the compartment should be described, and hazards at each point should be identified. Remedial measures for each hazard should be identified and documented. The means by which the hazard should be managed is then determined. Usually the relevant industry or commodity-specific NFPA standard will provide options. (*See Annex C.*)

**A.7.3.4.2.1** Refer to 6.1.1.3 and 6.1.1.8 of NFPA 654 and 6.4.2.2 of NFPA 664 for examples of methods to determine acceptable threshold accumulation level.

**A.8.2.2** It is preferable for buildings that handle combustible dust to be of either Type I or II construction, as defined by NFPA 220.

**A.8.2.3.1** Chapter 7 provides the process to determine where and whether a dust deflagration hazard exists. Section 8.2 is not intended to cover process equipment such as bins and silos.

**A.8.2.3.2** An enclosed means of egress is intended to be an exit separated from other parts of the building or building compartment as used in NFPA 101. Examples include exit stair enclosures and horizontal exit passageways.

**A.8.2.5.1** To the extent feasible and practical from a cost and sanitation standpoint, horizontal surfaces should be minimized to prevent accumulation of dust. Horizontal surfaces that can benefit from a sloped cover include girders, beams, ledges, and equipment tops. Overhead steel I-beams and similar structural shapes can be boxed with concrete or other non-combustible material to eliminate surfaces for dust accumulation. The additional weight of the box enclosures should be considered in the structural design. Surfaces should be as smooth as possible to minimize dust accumulations and to facilitate cleaning. One option based on clean design concepts is to construct the building walls so that the structural supports, electrical conduit, and so forth are on the exterior side of the building walls; therefore, the interior building compartment walls are smooth and less likely to collect fugitive dust.

**A.8.2.5.3** The space above suspended ceilings is an example of a space that is difficult to access for routine housekeeping. Periodic inspection of such spaces is necessary to ensure accumulations do not result in a deflagration hazard area.

**A.8.2.6.3.1** A building could be considered as a single combustible dust hazard area, or as a collection of smaller, separated combustible dust hazard areas. When the owner/operator chooses to consider the building as a single area, then the hazard analysis should consider the entire building floor area, and the considerations for mitigation apply to the

entire building. Where the combustible dust hazard areas are sufficiently distant to assert separation and the owner/operator chooses to consider each hazard area separately, the hazard analysis should consider each separated area, and the considerations for mitigation should be applied to each area independently. Due consideration should be given to overhead dust accumulations, such as on beams or ductwork, which would negate the use of separation to limit combustible dust hazard areas. If the separation option is chosen, a building floor plan, showing the boundaries considered, should be maintained to support housekeeping plans.

**A.8.2.6.3.2** Separation distance is the distance between the outer perimeter of a primary dust accumulation area and the outer perimeter of a second dust accumulation area. Separation distance evaluations should include the area and volume of the primary dust accumulation area as well as the building or room configuration.

**A.8.2.6.3.5** The assertion of separation must recognize the dust accumulation on all surfaces in the intervening distance, including floors, beam flanges, piping, ductwork, equipment, suspended ceilings, light fixtures, and walls. Process equipment or ductwork containing dust can also provide a connecting conduit for propagation between accumulation areas. In order to prevent flame propagation across the separation distance, the dust accumulation should be very low. The National Grain and Feed Association study, *Dust Explosion Propagation in Simulated Grain Conveyor Galleries*, has shown that a layer as thin as 1/100 in. is sufficient to propagate flame in a limited expansion connection, such as an exhaust duct or a hallway. In the subject study, the flame propagated for at least 80 ft (24.4 m) in a gallery 8 ft (2.4 m) tall by 8 ft (2.4 m) wide.

**A.8.2.6.4.2** Detachment distance is the radial distance between nearest points of two unconnected adjacent buildings.

**A.8.3.1** A means to determine protection requirements should be based on a risk assessment, with consideration given to the size of the equipment, consequences of fire or explosion, combustible properties and ignition sensitivity of the material, combustible concentration, and recognized potential ignition sources. Where multiple protections are prescriptively required, a risk assessment could determine that an adequate level of safety can be achieved with only some, or possibly none, of the prescribed protective measures. More specifically, while ignition source control without consideration of the potential consequences is generally not an accepted primary means of explosion protection, a risk assessment (which by definition requires consideration of the consequences) could determine that ignition source control provides an acceptable level of safety.

**A.8.3.3** All three of these types of systems commonly utilize air (or inert gases) to convey the combustible dusts from one location to another. However, each of the systems has unique design, function, and operational characteristics that are significantly different from each other. Each of these types of systems, due to these factors, represents a different level of risk that must be considered when used.

Compared to typical dust collection systems and centralized vacuum cleaning systems handling combustible dusts, typical dilute and dense phase pneumatic conveying systems represent a significantly lower deflagration risk. However, that does not mean there is not a deflagration risk present. Risk assessment should be used to determine the level of risk involved and the correct means to minimize that risk.

**A.8.3.3.1.1** The system information and documentation should include the following:

- (1) System design specifications
- (2) System installation specifications
- (3) Equipment specifications
- (4) Operational description
- (5) System deflagration protection and specifications, including explosibility information
- (6) System mechanical and electrical drawings
- (7) System controls and specifications

The design of these systems should be coordinated with the architectural and structural designs of the areas involved.

**A.8.3.3.1.2** Pneumatic conveying and dust collection systems are designed for specific conveying requirements. Changing any of those requirements can significantly change the ability of the system to provide the original design performance. An analysis of any proposed changes should be done to assure the system will still be able to perform as required to meet safety and operational requirements.

**A.8.3.3.1.3** The minimum velocity specified in the design for each of these systems differs significantly. Refer to the specific sections for each type of system for that information. For guidance on designing, acquisition, operation, and maintenance of dust collection systems, refer to ACGIH, *Industrial Ventilation: A Manual of Recommended Practice*.

**A.8.3.3.1.4** The requirements in 8.3.3.1.4 are applicable to dilute phase pneumatic conveying systems. Dense phase systems require a separate analysis.

**A.8.3.3.1.4.2** Some chemical and plastic dusts release residual flammable vapors such as residual solvents, monomers, or resin additives. These vapors can be released from the material during handling or storage. Design of the system should be based on a minimum airflow sufficient to keep the concentration of the particular flammable vapor in the airstream below 25 percent of the LFL of the vapor.

**A.8.3.3.2** There is a wide variety in the types of pneumatic conveying systems used for the transfer of combustible particulates from one or more locations to a single or multiple locations. These types include, but are not limited to, dilute, dense, and semi-dense phase with varying levels of vacuum (negative pressure) or positive pressure used in each case.

The current historical data and operational characteristics of these systems combine to offer the user an alternative that can provide a safer alternative to other, more risk-inherent methods of conveying the combustible particulate solid. Properties of the particulate solid, beyond just the explosibility parameters, should be considered in design and feasibility of the use of pneumatic conveying for a particular application and material.

**A.8.3.3.2.1** Properties can include the following:

- (1) Bulk density
- (2) Data on the range of particulate size
- (3) Concentration in conveying air/gas stream
- (4) The potential for reaction between the transported particulate and the extinguishing media used to protect the process equipment systems
- (5) Conductivity of the particulate
- (6) Other physical and chemical properties that affect the fire protection of the process and equipment systems.

**A.8.3.3.2.2** Rotary valves and diverter valves are not addressed within the ASME *Boiler and Pressure Vessel Code* or ASME B.31.3, *Process Piping*, so they would not be required to comply with those codes.

**A.8.3.3.2.3** Where a raw material or supply transport vehicle or container is connected to a pneumatic conveying system, it is considered a part of the pneumatic conveying system with regard to explosion protection requirements. As such, the requirements of isolation should be evaluated for this type of situation to determine if isolation is needed to protect the conveying system from the raw material supply. It is preferable to locate the filter receivers outside; however, this is often not feasible. Therefore, since deflagration hazards do exist, it is typically necessary to provide the proper protection for deflagration in the filter receiver (AMS) and propagation through the system.

**A.8.3.3.3** Dust collection systems for combustible dusts represent a significant increase in deflagration risk compared to most pneumatic conveying systems. This is due to the inherent design and operational characteristics of dust collection systems. A properly designed system is critical to minimizing that risk. For guidance on determining proper dust collection system design refer to ACGIH, *Industrial Ventilation: A Manual of Recommended Practice*.

**A.8.3.3.3.1** Proper dust collection design requires that a minimum air volume flow be maintained for each dust collection source point (hood). This value must be determined as part of the design process. This value should be documented to allow for field-testing to determine if the system is providing that flow and operating properly.

This design also requires that the hood be constructed to assure that a continuous airflow is provided at all times.

The ACGIH, *Industrial Ventilation: A Manual of Recommended Practice* has extensive information on the design basis for dust collection hoods and the necessary minimum air volumes and velocities to assure the containment, capture (i.e., collection), and control of the aerated dusts being generated.

**A.8.3.3.3.2** Proper dust collection design requires that a minimum air volume flow be maintained for each dust collection source point (e.g., hood). This value must be determined as part of the design process. This value should be documented to allow for field-testing to determine if the system is providing that flow and operating properly.

**A.8.3.3.3.3** Proper system design requires that airflows in the various branch lines be balanced to assure minimum air volume flow at each dust source collection point. When a branch line is disconnected, blanked off, or otherwise modified it changes the airflows in all the other branches of the system. This can lead to an imbalance of air flows that result in flows below the minimum required to keep the dust from accumulating in the ducts.

Use of manual slide or “blast” gates is not recommended. Use of such gates can lead to uncontrolled modification of the flow volumes for both a single line and the system as a whole. The results often lead to improper balance of the system airflows and material accumulations in the ducts. Proper design methods inherently assure minimum airflows and duct velocities without the use of manual slide or “blast” gates.

**A.8.3.3.3.4** Installation of branch lines for additional dust sources to an existing dust collection system will result in lower air volumes and duct velocities for the existing portions of the

system. Without providing for additional system performance this can result in a system performing below the minimum required for keeping the ducts free from material accumulations.

**A.8.3.3.3.5** Examples of operations that under normal operating conditions could generate flames, sparks, or hot material can include grinding, saws, etc. This section is intended to segregate the equipment and operations that are recognized ignition sources from those that are not.

**A.8.3.3.3.6** Combustible dusts vary considerably in their characteristics and the type of equipment necessary to separate them from the conveying air or gas stream. While the typical bag or cartridge dust collector (AMS) can be used with most combustible dusts, an exception would be most metal dusts, which can require a scrubber or wet collector. Refer to NFPA 484 for metal dust collection.

**A.8.3.3.3.7** The majority of dust collection systems use centrifugal fans for inducing the air flow through the system. Various models are available that will provide the performance characteristics required. Care must be taken to consider the worst-case situation, when the filters are nearly blinded or the scrubber is at maximum differential, as well as the situation where the system is new during start-up.

**A.8.3.3.3.8** The importance of locating the control equipment so that personnel operating the AMS are safe can be illustrated by the following conditions:

- (1) Where there is no explosion protection for the dust collector, the personnel operating the AMS would potentially be at risk.
- (2) Where the AMS is provided with deflagration venting, NFPA 68 describes the danger zone resulting from the actuation of the vent.

To address the above situations, it is possible to provide blast protection for personnel who must be in the danger zone.

**A.8.3.3.4** A centralized vacuum cleaning system represents a significant deflagration risk due to the fact that it is designed to both collect and convey combustible dusts, and that tramp metals and other foreign materials, which could create an ignition source, can enter the system through the vacuum cleaning process. However, through proper design and protection of the system against deflagration, this system can provide for the removal of combustible dusts from plant areas where dust accumulations represent a risk to personnel and property. In addition, the dust removed through the vacuum cleaning process will now be located in an area where it can be properly handled with minimal risk.

**A.8.3.3.4.1** It is recommended that no more than two simultaneous operators (hose vacuuming stations) be allowed on any one line to the AMS (a.k.a. filter receiver). This is to assure that adequate conveying velocity can be maintained with just a single operator on the same line. Multiple lines to the AMS can be used to allow for more than two simultaneous operators on the whole system (with no more than two simultaneous operators allowed on each line).

The minimum conveying velocity will vary with the combustible dusts being conveyed. Typically, the minimum conveying velocities should be the same as the minimum required for pneumatic conveying of the same material.

**A.8.3.3.4.2** It is recommended that 1.5 in. (38.1 mm) and/or 2.0 in. (50.8 mm) I.D. hoses be used for housekeeping pur-





poses. It is also recommended that 25 ft (7.6 m) maximum hose length be used. In most systems the pressure losses (i.e., energy losses) through the hose represent more than 50 percent of the overall system differential pressure requirements. Shorter hose lengths can be used to improve system performance.

Hoses of 1.5 in. (38.1 mm) I.D. are most commonly used for cleaning around equipment and for lighter duty requirements, while 2 in. (50.8 mm) I.D. hoses are used for larger dust accumulations and for cleaning large open areas.

**A.8.3.3.4.3** Ignition-sensitive materials typically have an MIE of 30 mJ or less.

**A.8.3.3.4.4** The creation of static electrical charges is a risk factor that can be minimized through the use of conductive vacuum cleaning tools and static dissipative and grounded hoses. This is a higher risk factor when low MIE combustible dusts are being vacuumed. Metal dusts represent a significantly increased risk when vacuum cleaning and require additional considerations as stated in NFPA 484.

**A.8.3.4.1.1** See NFPA 68 for guidance on calculating the dirty side volume.

**A.8.3.5.2** This section is in reference to closed-loop pneumatic conveying systems.

**A.8.3.5.3** Recommended design, maintenance, and operating guidelines for recirculation of industrial exhaust systems, as described in Chapter 7 of the ACGIH *Industrial Ventilation: A Manual of Recommended Practice*, should be followed.

**A.8.3.5.3(2)** The system should be designed, maintained, and operated according to accepted engineering practice, and the air-material separator efficiency should be sufficient to prevent dust in the recycled air from causing hazardous accumulations of combustible dust in any area of the building.

**A.8.3.5.3(3)** OSHA has established limits on oxygen concentration in the workplace. Permissible limits range from no lower than 19.5 percent by volume to no higher than 23.5 percent by volume in air. See 29 CFR 1910.146.

#### **A.8.4.2 Model Programs Annex. (Reserved)**

**A.8.4.2.1.1** Items that should be included in the housekeeping procedure include the following:

- (1) A risk assessment that considers the specific characteristics of the dust being cleaned (particle size, moisture content, MEC, MIE) and other safety risks introduced by the cleaning methods used
- (2) Personal safety procedures, including fall protection when working at heights
- (3) Personal protective equipment (PPE), including flame-resistant garments in accordance with the hazard analysis required by NFPA 2113
- (4) Cleaning sequence
- (5) Cleaning methods to be used
- (6) Equipment, including lifts, vacuum systems, attachments, and so forth
- (7) Cleaning frequency

**A.8.4.2.1.2** For information on selection of housekeeping methods refer to FM 7-76, Section 2.2.4, Operation and Maintenance. Other factors can be considered in the selection of a housekeeping method, such as the effectiveness of or compatibility of certain methods with the material.

**A.8.4.2.2.1** If a large quantity of material is spilled in an unclassified area, the bulk material should be collected by sweeping or shoveling or with a portable vacuum cleaner listed as suitable for Class II locations. Vacuum cleaners meeting the requirements in 8.4.2.2.1 can be used to clean up residual material after the bulk of the spill has been collected.

**A.8.4.2.2.1(6)** Liquids or wet material can weaken paper filter elements causing them to fail, which can allow combustible dust to reach the fan and motor.

**A.8.4.2.2.2** The Committee is not aware of vendors providing equipment listed for Class III electrically classified (hazardous) locations. A common practice is to use equipment listed for Class II in areas classified as Class III.

**A.8.4.2.3** With manual cleaning, such as using a scoop and brush, generating a dust cloud should be avoided. Where appropriate for the specific commodity, the use of natural bristle brushes should be considered to reduce the risk of static sparking.

**A.8.4.2.4** Use of high-pressure water can generate dust clouds, and care should be taken when using this method. Use of water wash-down for some metal dusts can result in hydrogen generation. Refer to NFPA 484 for restrictions on the use of water wash-down.

**A.8.4.2.4.3** Examples of additional precautions to be taken can include, but are not limited to, the following:

- (1) Operating management has full knowledge of and has granted approval for the use of water.
- (2) Ventilation, either natural or forced, is sufficient to maintain concentrations of flammable or toxic gasses at safe levels.
- (3) Complete drainage of all water effluent to a safe, contained area is available.

**A.8.4.2.6.1** Compressed air blowdown used for cleaning purposes has been demonstrated to present significant hazards and should be employed when other cleaning methods present higher risk. Compressed air blowdown does not remove accumulated dust, it simply moves the dust to another area, which will then have to be cleaned. It is preferable to use engineering design controls to eliminate areas that can be inaccessible or difficult to clean by other methods.

**A.8.4.2.6.2** All of the listed precautions might not be required for limited use of compressed air for cleaning minor accumulations of dust from machines or other surfaces between shifts. A risk assessment should be conducted to determine which precautions are required for the specific conditions under which compressed air is being used.

**A.8.4.6.1** Surfaces on which dust can accumulate can include walls, floors, and horizontal surfaces, such as equipment, ducts, pipes, hoods, ledges, beams, and above suspended ceilings and other concealed surfaces such as the interior of electrical enclosures.

Factory Mutual recommends that surfaces should be cleaned frequently enough to prevent hazardous accumulations (FM Data Sheet 7-76, *Prevention and Mitigation of Combustible Dust Explosives and Fire*, 2.3.5). Housekeeping for fugitive dusts is most important where the operational intent is that the dust accumulations are not normally present in the occupancy and the building has no deflagration protection features, such as damage limiting/explosion venting construction or classified electrical equipment, and additional

personal protection from dust deflagration hazards is also not provided. Factors that should be considered in establishing the housekeeping frequency include the following:

- (1) Variability of fugitive dust emissions
- (2) Impact of process changes and non-routine activities
- (3) Variability of accumulations on different surfaces within the room (i.e., walls, floors, overheads)

**A.8.4.6.3** One example of a transient release of dust is a temporary loss of containment due to a failure of a seal in process equipment or conveying systems. Table A.8.4.6.3 provides an example of an unscheduled housekeeping procedure to limit the time that a local spill or transient releases of dust are allowed to remain before cleaning the local area to less than the threshold housekeeping dust accumulation. The “level accumulation” of combustible dust should be established in the housekeeping program based on the risk of flash fires and secondary explosions from the dust hazard analysis.

**Table A.8.4.6.3 Unscheduled Housekeeping**

Level Accumulation	Longest Time to Complete Unscheduled Local Cleaning of Floor-Accessible Surfaces (hours)	Longest Time to Complete Unscheduled Local Cleaning of Remote Surfaces (hours)
1	8	24
2	4	12
3	1	3

**A.8.4.7.1** Typically, the housekeeping effectiveness is verified on an annual basis or after a significant change in the operation. If transient releases are becoming more frequent, the housekeeping effectiveness and equipment integrity should be verified.

**A.8.5.1** It is not always possible or practical for existing facilities to be in compliance with the new provisions of a standard at the effective date of that standard. Therefore, “retroactivity” in 8.5.1 means that a plan should be established to achieve compliance within a reasonable time frame.

**A.8.5.2** A means to determine protection requirements should be based on a risk assessment, with consideration given to the size of the equipment, consequences of fire or explosion, combustible properties and ignition sensitivity of the material, combustible concentration, and recognized potential ignition sources. Where multiple protections are prescriptively required, a risk assessment could determine that an adequate level of safety can be achieved with only some, or possibly none, of the prescribed protective measures. More specifically, while ignition source control without consideration of the potential consequences is generally not an accepted primary means of explosion protection, a risk assessment (which by definition requires consideration of the consequences) could determine that ignition source control provides an acceptable level of safety.

**A.8.5.3.1** Hot work activities include the following:

- (1) Cutting and welding
- (2) Other maintenance, modification, or repair activities involving the application of an open flame or the generation of hot sparks.

**A.8.5.3.2** The hot work area specified in NFPA 51B is 11 m (35 ft).

**A.8.5.4.2** Consensus standard hot surface dust layer ignition temperature tests include ASTM E2021, *Standard Test Method for Hot-Surface Ignition Temperature of Dust Layers*, and IEC 61241-2-1, *Electrical Apparatus for Use in the Presence of Combustible Dust — Methods for Determining the Minimum Ignition Temperatures of Dust*. The dust layer thickness used in these tests is nominally 1.27 cm (0.5 in.). Thicker dust layers produce lower hot surface ignition temperatures.

**A.8.5.5.2** The intent of this requirement is to address bearings that can have accumulations of dust on them or be in a suspended dust cloud. The concern is that if the bearing overheats it can present an ignition source to the dust cloud or the dust layer.

Such equipment can include, but is not limited to, the following:

- (1) Bucket elevator head and boot areas
- (2) Particulate size-reduction equipment
- (3) Blenders
- (4) Belt-driven fans where combustible dust is present

In addition to monitoring bearing temperatures directly, precursors to bearing or shaft overheating can also provide early warnings of bearing or shaft deterioration. These precursors include excessive shaft vibration or speed reduction. Monitoring can consist of periodic manual checks, installed devices, or automated monitoring.

**A.8.5.5.4** The risk assessment should include the potential for propagation of an explosion from an unmonitored unit.

**A.8.5.6.1** The best method to eliminate the need for electrically classified areas is to prevent the release of dust from equipment. The next best method to eliminate the need for electrically classified areas is to remove the dust by developing proper housekeeping procedures. If the release of dust from equipment, cannot be prevented or the dust cannot be cleaned up, then that area might be an electrically classified area. NFPA 499 can be used for guidance to supplement the criteria in Article 500.5 of *NFPA 70*. This guidance depends on a determination of the combustibility of dust in a particular area, the ignitability properties of the dust, and the nature of possible dust cloud formation and dust layer accumulations within and outside the electrical equipment near the dusts. NFPA 499 is a good source for guidance on identifying Class III areas.

The user of this document should be aware that the dust layer accumulation criteria in Articles 500–505 of *NFPA 70* and NFPA 499 is intended to address electrical ignition hazards due to overheating or shorting of electrical equipment. The threshold housekeeping dust accumulation criteria in this standard are based on a dust flash-fire or dust deflagration hazard. These differing criteria can lead to different layer depth requirements. It is possible that even where electrically classified equipment is installed the area can still be considered a flash-fire or deflagration hazard.

**A.8.5.6.1.1** Local signage or floor indications should be considered. Having local floor signage provides the every-



day operators and anyone else who would be in the facility with the awareness of the electrically classified areas. Knowledge of electrically classified areas gives anyone over the lifetime of the facility the awareness of immediate hazards within the facility.

**A.8.5.6.4** NFPA 70B contains recommendations on the development of an effective electrical equipment maintenance program. NFPA 70 Article 502.15 contains descriptions of seals for electrical enclosures and fittings. The description includes a requirement that sealing fittings be accessible. This requirement is intended to include cabinets and other enclosures such as MCCs, control panels, and main switch gear, but not conduit, raceways, junction boxes, or other similar equipment.

**A.8.5.6.5** Article 502 of NFPA 70 permits the use of Zone 20 equipment installation in a Class II, Division 1, location for the same dust. If the dust is a metal dust and not a combustible metal dust according to the test methods for Group IIIC, based on a conductivity criterion, this would potentially have equipment identified for Group IIIB (suitable for nonconductive dusts) installed in a Class II, Division 1, Group E, location. This would definitely not be appropriate. Contrary to the general statement in 506.6(A) of NFPA 70, a metal dust could be in Division Group E but not be conductive enough to be in Zone Group IIIC.

Another discrepancy in the requirements for zone classification versus division classification is that Article 506 of NFPA 70 provides no limitation on the designation of Zone 22 locations for combustible metal dusts. Under the division system in Article 500.5(C)(1)(3), where there is Group E metal dust in hazardous quantities, the location would be classified as Division 1 and would not be permitted to be classified as Division 2. Under the zone system, the less protective Zone 22 could be chosen.

Both of these discrepancies are nonconservative in comparison to the division classification system. While the NEC has established a framework for the use of zone classification for dusts, these nonconservative discrepancies in the boundaries between dust groups and area classification zones/divisions must be resolved before applying these concepts to industrial situations. The NFPA ECA committee had previously coordinated the boundaries between zone and division for gases but has not yet addressed this significant issue for dusts. Until these discrepancies can be addressed, NFPA 652 should not permit the application of zone classification for combustible dusts in industrial occupancies.

**A.8.5.7.1.1** See NFPA 77 for equipment component conductivity specifications and measurement methods.


**A.8.5.7.1.2(3)** ASTM E2019, *Standard Test Method for Minimum Ignition Energy of a Dust Cloud in Air*, is a test method for determining particulate and dust MIE.

**A.8.5.7.1.2(5)** The potential for propagating brush discharges exists where nonconductive materials with breakdown voltages exceeding 4 kV are exposed to processes that generate strong surface charges such as pneumatic conveying. Such discharges do not occur where the breakdown voltage is less than 4 kV.

**A.8.5.7.1.3** Where the bonding and grounding system is all metal, resistance in continuous ground paths typically is less than 10 ohms. Such systems include those having multiple components. Greater resistance usually indicates that the

metal path is not continuous, usually because of loose connections or corrosion. A permanent or fixed grounding system that is acceptable for power circuits or for lightning protection is more than adequate for a static electricity grounding system.

See Figure A.8.5.7.1.3 for illustrations of bonding and grounding principles.

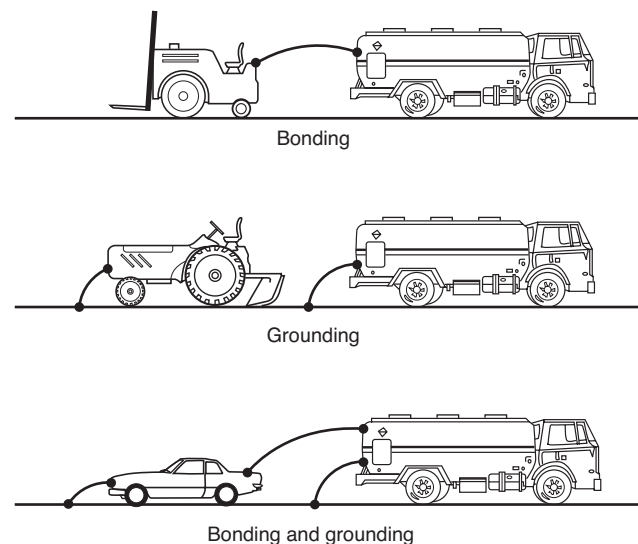

**FIGURE A.8.5.7.1.3 Bonding and Grounding.**

**A.8.5.7.1.4.3** Propagating brush discharges, which are generally considered to be the most energetic type of electrostatic discharge, do not produce discharge energies in excess of 2000 mJ.

**A.8.5.7.2.1** The limit on particulate discharge rates is due to concern about possible generation of charge accumulation during rapid transport and the subsequent potential for a bulking brush discharge. From Britton, Section 2-6.3.2 in *Avoiding Static Ignition Hazards in Chemical Operations*, the minimum size of a container for bulking brush discharges to occur has not been established, but is probably about 1 m<sup>3</sup>.

This section presumes that there are sufficient fine, suspendable particulates in the material so that the head space of the vessel being filled is at or above the MEC during the filling operation. Fine particulates are typically less than 200 mesh (0.075 mm).

**A.8.5.7.2.1(1)** The maximum electrostatic discharge energy from a bulking brush discharge energy is about 20 mJ. (See Britton, *Avoiding Static Ignition Hazards in Chemical Operations*.)

**A.8.5.7.2.1(2)** The threshold high electrical volume resistivity is usually considered to be  $1.0 \times 10^{10}$  ohm-m. Additional information on electrical resistivity can be found in *Avoiding Static Ignition Hazards in Chemical Operations* by L. Britton, with the values for common materials listed in Appendix B.

**A.8.5.7.2.2** The maximum electrostatic discharge energy from a bulking brush discharge energy is about 20 mJ (see Britton, *Avoiding Static Ignition Hazards in Chemical Operations*).

**A.8.5.7.2.2(1)** The limit on material transport or discharge rates for large particulates that contain no fines into a vessel that contains fines is due to the potential of dust clouds that could still be present in the headspace of the vessel from the

previous loading of the fine material or from the influx of the large material causing the fine material to be suspended into the headspace and then subsequently ignited by a bulking brush discharge.

**A.8.5.7.2.2(2)** The limit on material transport or discharge rates for large particulates when fine material is added to the vessel later is due to the possibility of a bulking brush discharge occurring in the vessel and the introduction of fine material could create a combustible atmosphere and be ignited by the bulking brush discharge. The time required for any charge on the large particulate to dissipate depends on the material properties, dimensions of the vessel, and a variety of other factors. A hazard assessment could be performed to determine the time after the large particulate has been added in which it would be safe to add the fine material.

**A.8.5.7.2.3** In *Electrostatic Hazards in Powder Handling*, Glor recommends the following limitations on hopper/silo/equipment filling rates for high-resistivity ( $>10^{10}$  ohm-m) powders that can produce bulking brush discharges. In the case of powders in the presence of granules with a diameter of several millimeters, Glor recommends the filling rate be less than 2000 to 5000 kg/hr (0.56 to 1.4 kg/s). For particles with diameters larger than 0.8 mm, he recommends maximum filling rates of 25,000 to 30,000 kg/hr (6.9 to 8.3 kg/s).

**A.8.5.7.3** NFPA 77 provides guidance on how to ground personnel. The most common methods of personnel grounding are through conductive flooring and footwear or through dedicated personnel-grounding devices such as wrist straps. Grounding devices should provide a resistance to ground between  $10^6$  and  $10^8$  ohms. The lower resistance limit ( $10^6$  ohms) is specified to protect personnel from electrocution due to inadvertent contact with energized electrical equipment, while the upper resistance limit ( $10^8$  ohms) is specified to ensure adequate charge dissipation. Grounding devices should be tested regularly, and cleaning should be performed to ensure that accumulations of noncombustible residues do not interfere with continuity.

**A.8.5.7.3.1** The user should expect that activities such as pouring, unloading, and transferring dusts can lead to the development of an ignitable atmosphere above the settled material in the receiving vessel.

**A.8.5.7.3.2(2)** Based on information in Britton, *Avoiding Static Ignition Hazards in Chemical Operations*, the maximum reasonable discharge energy from a person is estimated to be approximately 25 mJ. Where the MIE of the dust cloud is greater than 30 mJ, personnel grounding provides no risk reduction. MIE is dependent on particle size, so it is important to determine the MIE value on the particle size distribution that is likely to remain airborne during the operation. Since large particles will quickly fall out of suspension, the sub-75  $\mu$  fraction of the material (or material passing through a 200-mesh sieve) is typically tested for this purpose. Where a bulk material includes larger particles, the sub-75  $\mu$  MIE may be significantly lower than the bulk material MIE. ASTM E2019-03, *Standard Test Method for Minimum Ignition Energy of a Dust Cloud in Air*, is the test method for determining particulate and dust MIE.

**A.8.5.7.4** A more detailed description of FIBC ignition hazards can be found in IEC 61340-4-4, *Electrostatics—Part 4-4: Standard Test Methods for Specific Applications—Electrostatic Classification of Flexible Intermediate Bulk Containers (FIBC)*.

**A.8.5.7.4.1** Induction charging of ungrounded conductive objects, including personnel, should be addressed as part of the dust hazard analysis. The DHA should also consider that higher rates of transfer into and out of the FIBC increase the rate of charge generation. Consideration should also be given to the possibility of surface (cone) discharges while the FIBC is being filled, regardless of FIBC type.

For additional information on these phenomena, refer to NFPA 77. The use of internal liners in FIBCs can introduce additional electrostatic ignition hazards and should be subject to expert review prior to use.

**A.8.5.7.4.2.2** For this application, conductive particulate solids typically are those materials having bulk resistivity less than  $10^6$  ohm-m.

**A.8.5.7.4.3.2** See A.8.5.7.4.2.2.

**A.8.5.7.4.6** Table A.8.5.7.4.6 provides a useful guide for the selection and use of FIBCs based on the MIE of product contained in the FIBC and the nature of the atmosphere surrounding it.

**Table A.8.5.7.4.6 Use of Different Types of FIBCs**

Bulk Product in FIBC	Surroundings		
		Class II, Divisions 1 and 2 (1,000 mJ $\geq$ MIE $>3$ mJ) <sup>a</sup>	Class I, Divisions 1 and 2 (Gas Group C and D) or Class II, Divisions 1 and 2 (MIE $\leq 3$ mJ) <sup>a</sup>
MIE of Solids <sup>a</sup>	Nonflammable Atmosphere		
MIE $> 1000$ mJ	A, B, C, D	B, C, D	C, D <sup>b</sup>
1000 mJ $\geq$ MIE $> 3$ mJ	B, C, D	B, C, D	C, D <sup>b</sup>
MIE $\leq 3$ mJ	C, D	C, D	C, D <sup>b</sup>

Notes:

(1) Additional precautions usually are necessary when a flammable gas or vapor atmosphere is present inside the FIBC, for example, in the case of solvent wet solids.

(2) Nonflammable atmosphere includes combustible particulate solids having a MIE greater than 1000 mJ.

(3) FIBC Types A, B, and D are not suitable for use with conductive combustible particulate solids.

<sup>a</sup>Measured in accordance with ASTM E2019, capacitive discharge circuit (no added inductance).

<sup>b</sup>Use of Type C and D is limited to Gas Groups C and D with MIE greater than or equal to 0.14 mJ.

**A.8.5.7.4.7** In special cases it might be necessary to use a type of FIBC that is not permitted for the intended application based on the requirements of 8.5.7.4. For such cases, it might be determined that the FIBC is safe to use provided that filling or emptying rates are restricted to limit electrostatic charging. In the case of conductive combustible particulate solids, the use of a Type A FIBC might be acceptable provided that the maximum ignition energy from the FIBC or charged product within it is less than the MIE of the combustible particulate solids.

**A.8.5.7.5.1** Conductive containers are generally made from either metal or carbon-filled plastic having a volume resistivity less than  $10^6$  ohm-m.



**A.8.5.7.5.2** Induction charging of ungrounded conductive objects, including personnel, should be addressed as part of the risk assessment and dust hazard analysis when the use of nonconductive RIBC is being considered. The risk assessment should also consider that higher rates of transfer into and out of the RIBC increase the rate of charge generation, which could result in the propagation of brush discharges or surface (cone) discharges while the RIBC is being filled. For additional information on these phenomena, refer to NFPA 77.

**A.8.5.8.1** Maintenance and repair activities that can release or lift combustible dust include banging or shaking dust laden equipment components, blowing off dust accumulations from the surface of equipment, and inadvertently spilling combustible powder from a container. An example of a production activity that can generate a dust cloud is transporting an open drum of particulate past an operating fan. The dust clouds generated in these activities can be entrained into the airflow feeding a burner flame or pilot flame within nearby equipment.

**A.8.5.9.2** Diesel-powered front-end loaders suitable for use in hazardous locations have not been commercially available.

**A.8.5.10.1** The maximum safe operating temperature of a dryer is a function of the time-temperature ignition characteristics of the particulate solid being dried as well as of the dryer type. For short-time exposures of the material to the heating zone, the operating temperatures of the dryer can approach the dust cloud ignition temperature.

However, if particulate solids accumulate on the dryer surfaces, the operating temperature should be maintained below the dust layer ignition temperature. The dust layer ignition temperature is a function of time, temperature, and the thickness of the layer. It can be several hundred degrees below the dust cloud ignition temperature. The operating temperature limit of the dryer should be based on an engineering evaluation, taking into consideration the preceding factors.

**A.8.5.11.1** Particulate materials that are known to self heat under various circumstances include, but are not limited to, resinous sawdust, sewage sludge, powdered metals, wet agricultural materials, low rank coal, activated carbon charcoal, and bagasse. Tabulations of materials prone to self-heating can be found in the following references: *NFPA Fire Protection Handbook*; Bowes, *Self-Heating: Evaluating and Controlling the Hazards*; U.S. Department of Energy handbook, *Primer on Spontaneous Heating and Pyrophoricity*; and Babrauskas, *Ignition Handbook Database*. Test methods to assess the propensity for self-heating, and to determine critical storage pile sizes and time to self heat are also described in Bowes and Babrauskas. Methods of self-heating detection include temperature monitors within the pile or silo and carbon dioxide monitors in the silo. Self-heating management can be accomplished through timely processing of the affected particulate through the storage system before self-heating can become an issue.

Self-heating can also be managed through control of the temperature of the material as it is added to storage and through control of the residence time in storage. The permissible temperature and residence time can be determined on the basis of the characteristics of the material, the size of the pile, and the environment around the pile.

**A.8.5.12.2** Methods that are commonly used to remove foreign material include the following:

- (1) Permanent magnetic separators or electromagnetic separators that indicate loss of power to the separators

- (2) Pneumatic separators
- (3) Grates or other separation devices

**A.8.5.12.4** In the case of size reduction equipment with continuous screened outlets, high speeds that can generate friction and impact sparks are considered to be tip speeds in excess of 10 m/sec. In the case of blenders and other completely enclosed equipment processing material in batches, high speeds are considered to be blade tip speeds in excess of 1 m/sec.

**A.8.6.1.1** A specific evaluation of the work environment to determine the requirement for the wearing of flame-resistant garments should be based on the potential hazards that workers are exposed to as part of their work duties.

**A.8.6.1.3** It is important to distinguish between the different PPE requirements in NFPA 2112 and *NFPA 70E* for different exposure hazards. The PPE requirements in NFPA 2112 are not the same requirements in *NFPA 70E* and might not be sufficient protection for electric arc.

**A.8.6.1.4** Portions of this list are taken from Section 4.3 of NFPA 2113.

**A.8.6.1.6** At a minimum, the policy should address who is responsible for laundering, inspecting, repairing, and retiring garments. See also Section 6.1 from NFPA 2113. If flame-resistant clothing becomes contaminated with combustible particulate solids, the protective performance of the garments could be compromised. Wearers should maintain an awareness of and take precautions against the accumulation of combustible particulate solids on their protective clothing.

**A.8.6.2.1** This section does not include an incidental amount of elastic used in nonmelting fabric, underwear, or socks.

**A.8.6.2.2** See also Section 5.1 from NFPA 2113.

**A.8.8.1** Other means to control fugitive dust emissions can include established housekeeping procedures where the fugitive emissions do not approach the MEC, and the housekeeping schedule does not allow settled dust accumulations to exceed the threshold housekeeping dust accumulation limit.

**A.8.8.2** Use of liquid dust suppression methods for dust control involves the use of fine, atomized, or fogging liquid sprays to limit the emission of combustible dusts. By using an atomized or fogging spray of liquid, which is often just water, dust can be controlled and prevented from accumulating in surrounding areas. This method is also often used in place of standard dust collection for both economical and operational reasons.

**A.8.9.3.1** Small containers can pose an explosion hazard; however, explosion protection measures for these units are not always practical. Consideration should be given to explosion hazards when electing to omit protection; 8 ft<sup>3</sup> (0.23 m<sup>3</sup>) is roughly the size of a 55 gal (208.2 L) drum.

**A.8.9.4.1** A means to determine protection requirements should be based on a risk assessment, with consideration given to the size of the equipment, consequences of fire or explosion, combustible properties and ignition sensitivity of the material, combustible concentration, and recognized potential ignition sources.

**A.8.10.1.2** Fire protection systems for operating enclosures are often overlooked. Paragraph 8.10.1.2 is intended to help the user determine when fire protection systems are warranted. The design of the fire protection system should consider the hazards of the materials present. For example, water-



based protection systems are generally not appropriate for combustible metals, as described in NFPA 484.

**A.8.10.1.2(1)** Manual fire fighting poses an unacceptable risk to facility personnel and emergency responders. The evaluation of the risk to facility personnel and fire fighters should be made based on discussions and review of the hazard assessment described in Chapter 7. Such a system(s) is (are) needed to meet the objectives stated in Section 4.2.

**A.8.10.1.2(2)** The potential effectiveness of manual fire fighting should be assessed by experienced fire fighting personnel after reviewing the hazard assessment documentation developed in accordance with Chapter 7 requirements.

**A.8.10.2.1** Pneumatic conveying, centralized vacuum, and dust collection systems that move combustible particulate solids can be classified as water compatible, water incompatible, or water reactive. Inasmuch as water is universally the most effective, most available, and most economical extinguishing medium, it is helpful to categorize combustible particulate solids in relation to the applicability of water as the agent of choice. For details on use of water as an extinguishing agent, see Annex F of NFPA 654.

**A.8.10.2.4** In the case of automatic suppression systems, low momentum applications can be achieved by using small water drops or extinguishing powders and by avoiding accumulations of combustible particulate in the immediate vicinity of the discharge nozzle. In the case of dry pipe automatic sprinkler systems, it is particularly important to prevent fugitive combustible dust accumulations on or near the dry pipe because the initial discharge of compressed air can produce a suspended dust cloud and the potential for a flash fire or explosion.

In the case of manual application of extinguishing agents, 8.10.3.2 provides additional guidance on avoiding dust cloud formation during agent application.

**A.8.10.3.2** Extreme care should be employed in the use of portable fire extinguishers in facilities where combustible dusts are present. The rapid flow of the extinguishing agent across or against accumulations of dust can produce a dust cloud. When a dust cloud is produced, there is always a deflagration hazard. In the case of a dust cloud produced as a result of fire fighting, the ignition of the dust cloud and a resulting deflagration are virtually certain. Consequently, when portable fire extinguishers are used in areas that contain accumulated combustible dusts, the extinguishing agent should be applied in a manner that does not disturb or disperse accumulated dust. Generally, fire extinguishers are designed to maximize the delivery rate of the extinguishing agent to the fire. Special techniques of fire extinguisher use should be employed to prevent this inherent design characteristic of the fire extinguisher from producing an unintended deflagration hazard.

**A.8.10.4.2.1** A nozzle listed or approved for use on Class C fires produces a fog discharge pattern that is less likely than a straight stream nozzle to suspend combustible dust, which could otherwise produce a dust explosion potential.

**A.8.10.4.2.2** Fire responders should be cautioned when using straight stream nozzles in the vicinity of combustible dust accumulations that dust clouds can be formed and can be ignited by any residual smoldering or fire.

**A.8.10.5.1** A risk assessment should consider the presence of combustibles both in the equipment and in the area around

the process. Considerations should include the combustibility of the building construction, the equipment, the quantity and combustibility of process materials, the combustibility of packaging materials, open containers of flammable liquids, and the presence of dusts. Automatic sprinkler protection in air-material separators, silos, and bucket elevators should be considered.

**A.8.10.5.2** Sprinkler systems in buildings or portions of buildings where combustible metals are produced, handled, or stored pose a serious risk for explosion. When water is applied to burning combustible metals, hydrogen gas is generated. When confined in an enclosed space, dangerous levels of hydrogen gas can collect and result in the potential for a hydrogen explosion. The metal will likely spread and spew burning material.

**A.9.2** See ANSI/AIHA Z10-2012, *Occupational Health and Safety Management Systems*.

**A.9.3.1** The operating procedures should address both the normal operating conditions and the safe operating limits. Where possible, the basis for establishing the limits and the consequences of exceeding the limits should also be described. The operating procedures should address all aspects of the operation, including the following (as applicable):

- (1) Normal startup
- (2) Continuous operation
- (3) Normal shutdown
- (4) Emergency shutdown
- (5) Restart after normal or emergency shutdown
- (6) Anticipated process upset conditions
- (7) System idling

For manual operations, the procedures and practices should describe techniques, procedural steps, and equipment that are intended to minimize or eliminate combustible dust hazards.

Operating procedures and practices should be reviewed on a periodic basis, typically annually, to ensure they are current and accurate.

**A.9.3.2** Safe work practices include, but are not limited to, hot work, confined space entry, and lockout/tagout, and the use of personal protective equipment. (*See NFPA 51B.*) Consideration for extending the duration of the fire watch could be warranted based on characteristics of the material, equipment configuration, and conditions. For example, the PRB Coal Users' Group practice for hot work suggests fire watches could be warranted for 2 to 12 hours following the completion of hot work due to the exothermic chemical reaction of sub-bituminous coals. In addition to the hazards of combustible dust, safe work practices should address the hazards of mitigation systems such as inerting and suppression.

**A.9.4.1** Process interlocks and protection systems should be inspected, calibrated, and tested in the manner in which they are intended to operate, with written records maintained for review. In this context, "test" implies a nondestructive means of verifying that the system will operate as intended. For active explosion protection systems, this can involve the disconnection of final elements (i.e., suppression discharge devices or fast-acting valve actuators) and the use of a simulated signal to verify the correct operation of the detection and control system. Testing can also include slow-stroke activation of fast-acting valves to verify unrestricted travel. Some devices, such as explosion vent panels, suppression discharge devices, and



some fast-acting valve actuators, cannot be functionally “tested” in a nondestructive manner, and so only periodic, preventive, and predictive inspection, maintenance, and replacement (if necessary) are applied.

Inspection and maintenance requirements for explosion vents and other explosion protection systems are found in NFPA 68, and NFPA 69, respectively.

**A.9.4.2(5)** Process interlocks should be calibrated and tested in the manner in which they are intended to operate, with written test records maintained for review by management. Testing frequency should be determined in accordance with the AIChE *Guidelines for Safe Automation of Chemical Processes*. [654: A.12.1.2(5)]

**A.9.4.4** Corrective actions should be expedited on high-risk hazards (those that could result in a fatality or serious injury). Where in-kind repairs cannot be promptly implemented, consideration should be given to providing alternate means of protection.

**A.9.4.5** See Section 9.10 for information regarding document retention.

**A.9.5.1** Safety of a process depends on the employees who operate it and the knowledge and understanding they have of the process. It is important to maintain an effective and ongoing training program for all employees involved. Operator response and action to correct adverse conditions, as indicated by instrumentation or other means, are only as good as the frequency and thoroughness of training provided.

**A.9.5.2** All plant personnel, including management; supervisors; and operating, housekeeping, and maintenance personnel should receive general awareness training for combustible dust hazards, commensurate with their job responsibilities, including training on locations where hazards can exist on site, appropriate measures to minimize hazards, and response to emergencies.

**A.9.5.2.1** Safe work habits are developed and do not occur naturally. The training program should provide enough background information regarding the hazards of the materials and the process so that the employees can understand why it is important to follow the prescribed procedures. Training should address the following:

- (1) The hazards of their working environment and procedures in case of emergencies, including fires, explosions, and hazardous materials releases.
- (2) Operating, inspection, testing, and maintenance procedures applicable to their assigned work
- (3) Normal process procedures as well as emergency procedures and changes to procedures
- (4) Emergency response plans, including safe and proper evacuation of their work area and the permissible methods for fighting incipient fires in their work area
- (5) The necessity for proper functioning of related fire and explosion protection systems
- (6) Safe handling, use, storage, and disposal of hazardous materials used in the employees’ work areas
- (7) The location and operation of fire protection equipment, manual pull stations and alarms, emergency phones, first-aid supplies, and safety equipment
- (8) Equipment operation, safe startup and shutdown, and response to upset conditions

**A.9.5.2.3** The extent of this training should be based on the level of interaction the person is expected to have with the

system. For example, operators need to be aware of the hazards presented by explosion suppression systems but might not need to know how to operate the suppression system (e.g., interfacing with the system control panel or locking out devices). Maintenance personnel, on the other hand, might need to know how and when to lock out the devices and how to return the system to its operational state.

**A.9.6.2** Qualified contractors should have proper credentials, which include applicable American Society of Mechanical Engineers (ASME) stamps, professional licenses, and so forth.

**A.9.6.3** It is suggested that annual meetings be conducted with regular contractors to review the facility’s safe work practices and policies. Some points to cover include to whom the contractors would report at the facility, who at the facility can authorize hot work or fire protection impairments, and smoking and nonsmoking areas. The owner/operator does not necessarily need to provide the training to the contractor.

**A.9.6.3.3** In addition to the combustible dust fire and explosion hazards, contractors should also be made aware of other potential process and occupational hazards. There can be combustible materials other than combustible dusts in the equipment or immediate vicinity where contractors might be working. Combustion of dusts can generate toxic products, and some combustible dusts are acutely toxic.

**A.9.7.1** All plant personnel, including management, supervisors, and maintenance and operating personnel, should be trained to participate in plans for controlling plant emergencies.

The emergency plan should contain the following elements:

- (1) A signal or alarm system
- (2) Identification of means of egress
- (3) Minimization of effects on operating personnel and the community
- (4) Minimization of property and equipment losses
- (5) Interdepartmental and interplant cooperation
- (6) Cooperation of outside agencies
- (7) The release of accurate information to the public

Emergency drills should be performed annually by plant personnel. Malfunctions of the process should be simulated and emergency actions undertaken. Disaster drills that simulate a major catastrophic situation should be undertaken periodically with the cooperation and participation of public fire, police, and other local community emergency units and nearby cooperating plants.

Specialized training for public fire department(s) and industrial fire brigades can be warranted due to facility specific hazards where the methods to control and extinguish a fire can be outside of their normal arena of traditional fire fighting.

**A.9.8** To thoroughly assess the risks, analyze the incident, and take any corrective steps necessary, investigations should be conducted promptly based on the nature of the incident and in coordination with the AHJ (as applicable).

The investigation should include root cause analysis and should include a review of existing control measures and underlying systemic factors. Appropriate corrective action should be taken to prevent recurrence and to assess and monitor the effectiveness of actions taken.

Such investigations should be carried out by trained persons (internal or external) and include participation of workers. All investigations should conclude with a report on the action taken to prevent recurrence.