

NFPA

803

**FIRE PROTECTION
FOR LIGHT
WATER NUCLEAR
POWER PLANTS
1983**



**MORGAN TECHNICAL LIBRARY
NATIONAL FIRE PROTECTION ASSN.
BATTERYMARCH PARK
QUINCY, MA 02269**

Copyright © 1983

All Rights Reserved

1M-6-83-FP
Printed in U.S.A.

**NATIONAL FIRE PROTECTION ASSOCIATION, INC.
Batterymarch Park, Quincy, MA 02269**

NOTICE

All questions or other communications relating to this document should be sent only to NFPA Headquarters, addressed to the attention of the Committee responsible for the document.

For information on obtaining Formal Interpretations of the document, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Vice President and Chief Engineer, National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable Federal, State and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action which is not in compliance with applicable laws and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision — This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference — Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders or similar instruments. Any deletions, additions and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Vice President and Chief Engineer) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription — **A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Vice President and Chief Engineer), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and, (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rulemaking process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rulemaking powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Vice President and Chief Engineer), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if

Continued on inside back cover

© 1983 NFPA, All Rights Reserved

Standard for Fire Protection for Light Water Nuclear Power Plants

NFPA 803-1983

1983 Edition of NFPA 803

This edition of NFPA 803, *Standard for Fire Protection for Light Water Nuclear Power Plants*, was prepared by the Technical Committee on Atomic Energy and acted on by the National Fire Protection Association, Inc. at its Annual Meeting in Kansas City on May 18, 1983. It was issued by the Standards Council on June 9, 1983 with an effective date of June 29, 1983, and supersedes all previous editions.

Origin and Development of NFPA 803

The Committee on Atomic Energy was organized in 1953 for the purpose of providing guidance on practices necessary for fire safety in facilities handling radioactive materials. A Recommended Fire Protection Practice for Nuclear Reactors, NFPA 802, was developed and officially adopted in 1960. Following a serious fire in 1975 at the Brown's Ferry Plant of the TVA, the Nuclear Regulatory Commission expressed the need for a fire protection standard specifically covering nuclear power plants. The Committee started work on the preparation of this document early in 1976, and this standard is the result of their efforts.

The 1983 edition of the standard includes the following changes:

The scope and title have been made more explicit by the insertion of "Light Water" to describe more adequately the type of reactor to which the standard applies.

Deletion of descriptions of obsolete reactors or reactors that are not covered by the standard.

NFPA definitions have been added to the text.

Improved regulations governing the storage and use of flammable liquids in accordance with NFPA 30 and 31.

A complete revision to Chapter 9, Fire Signaling Systems, including the preparation of a new table designed to provide additional guidance and ease of selection of detectors.

A complete revision of Appendix B providing up-to-date references.

Committee on Atomic Energy

George E. Weldon, *Chairman*

Factory Mutual Research Corp.

Rep. Mutual Atomic Energy Reinsurance Pool

Wayne D. Holmes, *Secretary*

American Nuclear Insurers

Ford W. Burgess, EXXON Nuclear Idaho Co., Inc.

Richard E. Caines, Kaiser Aluminum & Chemical Co.

Richard E. Dalatri, Gibbs & Hill Inc.

Charles A. Doak, Alison Control Inc.

Stewart M. Fastman, American Insurance Assn.

Fred T. Foster, Babcock & Wilcox Co.

Larry E. Garland, The Gamewell Corp.

Rep. Automatic Fire Alarm Assn. Inc.

Leonard R. Hathaway, M & M Protection Consultants

L. Paul Herman, NATLSCO

Rep. Alliance of American Insurers

L. S. Homa, Underwriters Laboratories Inc.

Dwight S. Hull II, Tennessee Valley Authority

C. D. Kinney, Southern Co. Services Inc.

Rep. Edison Electric Inst.

Jacob B. Klevan, Rolf Jensen & Assoc., Inc.

Dr. Robert S. Levine, Ctr for Fire Research

Robert W. Lippincott, Nat'l Lead Co. of Ohio

Rep. NFPA Industrial Fire Protection Section

Anthony J. Mascena, Stone & Webster Engineering Corp.

J. E. Maxwell, General Electric Co.

Walter W. Maybee, US Dept. of Energy

Michael A. Neel, Elma, WA

David P. Nodley, US Nuclear Regulatory Commission

Robert J. O'Laughlin, Professional Loss Control Inc.

William P. Paulsen, Ebasco Services Inc.

Dr. John F. Riley, Ansul Co.

Rep. Fire Equipment Manufacturers Assn.

David J. Ristau, Wisconsin Public Service Corp.

Edward A. Sawyer, Yankee Atomic Electric Co.

Rep. Yankee Atomic Electric Co.

Rupert M. H. Terrier, Virginia Electric & Power Co.

Andrew Valachovic Jr., Bechtel Power Corp.

Jack A. Wood, Viking Corp.

Rep. NAS & FCA

Alternates

Paul H. Dobson, Factory Mutual Research Corp.

(Alternate to G. E. Weldon)

James S. Harrison, Bechtel Power Corp.

(Alternate to A. Valachovic)

George M. Hidzick, Kemper Group

(Alternate to L. P. Herman)

LeRoy J. Hill, Babcock & Wilcox Co.

(Alternate to F. T. Foster)

Donald J. Keigher, University of California

(Alternate to R. W. Lippincott)

John W. McCormick, Rolf Jensen & Assoc. Inc.

(Alternate to J. Klevan)

James D. Miceli, Alison Control Inc.

(Alternate to C. A. Doak)

Bruce G. Scheiman, Chemetron Fire Systems

(Alternate to Dr. J. F. Riley)

Ralph E. Thompson, Tennessee Valley Authority

(Alternate to D. S. Hull)

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Contents

Chapter 1 Introduction	803- 5
1-1 Scope	803- 5
1-2 Purpose	803- 5
1-3 Definitions	803- 5
1-4 Introduction and Special Problems relating to the Protection of Light Water Nuclear Electric Generating Stations ..	803- 8
1-5 Units	803- 9
Chapter 2 Functional Subdivision of the Plant Layout ..	803-10
Chapter 3 Inventory of Hazardous Materials	803-13
Chapter 4 Control of Combustible Material	803-15
Chapter 5 Construction Materials and Fire Loading on Buildings	803-16
Chapter 6 General Building Arrangement	803-18
6-1 General Fire Area Requirements	803-18
6-2 Specific Fire Separation Requirements	803-18
6-3 Protection of Openings in Fire Barriers	803-19
6-4 Reliability Considerations	803-20
Chapter 7 Heating, Ventilating and Air Conditioning ..	803-22
7-1 Introduction	803-22
7-2 Basic Standards	803-22
7-3 General Requirements	803-22
Chapter 8 Fire Prevention Measures	803-26
8-1 Administrative Procedures and Controls	803-26
8-2 Lighting Protection Measures for Buildings	803-28
8-3 Prevention Measures for Plant Equipment	803-28
8-4 Prevention Measures for Operation of the Plant	803-29
Chapter 9 Fire Signaling Systems	803-30
9-1 Fire Signaling Systems	803-30
9-2 Fire Detectors	803-31
9-3 Fire Signaling System Display and Supervision	803-31
9-4 Maintenance, Inspection and Acceptance, Testing of Fire Signaling Systems	803-31
9-5 Communications	803-40

Chapter 10	Fire Suppression Systems	803-41
10-1	General	803-41
10-2	Automatic Sprinkler and Water Spray Systems	803-46
10-3	Liquefied Compressed Gas Suppression Systems	803-46
10-4	Foam Systems	803-47
10-5	Dry Chemical Systems	803-47
Chapter 11	Yard Mains and Hydrants	803-49
Chapter 12	Water Supply	803-50
Chapter 13	Portable Fire Extinguishers and Hand Hose Lines	803-52
13-1	Portable and Wheeled Fire Extinguishers	803-52
13-2	Hand Hose Lines	803-53
Chapter 14	Manual Fire Fighting	803-55
14-1	803-55
14-2	Action Plan	803-55
14-3	Standard for Fire Defense Measures	803-55
14-4	Liaison with Public Fire Authorities	803-55
14-5	Regular Training and Drills	803-56
14-6	Equipment for the Plant Fire Brigade	803-56
Chapter 15	Planning and Fire Protection	803-57
15-1	803-57
15-2	803-57
15-3	803-57
15-4	803-57
15-5	Repairs and Revision Work	803-57
Chapter 16	Fire Prevention and Fire Protection for the Construction Site	803-58
16-1	803-58
16-2	Fire Prevention	803-58
16-3	Fire Protection	803-59
16-4	803-59
Chapter 17	Life Safety	803-60
Appendix A	803-61
Appendix B	Codes and Standards	803-65
Appendix C	Referenced Publications	803-67

Standard for Fire Protection for Light Water Nuclear Power Plants

NFPA 803-1983

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates explanatory material on that paragraph in Appendix A.

For information on referenced publications see Appendix C.

Chapter 1 Introduction

1-1 Scope. This standard covers the protection of light water nuclear power plants from the consequences of fire, including safety to life of on-site personnel, protection of property, and continuity of production. Nuclear safety is provided for in other documents such as Nuclear Regulatory Commission (NRC) regulations and ANSI Standards.

1-2 Purpose. This standard is prepared for the use and guidance of those charged with the design, construction, operation, and protection of light water nuclear power plants. This standard covers those requirements essential to assure that the consequences of fire will have minimum impact on the safety of construction and operating personnel, the physical integrity of plant components, and the continuity of plant operations. Additional emphasis is on requirements dictated by the need to protect the lives of constructors and operators from the consequences of fire and to conform to best fire protection engineering practice.

1-3 Definitions.

Approved. Acceptable to the "authority having jurisdiction."

NOTE: The National Fire Protection Association does not approve, inspect or certify any installations, procedures, equipment, or materials nor does it approve or evaluate testing laboratories. In determining the acceptability of installations or procedures, equipment or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization concerned with product evaluations which is in a position to determine compliance with appropriate standards for the current production of listed items.

Authority Having Jurisdiction. The "authority having jurisdiction" is the organization, office or individual responsible for "approving" equipment, an installation or a procedure.

NOTE: The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner since jurisdictions and "approval" agencies vary as do their responsibilities. Where public safety is primary, the "authority having jurisdiction" may be a federal, state, local or other regional department or individual such as a fire chief, fire marshal, chief of a fire prevention bureau, labor department, health department, building official, electrical inspector, or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the "authority having jurisdiction." In many circumstances the property owner or his designated agent assumes the role of the "authority having jurisdiction"; at government installations, the commanding officer or departmental official may be the "authority having jurisdiction."

Combustible. Any material which, in the form in which it is used and under the conditions anticipated, will ignite and burn.

Combustible Liquid. A liquid having a flash point at or above 100°F (37.8°C). (See NFPA 30, *Flammable and Combustible Liquids Code*.)

Fire Area. That portion of a building or plant that is separated from other areas by fire barriers.

Fire Barrier. Those components of construction (walls, floors or floor/ceiling assemblies and their supports, including beams, joists, columns, penetration seals or closures, fire doors, and fire dampers) that are rated by approval laboratories in hours of resistance to fire and are used to prevent the spread of fire.

Fire Brigade. As used in this standard, refers to those persons trained in plant fire fighting operations.

Fire Door. A door assembly rated in accordance with NFPA 252, *Standard Method of Fire Test of Door Assemblies*, and installed in accordance with NFPA 80, *Fire Doors and Windows*.

Fire Loading. The amount of combustibles present in a given situation, expressed in Btus per square foot.

Fire Prevention. Measures directed towards avoiding the inception of fire.

Fire Protection. Methods of providing for fire control or fire extinguishment.

Fire Production Manager. The person directly responsible for fire prevention and fire protection at the plant.

Fire Rated Penetration. An opening in a fire barrier for the passage of pipe, cable, duct, etc., which has been sealed so as not to reduce the integrity of the fire barrier.

Fire Resistance Rating. The time, in minutes or hours, that materials or assemblies have withstood a fire exposure as established in accordance with the test procedures of NFPA 251, *Standard Methods of Fire Tests of Building Construction and Materials*.

Fire Zone. Subdivisions of fire areas in which fire detection and/or suppression systems provide alarm information indicating the location of fire at a central fire control center.

Flame Spread Rating. A relative measurement of the surface burning characteristics of building materials when tested in accordance with NFPA 255, *Method of Test of Surface Burning Characteristics of Building Materials*.

Flammable Liquid. Any liquid having a flash point below 100°F (37.8°C) and having a vapor pressure not exceeding 40 psi (276 kPa) absolute pressure at 100°F (37.8°C).

Labeled. Equipment or materials to which has been attached a label, symbol or other identifying mark of an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

Limited Combustible. A building construction material which, in the form in which it is used, has a potential heat value not exceeding 3500 Btu per pound (8141 kJ/kg), and either has a structural base of noncombustible material with a surfacing not exceeding a thickness of $\frac{1}{8}$ inch (3.2 mm) which has a flame spread rating not greater than 50, or other material having neither a flame spread rating greater than 25 nor evidence of continued progressive combustion, even on surfaces exposed by cutting through the material on any plane. (See NFPA 220, *Standard on Types of Building Construction*.)

Listed. Equipment or materials included in a list published by an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of listed equipment or materials and whose listing states either that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.

NOTE: The means for identifying listed equipment may vary for each organization concerned with product evaluation, some of which do not recognize equipment as listed unless it is also labeled. The "authority having jurisdiction" should utilize the system employed by the listing organization to identify a listed product.

Noncombustible Material. A material which, in the form in which it is used and under the conditions anticipated, will not ignite, support combustion, burn, or release flammable vapors when subjected to fire or heat. Materials reported as noncombustible, when tested in accordance with ASTM E136-1981, *Test for Behavior of Materials in a Vertical Tube Furnace at 750°C*, shall be considered noncombustible materials.

Shall. Indicates a mandatory requirement.

Should. Indicates a recommendation or that which is advised but not required.

1-4 Introduction and Special Problems Relating to the Protection of Light Water Nuclear Electric Generating Stations.

1-4.1 General Introduction. Fire protection is both an art and a science. Perfection and practice in the art is the objective, with fire prevention being the ultimate goal. Fire prevention in the absolute sense is only possible where there is no combustible material to fuel a fire. The presence of combustible material creates a fire potential, no matter how slight. Thus, fire prevention must, as a first priority, consider the presence of any combustible material as a variance.

The total elimination of combustible material is seldom possible; therefore, fire protection requires additional measures to limit the consequences of fire.

A defense-in-depth philosophy of fire prevention, control, and extinguishment shall be adopted and implemented to minimize and mitigate the effects of fire, and reduce hazards to personnel and property damage to acceptable minimums.

A well-balanced fire protection program includes prevention, detection, extinguishment of fires, safety to life, and preservation of property. The protection of the environment and of the public against nuclear hazards takes priority over that of the plant itself, and is addressed by the appropriate regulatory agencies. However, the size of nuclear power plants makes the economic impact of a forced outage such that protection measures must be extended to include provisions to assure their continued operation.

1-4.2 Special Considerations in Fire Protection Encountered at Light Water Nuclear Power Plants. Consideration of the need for nuclear safety results in several areas of fire protection emphasis unique to the nuclear electric generating station; for example:

- (a) Reactor shutdown systems.
- (b) Cooling system integrity.
- (c) Filtering system integrity.
- (d) Ventilating system integrity.

NOTE: See Appendix B.

1-4.3 Defense-in-depth.

1-4.3.1 Light water nuclear power plants use the concept of defense-in-depth to achieve the high degree of safety required in the nuclear safety systems of the plant. This concept shall be extended to fire protection for the remaining areas of the plant.

1-4.3.2 With respect to the fire protection program the defense-in-depth principle is aimed at achieving an adequate balance in:

- (a) Preventing fires from starting.
- (b) Detecting fires quickly and suppressing those fires that occur, thereby limiting damage.
- (c) Designing the plant to limit the consequences of fire.

NOTE: No one of these echelons can be perfect or complete by itself. Strengthening any one can compensate in some measure for weaknesses, known or unknown, in the others.

1-4.4 Fire Protection Management Program. The fire protection program for a nuclear power plant shall cover design features, personnel, procedures, plans and equipment. Senior management participation in this program shall begin with early design concepts and plant layout and continue through plant operation. In order to effectively develop and conduct this program, a fire protection manager shall be appointed at the conceptual stage of the project. The manager shall be selected on the basis of education, experience and advancement as an industrial fire protection engineer. The manager shall establish liaison with all internal departments, with all authorities having jurisdiction, and with the public fire department.

1-5 Units. Metric units of measurement in this standard are in accordance with the modernized metric system known as the International System of Units (SI). One unit (liter), outside of but recognized by SI, is commonly used in international fire protection. If a value for measurement as given in this standard is followed by an equivalent value in other units, the first stated is to be regarded as the requirement. A given equivalent value may be approximate.

Chapter 2 Functional Subdivisions of the Plant Layout

2-1 Safety to the lives of on-site personnel, protection of property, and continuity of power production as affected by the possibility of fires shall be given appropriate consideration in the general arrangement of the nuclear power plant. For the purposes of fire hazard analysis the plant component facilities shall be divided into primary facilities, secondary facilities, and support facilities as follows:

NOTE: The nuclear power plant will generally consist of the following functional facilities which would be expected to vary in their physical relationship to each other from plant to plant.

(a) Typical Primary Facilities.

Reactor Building. Houses the reactor within a containment structure and its integral or free standing shield.

Reactor Auxiliary Building. Contains reactor auxiliary and emergency core cooling system (ECCS) equipment.

Control Building. Houses the main and auxiliary control panels, emergency switchgear, and batteries.

Turbine Building. Houses the turbine generator and turbine generator auxiliaries.

Steam Generator Building. Houses the steam generator.

Intake Pumping Station. Houses the condenser circulating water makeup pumps, the raw service water and fire protection pumps, and all necessary valves and strainers for these systems.

Electrical Switchyard. Encompasses the electrical transmission system coming into the site and leaving the site.

Emergency Power Generation Facility. That facility designed to provide on-site emergency power in the event of an off-site power failure.

Emergency Service Water Pumping Station. Houses the emergency service water pumps, and all necessary valves, strainers, and electrical switchgear for these systems.

Condenser Circulating Water Pumping Station. Houses the condenser circulating water pumps, pump isolation valves, pump suction and discharge conduits, and associated electrical equipment.

Electrical Control and Communications Building. Houses the switchyard relays, terminal communications equipment, and may act as a control center for the switchyard up until the time the main control room becomes operational.

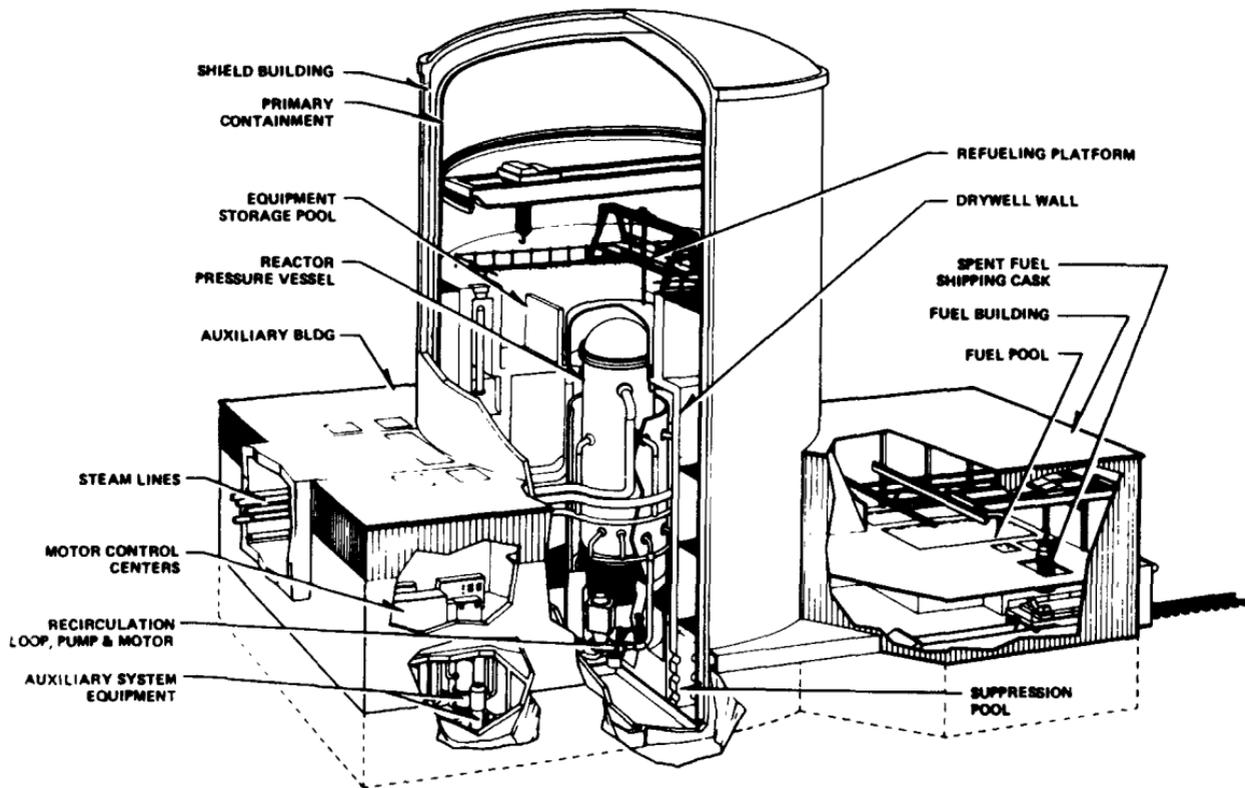


Figure 2-1 Mark III Reactor Building, Fuel Building and Auxiliary Building.

Main Heat Rejection System. Includes cooling towers and facilities associated with spray ponds and canals.

Station Transformers. Those transformers which provide auxiliary power to the plant or transmit power from the plant.

(b) Typical Secondary Facilities.

Fuel Building. Inclusion of primary equipment in this building would require upgrading of the affected portions of the building to primary facility status.

Radwaste Building. Houses the equipment for processing radioactive waste from the plant.

Makeup Water Treatment Plant. Facility for producing high purity water before use in the reactor or its support systems.

Condenser Circulating Water Treatment Building. Houses the plant and condenser circulating water biocide treatment system.

Demineralizer Regeneration Building. Contains facilities for regeneration and cleaning of resins from the plant condensate polishing system.

(c) Typical Support Facilities.

Office Building. Houses the offices for the plant's administrative employees and contains plant records.

Service Building. Encompasses the guard house, main gate, and office space for the plant's security force.

Auxiliary Boiler Building. Contains boilers for providing heating steam and steam to operate plant auxiliary equipment during the time that the nuclear steam supply is not available.

2-2 For these three types of facilities, safety to the lives of on-site construction and operating personnel and loss of property shall be given consideration as specified in Chapter 17 and elsewhere in this standard.

2-3 For primary and secondary facilities the cost of lost revenue and replacement power in addition to property loss shall be factored into the fire hazard analysis for determining the cost/benefit ratio for selecting the appropriate fire protection systems.

2-4* A fire hazard analysis shall be developed that will define the fire hazards that can exist and describe the loss limiting criteria to be used in the design of the facility. The fire hazard analysis shall take into consideration the basic data of the plant such as the functional subdivision of the facility, the controlled zones which have limited access, and the general plant layout of equipment or systems to develop the fire zone and the ratings of fire barriers.

Chapter 3 Inventory of Hazardous Materials

3-1 Combustible materials in both large and small concentrations will be present in nuclear power plants, as in most other industrial plants, and it shall be assumed that outbreaks of fire occur for a variety of reasons.

3-2 For the purpose of assessing the fire loading, an inventory of all flammable and combustible materials shall be made for each fire area, identifying the location, type, quantity and form of the materials. The materials shall be classified into:

(a) *Flammable and Combustible Materials.* Typical examples of flammable and combustible materials found in a nuclear power plant are:

Conventional fuels for emergency power units, auxiliary boilers, etc.

Lubricants and hydraulic oil.

Insulating materials (thermal and electric).

Building materials (incl. PVC and other plastics).

Filtering materials (e.g., oil bath filters, charcoal, etc.).

Cleansing materials.

Paints and solvents.

Packaging materials (e.g., bitumen, etc.)

Neutron shields (if organic materials).

Clothing.

(b) *Flammable Gases.* Typical examples of flammable gases found in a nuclear power plant are:

Hydrogen for generator cooling, for coolant conditioning of gas-cooled reactors, and from battery charging.

Propane or other fuel gases.

O₂ and H₂ by radiolysis in the core and addition of H₂ for improved recombination.

Gas for cutting and welding.

(c) *Combustible Radioactive Substances.* Typical examples of radioactive substances external to the reactor are:

Sealed radioactive materials, such as irradiated and/or plutonium containing fuel elements, irradiated control rods, neutron sources, etc.

Unsealed radioactive material, such as ion exchanger fillings and filter cartridges which have become loaded with radioactive substances, radwaste materials, etc.

3-3 While assessing the hazardous substances, ways and means of transporting the supplies of consumable goods on the site shall be considered.

3-4 Temporary but predictable and repetitive concentrations of combustible materials shall also be considered. These may include:

- (a) Replacement of lubricating or hydraulic oils.
- (b) Repainting equipment or structures.
- (c) Replacement of combustible filter materials.
- (d) Scaffolding or dunnage necessary to maintain or replace equipment.
- (e) Spare equipment in shipping crates or boxes awaiting installation.

Chapter 4 Control of Combustible Material

4-1 Combustibles, other than those which are an inherent part of operation, shall be restricted to protected compartments or spaces.

4-2 As part of the protective measures, consideration shall be given to reducing the fire loading of contents in primary or secondary facilities by reducing the amount of combustible materials, wherever possible, as indicated in the following design features:

(a) Provision of separate piping systems for the lubricating system and control system of the turbine generators.

(b) Use of an approved low hazard synthetic hydraulic fluid in the control systems.

(c) Use of approved noncombustible insulation materials on components.

4-2.1 Flammable and combustible liquid storage and use shall be in accordance with Chapter 5 of NFPA 30, *Flammable and Combustible Liquids Code*. Where oil burning equipment, stationary combustion engines or gas turbines are used, they shall be installed and used in accordance with NFPA 31, *Oil Burning Equipment*, or NFPA 37, *Stationary Combustion Engines and Gas Turbines*, as appropriate.

4-2.2 Hydrogen. The storage and use of hydrogen shall be in accordance with NFPA 50A, *Gaseous Hydrogen Systems at Consumer Sites*.

4-2.3 Flammable and combustible liquid and gas piping shall be in accordance with ANSI B31.1-1980 or ANSI B31.7-1969, including Addenda a-1972, b-1971, and c-1971, as applicable.

Chapter 5 Construction Materials and Fire Loading on Buildings

5-1 The use of plastics such as polyurethane and polyvinyl chloride (PVC) shall be minimized and used generally at locations totally inaccessible to ignition and effects of fire exposure.

NOTE: Halogenated plastics, such as polyvinyl chloride (PVC), release chlorine and hydrogen chloride gas during a fire; these gases are toxic and corrosive.

5-2 Construction materials for nuclear power plants shall be classified by at least one of the following tests:

(a) NFPA 255, *Surface Burning Characteristics of Building Materials*.

(b) NFPA 251, *Fire Tests of Building Construction and Materials*.

5-2.1 Certain materials of construction that do not meet the definition of noncombustible or limited combustible may have to be used in a nuclear power plant, and thus the location in the plant, the amount exposed to ignition, and the proposed fire protection system shall be justified in writing and the approval of the plant fire protection manager and the authority having jurisdiction shall be obtained.

5-3 Wall and structural components, thermal insulation materials, radiation shielding materials, and soundproofing shall be noncombustible, limited combustible or listed by a testing laboratory for flame spread, smoke, and fuel contribution, of 25 or less in its use configuration.

5-4 Suspended ceilings, including light diffusers, and their supports shall be of noncombustible or limited combustible construction. Electrical wiring above suspended ceilings shall be in metallic conduit or solid bottom, solid covered ferrous raceways. Otherwise concealed spaces shall be devoid of combustibles.

5-5 Roof coverings shall be Class A as determined by tests described in NFPA 256, *Standard Methods of Fire Tests of Roof Coverings*. Metal roof deck construction shall be Class I (Factory Mutual Approved) or "fire-acceptable" (as tested by Underwriters Laboratories, Inc.).

5-6 Transformers installed inside of buildings shall be either dry type or insulated and cooled with an approved liquid, unless installed in vaults in accordance with Article 450 of NFPA 70, *National Electrical Code*®.

5-7 Cooling towers constructed of combustible or nonapproved construction shall be protected with deluge sprinkler systems in accordance with NFPA 214, *Water Cooling Towers*. Fire hydrants shall be operational at the cooling tower site prior to beginning construction activities.

NOTE: Since cooling towers can be vital to the operation of the plant and reconstruction can be lengthy, noncombustible construction should be used.

Chapter 6 General Building Arrangement

6-1 General Fire Area Requirements.

6-1.1 The nuclear power plant shall be subdivided into separate fire areas to minimize the risk of spread of fire and the resultant consequential damage from corrosive gases, fire suppression agents, smoke, and contamination from radioactive substances. In addition subdivisions shall provide access for manual fire suppression activities.

6-1.2 In multi-unit plants, each unit shall be separated from the other either by distance or fire barriers. The distance or fire barrier rating shall be determined from the fire hazard analysis. (*See NFPA 80A, Recommended Practice for Protection of Buildings from Exterior Fire Exposures.*)

6-2 Specific Fire Separation Requirements.

6-2.1 An approved fire barrier having a fire resistance rating of 3 hours, with automatic- or self-closing fire doors having a fire protection rating of 3 hours, and with approved penetration protection, shall be provided as follows:

(a) To separate all contiguous buildings, such as turbine, reactor containment, auxiliary fuel handling, control, radwaste, service, administration, and other areas as dictated by reactor design and fire hazard analysis.

(b) To isolate turbine generator lube oil conditioning or system room and lube oil storage tank from turbine buildings and adjacent areas.

(c) To isolate emergency diesel generator rooms or buildings (emergency power generating areas) from each other and adjacent plant areas.

(d) To separate diesel fire pumps from other pumps in the same pumphouse.

(e) To separate all areas with concentrations of cables, such as cable spreading rooms, cable tunnels, cable penetration areas, cable shafts or chases, included within the reactor containment, from adjacent areas.

(f) To isolate auxiliary boiler rooms from adjacent areas.

6-2.2 Where fire barriers are constructed to prevent vertical spread of fire, stairways, elevator shafts and trash chutes shall be enclosed with walls or partitions having a fire resistance rating of 2 hours. Openings in such walls or partitions shall be protected with approved automatic- or self-closing fire doors having a fire protection rating of $1\frac{1}{2}$ hours.

6-2.3 Buildings shall be protected from exposure fires involving oil filled transformers, by locating the transformer facilities at least 50 feet (15.2 m) from other facilities or by providing a two-hour fire barrier between transformers and exposed facilities (see Figure 6-2.3). A one-hour fire barrier or a distance of 30 feet (9.1 m) shall be provided between adjacent transformers. Means shall be provided to contain oil spills.

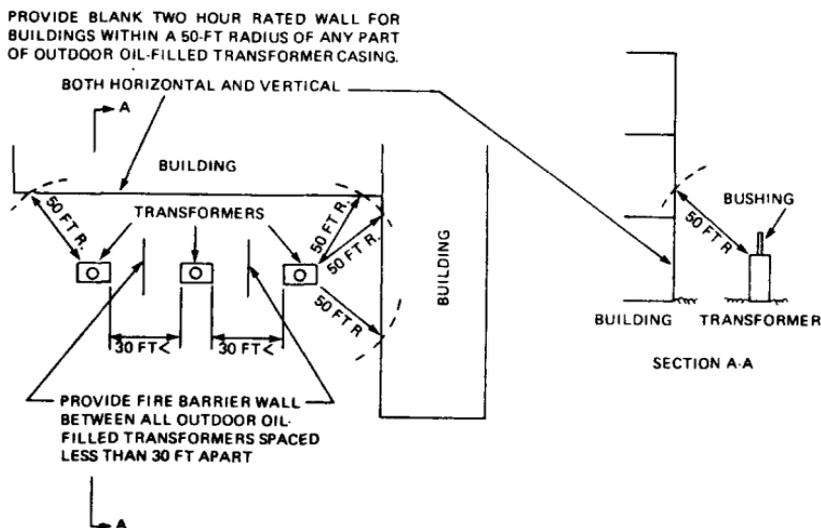


Figure 6-2.3

For SI Units: 1 ft = 0.3048 m.

6-3 Protection of Openings in Fire Barriers.

6-3.1 Electrical and Mechanical Penetrations.

6-3.1.1 Where electrical or mechanical equipment, other than ventilation ducts, must penetrate a fire barrier, the penetration shall be sealed (firestopped) with a material or device which maintains the required fire resistance rating of the fire barrier. The penetration seal (fire stop) shall be qualified in accordance with NFPA 251, *Fire Tests of Building Construction and Materials*, except as modified herein:

(a) Temperatures on the unexposed surfaces of the penetration seal (fire stop) shall be measured and reported to the authorities having jurisdiction. The temperatures on the unexposed side for the metallic parts of the penetration (e.g., cable trays, conductors, pipe, etc.) shall also be measured and reported to the authorities having jurisdiction. The results of the test shall be incorporated into the plant's fire hazard analysis (see Section 2-4).

(b) Immediately following the termination of the fire endurance test a hose stream test shall be conducted using the NFPA 251 solid-stream test or a spray-stream test conforming to the following criteria:

1. Spray nozzle that produces a long-range, narrow-angle (not exceeding 30°) high velocity spray.

2. Nozzle shall discharge a minimum of 75 gpm at 75 psi at 10 feet (4.7 liters/sec at 517 kPa at 3 m) from the test specimen.

3. Duration of application shall be not less than 2½ minutes for every 100 sq ft (9 m²) of area.

(c) The penetration seal (fire stop) shall be determined acceptable provided that:

1. Fire does not propagate to the unexposed side of the test assembly nor shall there be any visible flaming on the unexposed side.

2. Temperature readings on the unexposed side shall not be high enough to ignite combustible material as evaluated in the fire hazard analysis.

3. Penetration seal does not permit projection of water from hose stream test.

NOTE: If electrical or mechanical chases or shafts pass through a fire area without opening into that area, the penetration seals at fire barriers are not required provided the chases or shafts are enclosed with assemblies having fire resistance ratings not less than those of the fire barriers through which they pass.

6-3.2 Penetrations for Ventilation Ducts.

6-3.2.1 Where ventilation ducts must penetrate fire barriers, the ducts and opening protections shall comply with the provisions of Chapter 7 of this standard.

6-4 Reliability Considerations.

6-4.1 In accordance with the scope of this standard, it shall be recognized that continuing power production consideration dictates additional fire subdivision of the plant beyond that required for nuclear safety.

NOTE 1: The subdivision into fire areas for redundant nuclear safety systems is covered by other documents. (See Appendix B.)

NOTE 2: A fire which might be capable of damaging only one division of a redundant system, and therefore be acceptable from the standpoint of nuclear safety may not be acceptable from a standpoint of forced plant outage. Additional fire protection systems or fire barriers may be required.

6-4.2 When evaluating the length of plant outage, as a result of possible fire, consideration shall be given to the length of time required to satisfy the demands of all of the authorities having jurisdiction for examining causes of the fire, planning of the repairs and reconstruction, testing, and documentation of the adequacy of the restoration process.

6-4.3 Cable Construction.

6-4.3.1 Cable insulating materials represent a major source of fire loading throughout the plant and special consideration shall be given to their installation and protection.

6-4.3.2 As a minimum requirement, cable construction shall meet the fire and flame test requirements of IEEE No. 383. Meeting the requirements of IEEE No. 383 shall not eliminate the need for protection as specified in this standard.

Chapter 7 Heating, Ventilating and Air Conditioning

7-1 Introduction. Ventilation of a nuclear power plant involves balanced air differentials between plant areas, comfort ventilation, and heat removal from areas where heat is generated by equipment. This need also includes fire area isolation and smoke removal equipment, as well as equipment for filtering radioactive gases. The design of ventilation systems is further complicated by the seismic, tornado, and missile criteria for building penetrations.

7-2 Basic Standards. NFPA 90A, *Air Conditioning and Ventilating Systems*, NFPA 91, *Blower and Exhaust Systems, Dust, Stock and Vapor Removal or Conveying*, and NFPA 204M, *Smoke and Heat Venting Guide*, are the basic standards that shall be followed for the design, installation and operation of the ventilation systems necessary for normal and emergency operation of the plant except as modified below.

7-3 General Requirements.

7-3.1 Smoke and Corrosive Gas Removal.

7-3.1.1* Automatic shutdown of ventilation systems by temperature or smoke detectors as prescribed by applicable NFPA standards in the following buildings shall be consistent with nuclear safety and safety of on-site personnel:

- (a) Reactor building.
- (b) Auxiliary building.
- (c) Control building.
- (d) Turbine building.
- (e) Intake pumping station.
- (f) Emergency service water pumping station.
- (g) Condenser circulating water pumping station.
- (h) Electrical control and communications building.
- (i) Fuel building.
- (j) Emergency power generating building.

7-3.1.2 Smoke, corrosive gases and the nonradioactive substances which might be freed by the fire shall be vented from their place of origin directly to a safe location. Radioactive materials that might be released by the fire shall be confined, removed from the exhaust ventilation air stream or released under controlled conditions.

7-3.1.3 Ventilation systems designed to exhaust smoke or corrosive gases shall be evaluated to ensure that inadvertent operation or failures will not violate the controlled areas of the plant design.

7-3.1.4 Smoke ventilation shall be provided for fire areas based upon the fire hazard analysis.

NOTE 1: Separate smoke ventilation systems are preferred; however, smoke venting can be integrated into normal ventilation systems using automatic or manually positioned dampers and motor speed control.

NOTE 2: The lack of smoke and heat venting in areas of relatively high combustible loading can result in significant damage to structural components.

NOTE 3: Automatic or manual actuation of smoke and heat venting will be determined by the fire hazard analysis.

Smoke ventilation from areas that may contain radioactive substances shall not be ventilated outside the building. These smoke ventilation systems shall be connected to gas treatment systems to preclude release of radioactive substances.

7-3.1.5 The fresh-air supply intakes to all areas shall be located remotely from the exhaust air outlets and smoke vents of other fire areas to minimize the possibility of contaminating the intake air with the products of combustion.

7-3.1.6 Enclosed stairwells shall be designed to minimize smoke infiltration during a fire.

NOTE: Stairwells serve as escape routes and fire fighting access routes. Suitable methods of ensuring a smoke-free stairwell include pressurization of stairwells (see *NFPA 90A, Chapter 4 and Appendix C*) and the construction of smokeproof towers (see *5-2.3 of NFPA 101[®], Life Safety Code[®]*.)

7-3.1.7 When natural-convection ventilation is used, a minimum ratio of vent area to floor area shall be one to 200 except in oil hazard areas where a one to 100 ratio shall be provided.

NOTE: When mechanical ventilation is used, 300 cfm (8.5 m³/min) is equal to 1 sq ft (0.09 m²) of natural convection vent area.

7-3.1.8 To prevent corrosion which might be caused by direct release of chemicals in case of fire, the acids and alkalines used for the primary coolant treatment plant and stored in appreciable quantities on the site shall be protected so as not to increase the risk of damage in case of a fire.

7-3.1.9 The power supply and controls for mechanical ventilation systems shall be located outside the fire area served by the system or protected from fire damage.

7-3.2 Duct Systems.

7-3.2.1 Plastic ducts, including fire retardant types, shall not be used for ventilating systems.

7-3.2.2 Ventilation ducts that pass through fire areas which they do not serve shall not degrade the fire integrity of the fire rated enclosure.

NOTE: Fire dampers or fire doors compatible with the rating of the barrier may be required at the duct penetrations to the fire area (see 7-3.2.3).

7-3.2.3 Fire dampers shall be provided to prevent the passage of smoke, heat, or flame through ventilation ducts from one area to another.

7-3.2.3.1 Approved fire dampers having a rating of 1½ hours shall be installed where ventilation ducts penetrate fire barriers having a required fire resistance rating of 2 hours or less. Where ventilation ducts penetrate required 3 hour fire barriers, approved fire dampers having a fire protection rating of 3 hours shall be installed.

Exception: Fire dampers are not required for ventilation duct penetrations where shutdown of the ventilation system is not allowed.

7-3.2.4 Fire dampers shall be equipped with thermal elements. The closure of fire dampers shall be guaranteed by mounting the damper directly into the separating wall or by protecting the duct up to the damper according to the fire resistance of the separating wall structure.

7-3.2.5 Interconnections of individual fire areas via the ventilation system shall be avoided insofar as possible. Where this is not possible, the necessary precautions shall be taken to prevent the spread of smoke and fire by such routes.

NOTE: Fire dampers in the interconnecting ventilation ducts should be provided when the ventilation system cannot be sectioned off in the normal manner (see 7-3.2.3).

7-3.2.6 False floors or suspended ceilings shall not be employed as common pressure equalizing chambers for redundant ventilation systems but may be used for distribution of air to the corresponding room.

7-3.3 Filters.

7-3.3.1 Air entry filters shall have noncombustible filter media. They shall produce a minimum amount of smoke (UL Class 1) when subjected to heat. In order to decrease the fire hazard of these filters and of oil bath type filters, only approved fire-resistive adhesives and oils with an open-cup flash point equal to or greater than 464°F (240°C) and which do not produce appreciable smoke shall be used. HEPA filters shall meet UL 586.

7-3.3.2 Fire suppression systems shall be installed to protect filters which collect combustible material, unless the elimination of such protection is justified by the fire hazard analysis.

7-3.4 Special Equipment for Emergency Personnel.

7-3.4.1 Self-contained breathing apparatus using full-face, positive-pressure masks approved by NIOSH (National Institute for Occupational Safety and Health) shall be provided for fire brigade and control room personnel.

NOTE: Control room personnel may be furnished breathing air by a manifold system piped from a storage reservoir, if practical. Service or operating life should be a minimum of one-half hour for the self-contained units. At least two extra air bottles should be located on site for each self-contained breathing unit. In addition, an on-site 6-hour supply of reserve air should be provided and arranged to permit quick and complete replenishment of exhausted supply air bottles as they are returned. If compressors are used as a source of breathing air, only units approved for breathing air should be used.

Chapter 8 Fire Prevention Measures

8-1 Administrative Procedures and Controls.

NOTE: This section provides criteria for development of administrative procedures and controls necessary for the execution of the fire prevention and protection activities and practices for the operating plant. Included herein are the minimally accepted actions required of cognizant plant management to assure the performance of fire protection systems and personnel and the compliance with the fire prevention program.

8-1.1 The plant manager or his delegated fire protection manager shall be responsible for the periodic update of the fire hazard analysis.

8-1.2 The plant manager or his delegated fire protection manager shall be responsible for the following:

(a) Develop, implement, and periodically update as necessary a fire brigade plan in accordance with Chapter 14.

(b) Maintain housekeeping in such a manner so as to minimize the probability of fire causing loss of life or property damage.

(c) Develop, implement, and periodically update as necessary an emergency evacuation plan for all personnel.

(d) Develop, implement, and periodically update as necessary a welding and cutting safety procedure using NFPA 51B and NFPA 241 as guides (*see Chapter 15*).

(e) Restrict smoking and other sources of ignition to properly designated and supervised safe areas of the plant.

(f) Develop, implement, and periodically update as necessary a fire prevention surveillance plan integrated with periodic recorded rounds to all accessible unattended sections of the plant.

(g) Coordinate the periodic testing of all systems and equipment affecting fire prevention and fire protection in accordance with the applicable NFPA standards and/or the manufacturers'/installers' instructions and procedures to include maintenance of appropriate documentation.

(h) Develop an alternate protection plan for those instances when it becomes necessary to remove any fire protection equipment or system from service.

(i) Fire investigation and the coordination of all plant fire reporting. Responsibilities including reviewing fire reports, taking corrective action, and making the proper distribution of the reports.

(j) Conduct periodic inspections of the plant. A prepared checklist shall be used for the inspection. The areas of primary containment and high radiation areas normally inaccessible during plant operation shall be inspected as plant conditions permit but at least during each refueling outage. The results of each inspection shall be documented and retained for a period of two years.

8-1.3 Plant administrative procedures shall specify appropriate requirements governing the storage, use, and handling of flammable liquids and gases.

8-1.4 Plant administrative procedures shall specify appropriate requirements governing the control of electrical appliances, i.e., portable electrical heaters in critical areas.

8-1.5 The reduction and control of temporary fire loads in the plant is essential to provide defense-in-depth protection. As a minimum, plant administrative procedures shall require that the total fire loads, including temporary and permanent, will not exceed those quantities established for extinguishment by permanently installed fire protection systems and equipment except in approved controlled conditions. Under such conditions, the plant fire protection manager shall evaluate temporary fire loads using appropriate documented guidelines and shall be responsible for ensuring that applicable additional personnel and/or fire protection equipment is provided when limits are exceeded. The fire protection manager or his designated representative shall conduct weekly walk-through inspections to ensure implementation of required controls. During major maintenance operations the frequency of these walk-throughs shall be increased to daily. These inspections shall be documented and the records retained for a period of two years.

Transient fire loads, when allowed, shall be controlled and shall require the implementation of additional protective measures such as supplemental portable fire equipment, fire retardant impregnation and fire watches, depending upon the types and quantities of the transient combustibles and the potential fire exposure they present to the plant. Particular attention shall be given to the control of halogenated plastics. When the work is completed, the plant fire protection manager shall have the area inspected to confirm that the transient fire loads have been removed from the area. Extra equipment shall then be returned to its proper location. The results of this inspection shall be documented and retained for a period of two years.

8-1.6 Plant administrative procedures shall specify that all wood routinely used in the plant shall be approved pressure impregnated fire retardant type prior to being introduced into the plant.

8-1.7 Plant administrative procedures shall require an inplant review and prior approval of all work plans to assess potential fire hazard situations. Where such conditions are determined to exist special precautions shall be taken to define appropriate conditions under which the work is authorized.

8-2 Lighting Protection Measures for Buildings. The plant shall be equipped with an approved lighting protection system. (See *NFPA 78, Lightning Protection Code.*)

8-3 Prevention Measures for Plant Equipment.

8-3.1 The ignition of leaked or spilled oil shall be minimized by:

(a) Keeping the oil from contact with hot parts of the steam systems (wall temperature \geq ignition temperature), such as steam pipes and ducts, entry valve, turbine casing, reheater, and by-pass valve.

NOTE: Oil pipes should be located below steam lines.

(b) Using suitable electrical equipment.

(c) Sealing the insulation of hot plant components to prevent oil saturation.

(d) Use of concentric piping.

8-3.2 The ignition of gas shall be minimized by:

(a) Providing electrical installations suitable for hazardous (classified) locations as defined in *Article 500* of *NFPA 70, National Electrical Code*, in those areas where the fire hazard analysis shows these locations to exist.

8-3.3 Ignition of flammable materials in auxiliary equipment shall be minimized by:

(a) Providing approved combustion safeguards on boilers and other fossil fuel-fired equipment in accordance with *NFPA 85A, Prevention of Furnace Explosions in Fuel-Oil and Natural Gas-Fired Single Burner Boiler-Furnaces*; *NFPA 85B, Prevention of Furnace Explosions in Natural Gas-Fired Multiple Burner Boiler-Furnaces*; *NFPA 85D, Prevention of Furnace Explosions in Fuel Oil-Fired Multiple Burner Boiler-Furnaces*; or *NFPA 85E, Prevention of Furnace Explosions in Pulverized Coal-Fired Multiple Burner Boiler-Furnaces*.

(b) Constructing and installing equipment containing flammable or combustible liquids in accordance with *NFPA 30, Flammable and Combustible Liquids Code*, Chapter 5.

(c) Equipping all oil-filled transformers with:

1. High oil temperature limit switches in accordance with the manufacturer's recommendations, with an audible and visual signal or an automatic device to de-energize the transformer.
2. An overcurrent protection device.
3. A differential relay.
4. A gas detector and fault over-pressure relays with a warning signal and automated shut-down for equipment over 10 MW.
5. Lightning Protection.

(d) Equipping generators with warning signals, automated shut-down, and the following protective devices:

1. Overvoltage or undervoltage.
2. Overcurrent.
3. Differential relays.
4. Reverse power relays.
5. Proper performance of systems providing cooling and sealing gas.

(e) Installing only air circuit breakers, low oil content circuit breakers or circuit breakers filled with sulfur hexafluoride (SF_6) or similar nonflammable fluids when located indoors.

8-4 Prevention Measures for Operation of the Plant. (See Chapter 15.)

Chapter 9 Fire Signaling Systems

9-1 Fire Signaling Systems.

9-1.1 Fire signaling systems shall be provided in all areas of the plant as required by the fire hazard analysis. The requirements of this chapter constitute the minimum acceptable protective signaling system functions when used in conjunction with:

- NFPA 72A, *Local Protective System*
- NFPA 72B, *Auxiliary Signaling System*
- NFPA 72C, *Remote Station System*
- NFPA 72D, *Proprietary Signaling System*

All components of the fire signaling systems shall be of an approved type.

9-1.2 The signaling system's initiating device and signaling line circuits shall provide emergency operation for fire detection, fire alarm and water flow alarm during a single break or a single ground fault.

NOTE: See NFPA 72D for definitions of signaling line circuits and initiating device circuit.

9-1.3 Fire signaling equipment used for fixed fire suppression systems shall give audible and visual alarm and system trouble annunciation in the plant control room and the plant security office. A general alarm annunciation would be acceptable in one of the two locations. Local alarm shall be provided in the affected fire zone and to other locations as may be required by the authority having jurisdiction.

9-1.4 Audible signaling appliances shall produce a distinctive sound, used for no other purpose. See NFPA 72D, Section 4-4. Audible signaling devices shall be located and installed so that the alarm can be heard above ambient noise levels.

Exception: Visual signaling appliances may be used to supplement audible appliances in the protected areas. (See 9-3.1.)

9-1.5 Plant control room or plant security personnel shall be trained in the operation of all fire signaling systems used in the plant. (See 9-1.3.) This training shall include the ability to identify any alarm zone or fire protection system which is operating.

9-1.6 Fire signaling equipment and actuation equipment for the release of fixed fire suppression systems shall be connected to power supply sources in accordance with the requirements of Section 2-6 of NFPA 72D and 2-3.4.2 of NFPA 72A.

9-1.7 Manual fire alarm boxes shall be installed as required by the fire hazard analysis. (*See NFPA 72D.*) Where manual release devices are installed for the purpose of releasing an extinguishing agent in a fixed fire suppression system, they shall be clearly marked for that purpose.

9-1.8 All signals shall be permanently recorded in accordance with NFPA 72D, 4-5.2.

9-2 Fire Detectors.

9-2.1 Automatic fire detectors shall be selected and installed in accordance with:

(a) NFPA 72E, *Automatic Fire Detectors*.

(b) The design parameters required as a result of the fire hazard analysis of the plant area.

(c) The additional requirements of this standard.

When the fire hazard analysis shows that fire detection is needed, Table 9-2 shall be used in selecting the type of detectors to be installed. Additional considerations prior to selection shall include (1) response characteristics, (2) maintenance requirements, (3) testing requirements, (4) adaptability to environment, and (5) accessibility.

NOTE: This table is intended to show the types of fire detectors which have application to hazard areas listed. In some cases, more than one type of detector should be considered by the designer for application in a specific hazard area. Within each generic type of detector (*see NFPA 72E for detector types*) differences among specific principles of operation may suggest preference of a specific detector for specific hazards.

9-3 Fire Signaling System Display and Supervision.

9-3.1 The fire signaling system display panel shall be located in the plant control room or the plant security office. Annunciation circuits connecting zone, main control and remote annunciation panels shall be electrically supervised.

9-4 Maintenance, Inspection and Acceptance Testing of Fire Signaling Systems.

9-4.1 Maintenance, inspection and acceptance requirements shall be in accordance with appropriate NFPA standards for detection devices and signaling systems. The authority having jurisdiction shall be consulted on all alterations and additions to the system under its supervision.

Table 9-2

Plant Area	Combustible Loading/ Fire Hazard (See Note 1)	Anticipated Fire Development	Obstruction Congestion or Construction	Ceiling Height	Ventilation	Radioactive Contamination or Corrosion	Ambient Temperature	Acceptable Detector Choice (See 9-2.1)		
								*S	*T (See Note 2)	*F *O
Battery Rooms	Cable Insulation Plastic Battery Cases, Wood in Racks, Hydrogen Gas	Hydrogen Explosive or Slow	Low	Low	Moderate	Potentially Corrosive	Normal	X	X	X
Cable Penetration and Spreading Rooms	Cable Insulation, Relays, MCC	Slow	High/Moderate	Low/Moderate	Moderate	N/A	Normal	X	X	
Cable Tunnels	Cable Insulation	Slow	High	Low	Variable	Variable	Variable	X	X	
Cable Shafts and Chases	Cable Insulation	Slow	Variable	N/A	Variable	Variable	Variable	X	X	
Cable Tray Run Concentrations	Cable Insulation	Slow	Variable	Variable	Variable	Variable	Variable	X	X	
Combustible (Charcoal) Filters	Charcoal	Slow	High	Low	Variable	Potential Radiation	Normal	X		

(Computer Rooms Including Under Floor Space)	Cable Insulation, Class A Combustibles	Slow/Fast	Moderate/High	Low	High	N/A	Normal	X			
Control Room	Cable Insulation, Class A Combustibles	Slow/Moderate	Moderate/High	Low	Moderate/High	N/A	Normal	X			
Control Room Above Ceiling	Cable Insulation, Ducts, Lighting Equipment	Slow	Moderate/High or Inaccessible	Low	Variable	N/A	Normal	X			
Diesel Fire Pump Room	Oil, Plastic Battery Cases, Cable Insulation	Fast	Low/Moderate	Variable	Variable	Potentially Corrosive	Variable	X	X	X	
Diesel Generator Rooms	Oil, Cable Insulation	Fast	Low/Moderate	Variable	Moderate/High (During Operation)	N/A	Variable	X	X	X	
Diesel Fuel Day Tank Rooms	Oil	Fast	Moderate/High	Low	Low/Moderate	N/A	Normal	X	X	X	
Diesel Fuel Storage Tank If Not Buried	Oil	Fast	Low	Non-outdoors Variable Indoors	Non-outdoors Variable Indoors	N/A	Normal	X	X	X	
Filter Rooms and Plenums	Charcoal	Slow/Moderate	Low/Moderate	Variable	Variable	Potential Radiation	Normal	X	X		

Table 9-2 — (Continued)

Plant Area	Combustible Loading/ Fire Hazard (See Note 1)	Anticipated Fire Development	Obstruction Congestion or Construction	Ceiling Height	Ventilation	Radioactive Contamination or Corrosion	Ambient Temperature	Acceptable Detector Choice (See 9-2.1)			
								*S	*T	*F	*O
In-Plant Flammable Liquid Storage Rooms	Low/High Flash Point Liquids	Fast	Moderate/High	Variable	Low/Moderate	N/A	Normal	X	X	X	X
Fuel Oil Storage Tanks	Oils	Fast	Low	N/A Outdoors Variable Indoors	N/A Outdoors Variable Indoors	N/A	Normal		X	X	
Hydrogen Seal Oil Units	Oil, Hydrogen	Fast/ Extremely Fast	Low/ Moderate	Variable	Variable	N/A PWR, Potential Radiation BWR	Variable		X		
Instrument Rack Rooms	Cable, Possible Flammable Gas	Slow/Fast	Moderate/High	Variable	Low/Moderate	Potential Radiation	Variable	X	X	X	
Laboratories	Chemicals, Gases, Liquid	Moderate/ Fast	Low/ Moderate	Low	Low/ Moderate	Potential Radiation	Normal	X	X		X
Oil Lines and Reservoirs at Steam Driven Equipment	Oil, Oil Soaked Insulation	Fast/ Moderate	Low	Variable	Variable	None	Variable	X	X		

Reactor/ Coolant Recircula- tion Pumps	Oil, Oil Soaked Insulation	Fast/ Moderate	Moderate/ High	Variable	Variable	Potential Radiation	High	X X X
Record Storage Rooms	Class A	Slow	Low	Low	Low	None	Normal	X X
Relay Rooms/ Cabinets	Cable, Plastics	Slow	Moderate/ High	Low/ Moderate	Low/ Moderate	None	Variable	X X X
Switchgear Rooms	Cable, Electronics	Slow	Low/ Moderate	Variable	Moderate/ High	None	Normal	X X
Transformer Outdoor (If Combustible Oil Filled)	Oil	Fast/Ultra Fast	Low	N/A	Outdoors	Weather Corrosive	Normal	X X
Transformer Indoor (If Combustible Oil Filled)	Oil, Cable	Fast/Ultra Fast	Moderate	Variable	Variable	None	Variable	X X X
Turbine Building Beneath Operating Floor Where Oil Can Spread	Oil, Hydrogen Cable	Fast/ Explosive	Variable	Variable	Variable	None-PWR Potential Radiation BWR	Moderate/ High	X X

Table 9-2 — (Continued)

Plant Area	Combustible Loading/ Fire Hazard (See Note 1)	Anticipated Fire Development	Obstruction Congestion or Construction	Ceiling Height	Ventilation	Radioactive Contamination or Corrosion	Ambient Temperature	Acceptable Detector Choice (See 9-2.1)			
								*S	*T	*F	*O
Turbine Generator Governor Housing (If Combustible Fluid)	Lube Oil, Oil Soaked Insulation	Fast/ Moderate	Low	N/A	None	None-PWR Potential Radiation BWR	High	X	X		
Turbine Generator Bearings (Seals)	Oil, Oil Soaked Insulation	Fast/ Moderate	Low	N/A	None	None-PWR Potential Radiation BWR	Moderate/ High	X	X		
Turbine Oil Piping Above Operating Floor	Oil	Fast	High	Low	None	None-PWR Potential Radiation BWR	High	X	X	X	
Generator Bearings, Seals (Below Operating Floor)	Lube Oil, Hydrogen	Fast/Ultra Fast	High	Variable	Low	None-PWR Potential Radiation BWR	Moderate	X	X		

Generator Bearings, Seals (Above Operating Floor)	Lube Oil, Hydrogen	Fast/Ultra Fast	Low	N/A	None	None-PWR Potential Radiation BWR	Moderate	X	X		
Turbine Generator Lube Oil Conditioning or System Room	Lube Oil	Fast	Moderate	Variable	Low/Moderate	None-PWR	Moderate	X	X	X	
Turbine Generator Lube Oil Storage Room	Lube Oil, Possibly Hydrogen	Fast/Explosive	Moderate	Variable	Variable	None-PWR	Moderate	X	X	X	
Steam Valves (If Combustible Hydraulic Fluid)	Hydraulic Oil, Oil, Insulation	Fast/Moderate	Moderate/High	Variable	Variable	None-PWR Potential Radiation BWR	High	X	X		
Hydrogen Manifold Areas	Hydrogen	Fast/Explosive	Low	Variable	Variable	None-PWR	Normal	X	X	X	
Hydrogen Storage Outdoor	Hydrogen	Fast/Explosive	None	N/A	N/A	N/A	Normal	X	X	X	
Miscellaneous Flammable Gas Storage	Miscellaneous Gases	Fast/Explosive	None	Variable	Variable	N/A	Normal	X	X	X	X

Table 9-2 — (Continued)

Plant Area	Combustible Loading/ Fire Hazard (See Note 1)	Anticipated Fire Development	Obstruction Congestion or Construction	Ceiling Height	Ventilation	Radioactive Contamination or Corrosion	Ambient Temperature	Acceptable Detector Choice (See 9-2.1)			
								*S	*T	*F	*O (See Note 2)
Machine Shops	Various Class A and B	Moderate/ Fast	None	Variable	Low	Possible Radiation	Normal	X	X		
Weld Shops	Various Class A and B (Gases)	Moderate/ Fast	Moderate	Variable	Low/ Moderate	None	Normal		X		
Tool Cribs	Various Class A and B	Slow/ Moderate	Moderate	Low	Low	None	Normal	X	X		
Warehouse Storage Rooms	Various Class A and B	Slow/ Moderate	Moderate/ High	Variable	Low	None	Normal	X	X		
Truck and Railroad Unloading Areas	Various Class A and B	Moderate/ Fast	Moderate	Moderate/ High	Low	Potential Radiation	Normal		X		
Heating or Auxiliary Boiler Rooms	Fuel Oil	Moderate/ Fast	Moderate	Variable	Variable	Moderate	None	X	X	X	
Offices	Various Class A	Slow/ Moderate	Low	Low	Low	None	Normal	X	X		

Cooling Towers (Combustible)	Wood or Plastic	Moderate/ Fast	High	N/A	High	Corrosion and Moisture	Normal	X	
Access Control Areas	Various Class A and B	Moderate/ Fast	Moderate	Low	Variable	Potential Radiation	Normal	X	X
Locker Rooms	Various Class A	Moderate	Low	Low	Low	None	Normal	X	X
Low Radiation Waste Storage and Process	Various Class A Cable	Slow/ Moderate	Low/ Moderate	Variable	Low/ Moderate	Potential Radiation	Normal	X	X
Anticontamination Clothing Storage and Cleaning	Class A	Moderate	Low/ Moderate	Variable	Low/ Moderate	Potential Radiation	Normal	X	X
New Fuel Storage Area	Plastic, Cable	Slow	Low	Variable	Low	Potential Radiation	Normal	X	
New Fuel Handling Area	Various Class A and B Cable Insulation	Slow/ Moderate	Low	High	Low	Potential Radiation	Normal	X	X

NOTE 1: (comb. loading/fire hazard column)

The combustible loading for each fire area represents combustibles normally expected in these areas excluding transient combustibles, which shall be identified by the detailed fire hazard analysis of the respective plant area.

NOTE 2: "T" column under detectors

Automatic sprinklers, when selected as a suppression system from Table 10-1.1, also act as thermal, spot-type detectors. This could occur if sprinklers are used in a wet pipe, dry pipe, preaction wet pilot, or preaction dry pilot configuration.

*Detector Designations: S – Smoke T – Temperature F – Flame O – Other

9-5 Communications.

9-5.1 The plant public address system shall be available on a priority basis for fire announcements, directing plant fire brigades, and fire evacuation information.

9-5.2 Radio, telephone or other 2-way communication systems shall be provided.

Chapter 10 Fire Suppression Systems

10-1 General.

10-1.1 Automatic suppression systems shall be provided in all areas of the plant as required by the fire hazard analysis. Except as modified in this chapter, the following NFPA standards shall be used:

NFPA 11, *Low Expansion Foam and Combined Agent Systems*

NFPA 11A, *Medium and High Expansion Foam Systems*

NFPA 12, *Carbon Dioxide Systems*

NFPA 12A, *Halon 1301 Fire Extinguishing Systems*

NFPA 12B, *Halon 1211 Fire Extinguishing Systems*

NFPA 13, *Installation of Sprinkler Systems*

NFPA 15, *Water Spray Fixed Systems*

NFPA 16, *Deluge Foam-Water Sprinkler and Foam-Water Spray Systems*

NFPA 17, *Dry Chemical Systems*.

10-1.2 The extinguishing systems chosen shall be based upon the design parameters required as a result of the fire hazard analysis. When the fire hazard analysis shows that a fixed extinguishing system is needed, Table 10-1.2 shall be used in selecting the type of system or combination of systems to be installed.

10-1.3 Selection of extinguishing agent shall be based upon:

(a) Type or class of hazard.

(b) Effect of agent discharge on critical equipment such as thermal shock, continued operability, water damage, over-pressurization, cleanup, etc.

(c) Health hazards.

10-1.4 A designated person(s) working in the plant shall be trained in the maintenance, inspection, operation and emergency actuation of all fixed fire suppression systems installed in the plant, whether automatic or manual.

10-1.5* Each fire suppression system shall be equipped with approved alarm devices, annunciated locally or in the hazard area. (See 9-1.3.)

Table 10-1.2

Area or Hazard To Be Protected	Water Systems			Liquefied Compressed Gases			Foam Systems			Dry Chemical
	Automatic Sprinklers	Pre-Action Sprinklers	Deluge-Water Spray	Halon 1301	Halon 1211	Carbon Dioxide	Mech.	Foam Water Systems	High Expansion	
Auxiliary Oil or Gas Boiler Room	X	X					X (oil)	X (oil)		X
Battery Rooms	X	X		X	X	X				
Cable Penetration Rooms and Spreading Rooms	X (note 1)	X (note 1)	X (note 1)	X (note 2)	X (note 2)	X (note 2)				
Cable Tunnels, Shafts, Chases, Cable Tray Run Concentrations	X (note 1)	X (note 1)	X (note 1)	X (note 2)	X (note 2)	X (note 2)				X (multipurpose only)
Combustible (Charcoal) Filters			X							
Computer Rooms (Including under floor space)	X	X		X		X (note 4)				
Control Room		X		X						
Diesel Fire Pump Room	X									
Diesel Generator Rooms (note 3)	X	X		X	X	X	X	X	X	X
Diesel Fuel Day Tank Rooms	X	X	X	X	X	X	X	X	X	X
Diesel Fuel Storage Tank, If Not Buried	X		X	X	X	X	X	X	X	X

Table 10-1.2 (Continued)

Area or Hazard To Be Protected	Water Systems			Liquefied Compressed Gases			Foam Systems			Dry Chemical
	Automatic Sprinklers	Pre-Action Sprinklers	Deluge-Water Spray	Halon 1301	Halon 1211	Carbon Dioxide	Mech.	Foam Water Systems	High Expansion	
Filter Rooms and Plenums	X	X	X							
Flammable Liquid Storage Areas	X		X	X	X	X	X	X	X	X
Fuel Oils Storage Tanks	X		X				X	X	X	X
Hydrogen Seal Oil Units			X							X
Instrument Rack Rooms				X	X	X				
Laboratories	X	X		X	X	X				
Oil Lines & Reservoirs at Steam Turbine Driven Equip. (if more than 50 gallons)	X	X	X	X (note 5)	X (note 5)	X (note 5)				X
Reactor Coolant/Recirculation Pumps	X	X	X			X	X	X		X
Record Storage Rooms	X	X		X (note 6)	X (note 6)	X (note 6)				
Relay Rooms/Cabinets	X	X		X	X	X				
Switchgear Rooms		X		X	X	X				

Table 10-1.2 (Continued)

Area or Hazard To Be Protected	Water Systems			Liquefied Compressed Gases			Foam Systems			Dry Chemical
	Automatic Sprinklers	Pre-Action Sprinklers	Deluge-Water Spray	Halon 1301	Halon 1211	Carbon Dioxide	Mech.	Foam Water Systems	High Expansion	
Transformer Outdoor (if combustible oil filled)			X							
Transformer Indoor (if combustible oil filled)	X	X	X	X	X	X				X
Turbine Bldg. Beneath Operating Floor Where Oil Can Spread	X	X					X	X		X
Turbine Generator Governor Housing (if combustible fluid)		X	X	X (note 5)	X (note 5)	X (note 5)				X
Turbine Generator Bearings (seals)		X	X	X (note 5)	X (note 5)	X (note 5)				X
Turbine Generator Lube Oil Conditioning or System Room	X	X	X	X	X	X	X	X	X	X
Turbine Generator Lube Oil Storage Rooms	X	X	X	X	X	X	X	X	X	X
Steam Valves (if combustible hydraulic fluid)			X			X				X
Staging, Storage and Warehousing Areas	X	X							X	

Table 10-1.2 (Continued)

Area or Hazard To Be Protected	Water Systems			Liquefied Compressed Gases			Foam Systems			Dry Chemical
	Automatic Sprinklers	Pre- Action Sprinklers	Deluge- Water Spray	Halon 1301	Halon 1211	Carbon Dioxide	Mech.	Foam Water Systems	High Expan- sion	
Truck and Railroad Bays (other areas of combustible occupancy)	X	X								
Cooling Towers (combustible)			X							

Note 1. Systems shall be designed so that water is directed into every tray. Where closed head sprinkler or thermal detection systems are used, means shall be provided for prompt actuation.

Note 2. Ceiling sprinklers may be required in addition.

Note 3. Release of extinguishing agent shall not be prevented if equipment is operating.

Note 4. Under floor only.

Note 5. Design concentrations shall be maintained during the entire coast down period.

Note 6. Combustible storage should be in metal cabinets.

10-1.6 All shut-off valves controlling fire suppression systems (see 10-2.2) shall be supervised by one of the following methods:

- (a) Electrical supervision with an audible signal annunciating in accordance with Chapter 9.
- (b) Locking valves open.

10-2 Automatic Sprinkler and Water Spray Systems.

10-2.1 Where water is used as an extinguishing agent, systems shall be designed, installed, and maintained in accordance with the provisions of NFPA 13 and NFPA 15.

NOTE: Hydraulically calculated systems are preferred.

10-2.2 Each system shall have an independent connection to the plant yard main and be equipped with an approved indicating type control or shut-off valve.

NOTE: Multiple sprinkler and standpipe systems may be supplied by interior headers or fire protection loops. When provided, such headers or loops are considered an extension of the yard main system and should be provided with at least two connections to the yard main. The arrangement should be supplied and valved so that no single impairment can affect sprinkler and hose protection at the same time.

10-2.3 Drainage of all buildings shall be assessed to assure acceptable run-off or retention of fire protection water and to minimize damage.

NOTE 1: Equipment vulnerable to water damage should be placed on pedestals and floor openings should be curbed or sealed.

NOTE 2: The installation of a completely, properly engineered automatic sprinkler or water spray system in a building will generally reduce the draining and retention tank requirements, as compared to a building which relies primarily on manual fire fighting.

10-3 Liquefied Compressed Gas Suppression Systems.

10-3.1 In areas where appreciable Class C hazards exist and where the use of other agents might result in equipment malfunction or damage as determined by the fire hazard analysis, liquefied compressed gas extinguishing agent systems shall be installed. These systems, where required, shall be designed, installed, and maintained in accordance with the appropriate agent standard as follows:

Halon 1301 - NFPA 12A

Halon 1211 - NFPA 12B

Carbon Dioxide - NFPA 12.

10-3.2 When liquefied compressed gas extinguishing agent systems are used, they shall be automatically actuated by an approved method of detection meeting the requirements of NFPA 72E. To en-

sure rapid detection, particular attention shall be given to the choice of actuation means, the air flows usually involved, and the heat release rates for the hazard under fire conditions.

NOTE 1: For carbon dioxide total flooding systems that are automatically actuated in normally occupied areas, a predischARGE alarm and time delay are required to allow for personnel evacuation of the area.

NOTE 2: Halon 1211 is not acceptable for total flooding use in normally occupied areas.

NOTE 3: Electrical equipment need not be de-energized prior to the discharge of these extinguishing agent systems, but shut-down is desirable if it can be accomplished.

10-4 Foam Systems.

10-4.1 Where fires involving flammable liquids and gases under pressure are likely, foam systems shall not be used. These systems, where required by the fire hazard analysis, shall be designed, installed, and maintained in accordance with the appropriate agent standard as follows:

Low Expansion Foam and Combined Agent Extinguishing Systems - NFPA 11

Medium and High Expansion Foam Systems - NFPA 11A

Deluge Foam-Water Sprinkler and Foam-Water Spray Systems - NFPA 16

NOTE 1: Foam systems may be used in areas where appreciable Class B hazards exist, especially where flammable liquid fuel in-depth or spills are likely.

NOTE 2: High expansion foam systems are particularly suited for total flooding applications, but should not be used in normally occupied areas.

10-4.2 Foam systems shall be designed to be automatically actuated by an approved method of detection meeting the requirements of NFPA 72E.

10-4.3 Foam systems shall not be used to protect hazards involving energized electrical equipment.

10-5 Dry Chemical Systems.

10-5.1 Where appreciable Class B hazards exist, dry chemical systems shall be considered as appropriate protection.

NOTE 1: Dry chemical systems, utilizing multipurpose dry chemical, are also effective on Class A hazards, provided that "deep-seated" fires are not likely.

NOTE 2: Dry chemical systems may be used in conjunction with AFFF in a combined agent application, where securing action is required in addition to extinguishment.

NOTE 3: Electrical equipment need not be de-energized prior to system discharge, but shut-down is desirable if it can be accomplished.

NOTE 4: Dry chemical systems are not recommended for use in hazard areas where sensitive electrical equipment is located, due to the potential for damage to the equipment from the dry chemical and its products of decomposition where moisture and high temperatures are likely.

10-5.2 Where dry chemical systems are required by the fire hazard analysis, they shall be designed, installed, and maintained in accordance with the requirements of NFPA 17.

10-5.3 Dry chemical systems shall be designed to be automatically actuated by an approved method of detection meeting the requirements of NFPA 72E.

Chapter 11 Yard Mains and Hydrants

11-1 Outdoor fire hydrants and associated equipment shall be provided on the plant site for fire suppression undertaken by the plant fire brigade in the event of a major fire.

11-2 The yard mains shall be looped and shall be of sufficient size to meet the flow requirements specified in Section 12-4.

NOTE 1: Twelve-inch diameter cement-lined pipe is recommended. (*See NFPA 24, Private Fire Service Mains and Their Appurtenances.*) Main sizes should be designed to encompass any anticipated expansion.

NOTE 2: The underground main should be arranged such that any one break will not put both a fixed water extinguishing system and hose lines protecting the same area out of service.

11-3 Sufficient indicator valves shall be installed to provide adequate sectional control of the fire water supply.

11-4 A sufficient number of hydrants shall be installed to provide two streams for every part of the interior of each building not covered by standpipe protection and to provide hose stream protection for every part of each building. There shall be sufficient hydrants to concentrate the required fire flow about any important structure with no hose line exceeding 500 ft (152 m) in length. Each hydrant shall have its own gate valve.

11-5 American National Fire Hose connection screw thread shall be specified. (*See NFPA 1963, Standard for Screw Threads and Gaskets for Fire Hose Connections.*)

11-5.1 Where threads of responding fire departments differ, adapters shall be provided at the hydrants.

Chapter 12 Water Supply

12-1 The water supply system for the permanent fire protection installation shall be determined by the fire hazard analysis.

12-2 A water supply shall be provided during the initial construction period as specified in Section 16-3(b).

12-3 The fire main system piping shall not serve service water system functions. The fire water loop shall meet the construction requirements of NFPA 24, *Private Fire Service Mains and Their Appurtenances*.

12-4 The water supply for the permanent fire protection installation shall be based on the maximum automatic sprinkler or fixed water spray system demand, with simultaneous flow of 750 gpm at grade (2835 L/min) for hose streams and the shortest portion of the fire loop main out of service.

12-4.1 The use of multiple approved fire pumps shall be based on supplying the demand required in Section 12-4 with the largest pump out of service, utilizing different power sources.

12-4.2 Fire pumps shall meet the requirements of NFPA 20, *Centrifugal Fire Pumps*, and shall be automatic starting.

12-5 An automatic pressure maintenance pump (jockey pump) or a head tank shall be provided to keep the fire water main pressure at approximately 10 psig (68.9 kPa) above the start pressure setting of the fire pump(s).

12-6 Pumps shall take suction from acceptable sources of water (*see NFPA 20*). If the source is from tanks, at least two tanks shall be provided and each tank shall be sized to contain a minimum 2-hour fire water flow demand. Where tanks are used, these tanks shall be automatically filled from a source capable of providing a 2-hour supply for the fire protection requirement in 8 hours. Fire water supply tanks shall comply with NFPA 22, including freeze protection requirements.

NOTE: The 8-hour requirement for refilling may be reduced or eliminated if the initial supply exceeds the 2-hour supply requirement on a volume/ratio basis.

12-7 Salt and tidal water shall not be acceptable primary natural water sources.

12-8 The following supervisory signals, where applicable, shall be received in the control room or plant security office in accordance with Chapter 9:

- (a) Pump running
- (b) Power failure
- (c) Failure to start
- (d) Water level
- (e) Pump room and tank temperatures.

Chapter 13 Portable Fire Extinguishers and Hand Hose Lines

13-1 Portable and Wheeled Fire Extinguishers.

13-1.1 Portable and wheeled fire extinguishers shall be installed, inspected, maintained, and tested in accordance with NFPA 10, and approved or listed by a testing laboratory.

13-1.2 Portable and wheeled fire extinguishers shall be selected for the specific class or classes of hazards using the following descriptive guide.

13-1.2.1 Class "A" Hazards. Portable and wheeled fire extinguishers for protecting Class "A" hazards shall be selected from the following: water types, foam, Halon 1211, or multipurpose dry chemical.

NOTE 1: Portable and wheeled fire extinguishers that contain water, water/antifreeze, or foam should not be used on energized electrical equipment because a personal electrical shock hazard would be present.

NOTE 2: Multipurpose dry chemical is not recommended for installation in locations having sensitive electronic equipment, due to the potential for damage to this equipment from the dry chemical and its decomposition products.

13-1.2.2 Class "B" Hazards. Portable and wheeled fire extinguishers for protection of Class "B" hazards shall be selected from the following: dry chemical types, Halon 1211, foam or carbon dioxide.

NOTE 1: In addition to its extinguishing capabilities, foam can be utilized to secure a flammable liquid spill before ignition.

NOTE 2: Some of the extinguishing agents, i.e., carbon dioxide and foam, are relatively ineffective on fires involving flammable liquids under pressure.

13-1.2.3 Class "C" Hazards. Portable and wheeled fire extinguishers for protecting Class "C" hazards shall be selected from the following: Halon 1211, carbon dioxide, dry chemical types.

NOTE 1: Carbon dioxide units equipped with metal horns should not be used on fires in energized electrical equipment.

NOTE 2: Dry chemical is not recommended for use in an area where sensitive electrical equipment is located, due to the potential for damage to this equipment from a dry chemical and its products of decomposition.

13-1.2.4 Class "D" Hazards. Portable and wheeled fire extinguishers and extinguishing agents for the protection of Class "D" hazards shall be of types approved for use on the specific combustible metal hazard.

NOTE 1: Where approvals are not available for a specific combustible metal, recommendations of a manufacturer may be utilized providing proper test data or use records are available.

NOTE 2: Agent for Class "D" hazards can be applied utilizing a scoop and a container.

13-1.3 A sign shall be located adjacent to each portable and wheeled fire extinguisher and shall plainly indicate the type of fire for which it is intended.

13-1.4 All persons working in an area shall be thoroughly trained in the use of all types of portable and wheeled fire extinguishers in the area and shall be familiar with their location. This training shall include both the capabilities and limitations of each available type of extinguisher.

13-2 Hand Hose Lines.

13-2.1 Hand hose lines utilizing water, foam, carbon dioxide, or dry chemical shall be installed, inspected, and maintained in accordance with the following NFPA standards, respectively: NFPA 14, NFPA 11, NFPA 12, and NFPA 17.

13-2.2 Hand hose lines utilizing water, foam, carbon dioxide, and dry chemical shall be selected for the specific class or classes of hazards utilizing the following descriptive guide.

13-2.2.1 Class "A" Hazards. Hand hose lines for the protection of Class "A" hazards shall be selected from the following: water, foam, and dry chemical (multipurpose only). The nozzles for these hand hose lines shall be approved, electrically safe nozzles in the plant areas where Class "A" hazards involve energized electrical equipment.

13-2.2.2 Class "B" Hazards. Hand hose lines for the protection of Class "B" hazards shall be selected from among the following: water, foam, and dry chemical.

NOTE: Foam is not considered suitable alone for fires involving gases and liquefied gases nor for three-dimensional flammable liquid fires. If these hazards are encountered, hand portable, wheeled dry chemical fire extinguishers or dry chemical hand hose lines are most effective especially when used in combination.