



# **UL 4248-9**

## **STANDARD FOR SAFETY**

**Fuseholders – Part 9: Class K**

ULNORM.COM : Click to view the full PDF of UL 4248-9 2023

ULNORM.COM : Click to view the full PDF of UL 4248-9 2023

UL Standard for Safety for Fuseholders – Part 9: Class K, UL 4248-9

First Edition, Dated February 28, 2007

### **Summary of Topics**

***This revision of ANSI/UL 4248-9 dated May 25, 2023 is being issued to update the title page to reflect the most recent designation as a Reaffirmed American National Standard (ANS). No technical changes have been made.***

***As noted in the Commitment for Amendments statement located on the back side of the title page, ULSE, CSA Group, and ANCE are committed to updating this harmonized standard jointly. However, the revision pages dated May 25, 2023 will not be jointly issued by ULSE, CSA Group, and ANCE as these revision pages only address UL ANSI approval dates.***

Text that has been changed in any manner or impacted by ULSE's electronic publishing system is marked with a vertical line in the margin.

The requirements are substantially in accordance with Proposal(s) on this subject dated April 7, 2023.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of ULSE Inc. (ULSE).

ULSE provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will ULSE be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if ULSE or an authorized ULSE representative has been advised of the possibility of such damage. In no event shall ULSE's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

Users of the electronic versions of UL's Standards for Safety agree to defend, indemnify, and hold ULSE harmless from and against any loss, expense, liability, damage, claim, or judgment (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser's computer system.

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 4248-9 2023



Association of Standardization and Certification  
NMX-J-009/4248/9-ANCE  
First Edition



CSA Group  
CSA C22.2 No. 4248.9-07  
First Edition



ULSE Inc.  
UL 4248-9  
First Edition

## Fuseholders – Part 9: Class K

February 28, 2007

(Title Page Reprinted: May 25, 2023)



ANSI/UL 4248-9-2007 (R2023)

*ULNORM.COM : Click to view the full PDF of UL 4248-9 2023*

**ULSE INC. COPYRIGHTED MATERIAL – NOT AUTHORIZED FOR FURTHER REPRODUCTION OR DISTRIBUTION WITHOUT PERMISSION FROM ULSE INC.**

## **Commitment for Amendments**

This standard is issued jointly by the Association of Standardization and Certification (ANCE), the Canadian Standards Association (operating as "CSA Group"), and ULSE Inc. (ULSE). Comments or proposals for revisions on any part of the standard may be submitted to ANCE, CSA Group, or ULSE at any time. Revisions to this standard will be made only after processing according to the standards development procedures of ANCE, CSA Group, and ULSE. CSA Group and ULSE will issue revisions to this standard by means of a new edition or revised or additional pages bearing their date of issue. ANCE will incorporate the same revisions into a new edition of the standard bearing the same date of issue as the CSA Group and ULSE pages.

## **Copyright © 2007 ANCE**

Rights reserved in favor of ANCE.

## **ISBN 1-55436-046-3 © 2007 Canadian Standards Association**

All rights reserved. No part of this publication may be reproduced in any form whatsoever without the prior permission of the publisher.

This Standard is subject to review within five years from the date of publication, and suggestions for its improvement will be referred to the appropriate committee. To submit a proposal for change, please send the following information to [inquiries@csagroup.org](mailto:inquiries@csagroup.org) and include "Proposal for change" in the subject line: Standard designation (number); relevant clause, table, and/or figure number; wording of the proposed change; and rationale for the change.

To purchase CSA Group Standards and related publications, visit CSA Group's Online Store at [www.csagroup.org/store/](http://www.csagroup.org/store/) or call toll-free 1-800-463-6727 or 416-747-4044.

## **Copyright © 2023 ULSE INC.**

Our Standards for Safety are copyrighted by ULSE Inc. Neither a printed nor electronic copy of a Standard should be altered in any way. All of our Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of ULSE Inc.

This ANSI/UL Standard for Safety consists of the First Edition including revisions through May 25, 2023.

The most recent designation of ANSI/UL 4248-9 as a Reaffirmed American National Standard (ANS) occurred on May 25, 2023. ANSI approval for a standard does not include the Cover Page, Transmittal Pages, Title Page (front and back), or the Preface.

Comments or proposals for revisions on any part of the Standard may be submitted to ULSE at any time. Proposals should be submitted via a Proposal Request in ULSE's Collaborative Standards Development System (CSDS) at <https://csds.ul.com>.

For information on ULSE Standards, visit <http://www.shopulstandards.com>, call toll free 1-888-853-3503 or email us at [ClientService@shopULStandards.com](mailto:ClientService@shopULStandards.com).

## CONTENTS

<b>PREFACE .....</b>	<b>5</b>
1 General .....	7
1.1 Scope.....	7
4 Classification .....	7
5 Characteristics .....	7
5.1 Summary of characteristics .....	7
7 Construction .....	7
7.6 Contacts of a cartridge fuseholder.....	7
8 Tests .....	10
8.1 General .....	10
8.4 Verification of temperature rise .....	10

ULNORM.COM : Click to view the full PDF of UL 4248-9 2023

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 4248-9 2023

## PREFACE

This is the common ANCE, CSA Group, and ULSE standard for Fuseholders – Part 9: Class K. It is the first edition of NMX-J-009/4248/9-ANCE, the first edition of CSA C22.2 No. 4248-9, and the first edition of UL 4248-9.

This common standard was prepared by the Association of Standardization and Certification (ANCE), CSA Group, and ULSE. The efforts and support of the CANENA Technical Harmonization Subcommittee 32B – Fuseholders are gratefully appreciated.

This standard is considered suitable for use for conformity assessment within the stated scope of the standard.

This standard was reviewed by the CSA Subcommittee on Low voltage fuses, under the jurisdiction of the CSA Technical Committee on Industrial Products and the CSA Strategic Steering Committee on Requirements for Electrical Safety, and has been formally approved by the CSA Technical Committee.

This standard will be submitted to the Standards Council of Canada for approval as a National Standard of Canada.

Where reference is made to a specific number of samples to be tested, the specified number shall be considered a minimum quantity.

**Note:** *Although the intended primary application of this standard is stated in its scope, it is important to note that it remains the responsibility of the users of the standard to judge its suitability for their particular purpose.*

### Level of harmonization

This standard is published as an identical standard for ANCE, CSA Group, and ULSE.

An identical standard is a standard that is exactly the same in technical content except for national differences resulting from conflicts in codes and governmental regulations. Presentation is word for word except for editorial changes.

### Interpretations

The interpretation by the standards development organization of an identical or equivalent standard is based on the literal text to determine compliance with the standard in accordance with the procedural rules of the standards development organization. If more than one interpretation of the literal text has been identified, a revision is to be proposed as soon as possible to each of the standards development organizations to more accurately reflect the intent.

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 4248-9 2023

## Fuseholders – Part 9: Class K

### 1 General

*This Part is intended to be read together with the Standard for Fuseholders – Part 1: General Requirements, hereafter referred to as Part 1. The numbering of the Clauses in this Part correspond to like numbered Clauses in Part 1. The requirements of Part 1 apply unless modified by this Part. For Clauses not shown below, refer to the Standard for Fuseholders – Part 1: General Requirements, NMX-J-009-4248-ANCE ♦ CSA C22.2 No. 4248.1 ♦ UL 4248-1.*

#### 1.1 Scope

1.1.2 These requirements cover fuseholders intended for use with Class K Fuses as described in NMX-J-009/248/9-2000-ANCE, CSA C22.2 No. 248.9, UL 248-9, Low-Voltage Fuses – Part 9: Class K Fuses.

### 4 Classification

4.1 Class K fuseholders have a minimum short-circuit withstand rating of 50,000 A. Class K fuseholders are rated 250 V or 600 V, and are divided into six body sizes in each voltage rating corresponding to the Class K fuse body sizes.

### 5 Characteristics

#### 5.1 Summary of characteristics

##### 5.1.3 Voltage and current rating

5.1.3.1 Class K fuseholders shall be rated 250 V or 600 V.

5.1.3.2 Class K fuseholders shall be rated 30, 60, 100, 200, 400, or 600 A.

##### 5.1.4 Withstand rating


5.1.4.1 Class K fuseholders shall have a minimum short-circuit withstand rating of a 10,000 A.

### 7 Construction

#### 7.6 Contacts of a cartridge fuseholder

7.6.1 The dimensions of a Class K fuseholder, shall be as specified in [Figure 7.6A](#) or [Figure 7.6B](#), whichever is applicable.

**Figure 7.6A**  
**Class K fuseholder – Ferrule-contact type**

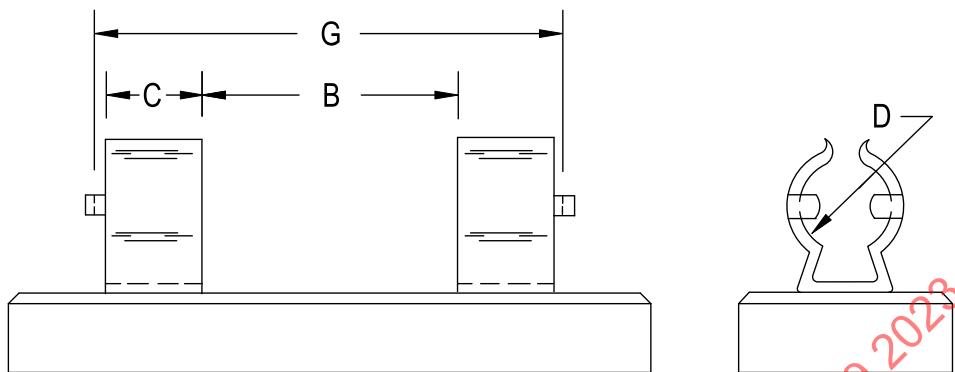

SB0574B

Tabs shown are a typical end-stop configuration.

Class of fuse	Potential rating of fuse, volts	Current rating of fuse, amperes	Dimensions, mm (in)					
			B	C	D	E	G	
			Distance <sup>a</sup> between contact clips	Minimum width of contact clip	Diameter of ferrule	Thickness of blade	Distance between end stops	Minimum
K	250	30	25.4 (1.0)	12.7 (0.5)	14.27 (0.562)	–	51.59 (2.031)	53.97 (2.125)
		60	44.45 (0.750)	15.88 (0.625)	20.62 (0.812)	–	76.99 (3.031)	79.38 (3.125)
		100	101.6 (4.0)	22.22 (0.875)	–	3.18 (0.125)	–	–
		200	114.3 (4.5)	31.75 (1.250)	–	4.75 (0.187)	–	–
		400	127.0 (5.0)	44.45 (1.750)	–	6.35 (0.250)	–	–
		600	152.4 (6.0)	53.97 (2.125)	–	6.35 (0.250)	–	–
	600	30	101.6 (4.0)	12.7 (0.5)	20.62 (0.812)	–	127.79 (5.031)	130.17 (5.125)
		60	107.95 (4.250)	15.88 (0.625)	26.97 (1.062)	–	140.49 (5.031)	142.88 (5.625)
		100	152.4 (6.0)	22.23 (0.785)	–	3.18 (0.125)	–	–
		200	177.8 (7.0)	31.75 (1.250)	–	4.75 (0.187)	–	–
		400	203.2 (8.0)	44.45 (1.750)	–	6.35 (0.250)	–	–
		600	228.6 (9.0)	53.97 (2.125)	–	6.35 (0.250)	–	–

<sup>a</sup> Tolerances for the B dimensions are:

60 A or less: plus 0.79 mm (0.031 in) and minus 1.57 mm (0.062 in);

100 and 200 amperes: plus 1.57 mm (0.062 in) and minus 0.79 mm (0.031 in);

400 and 600 amperes: plus 2.36 mm (0.093 in).